


| Customer Information |  | Service Location & Contractor Information |                       | General Information |                  |
|----------------------|--|---|-----------------------|---------------------|------------------|
| Customer:            | CORRECTIONAL SERVICE CANADA  | 911 Address:                              | 3766 HWY 15, NEW BLDG | Date prepared:      | 7/27/2012        |
| Address:             | JOYCEVILLE INSTITUTION HWY 15, PO BOX 880 STN MAIN<br>KINGSTON ON K7L4X9 | Concession:                               | 5                     | Rate Class:         | Sub-Transmission |
| Primary #            | 613-545-8282   | Township:                                 | PITTSBURGH            | D.S.:               | FRONTENAC        |
| Bus:                 |  | RP#:                                      |                       | Customer Cable:     | Yes              |
| Fax:                 |  | Sublot:                                   |                       | Feeder:             | Q3M1             |
|                      |  | Contractor:                               |                       | Service Size:       | 1000             |
|                      |  | Ph #:                                     |                       | Switch:             | Q3M1             |
|                      |  | Fax:                                      |                       | Account #:          | 0                |
|                      |  |   |                       | Transformer:        | CUSTOMER         |

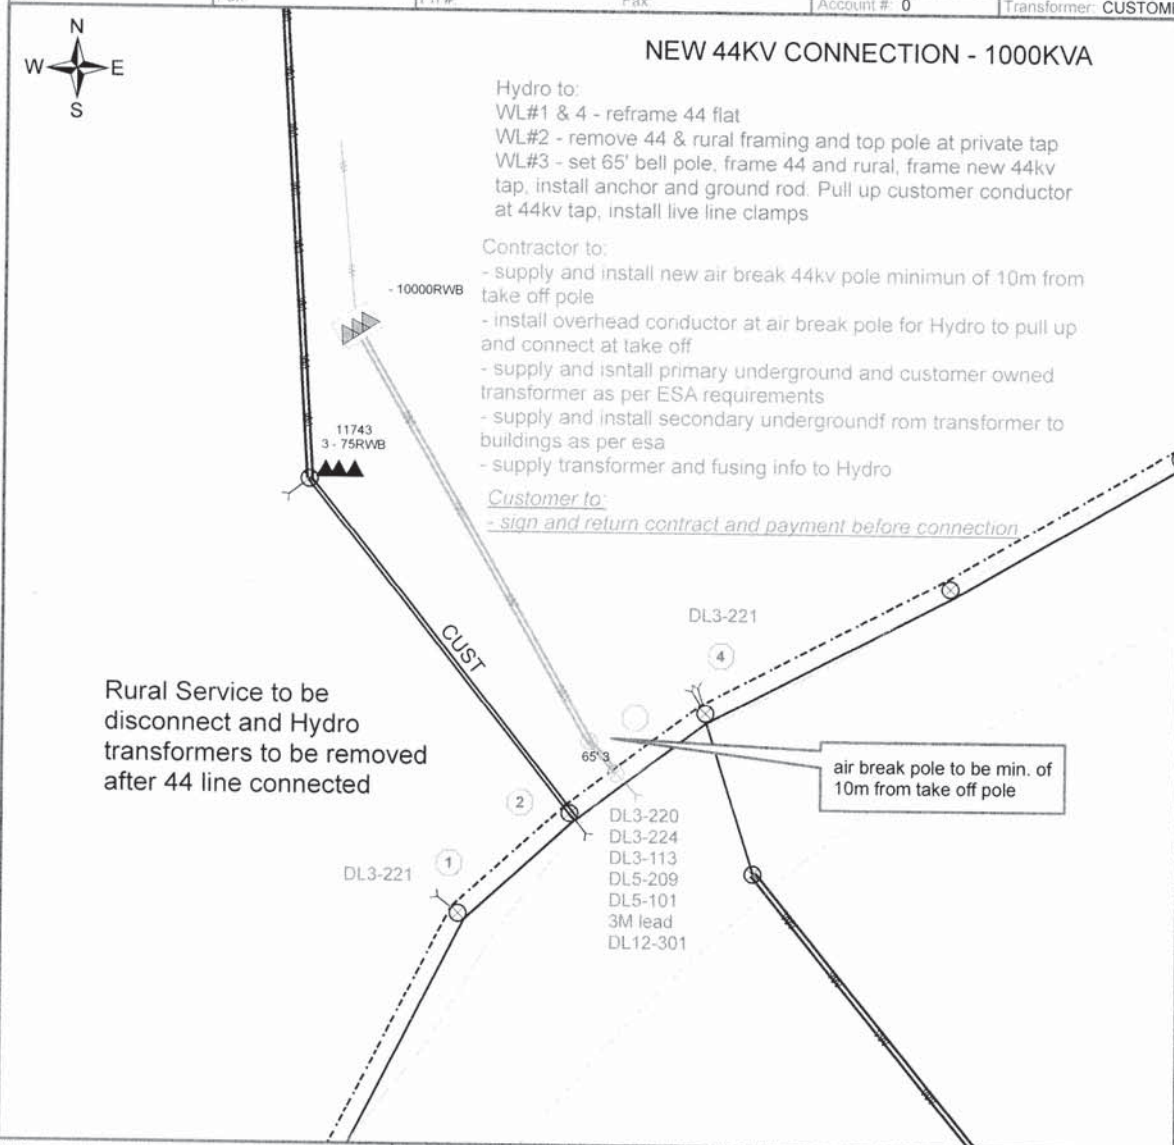

**Notes:** - This Layout is valid for 6 months from the date prepared. There will be a charge to re-design due to customer initiated changes.  
 - All work to be done to Electrical Safety Code

|   |  |                                     |                                    |                              |
|---|--|-------------------------------------|------------------------------------|------------------------------|
| Existing                                | Hydro One Only Section 2.0                     | Hydro One or Contractor Section 3.0 | Work by Customer                   | Work by Others (Bell or LDC) |
| X Remove - Hydro One Only - Section 2.0 | X Remove - Hydro One or Contractor Section 3.0 | X Remove - By Customer              | X Remove - By Others (Bell or LDC) |                              |

|                              |              |                        |                       |                    |           |
|------------------------------|--------------|------------------------|-----------------------|--------------------|-----------|
| El Order No                  | 614763612    | Service Centre Name:   | Kingston              | Secondary Voltage: | 347/600   |
| Hydro One Phone #            | 866-646-4619 | Prepared By:           | Joanne Ottenhof       | SAP Order #:       | 60694218  |
| Hydro One Fax #              | 613-967-3589 | Departure Date & Time: | 6/15/2012 11:15:00 AM | CM Number:         | 00116632  |
| Electrical Safety Authority: | 877-372-7233 | Arrival Date & Time:   | 6/15/2012 9:00:00 AM  | Customer #:        | 000009999 |