

1	SEE STEAM AND EXHAUST DIAGRAM	DRG NO 72-759
2	SEE COMPRESSED AIR DIAGRAM	DRG NO 72-758
3	SEE BILGE AND BALLAST DIAGRAM	DRG NO 72-751
4	SEE FIRE AND WASHDECK DIAGRAM	DRG NO 72-257
5	SEE FOAM SYSTEM DIAGRAM	DRG NO 72-266
6	SEE DOMESTIC HOT AND COLD WATER DIAGRAM	DRG NO 72-260
7	SEE CONDENSATE AND DRAINS DIAGRAM	DRG NO 72-760

- | MONITORING POINT SYMBOLS | |
|--------------------------|------------------------|
| (P) | PRESSURE GAUGE |
| (C) | COMPOUND GAUGE |
| (T) | THERMOMETER (LOCAL) |
| (PT) | PRESSURE TRANSDUCER |
| (VT) | VACUUM TRANSDUCER |
| (TT) | TEMPERATURE TRANSDUCER |
| (PS) | PRESSURE SWITCH |
| (FS) | FLOW SWITCH |
| (LS) | LIMIT SWITCH |
| (AL) | LEVEL-ALARM LOW |

C.C.G.S. ANN HARVEY
APRIL 1987
AS FITTED



PROJECT

THE

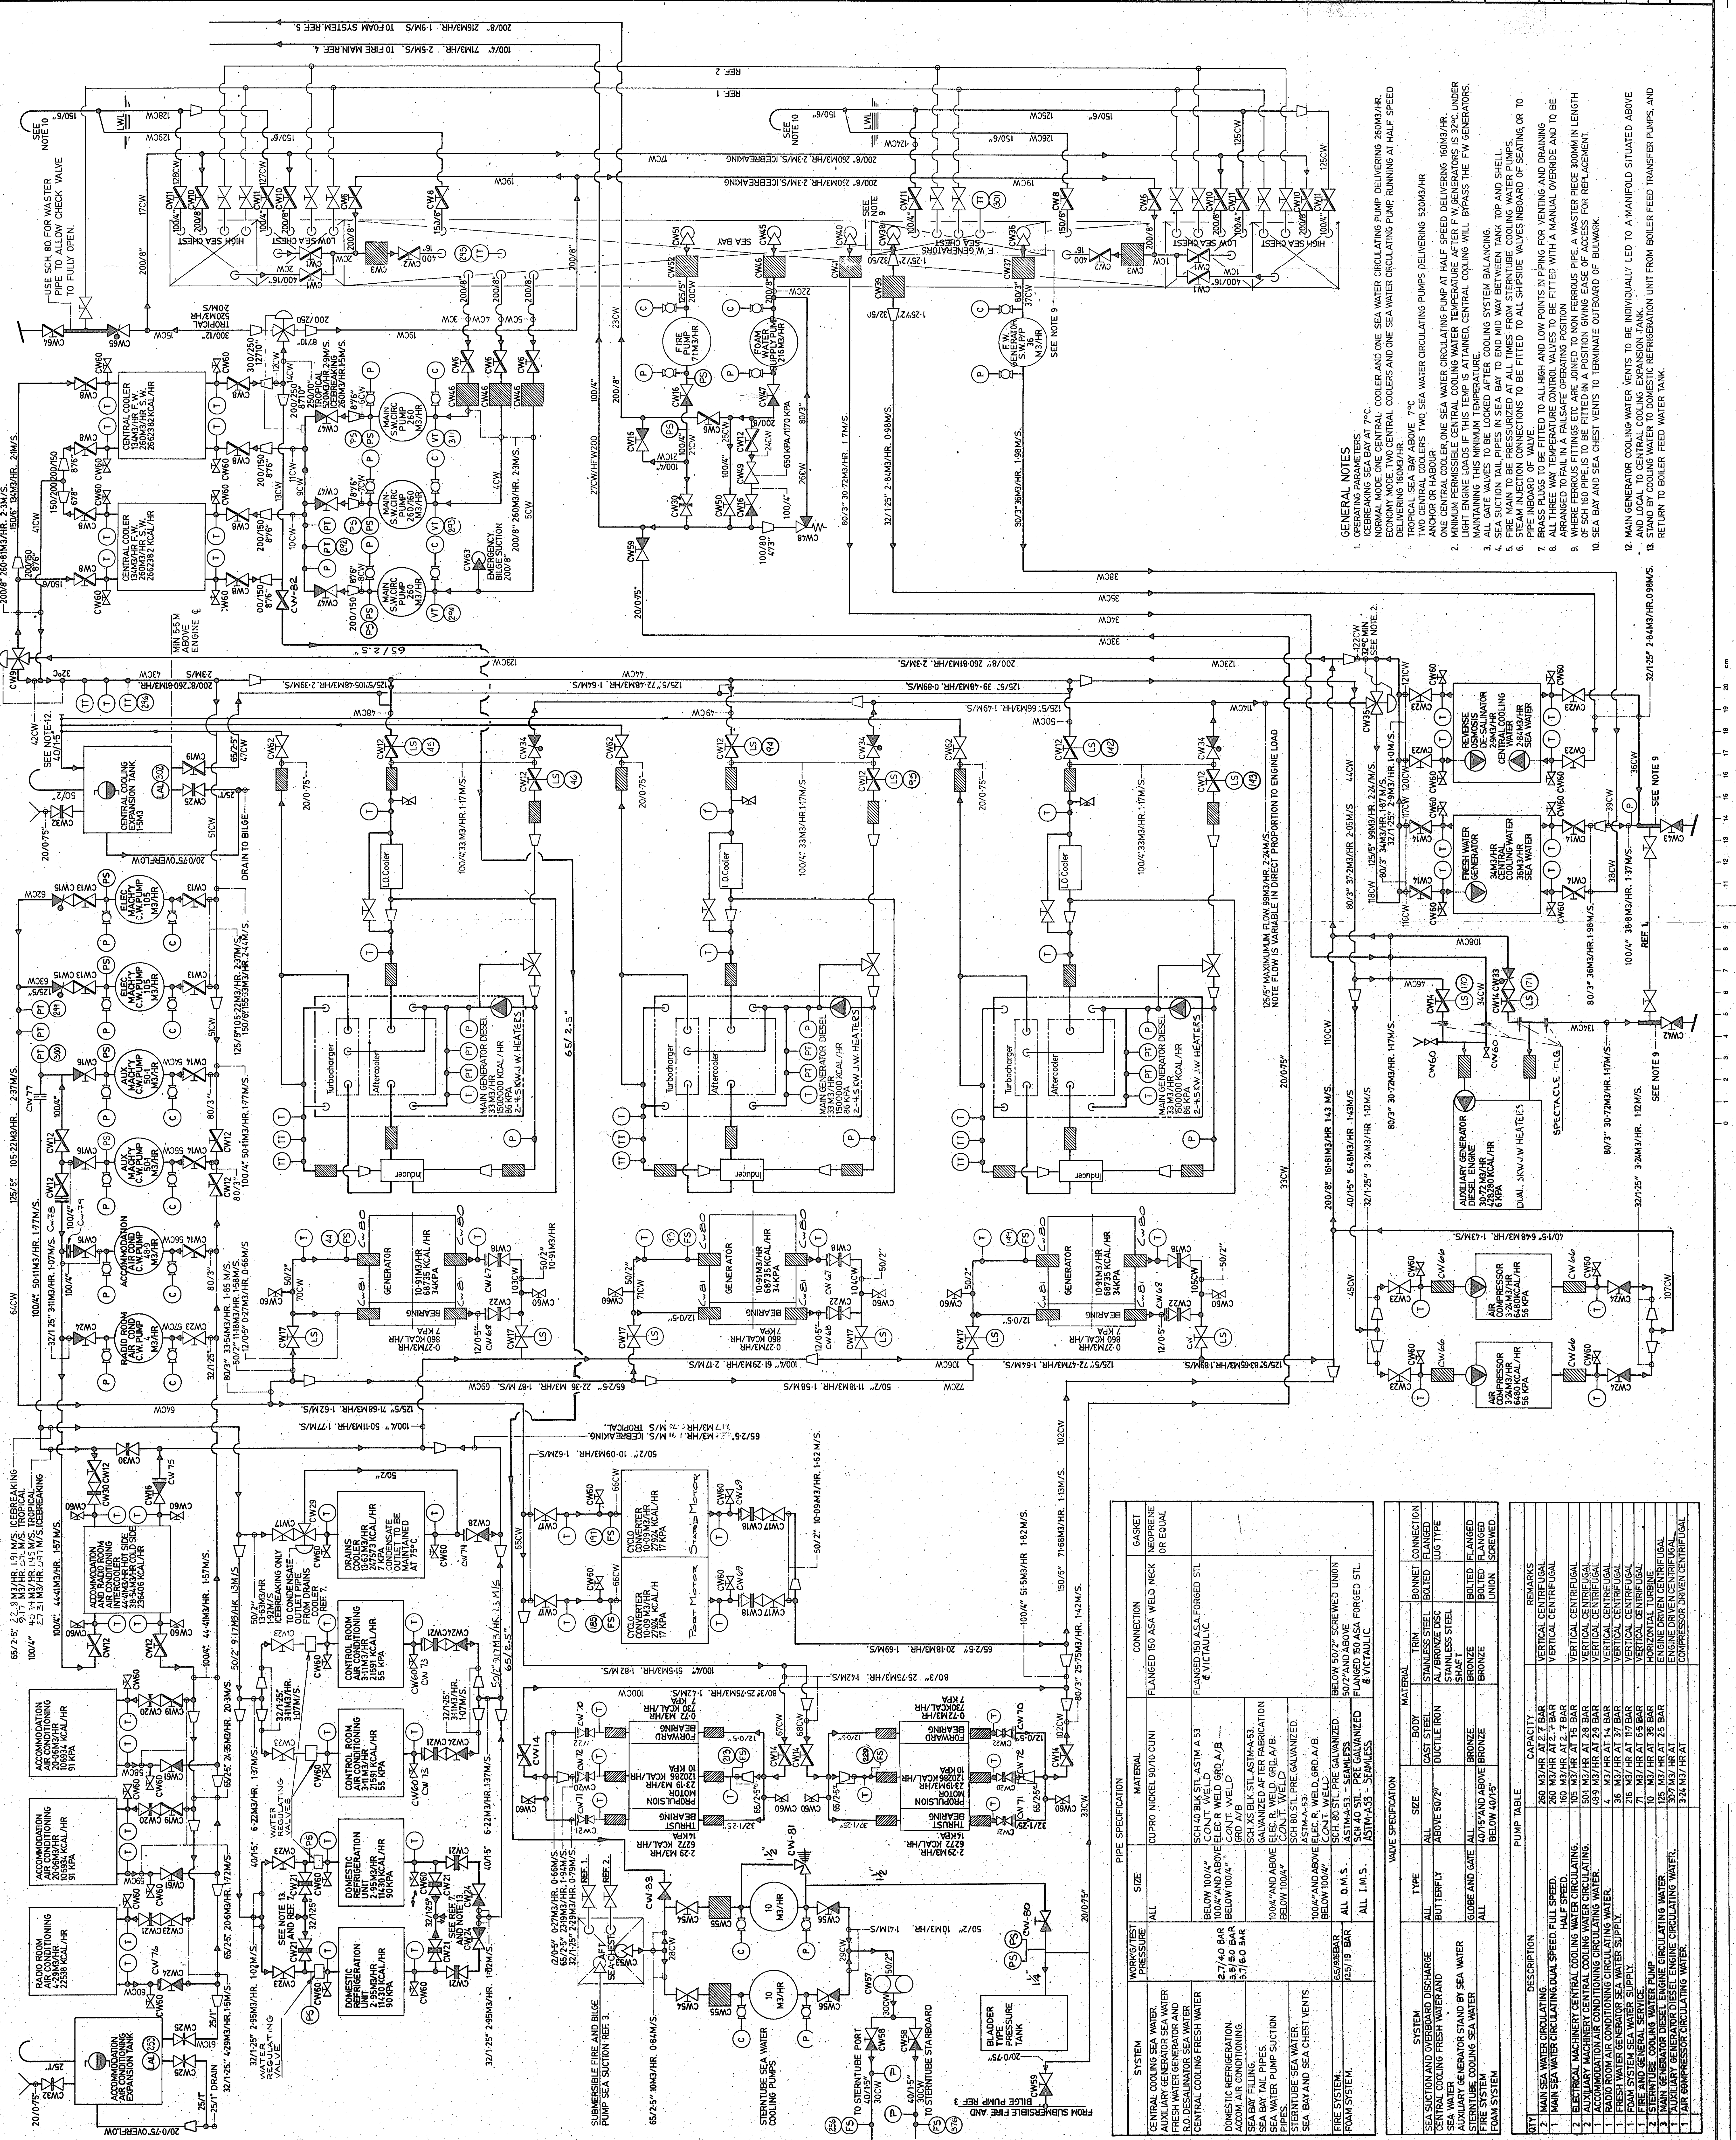
APPR. SEN

OWNER	
FLOWER	

A.B.S.

Scale.

DRG. No.

[illegible][illegible]