

Real Property
Branch

A detail no.
no. du detail

B location drawing no.
sur dessin no.

C drawing no.
dessin no.


Remplacement du systèmes
d'Alarme Incendie -
Tour Fédéral /
Fire Alarm Replacement -
Federal Tower
200 Promenade du Portage, Gatineau. Qc

3e ÉTAGE
ALARME INCENDIE - NOUVEAU/
3th FLOOR
FIRE ALARM - NEW

R.051473.002

CE-03 (E203)

Nom du fichier: G:\034\04457\z5_CAD\03_ELI034P0444570300000ELE204.dwg

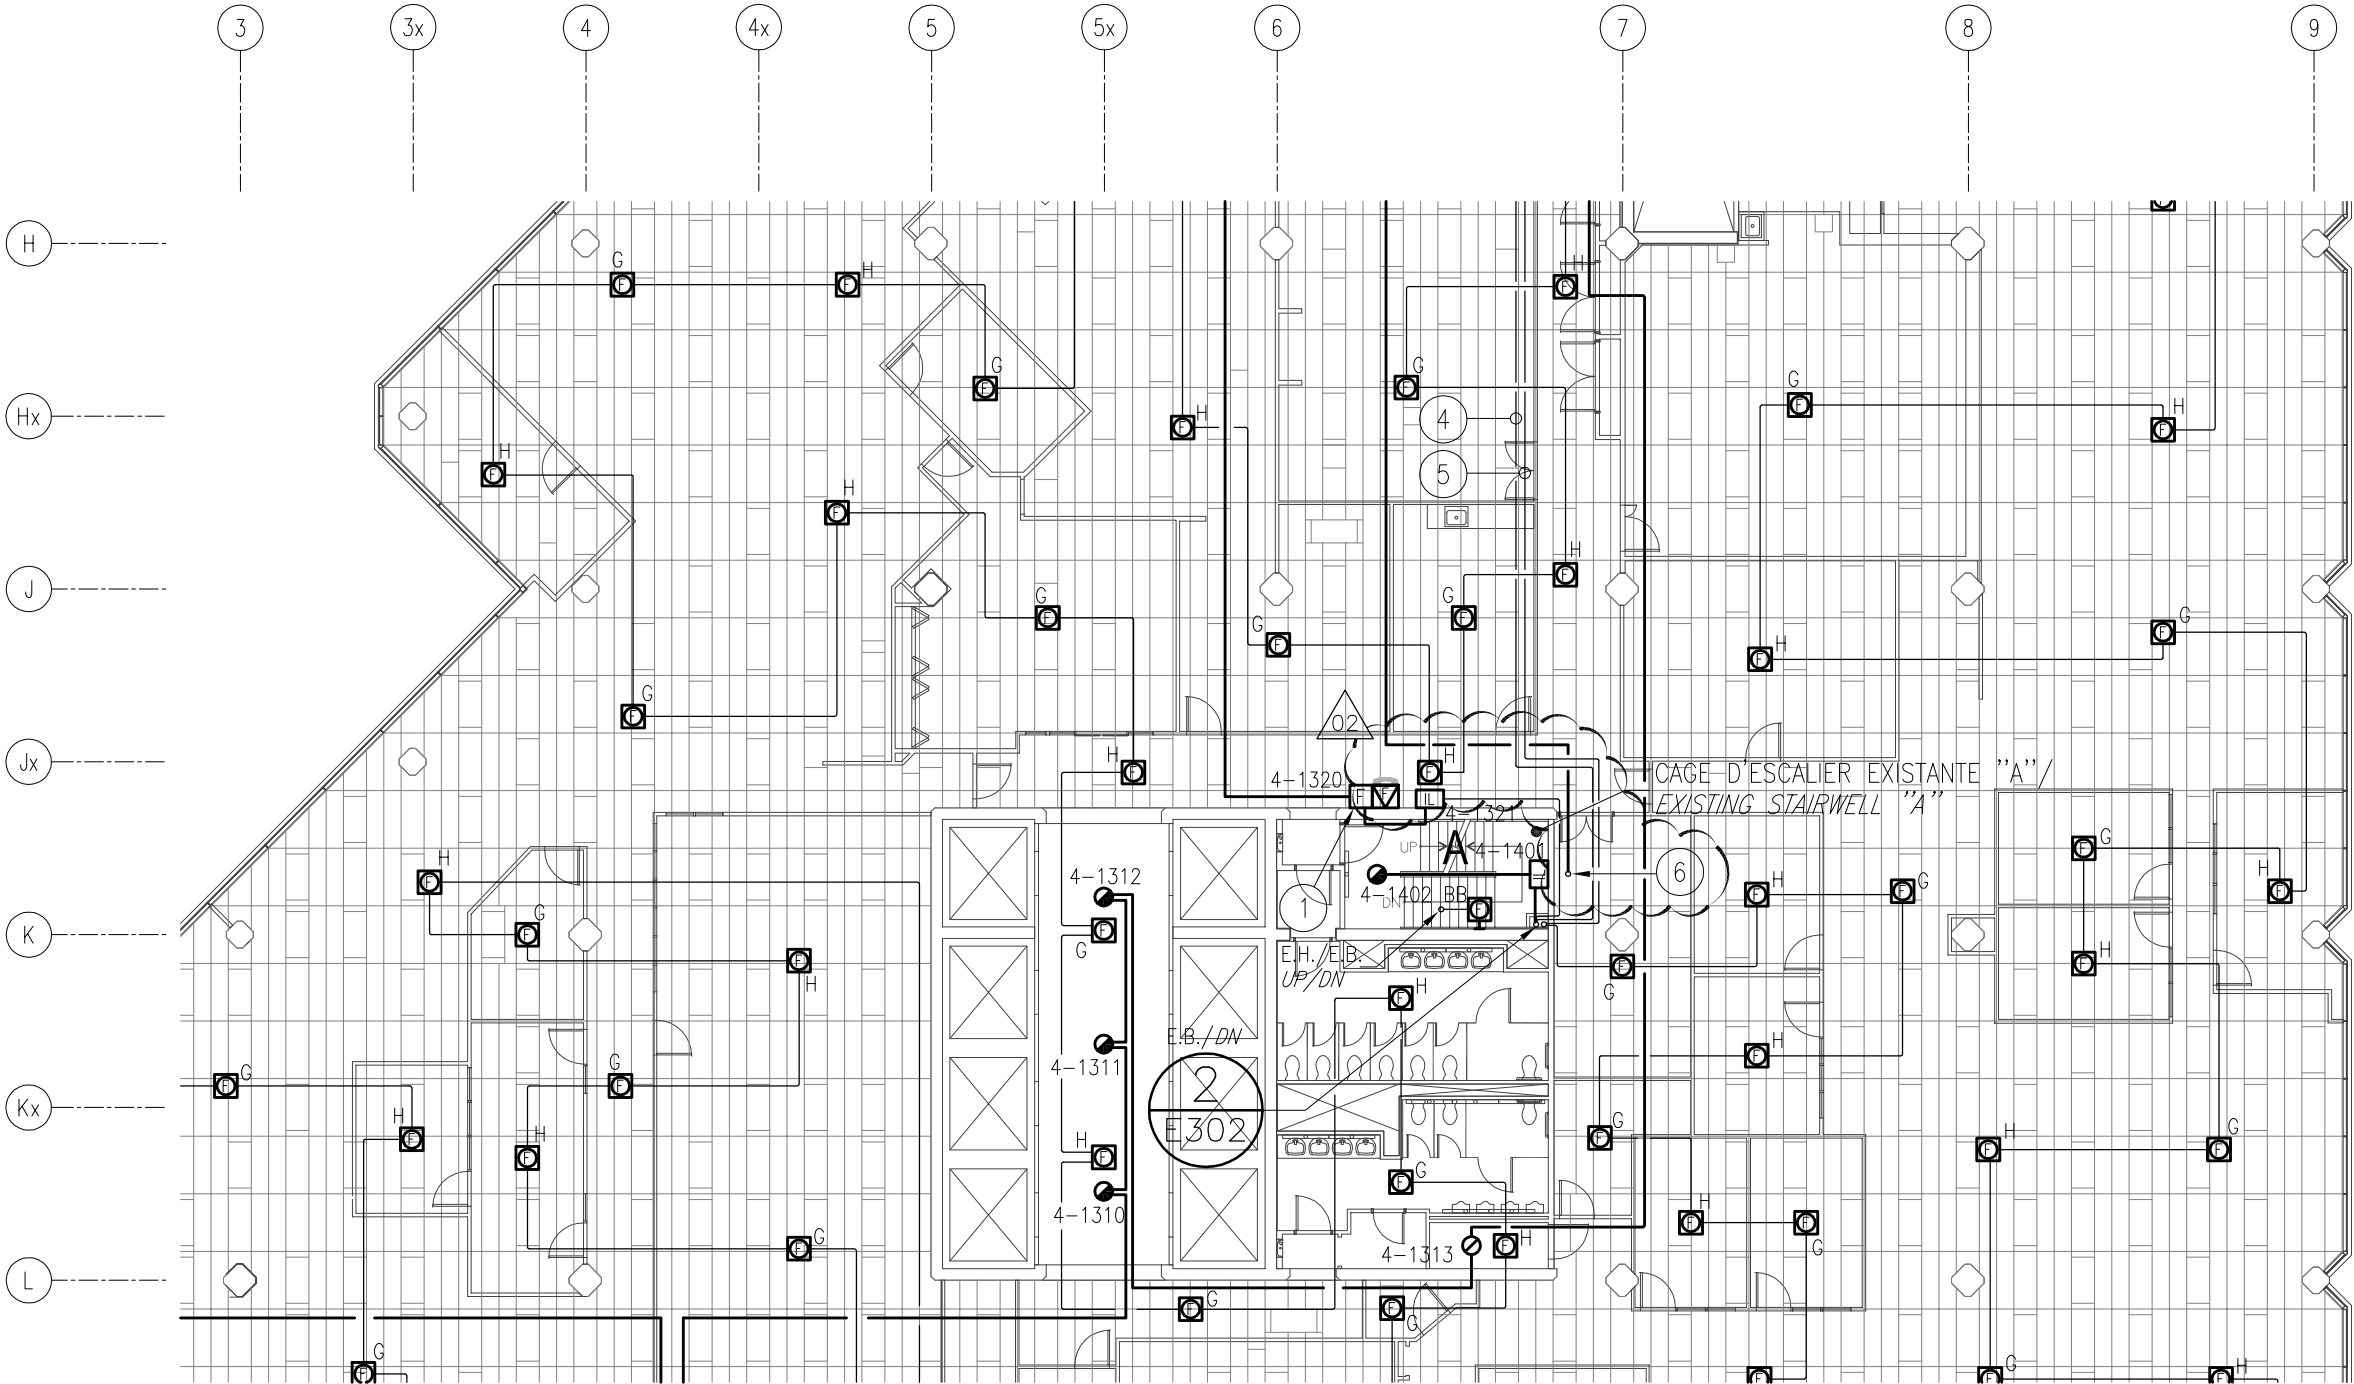

NOTES PARTICULIÈRES/
DRAWING NOTES

- ⑤ FILAGE HAUT-PARLEUR./ *SPEAKER WIRING*
- ⑥ E.B/DN – FILAGE TÉLÉPHONIQUE JUSQU’AU PAI AU P.C.A.C. (3e ÉTAGE)./ *TELEPHONE WIRING UP TO PAI IN C.A.C.F. (3rd FLOOR)*

Canada



Public Works and
Government Services
Canada
Real Property
Branch

Travaux publics et
services gouvernementaux
Canada
Direction générale
des biens immobiliers

Contractor to verify all dimensions
& conditions on site and immediately
notify the engineer of all discrepancies.

02	Addenda #1 / Addendum #1	2013-04-04
----	--------------------------	------------

revisions	description	date
-----------	-------------	------

<div>A C</div>	A detail no. no. du detail B location drawing no. sur dessin no. C drawing no. dessin no.	<div>A B C</div>
--------------------	--	--------------------------

project	projet
---------	--------

Remplacement du systèmes
d'Alarme Incendie -
Tour Fédéral /
Fire Alarm Replacement -
Federal Tower
200 Promenade du Portage, Gatineau. Qc

drawing	dessin
---------	--------

4e ÉTAGE
ALARME INCENDIE - NOUVEAU/
4th FLOOR
FIRE ALARM - NEW

Designed By	Olivier Soucy	Conçu par
-------------	---------------	-----------

Date	2013-04-04	(yyyy/mm/dd)
------	------------	--------------

Drawn By	Alain Gingras	Dessiné par
----------	---------------	-------------

Date	2013-04-04	(yyyy/mm/dd)
------	------------	--------------

Reviewed By	Normand Dargis	Examiné par
-------------	----------------	-------------

Date	2013-04-04	(yyyy/mm/dd)
------	------------	--------------

Approved By	Olivier Soucy	Approuvé par
-------------	---------------	--------------

Date	2013-04-04	(yyyy/mm/dd)
------	------------	--------------

Tender	Yvan Leduc	Soumission
--------	------------	------------

Project Manager	Administrateur de projets
-----------------	---------------------------

Project no.	No. du projet
-------------	---------------

R.051473.002

Drawing no.	No. du dessin
-------------	---------------


CE-04 (E204)

CE-05 (E213)





Nom du fichier: G:\034\P044457\z5_CAD\03_ELI034P0444570300000ELE304.dwg

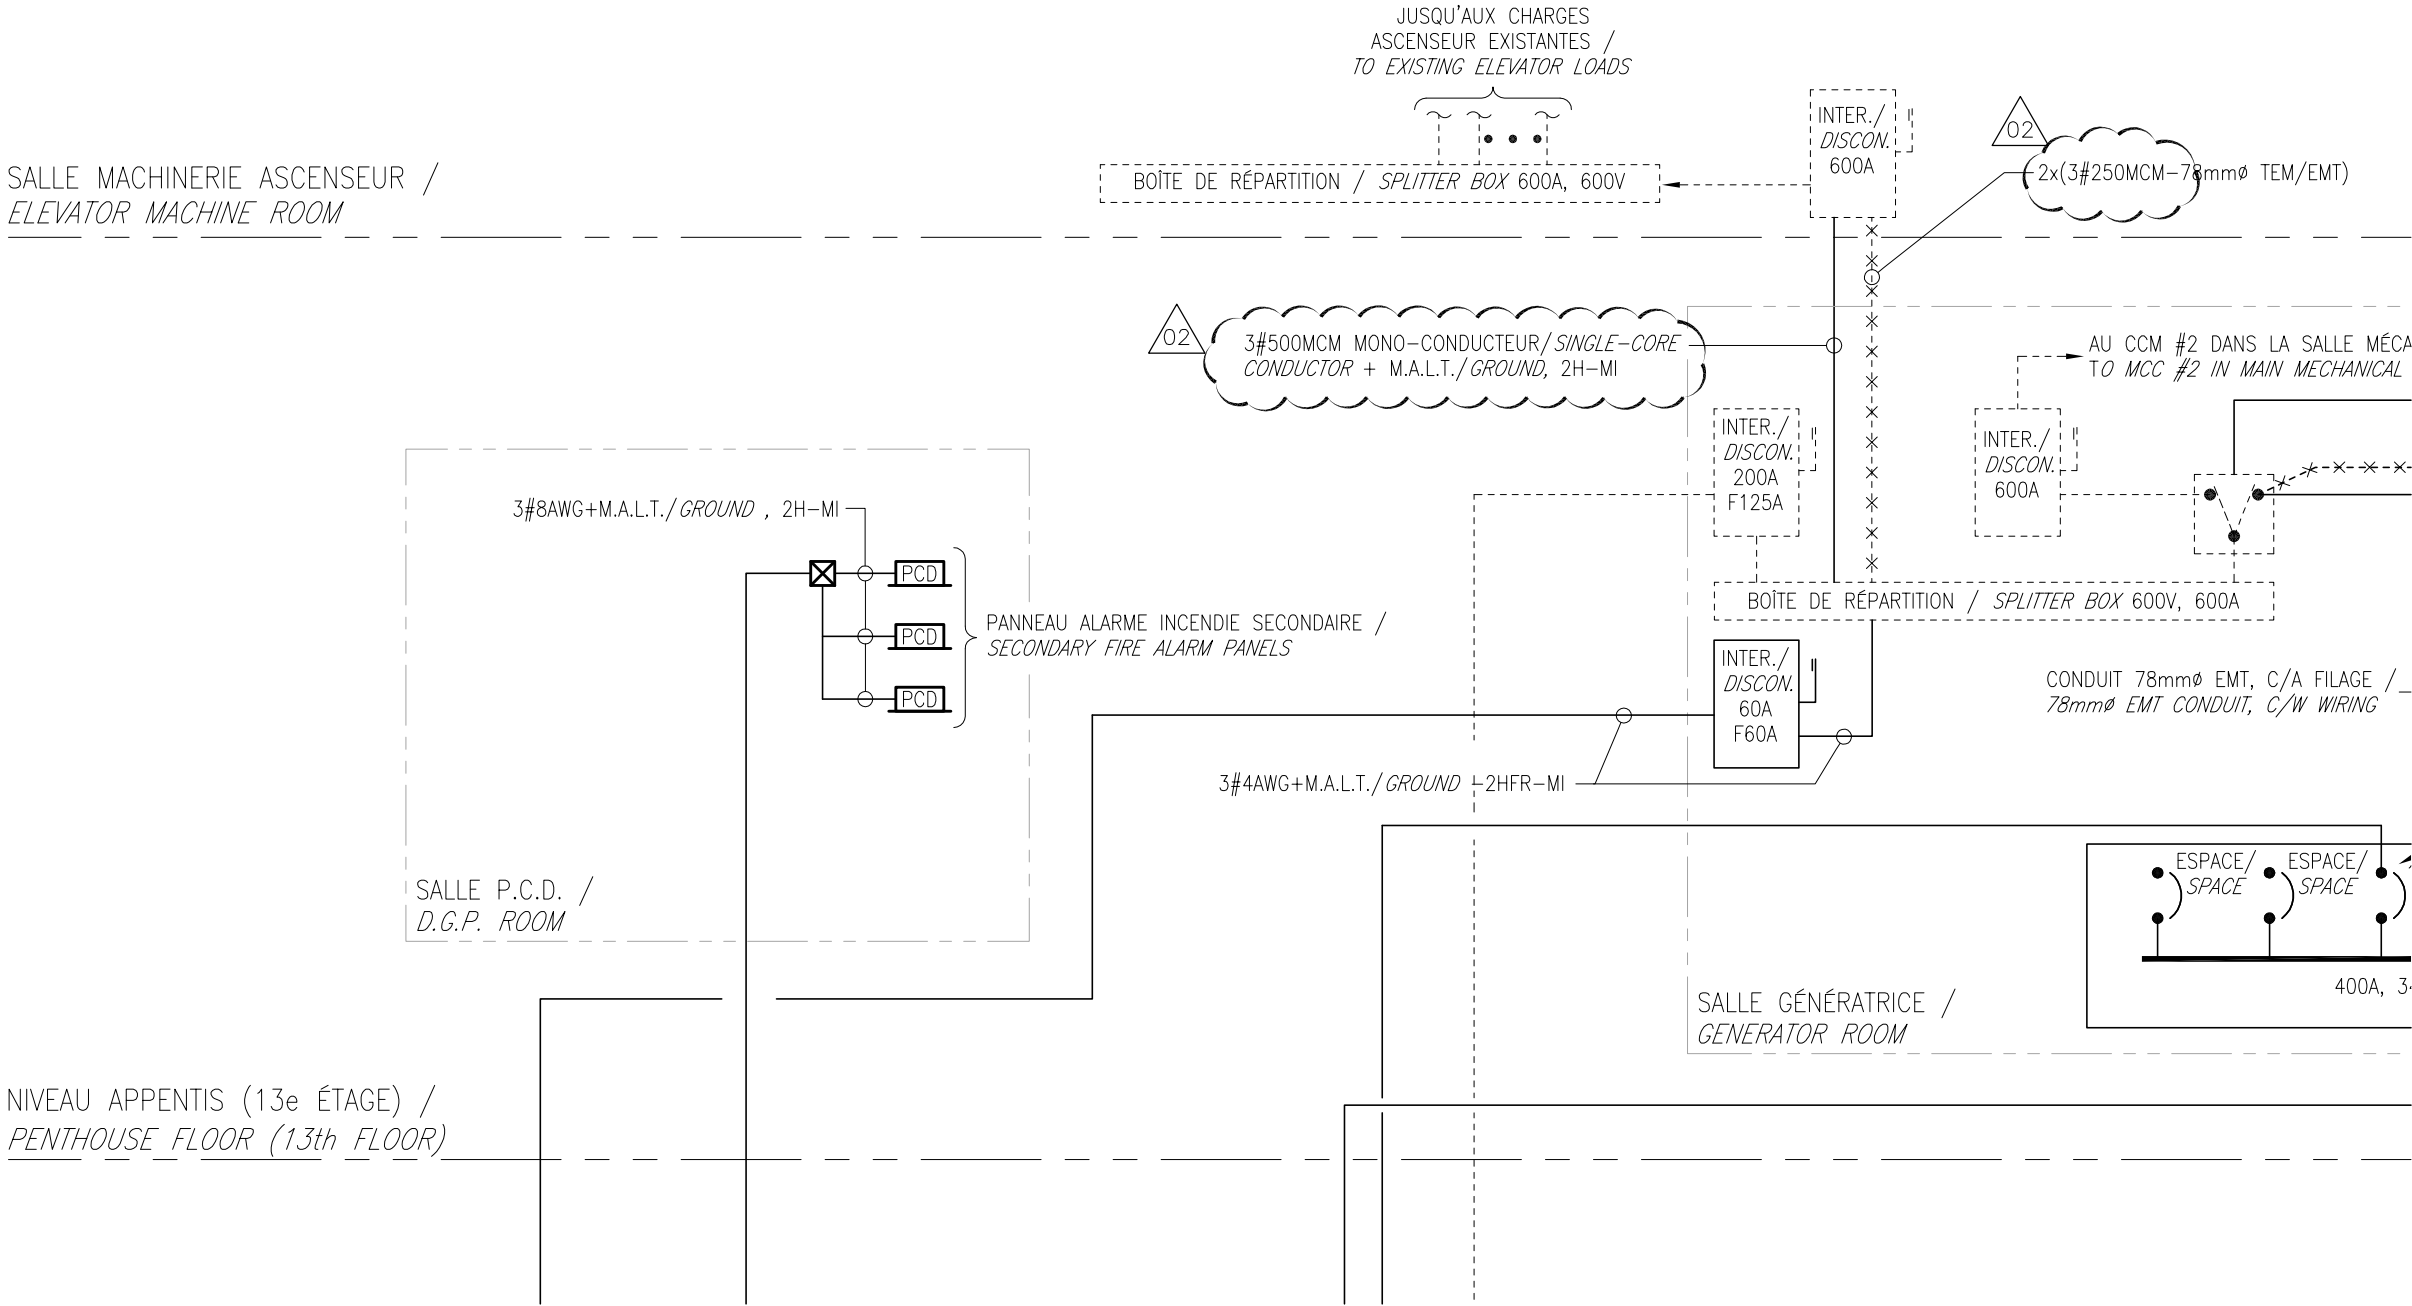

Canada



Public Works and
Government Services
Canada

Travaux publics et
services gouvernementaux
Canada

Real Property
Branch

Direction générale
des biens immobiliers

Contractor to verify all dimensions
& conditions on site and immediately
notify the engineer of all discrepancies.

02	Addenda #1 / Addendum #1	2013-04-04
----	--------------------------	------------

revisions	description	date
-----------	-------------	------

<div>A</div> <div>C</div>	A detail no. no. du detail B location drawing no. sur dessin no. C drawing no. dessin no.	<div>A</div> <div>B</div> <div>C</div>
---------------------------	--	--

project

Remplacement du systèmes
d'Alarme Incendie -
Tour Fédéral /
Fire Alarm Replacement -
Federal Tower
200 Promenade du Portage, Gatineau. Qc

drawing

SCHÉMA ÉLECTRIQUE
UNIFILAIRE PARTIEL -
EXISTANT ET NOUVEAU
ELECTRICAL SINGLE LINE
DIAGRAM EXTRACT -
EXISTING AND NEW

Designed By

Date

Drawn By

Date

Reviewed By

Date

Approved By

Date

Tender

Project Manager

Project no.

R.051473.002

Drawing no.

CE-07 (E304)