

RETURN BIDS TO:
RETOURNER LES SOUMISSIONS À:
Public Works Government Services Canada- Bid
Receiving / Réception des soumissions
189 Prince William Street
Room 421
Saint John
New Brunswick
E2L 2B9

SOLICITATION AMENDMENT
MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Public Works Government Services Canada- Bid
Receiving / Réception des soumissions
189 Prince William Street
Room 421
Saint John
New Bruns
E2L 2B9

Title - Sujet 50 Bed Living Unit, Westmorland Ins	
Solicitation No. - N° de l'invitation EC016-130878/A	Amendment No. - N° modif. 015
Client Reference No. - N° de référence du client R.043929.001	Date 2012-09-13
GETS Reference No. - N° de référence de SEAG PW-\$PWB-020-3101	
File No. - N° de dossier PWB-2-35024 (020)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2012-09-19	Time Zone Fuseau horaire Atlantic Daylight Saving Time ADT
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Donovan, Janine PWB	Buyer Id - Id de l'acheteur pwb020
Telephone No. - N° de téléphone (506) 636-5347 ()	FAX No. - N° de FAX (506) 636-4376
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

Cette modification de l'invitation numéro 15 est soumise et comprend la modification numéro 15 suivante.

La modification qui suit apportée aux documents de soumission entre en vigueur dès maintenant. L'addenda fera partie des documents de contrat.

Toutes autres conditions ne changent pas.

Modification numéro 15

1. DEVIS

.1 Reference Specification Section 07 46 13

Section 07 46 13, Part 2.1.7, Add the following:

- .3 Ideal Roofing, Model 'Urban Accent'
- .4 Rollform Group, Model 'S-12-R'

.2 Reference Specification Section 07 61 00

Section 07 61 00, Part 2.6.5, Add the following:

- .3 Ideal Roofing, Model 'Urban Accent'
- .4 Rollform Group, Model 'S-12-R'

.3 Reference Specification Section 21 13 16: Dry Pipe Sprinkler Systems

Section 25 13 16, Part 2.4: Sprinkler Heads, Add the following:

- .3 Special Sprinkler Head for protection of Range Hoods:
 - .1 7.5 mm orifice, 163C temperature rating, 160 angle of discharge sprinkler head for protection of residential range hoods for both inmate and staff-occupied areas.
 - .2 The line serving this sprinkler is required to be provided with a listed strainer.
 - .3 Activation of this sprinkler is also required to immediately shut off the fuel or energy to the cooking range and may be accomplished by the installation of a flow switch in the line serving this sprinkler connected to a disconnecting means with a manual reset, such as a circuit breaker or gas solenoid or both as the case may be.
 - .4 Shut-off may also be accomplished through operation of the sprinkler alarm valve.
 - .5 No time delay is permitted for shutting off the fuel or energy.
 - .6 Acceptable Materials:
 - .1 Manufacturer: Tyco (formerly Gem/Grinnell), Model Model EA-1 Protectospray Nozzle.

.4 Reference Specification Section 21 13 13: Wet Pipe Sprinkler Systems

Section 25 13 13, Part 2.4: Sprinkler Heads, Add the following:

- .3 Special Sprinkler Head for protection of Range Hoods:
 - .1 7.5 mm orifice, 163C temperature rating, 160 angle of discharge sprinkler head for protection of residential range hoods for both inmate and staff-occupied areas.

- .2 The line serving this sprinkler is required to be provided with a listed strainer.
- .3 Activation of this sprinkler is also required to immediately shut off the fuel or energy to the cooking range and may be accomplished by the installation of a flow switch in the line serving this sprinkler connected to a disconnecting means with a manual reset, such as a circuit breaker or gas solenoid or both as the case may be.
- .4 Shut-off may also be accomplished through operation of the sprinkler alarm valve.
- .5 No time delay is permitted for shutting off the fuel or energy.
- .6 Acceptable Materials:
 - .1 Manufacturer: Tyco (formerly Gem/Grinnell), Model Model EA-1 Protectospray Nozzle.

2 DESSINS

.1 Reference Drawing A-306, 'Section Details'

- .1 Note that the line shown extending over the rain gutter is the mesh cap referred to in the adjacent descriptive note. It is not the Aluminum drip edge which is shown below the roof sheet.

.2 Reference Drawing A-404, 'Enlarged Partial Plans Second Floor Area A'

- .1 Note that the section of wall on gridline 17 between F and G should be tagged as wall type P5

.3 Reference Drawing MH-202, Second Floor Plan Heating

- .1 Delete sizes (NPS 1 GWS and NPS 1 GWR) to A/C-1 and add (NPS 1 GWS and NPS 1 GWR).

.4 Reference Drawing MH-401, Heating Schematics

- .1 Partial Plan 2/MH401: Delete NPS 2 size shown on reheat HWS and add NPS 2 HWS.

.5 Reference Drawing MH-402, Heating Schedules

Branch pipe sizes are as follows:

- .1 Cabinet Heaters: As indicated on heating schedule on drawing MH-402.
- .2 Unit Heater UH-1: NPS HWS and HWR.
- .3 Reheat Coils: NPS HWS and HWR.
- .4 Wall fin types WF-1, WF-2, and WF-3: NPS HWS and HWR.
- .5 Conv-1: NPS HWS and HWR.

.6 Reference Drawing MC-403, Controls Details


- .1 Provide control points for Variable Air Volume Terminal Units and reheat coils as per attached sketch CSK-001.

.7 Reference Drawing SP-902, Ground Floor Plan Sprinkler System


- .1 Provide the following side wall protective spray head for residential range hoods:
Protectospray Nozzle (7.5 mm orifice, 163C temperature rating, 160 angle of discharge) Head is based on a Tyco (formerly Gem/Grinnell) Model EA-1.

.8 Reference Drawing E-504, 'Intercom System Riser Diagram'

- .1 Amend the note describing the intercom cabling within the New Living Unit Building to read:
"2#18TW. + #12B in 19mmC (Typical)

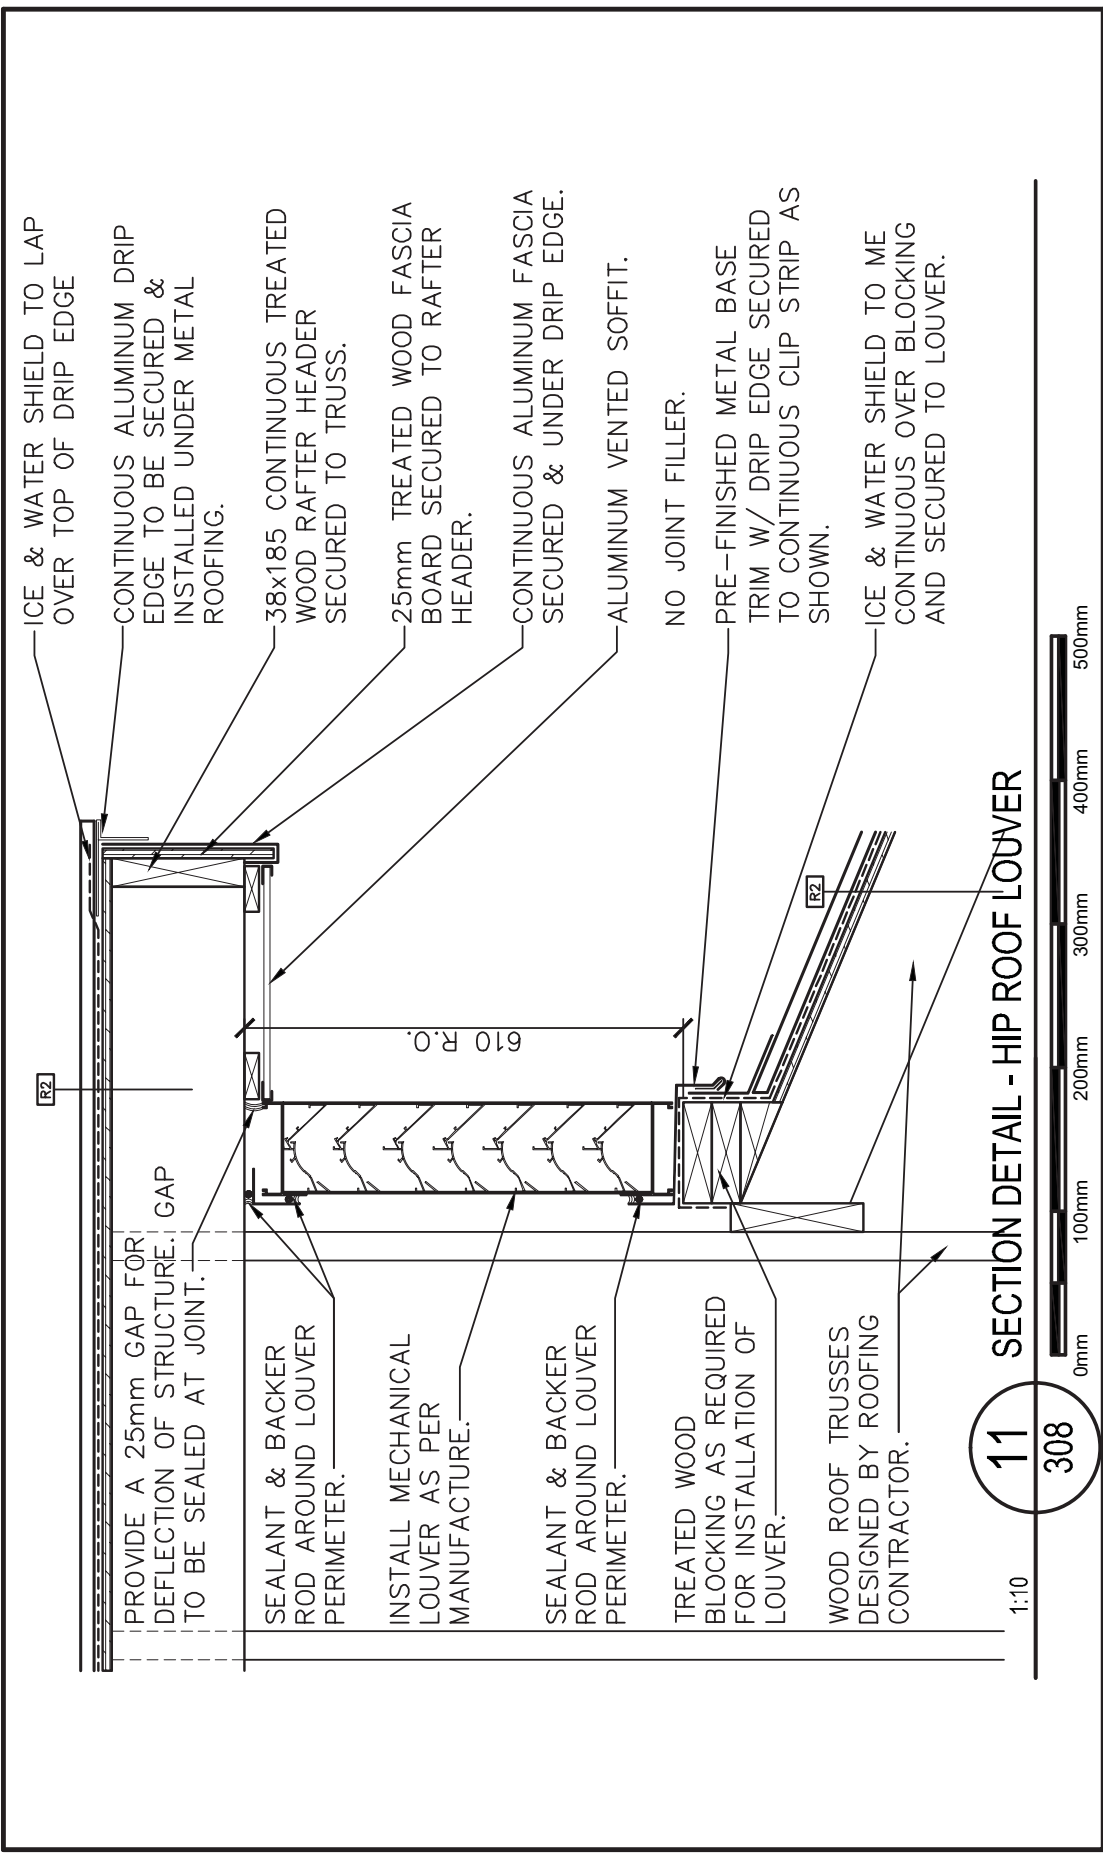

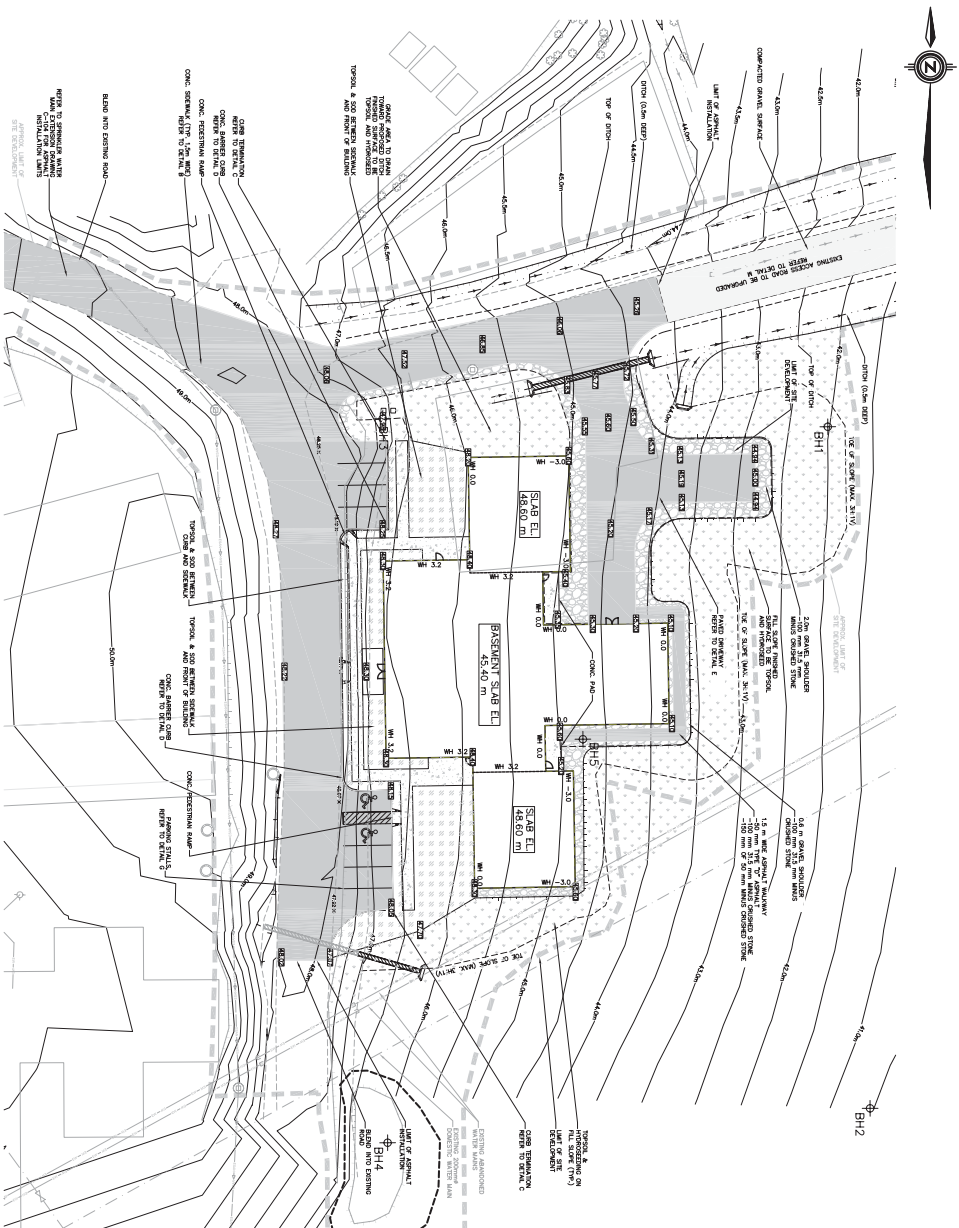
















Public Works and Government Services Canada		Travaux publics et Services gouvernementaux Canada		Tender	
C. MILLIGAN		Soutmission		PWGSC Project Manager	
PWGSC L1 (2004)		Administrateur de projets TP56C		ASK-003	
50 BED LIVING UNIT WESTMORLAND INSTITUTE DORCHESTER, NB		NEW SECTION DETAIL 11/A308 HIP ROOF LOUVER		no. du projet R.043929.001	
project		Drawing title		designed	
project		project		WHW, CSC	
project		project		drawn	
project		project		D.BRENNAN	
project		project		approved	
project		project		R.TURNER	
project		project		date	
project		project		2012/09/13	
project		project		no. du dessin	
project		project		ASK-003	











GRADING PLAN

SCALE: 1:250 METERS

 whitwarchitects (not for sale) 1401 W. 10th St., Ed 2028 www.whitwarchitects.com www.whitwarchitects.com		I am the duly authorized agent of the Government of the State of Colorado	
GENITYAR 1401 W. 10th St., Ed 2028 Denver, Colorado 80202			
STANDARD TREATMENT LEGEND			
	TOPCOAT AND FINISHED		CONCRETE
	TOPCOAT, STIPPLED		SAND, STIPPLED
	TOPCOAT, AND SAND		AGGREGATE FINISH
	SOLID COLOR FINISH		
TYPE OF FINISH 1. TOPCOAT AND FINISHED 2. TOPCOAT, STIPPLED 3. TOPCOAT, AND SAND 4. AGGREGATE FINISH 5. SAND, STIPPLED 6. SOLID COLOR FINISH		REMARKS 1. _____ 2. _____ 3. _____ 4. _____ 5. _____ 6. _____	
DATE _____		BY _____	

 whitwarchitects (not for sale) 1401 W. 10th St., Ed 2028 www.whitwarchitects.com www.whitwarchitects.com		I am the duly authorized agent of the Government of the State of Colorado	
GENITYAR 1401 W. 10th St., Ed 2028 Denver, Colorado 80202			
STANDARD TREATMENT LEGEND			
	TOPCOAT AND FINISHED		CONCRETE
	TOPCOAT, STIPPLED		SAND, STIPPLED
	TOPCOAT, AND SAND		AGGREGATE FINISH
	GRAVEL, SAND, STIPPLED		
TYPE OF FINISHING		REMARKS	
1. TOPCOAT 2. TOPCOAT AND FINISHED 3. TOPCOAT, STIPPLED 4. TOPCOAT, AND SAND 5. SAND, STIPPLED 6. AGGREGATE FINISH 7. GRAVEL, SAND, STIPPLED	1. TOPCOAT 2. TOPCOAT AND FINISHED 3. TOPCOAT, STIPPLED 4. TOPCOAT, AND SAND 5. SAND, STIPPLED 6. AGGREGATE FINISH 7. GRAVEL, SAND, STIPPLED	1. TOPCOAT 2. TOPCOAT AND FINISHED 3. TOPCOAT, STIPPLED 4. TOPCOAT, AND SAND 5. SAND, STIPPLED 6. AGGREGATE FINISH 7. GRAVEL, SAND, STIPPLED	
DATE		DATE	
TIME		TIME	
BY		BY	
DATE		DATE	

 whitwarchitects (not for sale) 1401 W. 10th St., Ed 2028 www.whitwarchitects.com www.whitwarchitects.com		I am the duly authorized agent of the Government of the State of Colorado	
GENITYAR 1401 W. 10th St., Ed 2028 Denver, Colorado 80202			
STANDARD TREATMENT LEGEND			
	TOPCOAT AND FINISHED		CONCRETE
	TOPCOAT, STIPPLED		SAND, STIPPLED
	TOPCOAT, AND SAND		AGGREGATE FINISH
	SOLID COLOR FINISH		
TYPE OF FINISH 1. TOPCOAT AND FINISHED 2. TOPCOAT, STIPPLED 3. TOPCOAT, AND SAND 4. AGGREGATE FINISH 5. SAND, STIPPLED 6. SOLID COLOR FINISH		REMARKS 1. _____ 2. _____ 3. _____ 4. _____ 5. _____ 6. _____	
DATE _____		BY _____	