
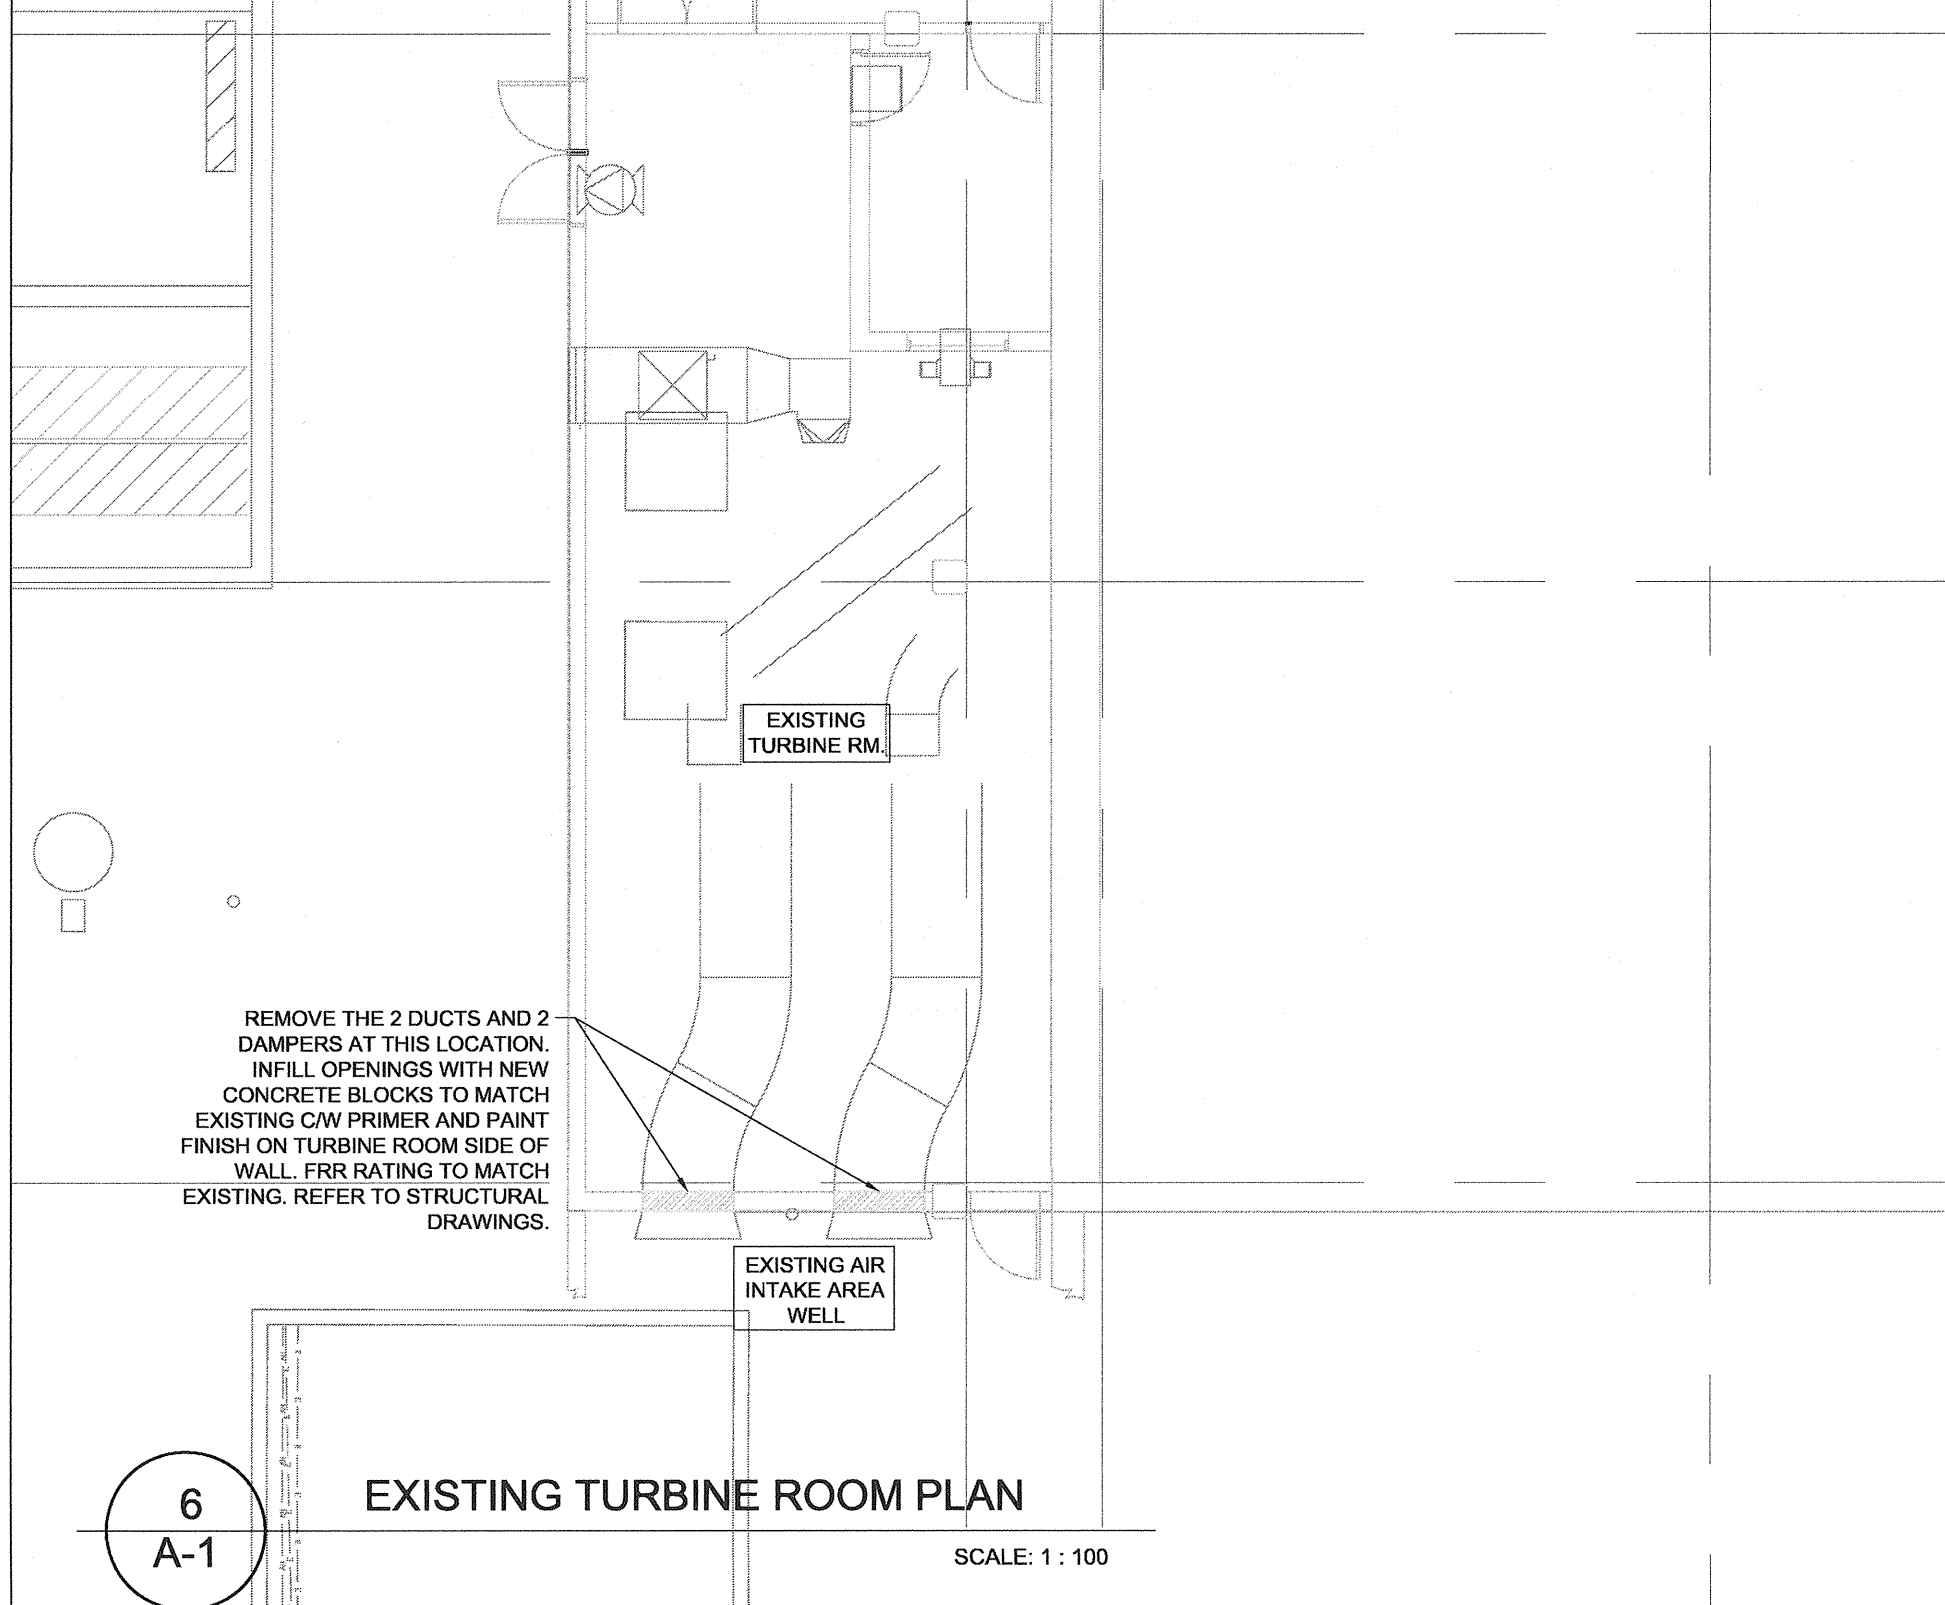
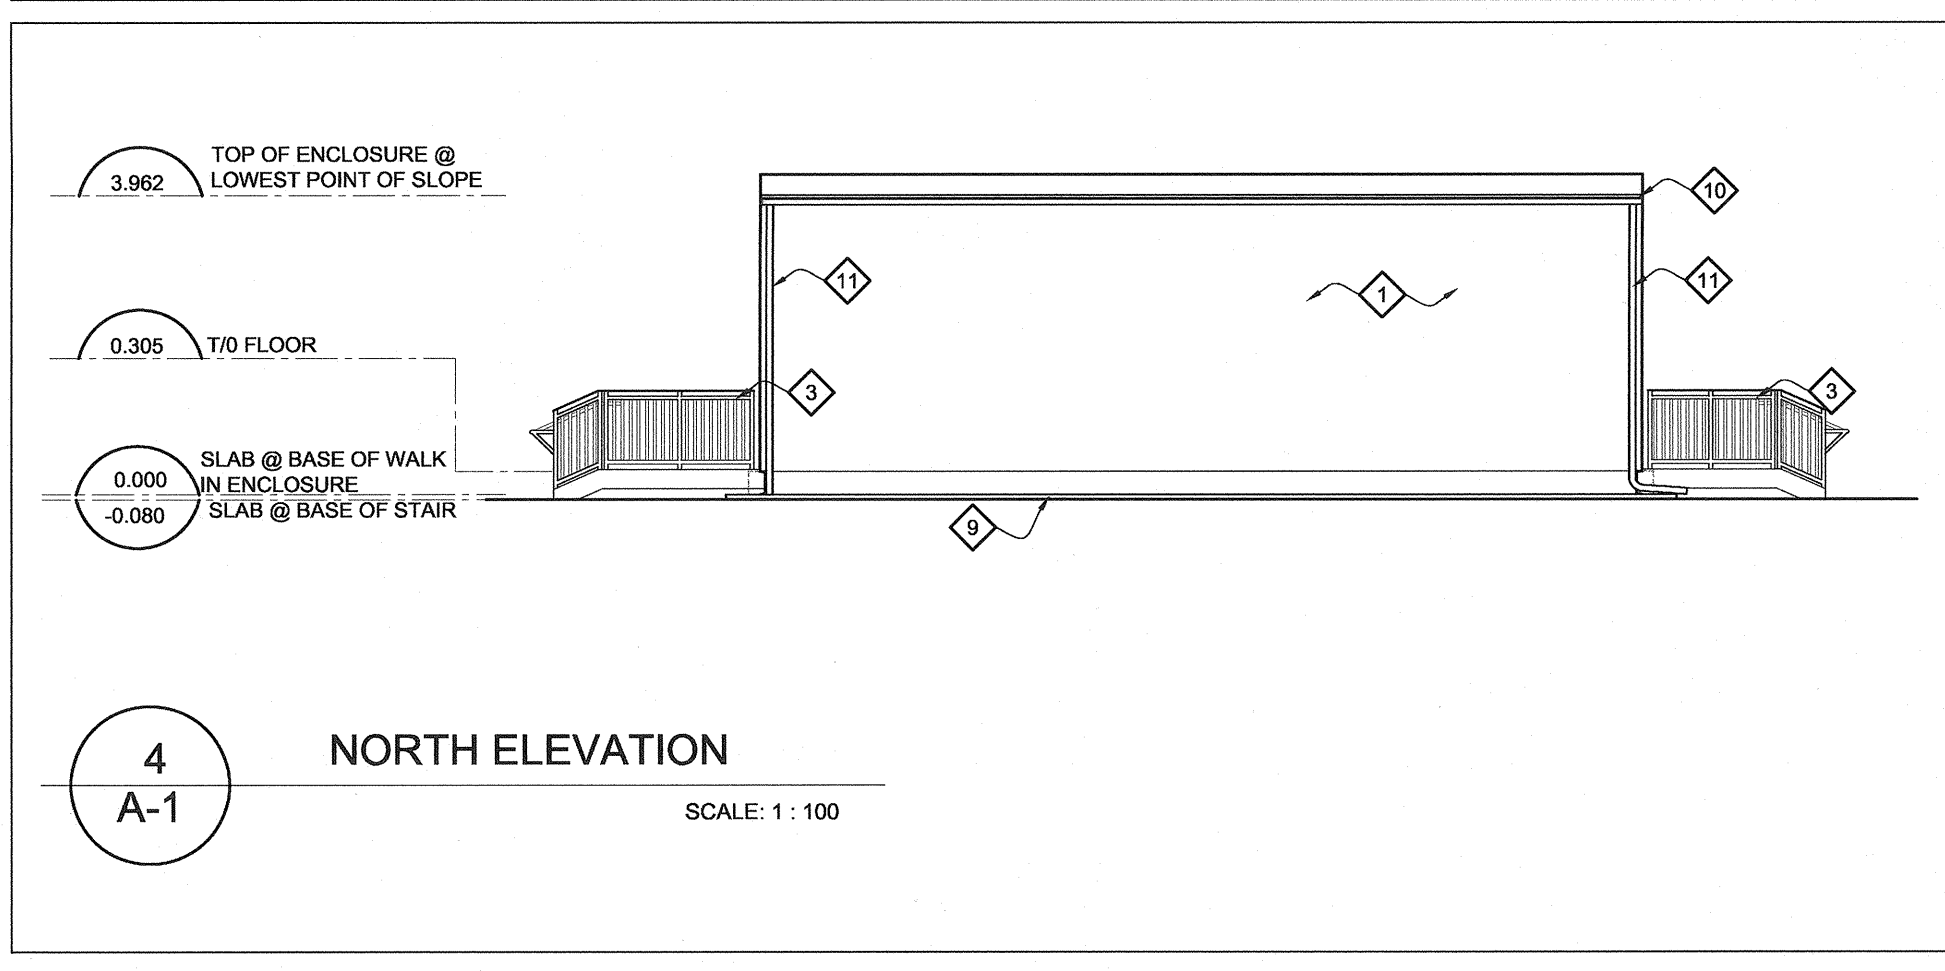


GENERAL PROJECT NOTES:

- REFER TO SPECIFICATION SECTION 2632.20 FOR DETAILED DESCRIPTION OF WALK-IN ENCLOSURE FOR EQUIPMENT.
- REFER TO DWG 8/A-1 FOR DOOR INFORMATION.
- ANCHORING OF STAIRS TO BE COORDINATED WITH STRUCTURAL DRAWINGS AND TO ALLOW FOR MOVEMENT.
- GRATING ON ALL STAIRS & LANDINGS TO BE CONTINUOUS BETWEEN SUPPORT BEAMS & ANCHORED IN PLACE. SUBMIT SHOP DRAWINGS STAMPED BY AN ENGINEER LICENSED IN ONTARIO FOR STAIRS, LANDINGS AND BALUSTRADES.
- CONTRACTOR TO PATCH AND REPAIR ALL METAL GALVANIZING DAMAGED ON SITE WITH ZINC RICH PRIMER C/P PAINT FINISH TO MATCH ADJOINING SURFACE.
- ALL STAIRS, BALUSTRADES AND LANDINGS ARE TO BE CONSTRUCTED TO BE DE-MOUNTABLE.

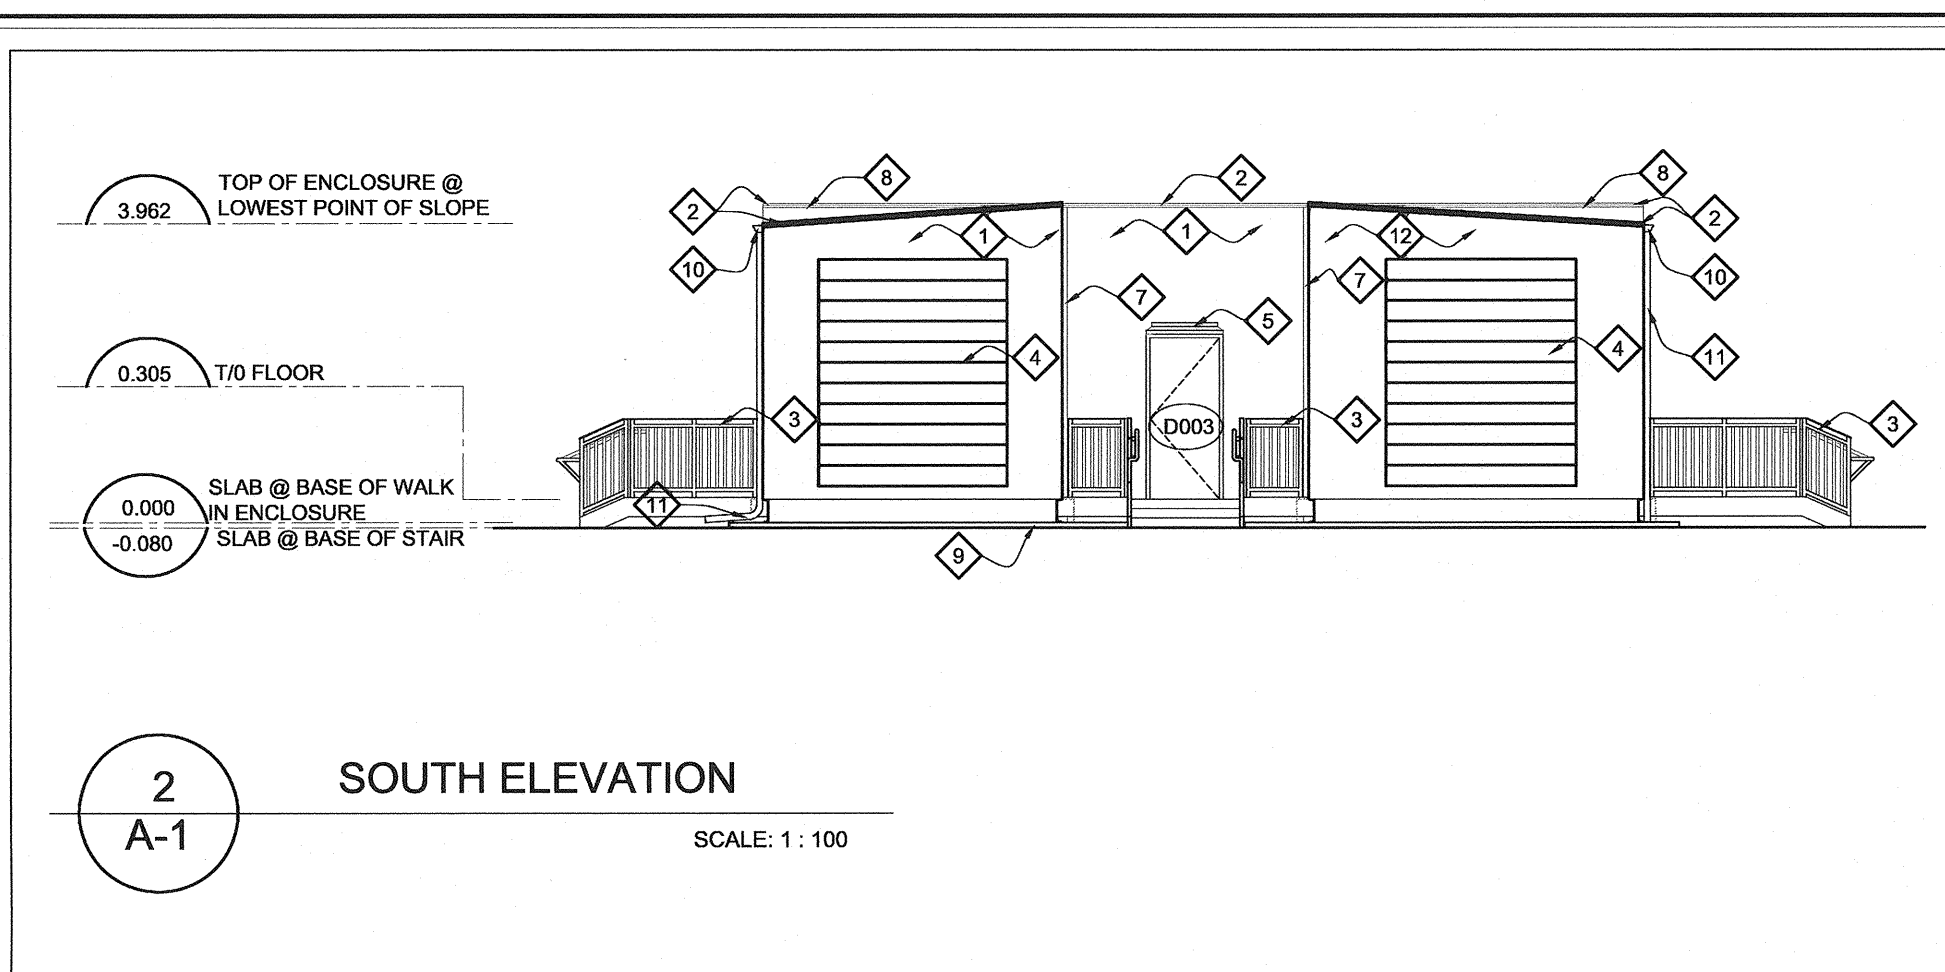



DOOR SCHEDULE NOTES:

- VERIFY DOOR SWING WITH FLOOR PLANS.
- ALL EXTERIOR HOLLOW METAL DOORS TO BE INSULATED.
- CONTRACTOR TO PROVIDE SHOP DRAWINGS/ CUT SHEETS FOR ALL DOOR HARDWARE.
- ALL SHIMS USED IN INSTALLATION OF EXTERIOR DOORS TO BE PLASTIC SHIMS (NO CEDAR SHIMS ARE ACCEPTABLE).
- COORDINATE AMOUNT OF GWG AND INSTALLATION OF HARDWARE, WITH FIRE RATINGS ON ALL DOORS & FRAMES. FIRE RATING TO BE MAINTAINED.
- PROVIDE ALL BLOCKING AS REQUIRED TO INSTALL ALL DOOR AND FRAME RELATED HARDWARE. IF WOOD BLOCKING IS REQUIRED FIRE RATED PLYWOOD C/P FIRE RATED PAINT IS TO BE USED.

NO	FROM	TO	TYP	SLIDELIGHT	WIDTH	HGT	WDTH	TH	M	F	M	F	THROAT	THRES.	GLASS	FPR (HOURS)	REMARKS
D001	STAIR-01	RM-100	E3	-	3048	1830	45	IHM	PT	IST	PT	PT	96	YES	-	1 1/2	ACTIVE LEAF C/W MORTISE LOCK
D002	STAIR-02	RM-101	E2	-	3048	1220	45	IHM	PT	IST	PT	PT	96	YES	-	1 1/2	-
D003	STAIR-03	RM-100	E1	-	2134	915	45	IHM	PT	IST	PT	PT	96	YES	-	1 1/2	ACTIVE LEAF C/W MORTISE LOCK
D004	STAIR-04	RM-102	E3	-	3048	1830	45	IHM	PT	IST	PT	PT	96	YES	-	1 1/2	-
D005	STAIR-03	RM-102	E1	-	2134	915	45	IHM	PT	IST	PT	PT	96	YES	-	1 1/2	-
D006	STAIR-03	RM-103	E4	-	3048*	1067*	45	EXIST	PT	EXIST	EXIST	EXIST	EXIST	EXIST	EXIST	-	-
D007	STAIR-05	RM-103	E5	-	3048*	2134*	45	EXIST	PT	EXIST	EXIST	EXIST	EXIST	EXIST	EXIST	-	-
D008	RM-101	RM-100	E8	-	3048	1220	45	IHM	PT	IST	PT	PT	96	-	GWG	1 1/2	-
D009	RM-100	RM-102	E8	-	3048	1220	45	IHM	PT	IST	PT	PT	96	*YES	GWG	1 1/2	-

DOOR SCHEDULE LEGEND:

ALUM	ANOD	EXIST	F	FPR	FW	GWG	HGT	IHM	IST	M	NO	PT	PS	TH	THRES	TRANS	TYP
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

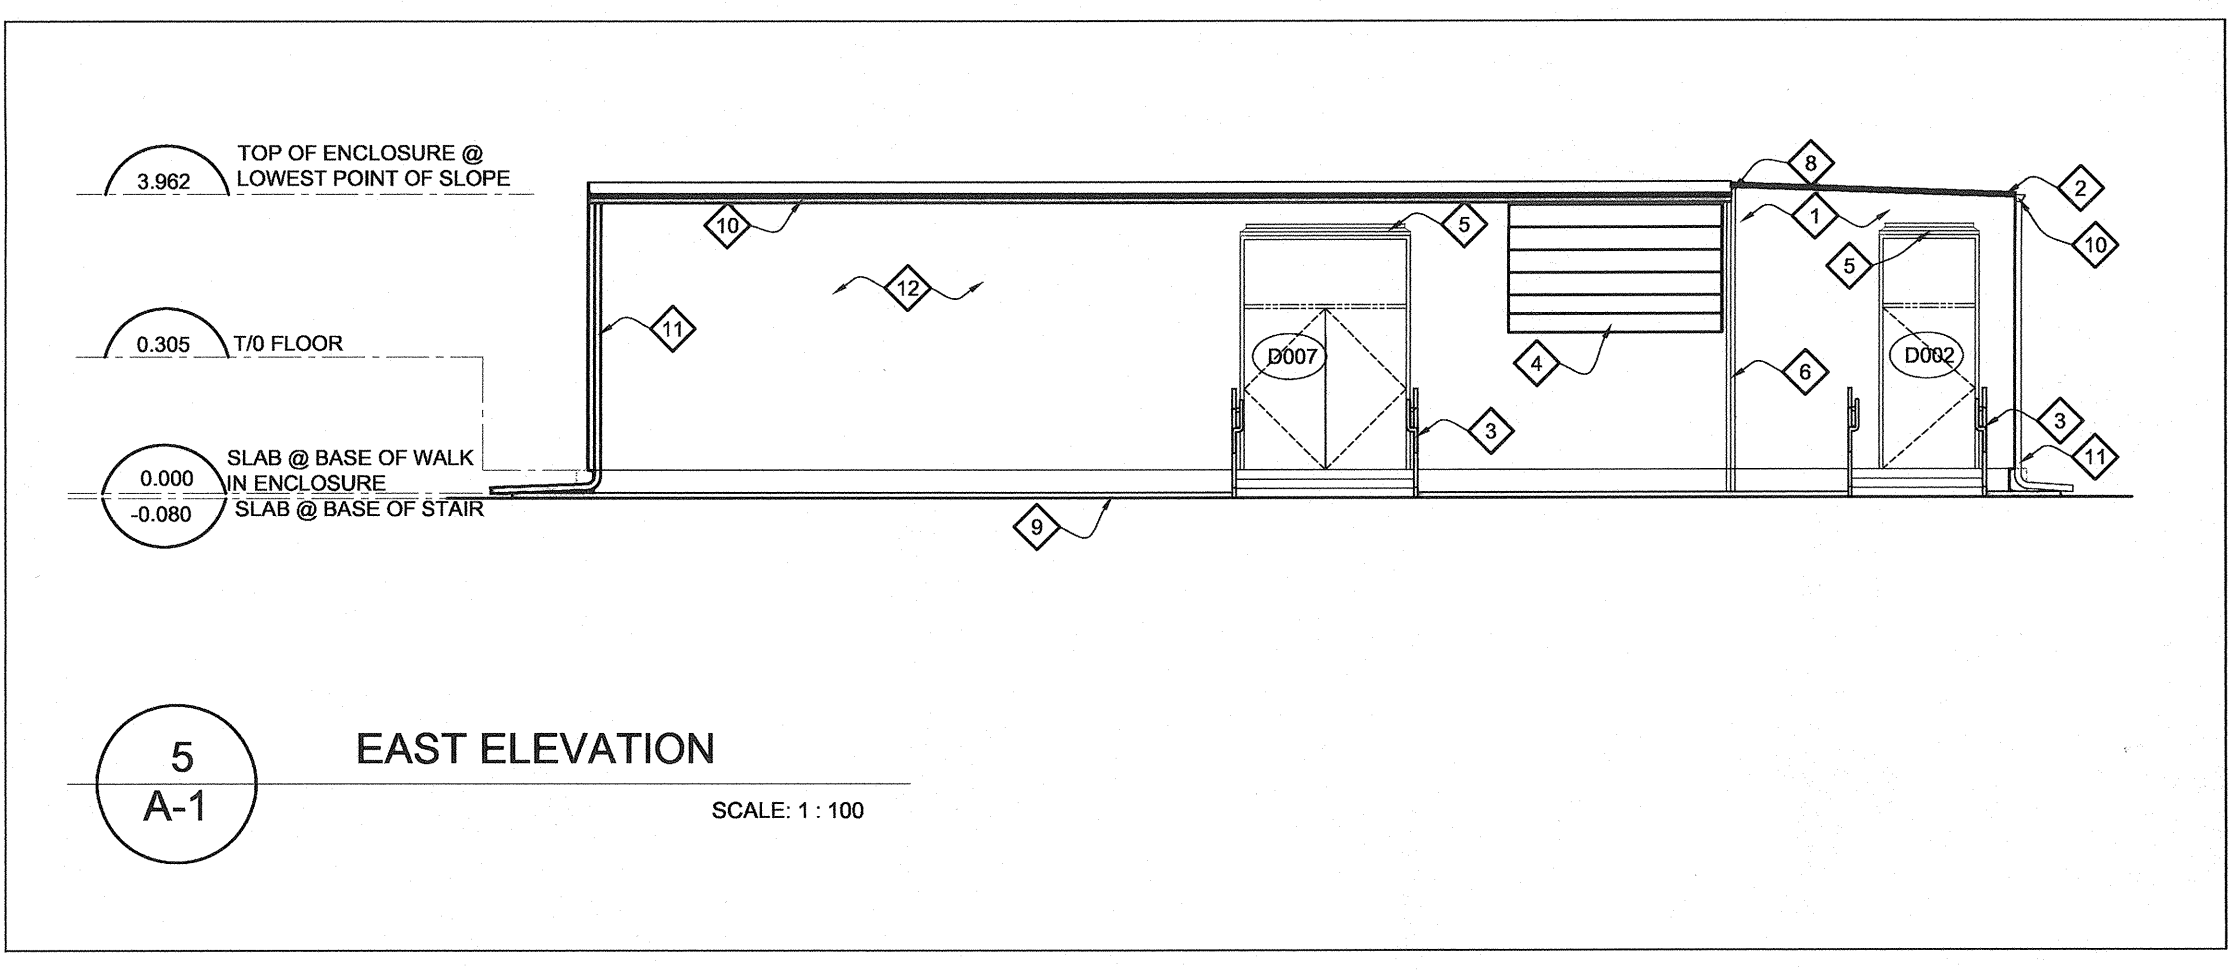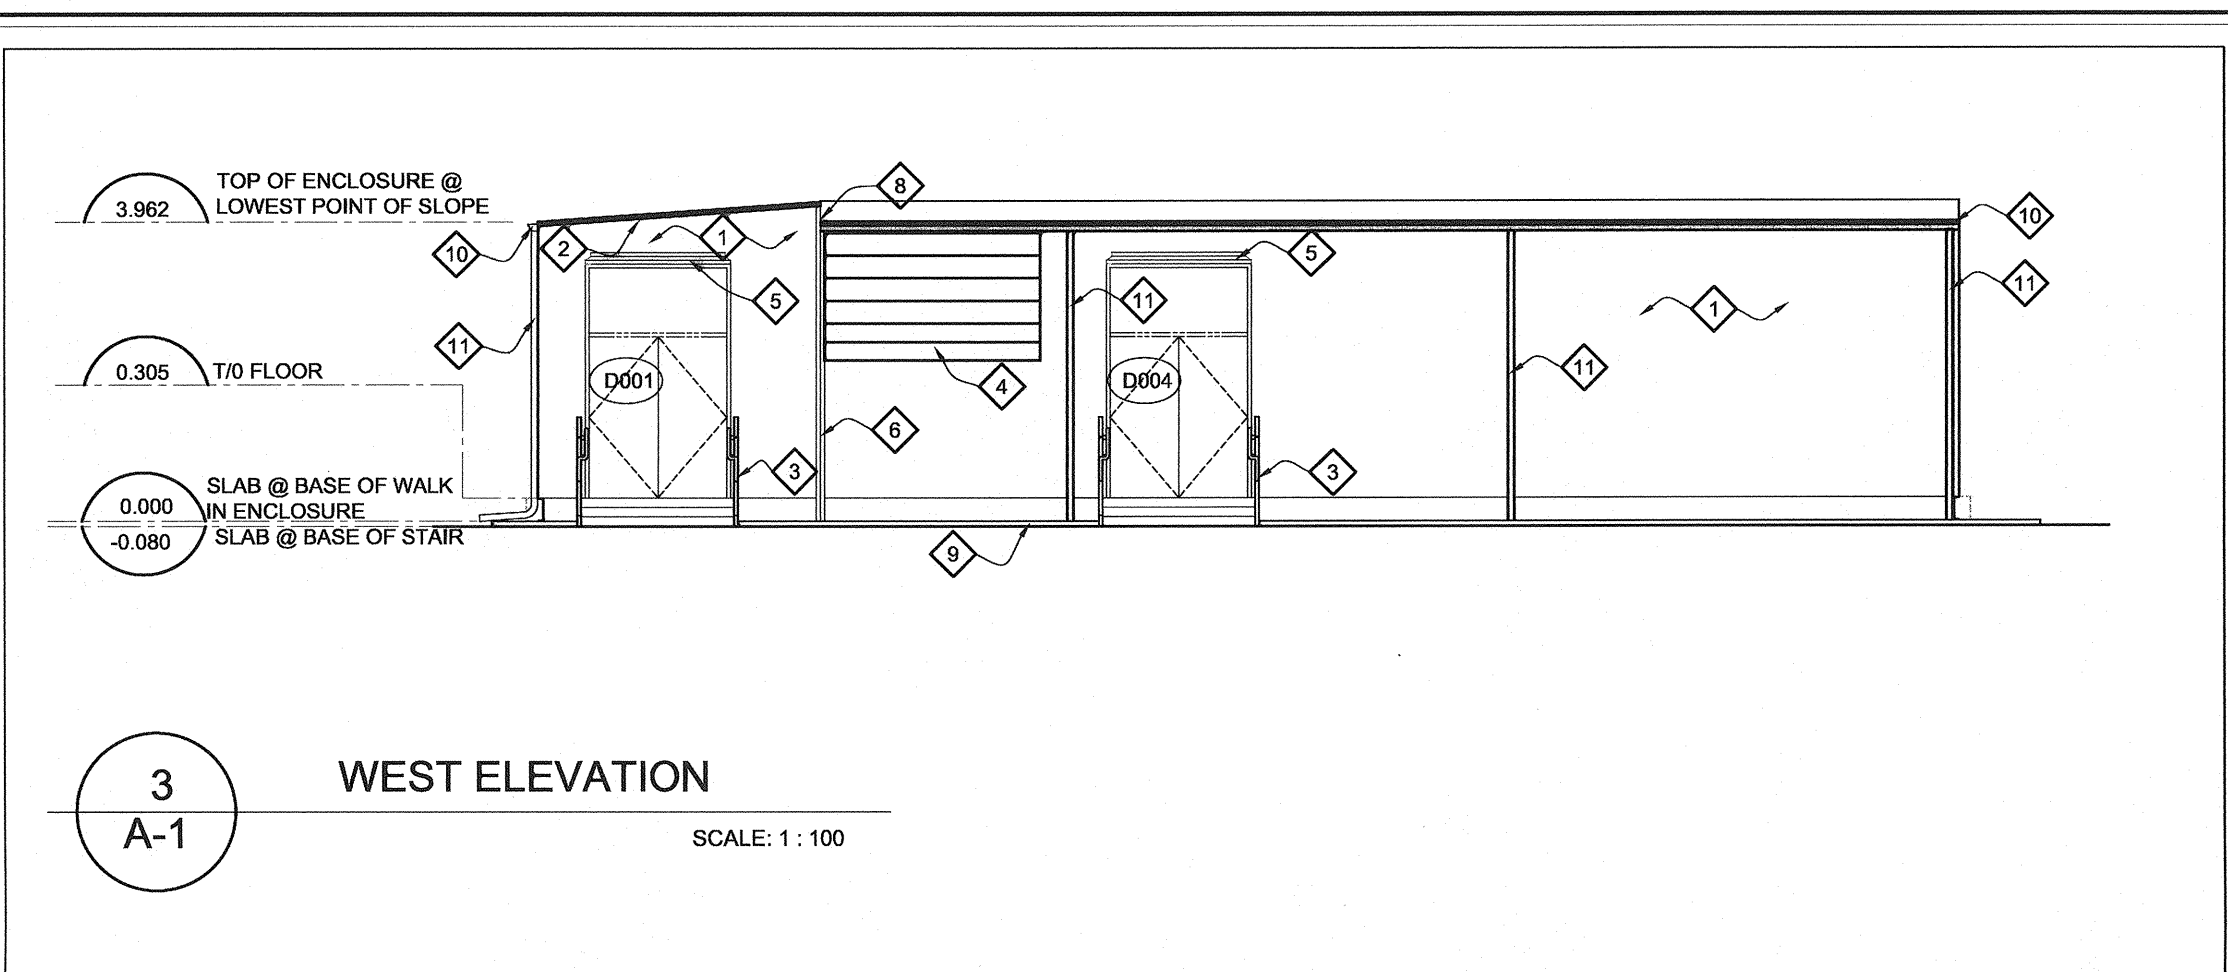

ELEVATION LEGEND:

- PREFAB EXTERIOR STEEL SHEET OF SATIN GALV. STEEL. PRE-FINISHED PAINTED COLOUR TO MATCH EXISTING PREFAB UNIT.
- PREFAB ROOF FLASHING C/P DRIP.
- METAL STAIRS & LANDINGS C/W GUARDS AND HANDRAILS. REFER TO DWG 1/A-1.
- MECHANICAL EQUIPMENT REFER TO MECHANICAL DRAWINGS.
- PROVIDE PRE-FINISHED DRAIN SHIELD ABOVE ALL EXTERIOR DOORS. (TYPICAL). COLOUR TO MATCH ENCLOSURE.
- "PATCH" BETWEEN PREFAB STRUCTURES, REFER TO DWG 8/A-2.
- "PATCH" BETWEEN PREFAB STRUCTURES AT INSIDE CORNER, REFER TO DWG 7/A-2.
- "PATCH" BETWEEN PREFAB STRUCTURES AT ROOF. REFER TO DWG 8/A-2 & COORDINATE WITH SPECIFICATION ON REQUIREMENT FOR WATERTIGHT JOINT.
- CONCRETE EQUIPMENT PAD, REFER TO STRUCTURAL DRAWINGS.
- PROVIDE PRE-FINISHED METAL GUTTER TO MATCH ENCLOSURE C/W T-REX SYSTEM (OR APP. ALT.) AND END CAPS.
- PRE-FINISHED METAL DOWNSPOUT TO DIRECT WATER AWAY FROM FOUNDATION C/W SPLASH PAN.
- RELOCATED PREFAB ENCLOSURE.
- CONCRETE "STAIR" PAD REFER TO STRUCTURAL.

FENCE GATE SCHEDULE NOTES:

- VERIFY GATE SWING WITH FLOOR PLANS.
- CONTRACTOR TO PROVIDE SHOP DRAWINGS/ CUT SHEETS FOR ALL GATE HARDWARE.
- ALL GATE HARDWARE TO BE EXTERIOR GRADE. FENCE GATE DESIGN TO INCLUDE GALVANIZED METAL PLATES TO TAKE REQUIRED HARDWARE.

NO	FROM	TO	TYP	HGT	WIDTH	M	F	M	F	REMARKS
0001	FENCED AREA	EXTERIOR	-	2180	1830	SC / SF	GALV	SC	GALV	100% COORDINATE LOCATION, SIZE AND GAUGE AS PER CLIENT REQUIREMENTS.
0002	FENCED AREA	EXTERIOR	-	2180	915	SC / SF	GALV	SC	GALV	100% COORDINATE LOCATION, SIZE AND GAUGE AS PER CLIENT REQUIREMENTS.
0003	FENCED AREA	EXTERIOR	-	2180	1830	SC / SF	GALV	SC	GALV	100% COORDINATE LOCATION, SIZE AND GAUGE AS PER CLIENT REQUIREMENTS.
0004	FENCED AREA	EXTERIOR	-	2180	915	SC / SF	GALV	SC	GALV	100% COORDINATE LOCATION, SIZE AND GAUGE AS PER CLIENT REQUIREMENTS.
0005	FENCED AREA	EXTERIOR	-	2180	1830	SC / SF	GALV	SC	GALV	100% COORDINATE LOCATION, SIZE AND GAUGE AS PER CLIENT REQUIREMENTS.
0006	FENCED AREA	EXTERIOR	-	2180	1830	SC / SF	GALV	SC	GALV	100% COORDINATE LOCATION, SIZE AND GAUGE AS PER CLIENT REQUIREMENTS.

FENCE GATE SCHEDULE LEGEND:

SC	SF	GALV
-	-	-

Public Works and Government Services Canada / Travaux publics et Services gouvernementaux Canada

National Centre of Expertise Architectural and Engineering Services Real Property Services Branch

Centre d'expertise national Services d'architecture et d'ingénierie Direction générale des services immobiliers

FD farrow dreesen architects inc. 1350 Wellington Street W. Ottawa, Ontario K1Y 3C1 P: +1 613 725 2284 F: +1 613 724 6632 www.farrow-dreesen.com

ARCHITECTS OF ONTARIO / ARCHITECTES DE L'ONTARIO LICENCE 4855 February 28, 2013

00 ISSUED FOR TENDER Feb 28, 2013

revisions description date

GOVERNMENT OF CANADA

TURBINE REPLACEMENT

ARCHITECTURAL - PLANS, ELEVATIONS AND DOOR SCHEDULE

designed R.H./D.F. R.H. T.D. D.F. C. CAMPBELL

drawn R.H. T.D. D.F. C. CAMPBELL

date R.H. T.D. D.F. C. CAMPBELL

approved R.H. T.D. D.F. C. CAMPBELL

date R.H. T.D. D.F. C. CAMPBELL

Tender PWC Project Manager Administrateur de projet project no. R.055763.002 drawing no. A1 of 2