


No.	Issue	Date

No.	Revision	Check By	Date

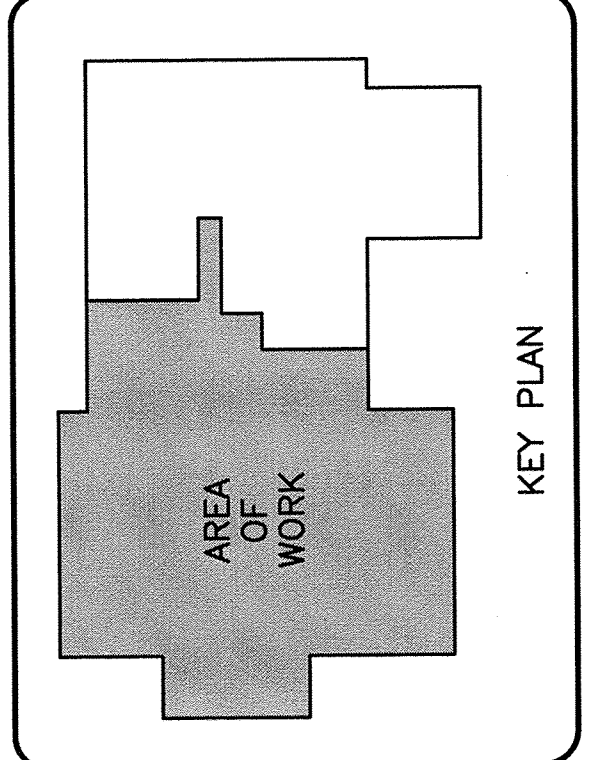


RELEASED FOR CONSTRUCTION

Contract North

exp Services Inc.
 11 J.A. Gillison
 No. 871
 DATE: March 22 / 13
 Prepared by: EXP
 Project Engineer: EXP
 Project Estimator: EXP

Drawn By: RDD
 Check Standards: CPK
 Check By: CPK
 Designed By: CTG
 Date Printed: [Blank]
 Check Design: [Blank]
 Check By: SGT

exp Services Inc.
 T: 1.508.462.2000 | F: 1.508.469.3854
 1000 Highway 108, Suite 300
 Fredericton, NB E3B 3Z2
 CANADA
 www.exp.com

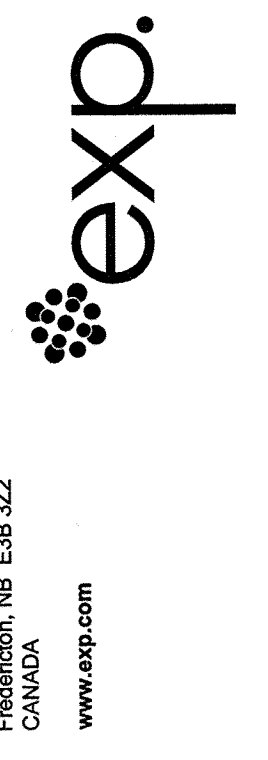

• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
 • INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

Project Title: **VENTILATION UPGRADE
 GOCB EAST PRINCE, PE**

Dwg. Title: **VENTILATION
 DEMOLITION**


Project No.: **FRE-00210847-A0**

Dwg. No.: **2300-1**

Rev. No.: **0**

Scale: **1:50**

This drawing is to be sealed

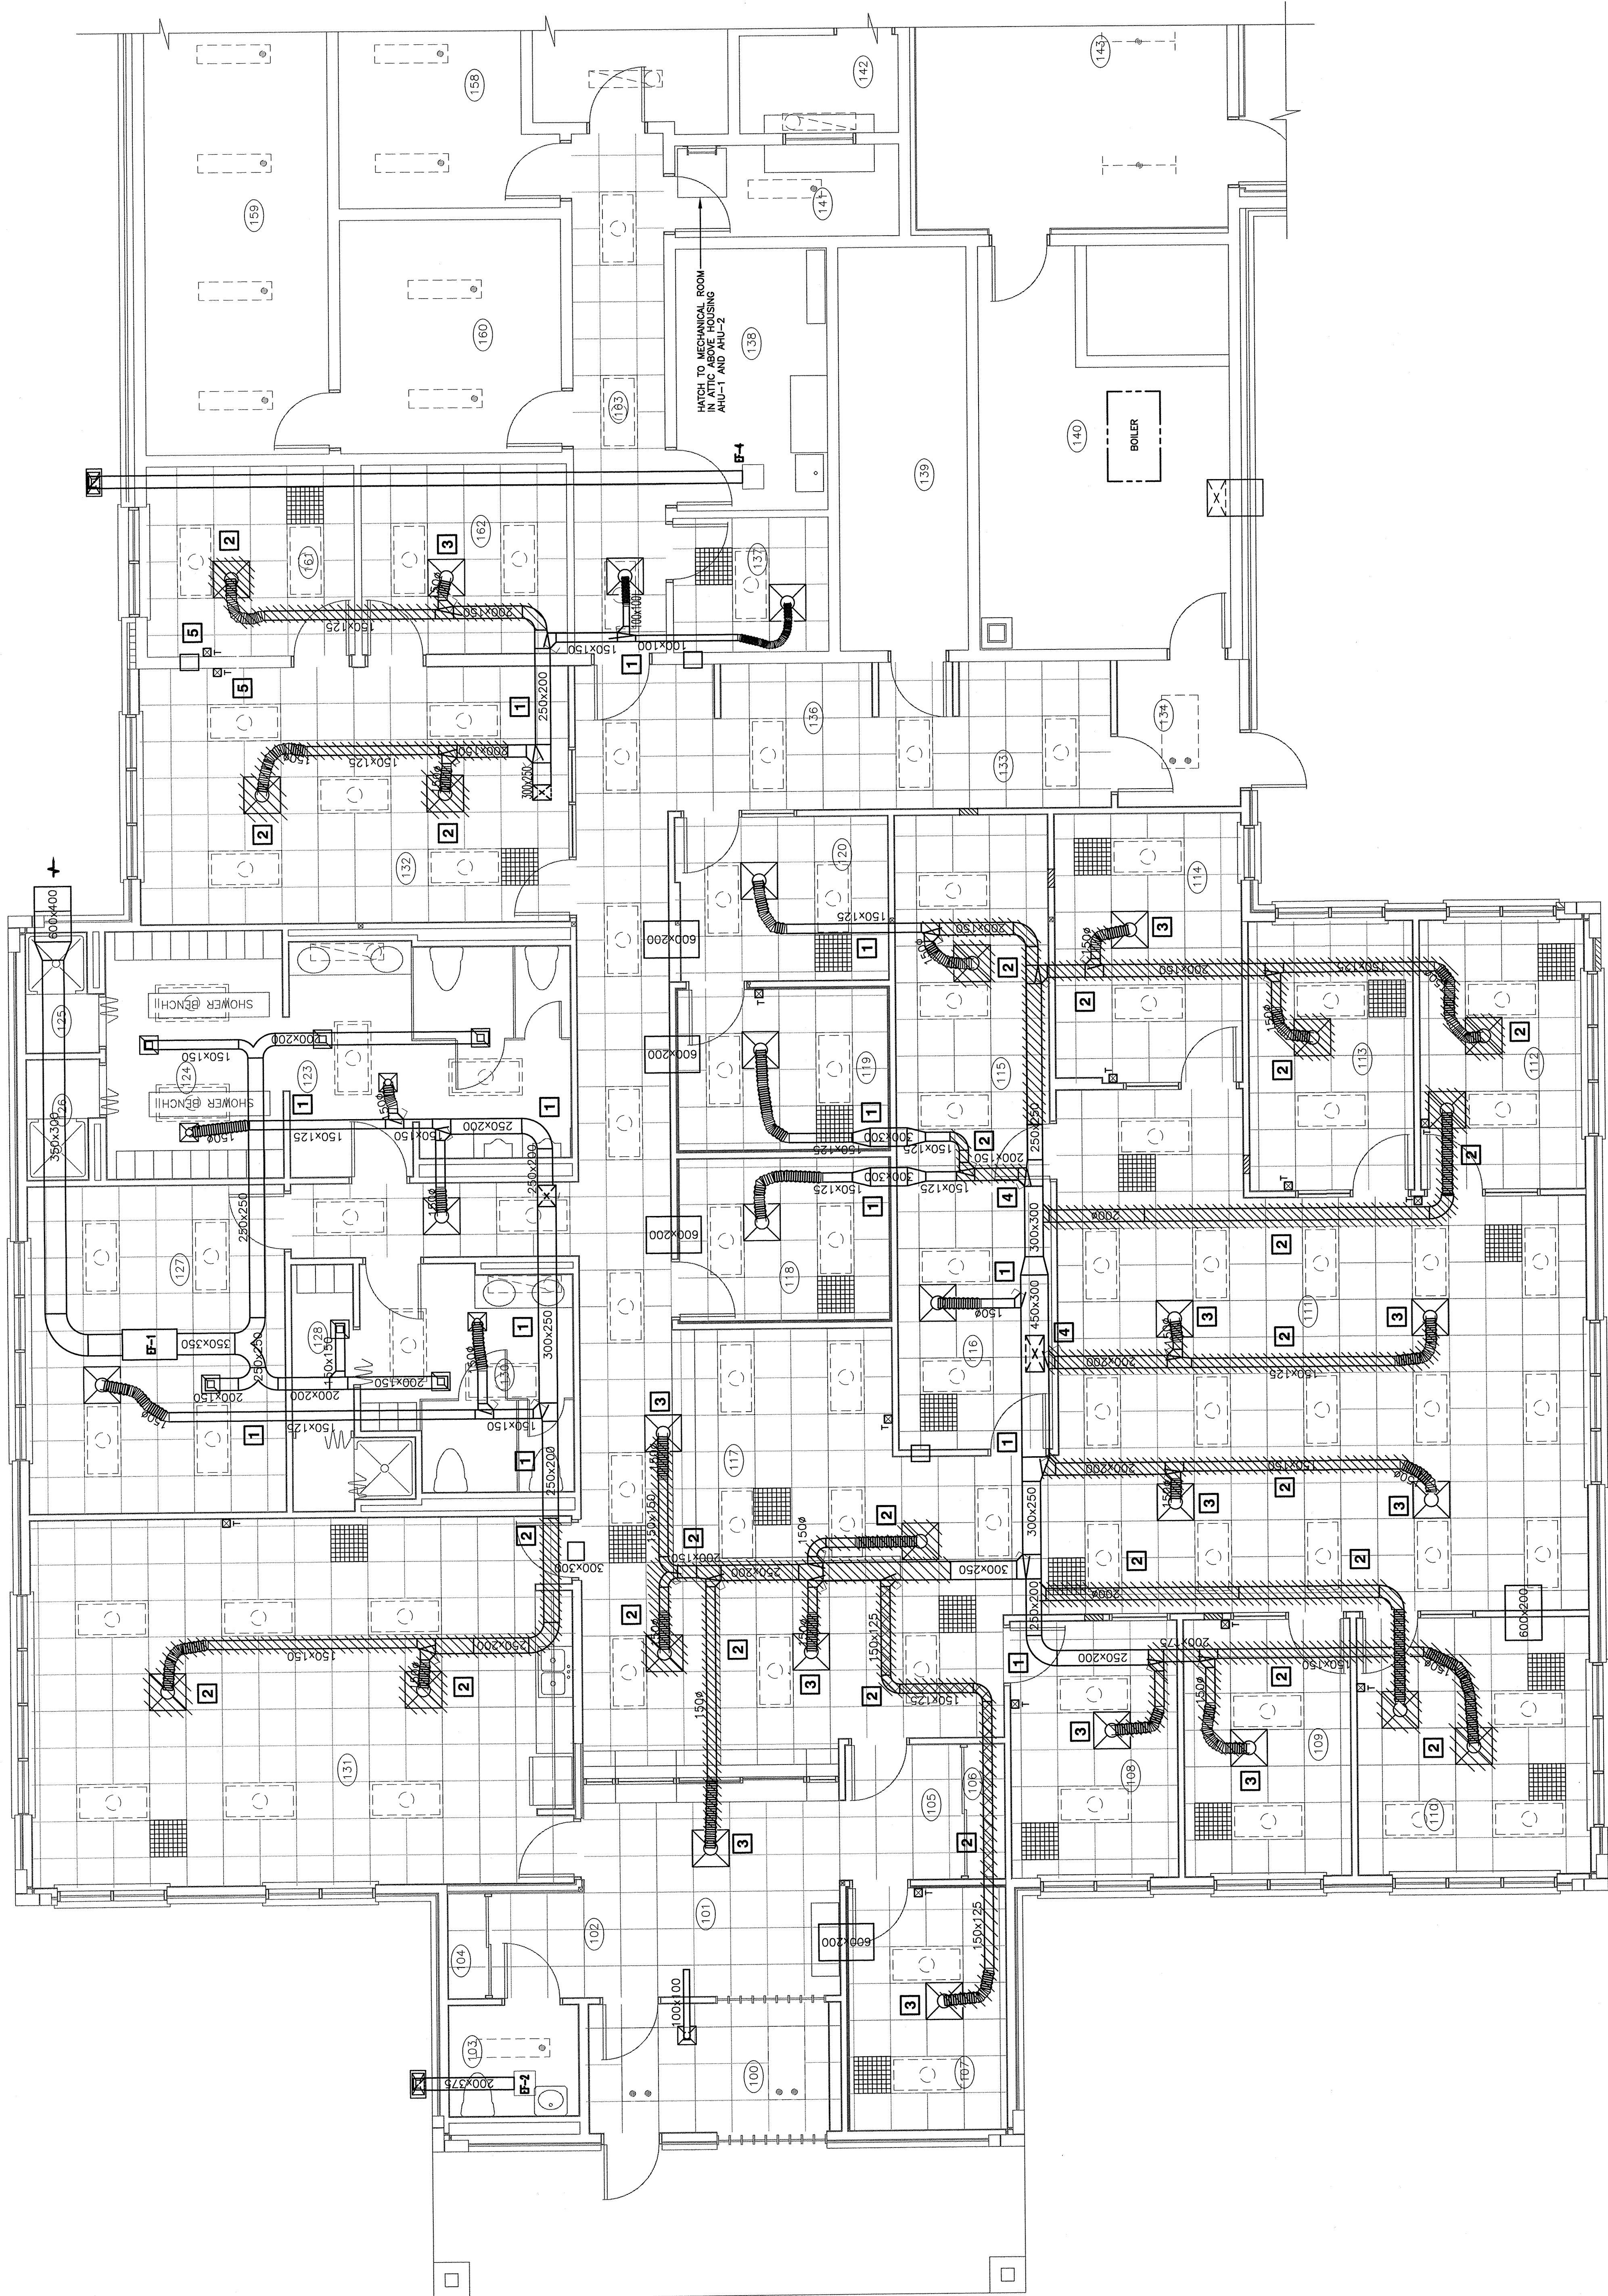

- NOTES**
- EXISTING DUCTWORK TO REMAIN AS IS.
 - REMOVE EXISTING SA DIFFUSER, DUCTWORK, ETC. AS SHOWN.
 - EXISTING SA DIFFUSER TO REMAIN AS IS. REMOVE EXISTING FLEXIBLE DUCTWORK, ETC. AS SHOWN.
 - REMOVE EXISTING BRANCH DUCT AND SEAL OPENING AIRTIGHT.
 - REMOVE EXISTING TEMPERATURE SENSOR AND PROVIDE STAINLESS STEEL COVER PLATE.

LEGEND

---	EXISTING	EXHAUST AIR	TC-1	TEMPERING COIL #1
////	TO BE REMOVED	FA FRESH (OUTSIDE) AIR	HC	HEATING COIL
---	TO BE RELOCATED	T1 EXISTING THERMOSTAT	□	BALL VALVE
---	NEW DUCTWORK	T2 NEW TEMPERATURE SENSOR	□	BALANCING VALVE
---	FLEXIBLE DUCTWORK	T3 HEATING WATER TEMP. SENSOR	□	CHECK VALVE
---	AHU-1	T4 DUCT TEMPERATURE SENSOR	□	STRAINER
---	AIR HANDLING UNIT (EXIST)	SS SOLID STATE RELAY	□	CIRCULATING PUMP
---	EXHAUST FAN #1 (EXIST)	AW-1 AIRFLOW DIRECTION	□	TEMPERATURE SENSOR
---	VARIABLE AIR VOLUME BOX #1	ND NEW DIFFUSER - TYPE 1	□	
---	BALANCING DAMPER	ES EXISTING DIFFUSER	□	
---	SUPPLY AIR	SA EXISTING DIFFUSER/GRILLE	□	
---	RETURN AIR	RA EXISTING AIRFLOW	□	

PARTIAL PLAN
 FIRST FLOOR - DEMOLITION