


1. FOR ELECTRICAL DEVICES & EQUIPMENT TO BE REMOVED, CONTRACTOR SHALL REMOVE ALL ASSOCIATED CONDUIT AND WIRING BACK TO SOURCE.
2. FOR ELECTRICAL DEVICES AND EQUIPMENT TO BE REPLACED REUSE EXISTING CONDUIT AND PROVIDE NEW WIRING.
3. OWNER HAS FIRST RIGHT OF REFUSAL OF ALL REMOVED MATERIAL. IF OWNER REFUSE MATERIALS, CONTRACTOR IS TO REMOVE MATERIALS FROM THE SITE.

4. INFORMATION PERTAINING TO EXISTING CIRCUITS AND EQUIPMENT SHOWN ON THESE DRAWINGS MAY NOT FULLY OR ACCURATELY REFLECT THE EXISTING CONDITIONS. BEFORE WORKING ON EQUIPMENT, TRACE WIRING BACK TO SOURCE AND ENSURE THAT ASSOCIATED CIRCUITS ARE DE-ENERGIZED.
5. ALL DEVICES TO BE REMOVED IN THIS CONTRACT MAY NOT BE SHOWN ON DEMOLITION PLANS. CONTRACTOR TO CONFIRM SCOPE OF WORK OF DEMOLITION DURING THE PRE-TENDER SITE VISIT. NO EXTRA WILL BE ALLOWED FOR ITEMS WHICH A NORMAL PRE-TENDER SITE VISIT WOULD HAVE IDENTIFIED
6. IN AREAS WHERE DEVICES HAVE BEEN REMOVED AND NO LONGER REQUIRED IN NEW WORK, PATCH/PAINT AND MAKE GOOD.
7. EXISTING CONTROL SEQUENCE OF OVERALL BUILDING EQUIPMENT IS TO BE MAINTAINED. WHERE NEW CONTROL EQUIPMENT IS INSTALLED TO REPLACE EXISTING CONTRACTOR MUST ENSURE ALL INTERLOCKING, WIRING ETC ARE PROVIDED TO FACILITATE THIS WORK.
8. IN AREAS WHERE DEVICES ARE BEING MONITORED BY THE FIRE ALARM SYSTEM AND ARE BEING REPLACED, ENSURE NEW DEVICES ARE RECONNECTED TO EXISTING F/A CIRCUIT. PROVIDE CONDUIT/WIRING TO SUIT. TEST AND VERIFY F/A SYSTEM IN ACCORDANCE WITH  
CAN/ULC-S524-06 AND  
CAN/ULC-S537

1. REFER TO MECHANICAL DRAWINGS PRIOR TO COMMENCING WITH WORK FOR EXACT EQUIPMENT LOCATIONS AND POWER REQUIREMENTS.
2. PROVIDE LIQUID TIGHT CONNECTIONS TO EQUIPMENT IN AREAS EXPOSED TO WATER.

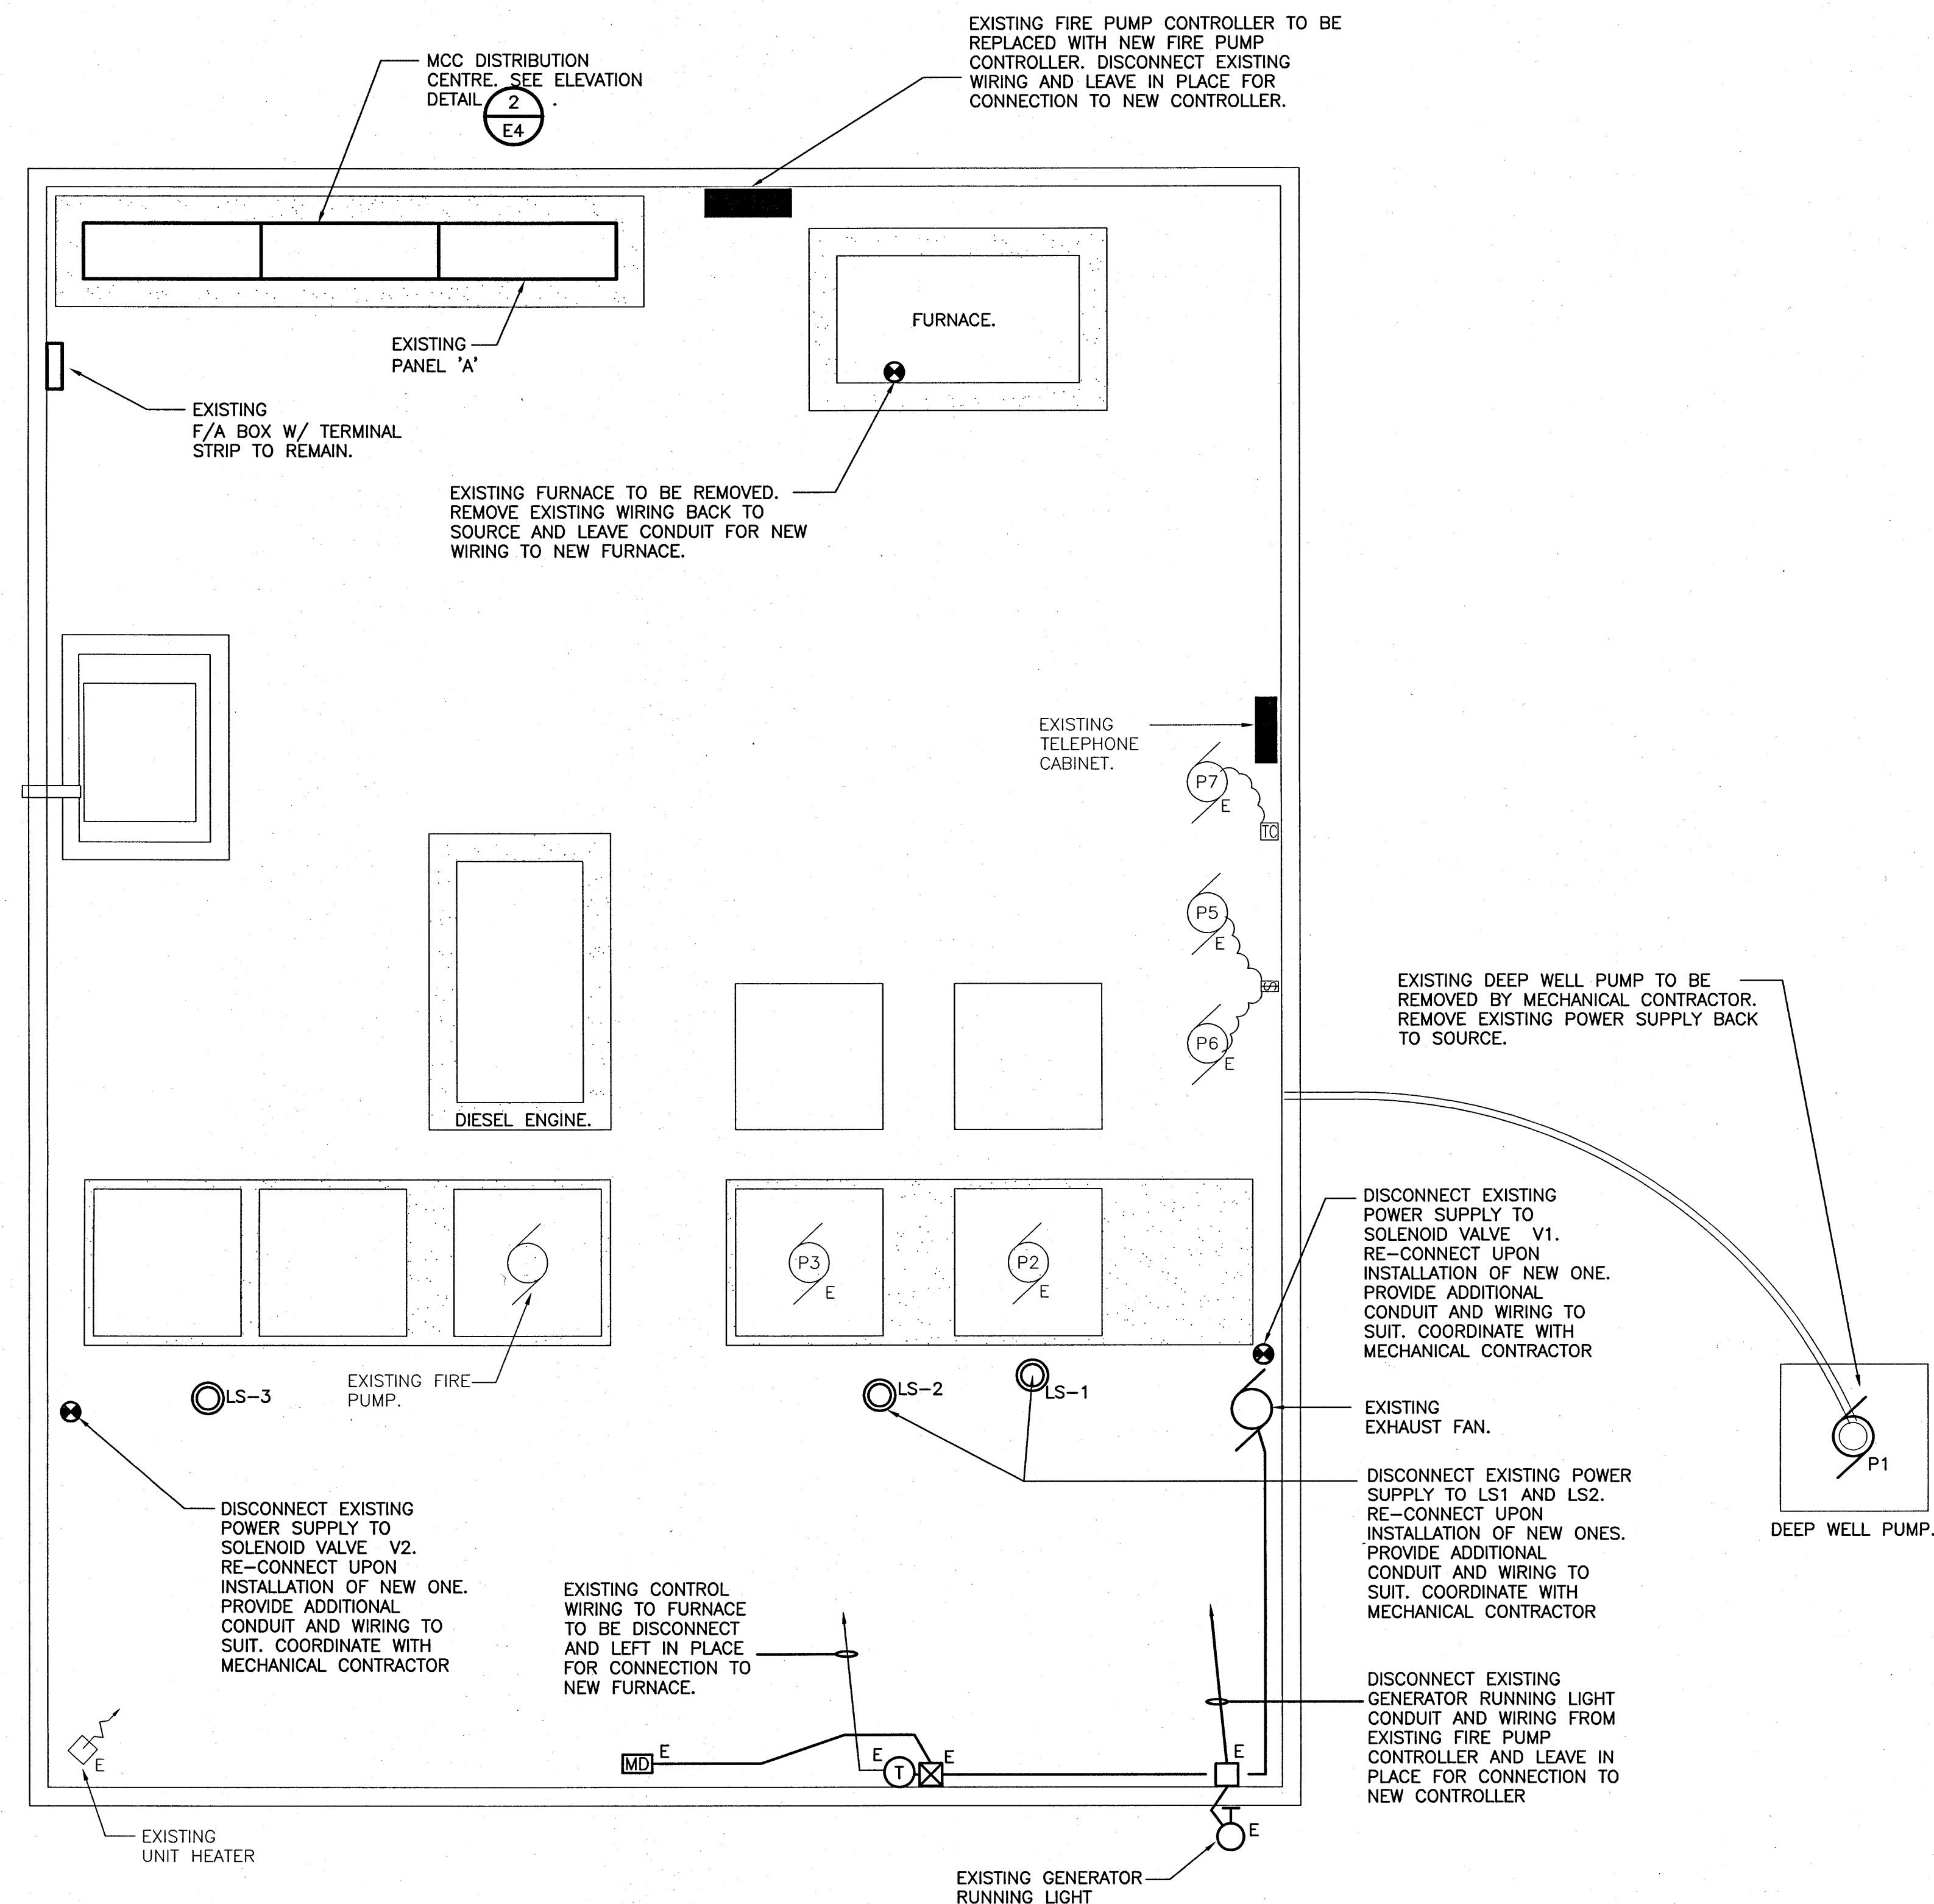

1  
E2

EXISTING POWER PLAN-DEMOLITION

1 : 25