
1.0 GENERAL NOT USED

2.0 ARCHITECTURAL

- .1 Item: Specifications
Refer: Contract Documents - Section 09 96 75
Instructions: .1 Delete Section 09 96 75. Polymer coating to be deleted in Room 118. Intumescent fire retardant paint to be deleted in Room 118.
.2 Provide fire retardant plywood to walls, partitions and ceiling. Fire retardant plywood to treated to CSA 080.27, flamespread 75<, all end cuts to be field treated. Fire retardant treatment to be compatible with epoxy coating.
.3 Provide epoxy coating over fire retardant treated plywood. Epoxy coating to the requirements of Section 09 96 70. Revise Section 09 99 70 to delete Polymer Coating and replace with Epoxy coating.

- .2 Item: Specifications
Refer: Contract Documents - Section 00 22 13
Instructions: Add Clause 1.7 Security Requirements:
.1 Personnel employed on this project will be subject to security check. Obtain clearance, as instructed, for each individual who will be required to enter the premises.
.2 Submit an escort request to Departmental Representative at least 14 days before service is needed. For requests submitted within time noted above, costs of security escort will be paid for by Departmental Representative. Cost incurred by late request will be Contractor's responsibility.
.3 Any escort request may be cancelled free of charge if notification of cancellation is given at least 4 hours before scheduled time of escort. Cost incurred by late request will be Contractor's responsibility.
.4 Calculation of costs will be based on average hourly rate of security officer for minimum of eight hours per day for late service and of four hours for late cancellations.

- .3 Item: Specifications
Refer: Contract Documents - Section 01 78 00
Instructions: Add the following to Clause 1.4.1.2. Contractor to provide one electronic copy of final A/M/E O & M manual on CD in addition to the 3 hard copies.

- .4 Item: Drawings
Refer: Contract Documents - Sheet A1/Detail 7
Instructions: Delete Window Protection Detail 7 and replace with ASK 01.

3.0 MECHANICAL

- .1 Item: Mechanical Items
Refer: Contract Documents
Instructions: Refer to mechanical Addendum 01.

4.0 ELECTRICAL

.1 Item: Electrical Items
Refer: Contract Documents
Instructions: Refer to electrical Addendum 01.

END OF ADDENDUM No. 01

3.0 MECHANICAL

- .1 Item: Revise Note 13
 Refer: Keynote 13 Drawing M102
 Instructions: Add to note “SEE ARCHITECTURAL DRAWINGS”
- .2 Item: Relocation of Oil Tank
 Refer: Drawing M104
 Instructions: Add the following note: “IN RELOCATING THE TANK REUSE THE
EXISTING TANK STAND AND ARRANGE THE LADDER TO
PROVIDE ACCESS FOR FILLING THE TANK.”

END OF ADDENDUM

1.0 GENERAL NOT USED

2.0 ARCHITECTURAL NOT USED

3.0 MECHANICAL


.1 Item:
Refer: Contract Documents -
Instructions:

4.0 ELECTRICAL

.1 Item: Cell light
Refer: Drawings: ESK-01 & ESK-02
Instructions: location of the Cell lights as noted and clarified – 1725 mm from exterior wall to rear edge of light fixture.

Attachments: Drawings ESK-01 & ESK-02

END OF ADDENDUM No. 01

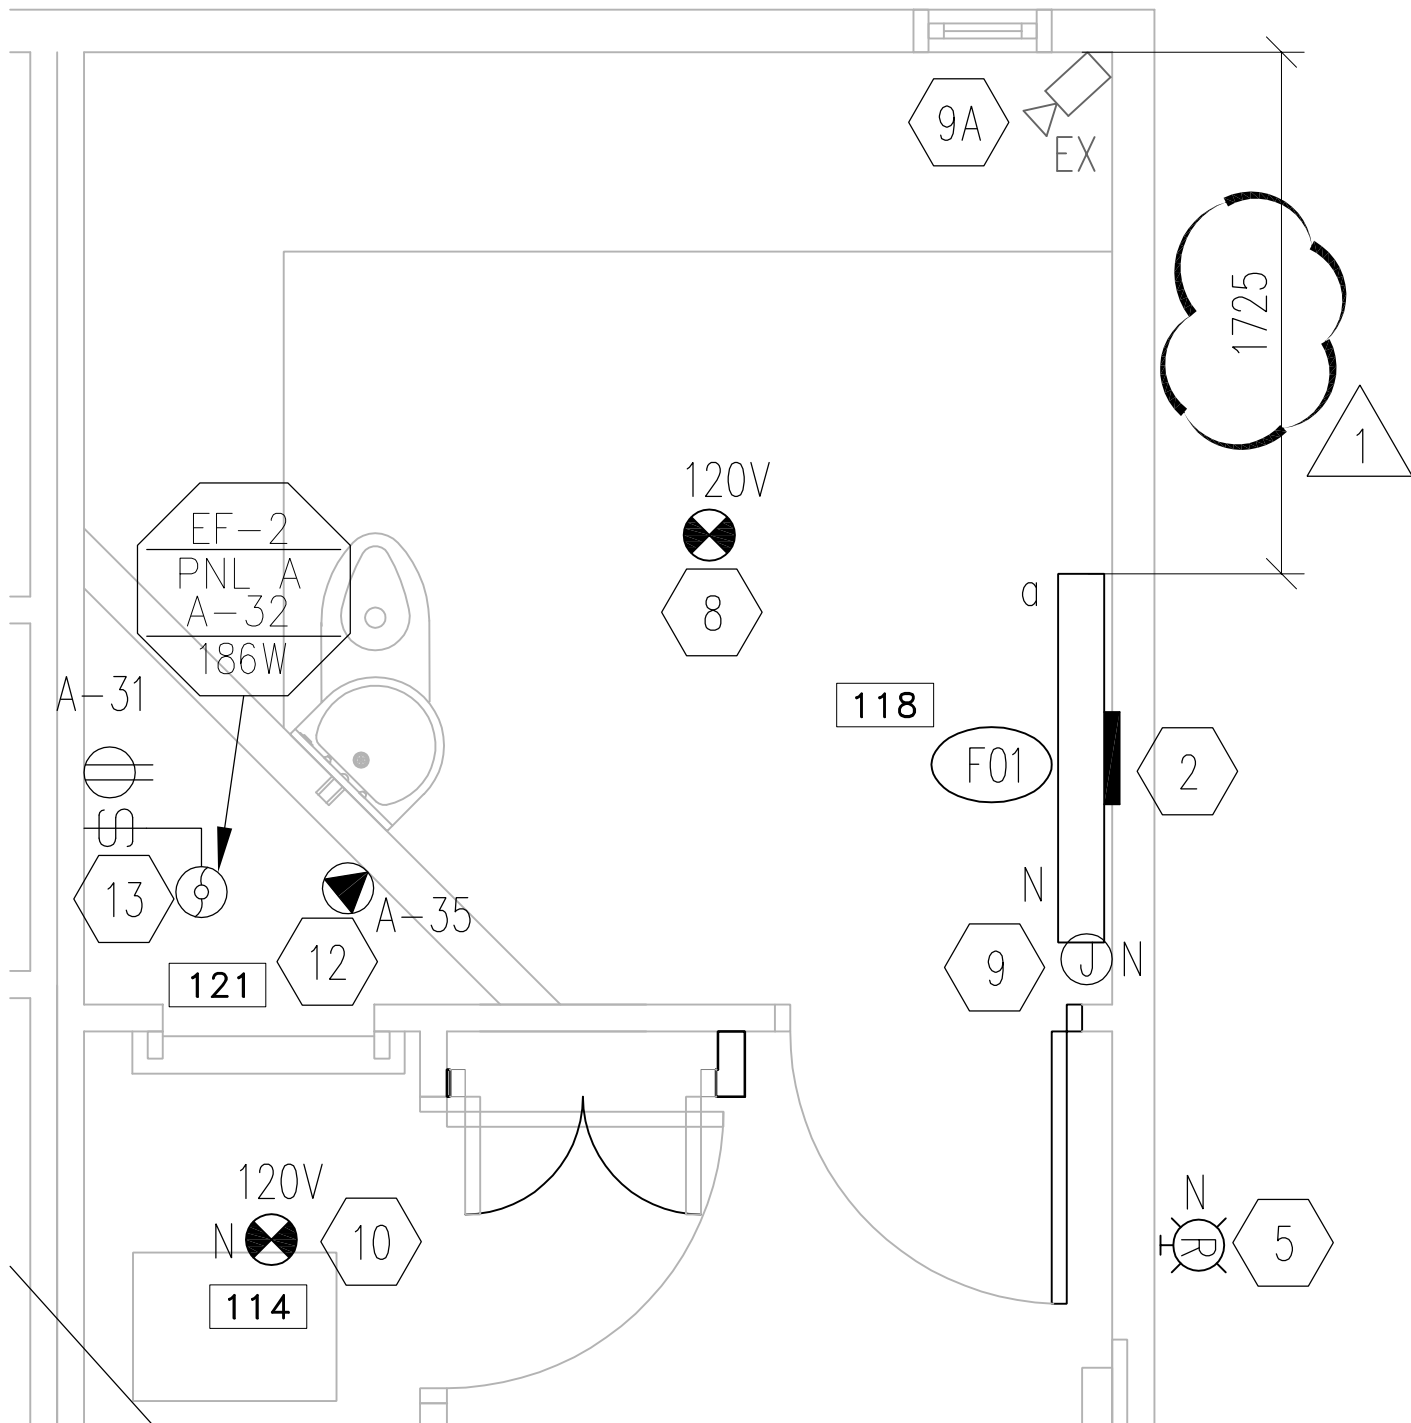

YELLOWKNIFE OFFICE
P.O. Box 1529
2nd Floor 4902 49 Street
Yellowknife, NT X1A 2P2

Bus: (867) 873-2395
Toll Free: 1-800-263-2393
Fax: (867) 873-2547

info@williamsengineering.com
www.williamsengineering.com


WILLIAMS
ENGINEERING
CANADA



JOB. TITLE: RENOVATIONS TO
GOVERNMENT OF CANADA BUILDING
ULUKHAKTOK, NWT

DWG. TITLE: ADDENDUM E-01
DRAWING E101
CELL FIXTURE LOCATION

DWN. BY: MAC	DES. BY: MAC	PROJ. MGR.: --
PEER REVIEW: JAK	DATE: (YY-MM-DD) 2013.05.30	SCALE: NTS
CLIENT PROJ. # WBSE # R.023085.001	WE PROJ. # 27574.00	OF 2 REV # A
DWG #		ESK-01

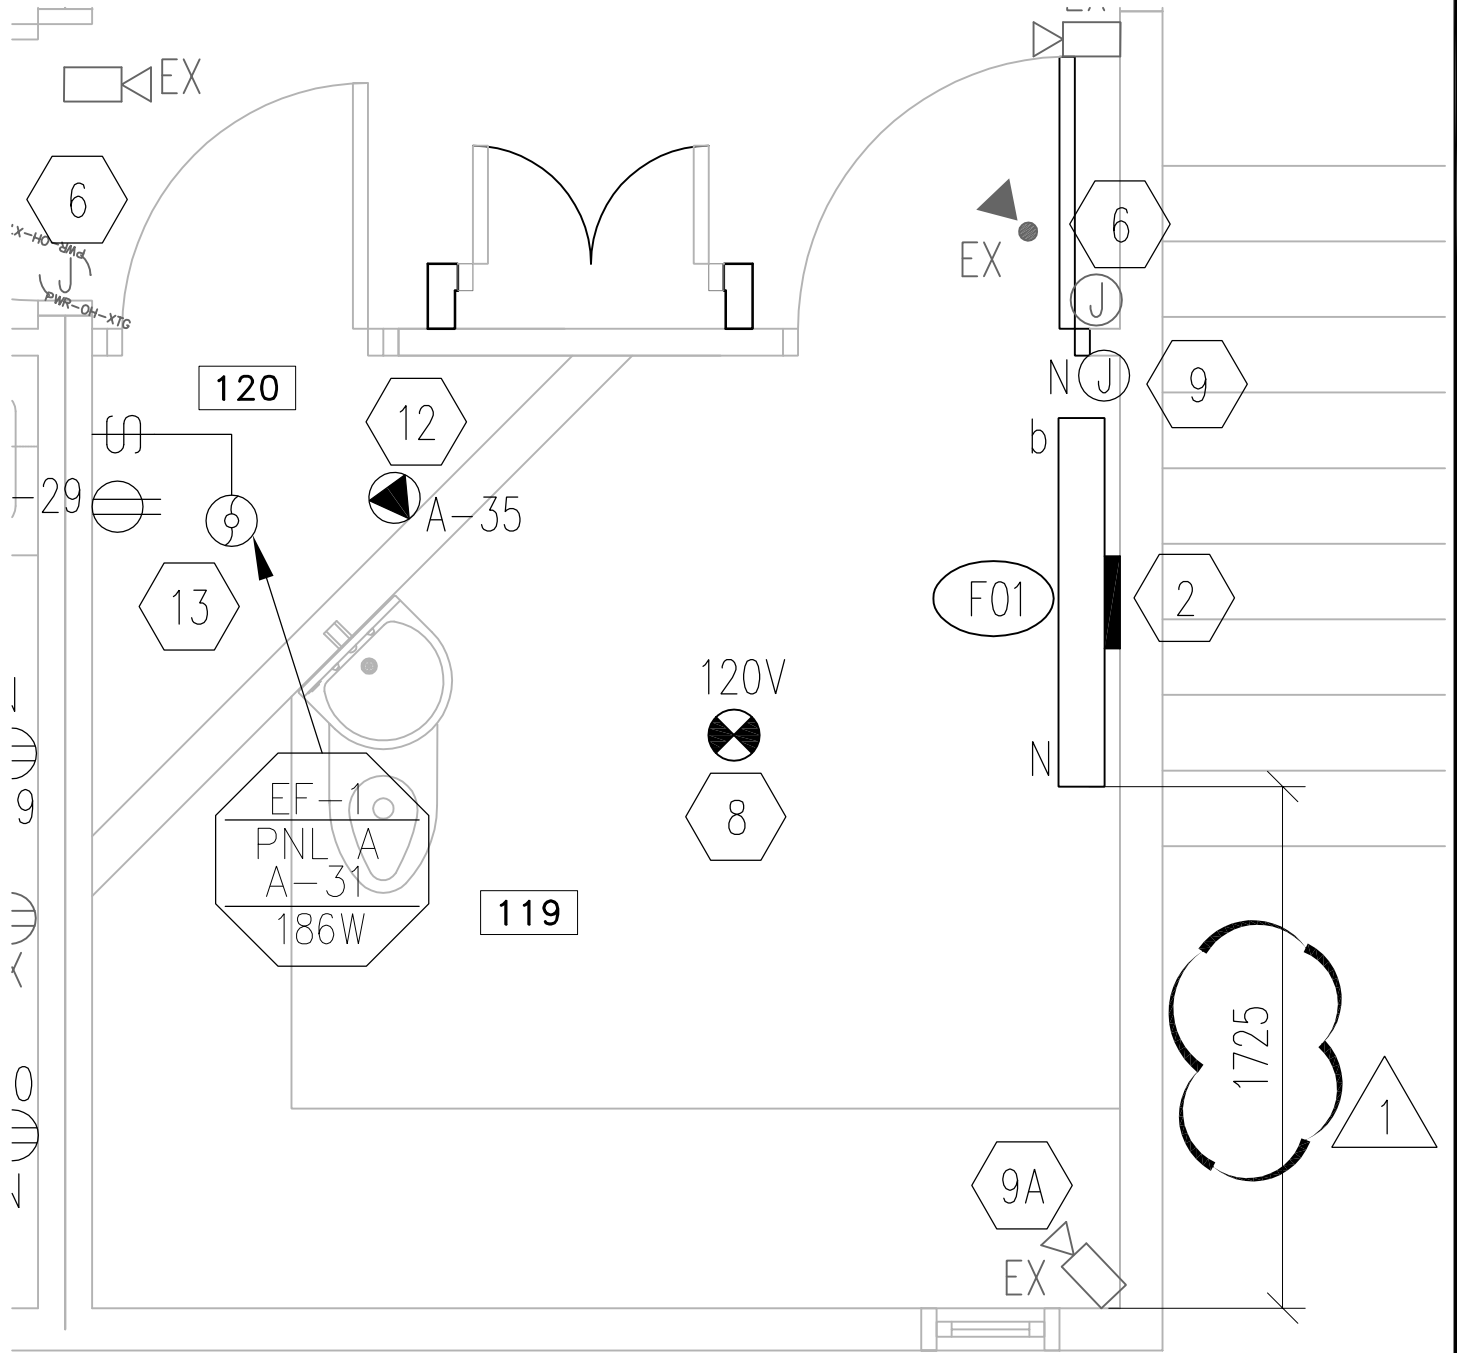

YELLOWKNIFE OFFICE
 P.O. Box 1529
 2nd Floor 4902 49 Street
 Yellowknife, NT X1A 2P2

Bus: (867) 873-2395
 Toll Free: 1-800-263-2393
 Fax: (867) 873-2547

info@williamsengineering.com
 www.williamsengineering.com



JOB. TITLE:
**RENOVATIONS TO
 GOVERNMENT OF CANADA BUILDING
 ULUKHAKTOK, NWT**

DWG. TITLE:
**ADDENDUM E-01
 DRAWING E101
 CELL FIXTURE LOCATION**

DWN. BY: MAC	DES. BY: MAC	PROJ. MGR.: --
PEER REVIEW: JAK	DATE: (YY-MM-DD) 2013.05.30	SCALE: NTS
CLIENT PROJ. # WBSE # R.023085.001	WE PROJ. # 27574.00	OF 2 REV # A
DWG #		ESK-02