


MECHANICAL WORK NOTES

- 1 REPLACE (E) SAD WITH NEW DUCT CONNECTION, SIZE TO MATCH DIFFUSER DIAMETER. REFER TO DWG M-2 FOR NEW LOCATION OF SAD.
- 2 REMOVE (E) SAD AND CAP CONNECTION AT SUPPLY DUCT.
- 3 REPLACE (E) RAD WITH NEW GRILLE, WITH SIZE AS NOTED. PROVIDE (N) PLENUM BOX AS REQUIRED TO RECONNECT DUCTING. PROVIDE DUCTING AS REQUIRED.
- 4 REMOVE (E) RAG AND CAP CONNECTION AT RETURN DUCT.
- 5 REMOVE (E) RAG AND DUCTING UP TO MECHANICAL EQUIPMENT ROOM. REMOVE EXHAUST FAN IN MER AND ELECTRICAL CONNECTIONS FROM SECOND FLOOR AND TO ELECTRICAL PANEL.
- 6 REPLACE (E) RAG AND CONNECT TO EXIST. DUCTING IN CEILING SPACE.
- 7 (E) TSTATS TO REMAIN AND BE REUSED. RELOCATE AS NOTED TO SUIT DEMOLISHED WALLS AND ZONING.
- 8 REMOVE ABANDONED DUCTING AND CAP OPEN-ENDED SUPPLY DUCTING IN CEILING SPACE.
- 8 REMOVE EXISTING SINK AND CAP PLUMBING FOR FUTURE CONNECTION. REMOVE HOSE AND FAUCET AND PLUMBING.
- 9 REMOVE EXISTING SINK AND CAP PLUMBING FOR FUTURE CONNECTION. REMOVE HOSE AND FAUCET AND PLUMBING.
- 10 REMOVE EXISTING GLASS DRAINAGE PIPING ABANDONED IN CEILING SPACE.
- 11 (E) CLEANOUTS ARE ABANDONED. TO BE COVERED BY FLOOR TILES BY ARCHITECTURAL.

LEGEND (MECHANICAL)

- (E) EXISTING EQUIPMENT  
(N) NEW EQUIPMENT  
C/E CONNECT TO EXISTING  
(E) EXISTING THERMOSTAT  
(N) NEW THERMOSTAT AND TUBING  
(E) EXISTING THERMOSTAT TO BE REMOVED  
(E) THERMOSTAT TO BE RELOCATED C/W TUBING  
(E) EXISTING EQUIPMENT TO BE REMOVED  
SAD SUPPLY AIR DIFFUSER  
RAD RETURN AIR DIFFUSER  
EAD EXHAUST AIR GRILLE  
CEILING 600x600 SAD, OR 300x300 AS NOTED C/W GDB  
600x300 GRILLE C/W INSULATED PLENUM FOR DUCT CONNECTION  
(A/B/C) A - TYPE OF DIFFUSER  
B - SAD NECK SIZE OR GRILLE SIZE  
C - AIRFLOW

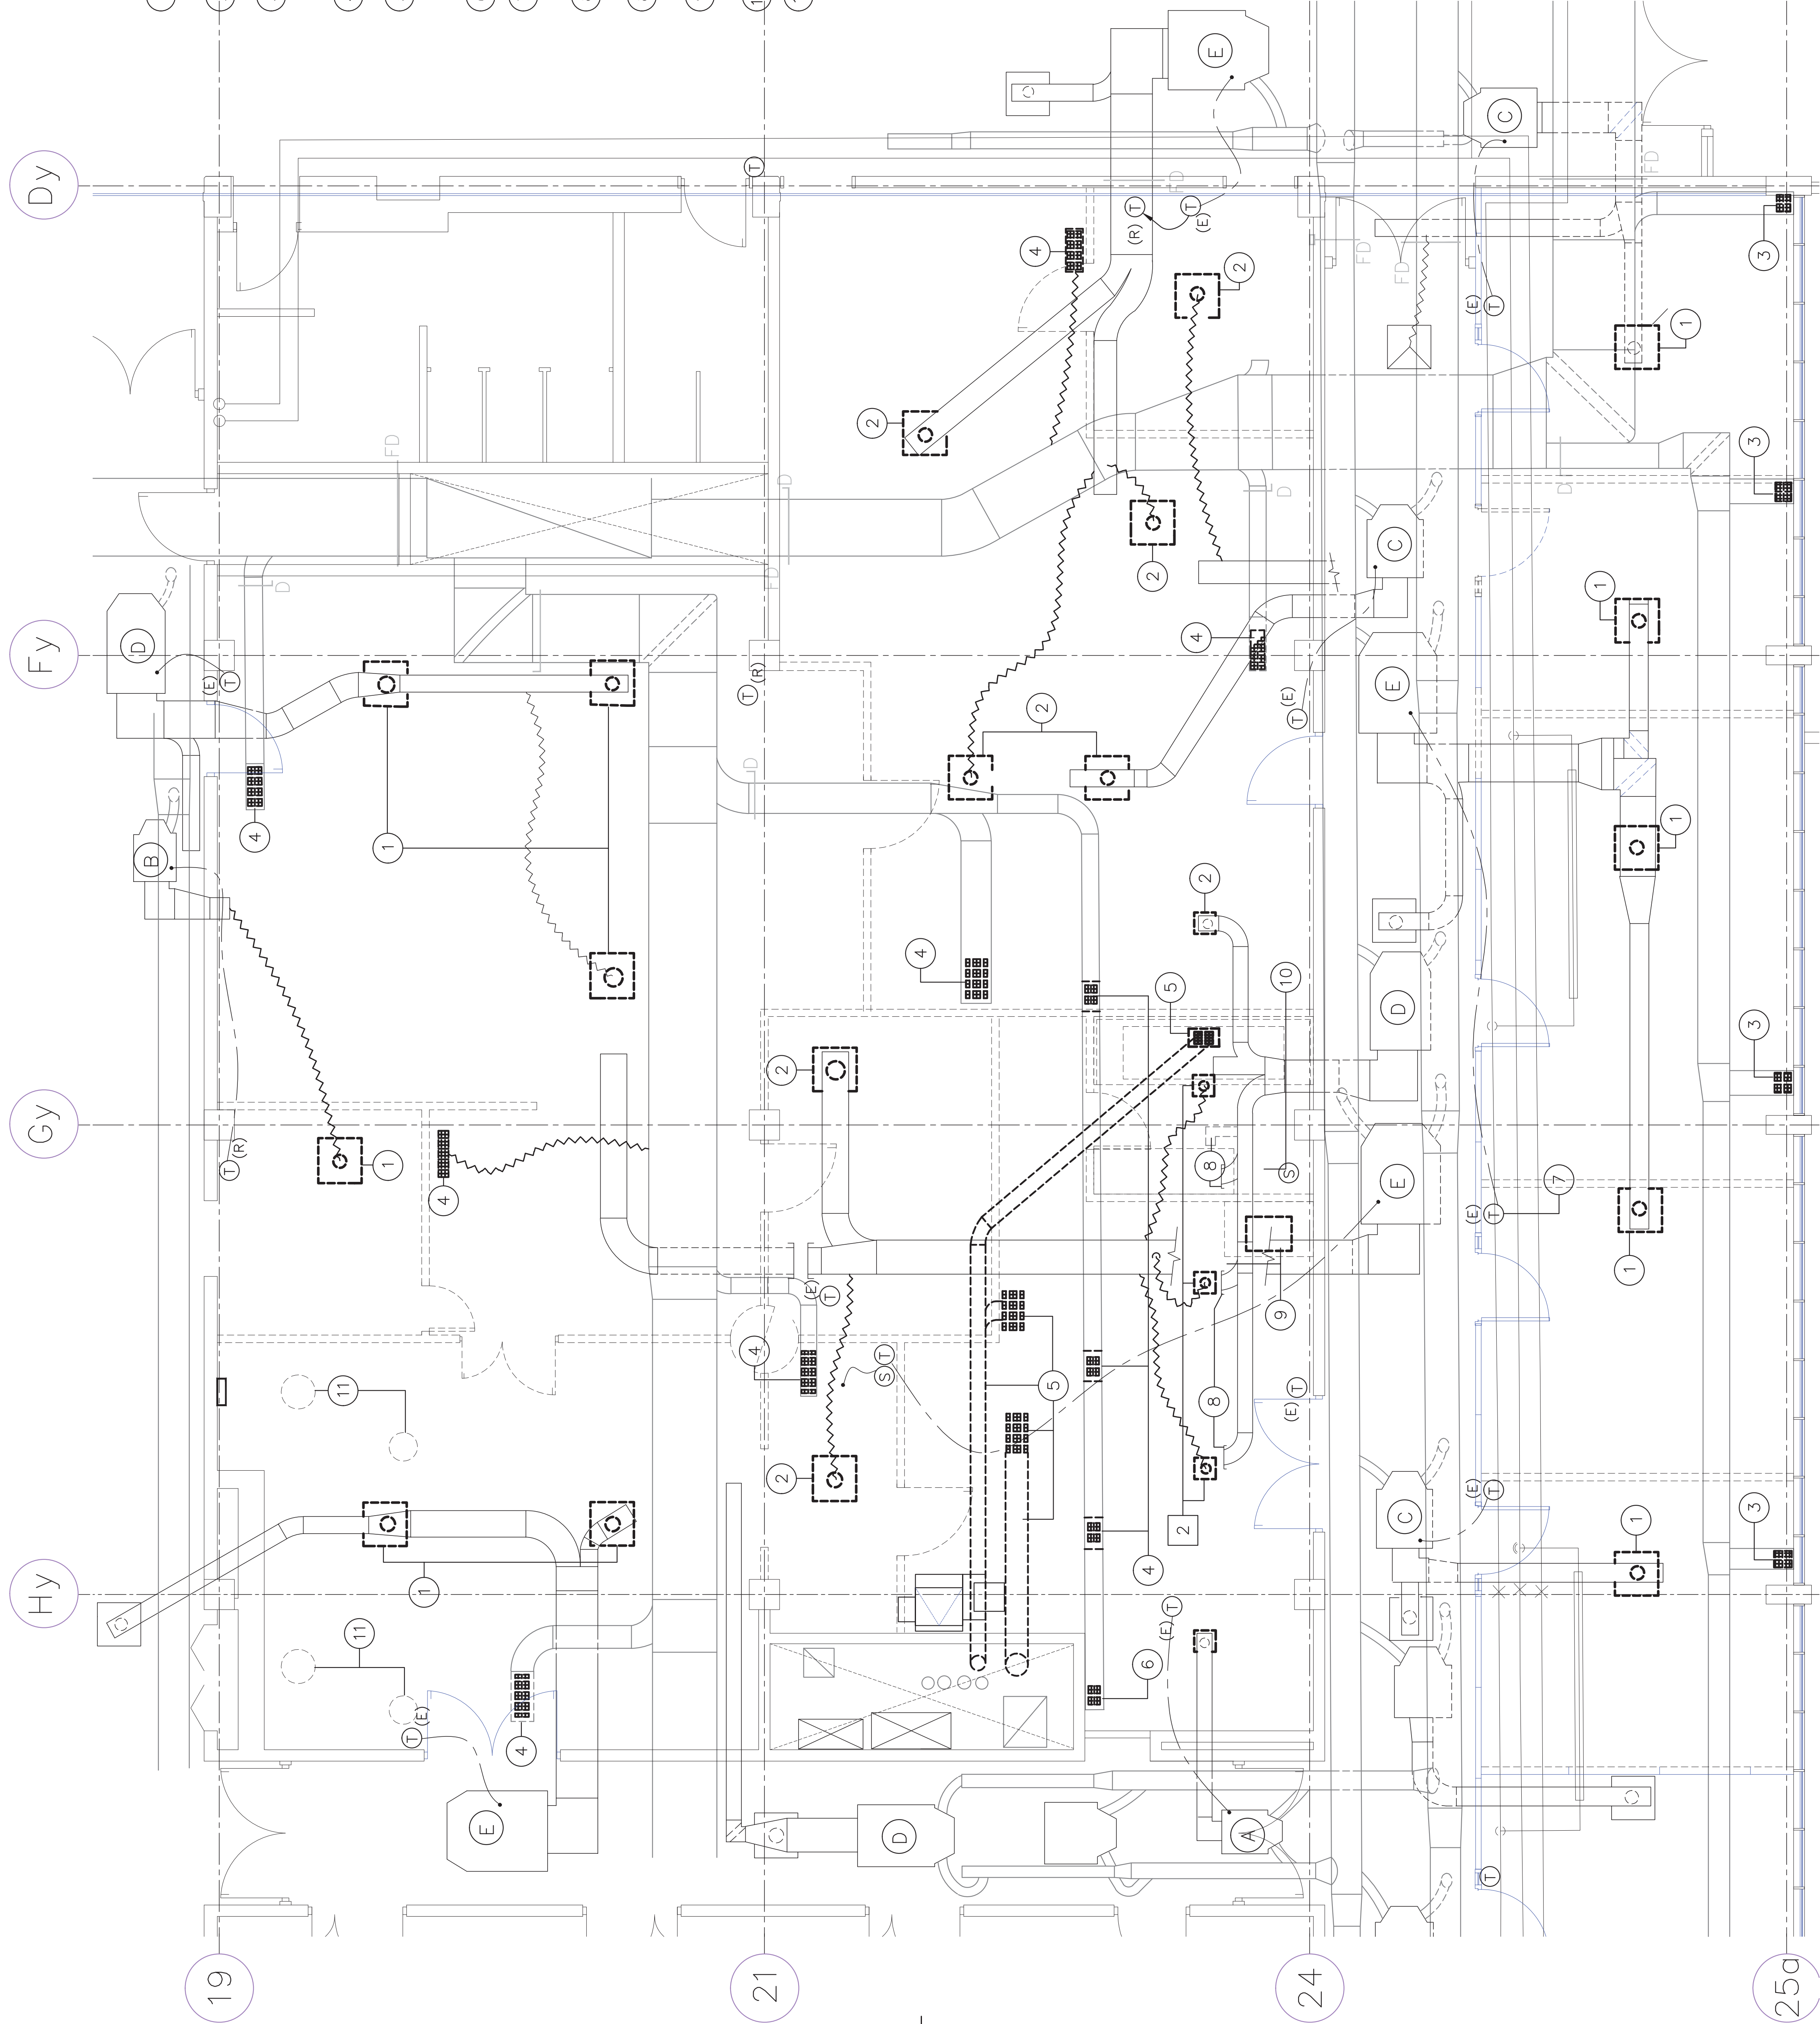

revision	date
04	
03	2013-07-08
02	2013-06-28
01	2013-05-31

Do not scale drawings.  
Verify all dimensions and conditions on site and immediately  
notify the Departmental Representative of all discrepancies.

revision	date
04	
03	2013-07-08
02	2013-06-28
01	2013-05-31

Do not scale drawings.  
Verify all dimensions and conditions on site and immediately  
notify the Departmental Representative of all discrepancies.

revision	date
04	
03	2013-07-08
02	2013-06-28
01	2013-05-31

Do not scale drawings.  
Verify all dimensions and conditions on site and immediately  
notify the Departmental Representative of all discrepancies.

revision	date
04	
03	2013-07-08
02	2013-06-28
01	2013-05-31

Do not scale drawings.  
Verify all dimensions and conditions on site and immediately  
notify the Departmental Representative of all discrepancies.

revision	date
04	
03	2013-07-08
02	2013-06-28
01	2013-05-31

Do not scale drawings.  
Verify all dimensions and conditions on site and immediately  
notify the Departmental Representative of all discrepancies.