


BASEMENT ELEVATOR PITS 1 & 2
DEMOLITION WORK


1
E3
1:100

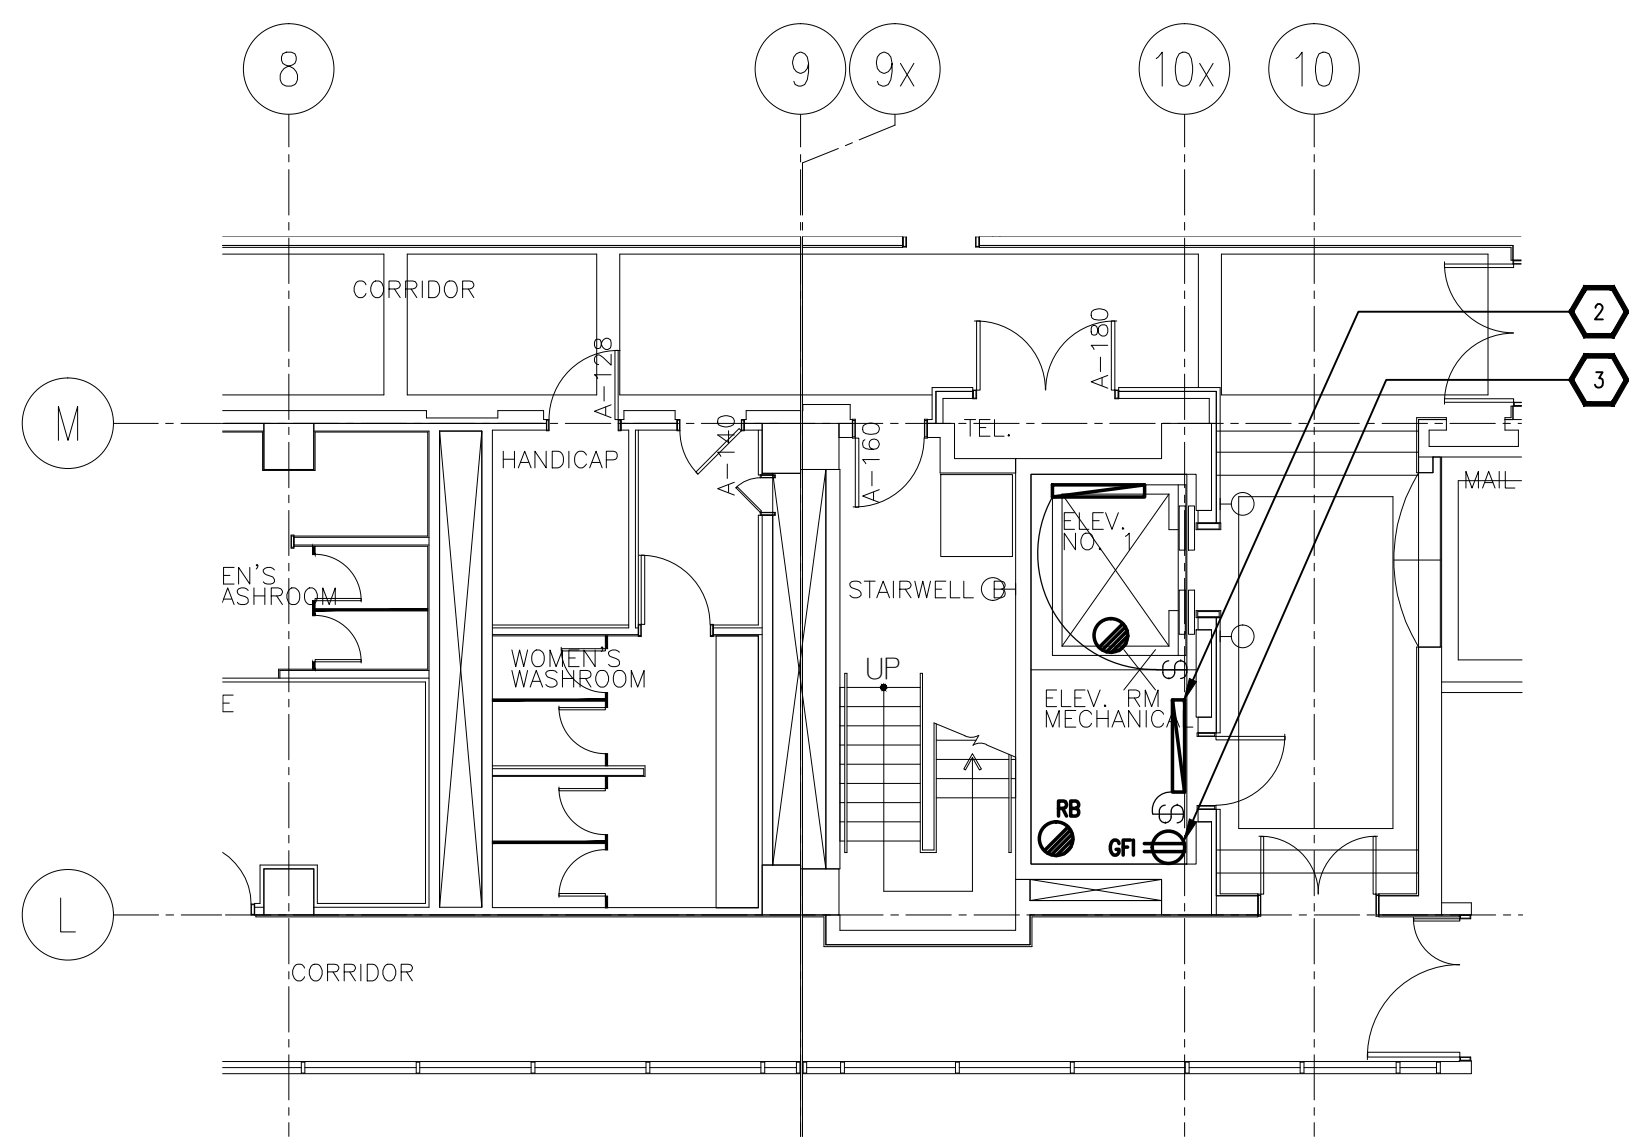

BASEMENT ELEVATOR PITS 1 & 2
NEW WORK


2
E3
1:100

DRAWING NOTES	
1	TYPICAL: DISCONNECT AND REMOVE EXISTING INCANDESCENT LIGHT FIXTURES AND RETAIN CIRCUIT AND WIRING FOR NEW LAYOUT.
2	TYPICAL: PROVIDE 2x32W-T8 STRIP LIGHT FIXTURE C/W WIRE GUARD.
3	TYPICAL: DISCONNECT AND REMOVE EXISTING DUPLEX RECEPTACLES AND RETAIN CIRCUIT FOR NEW GFI RECEPTACLES.
4	TYPICAL: PROVIDE NEW F/A SMOKE DETECTORS AND SURFACE MOUNT TO SIDE WALL.

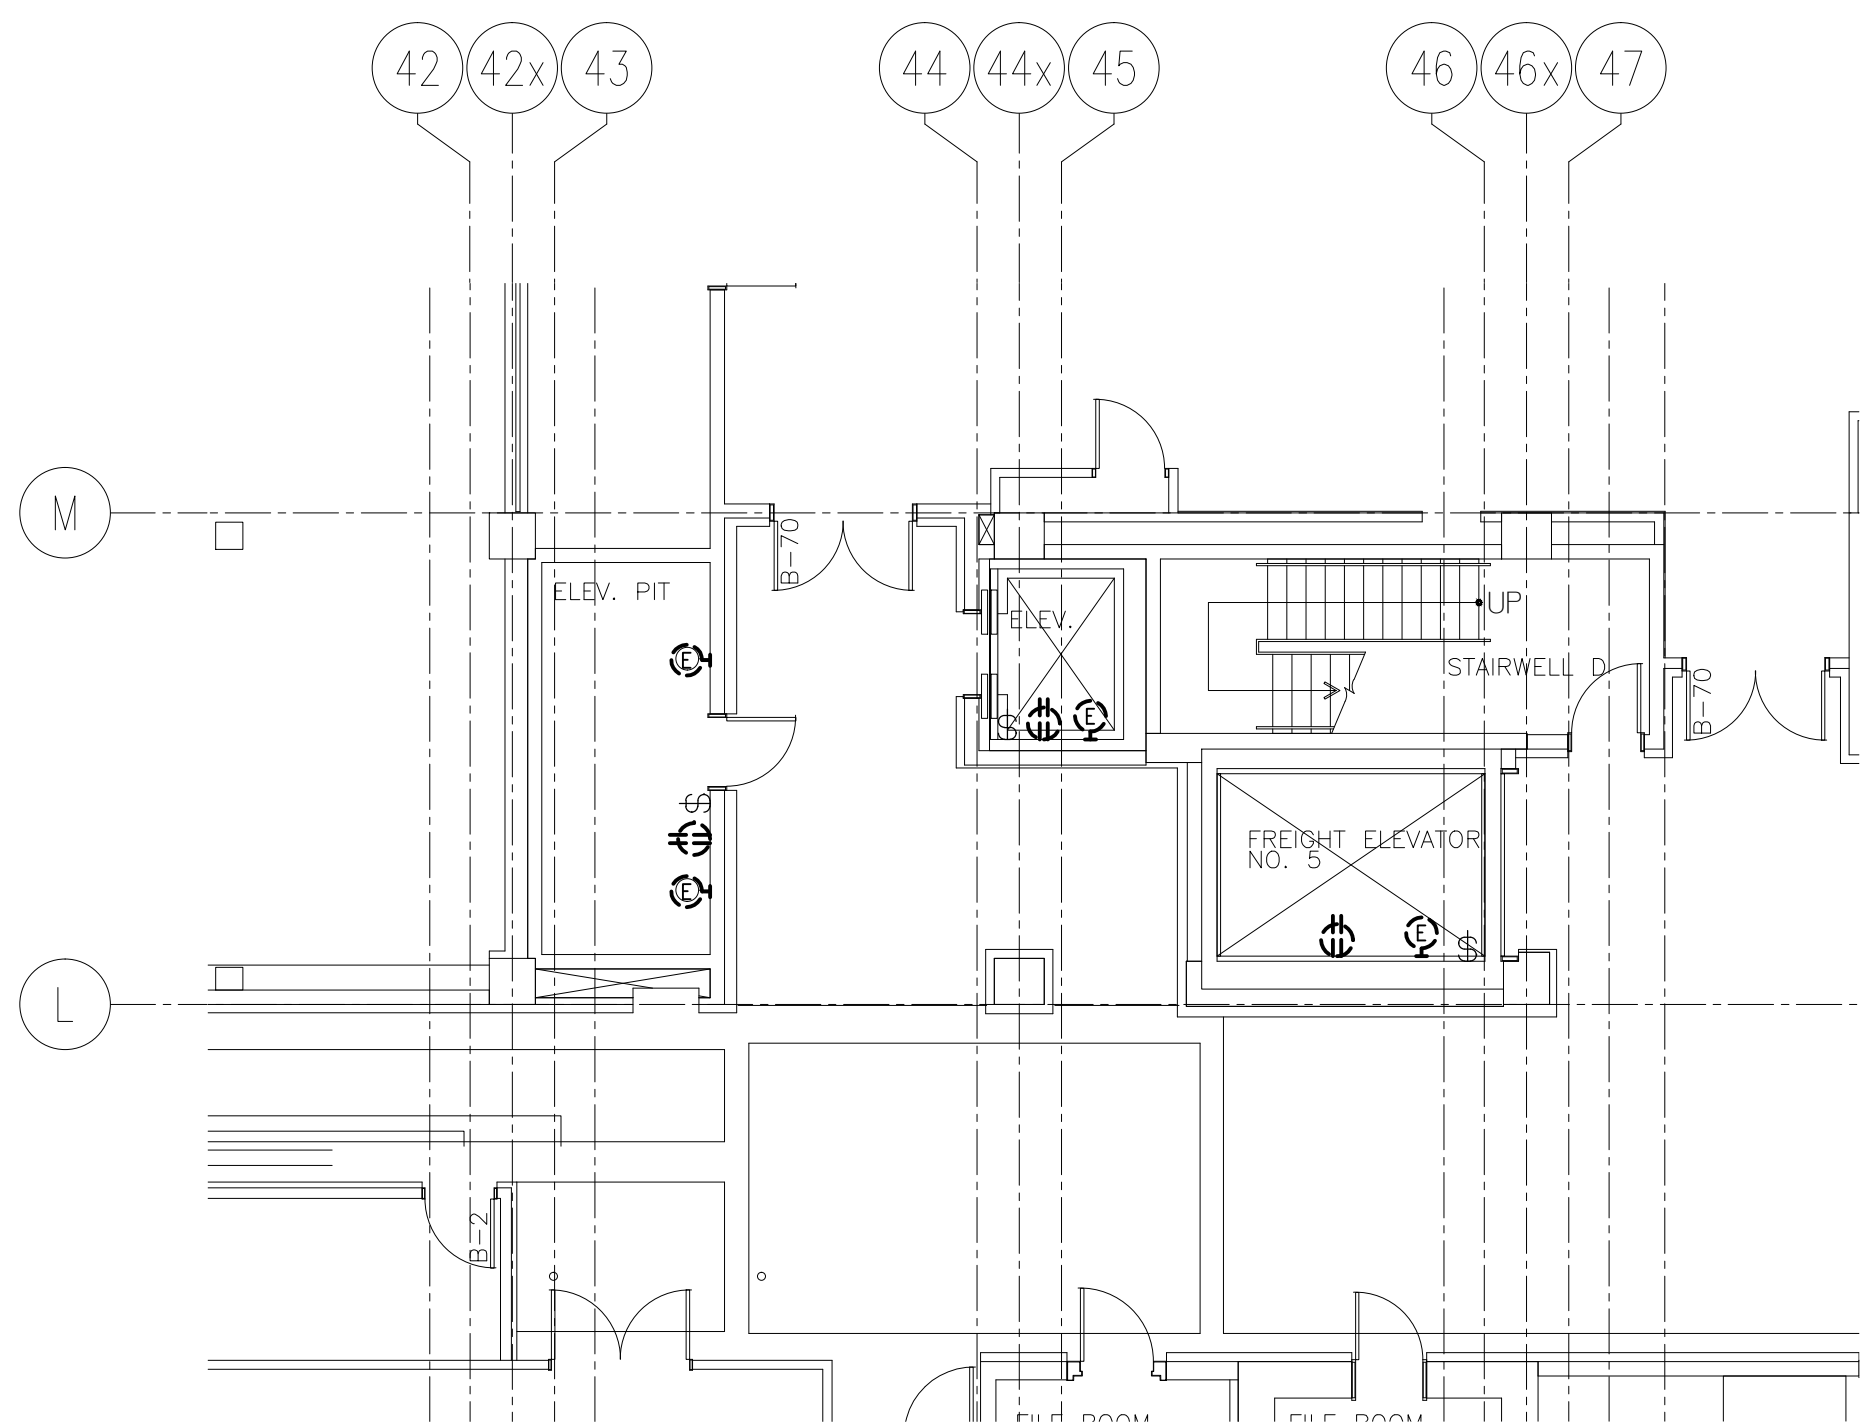

BASEMENT ELEVATOR PITS 3, 4, 5 & 6
DEMOLITION WORK

3
E3
1:100

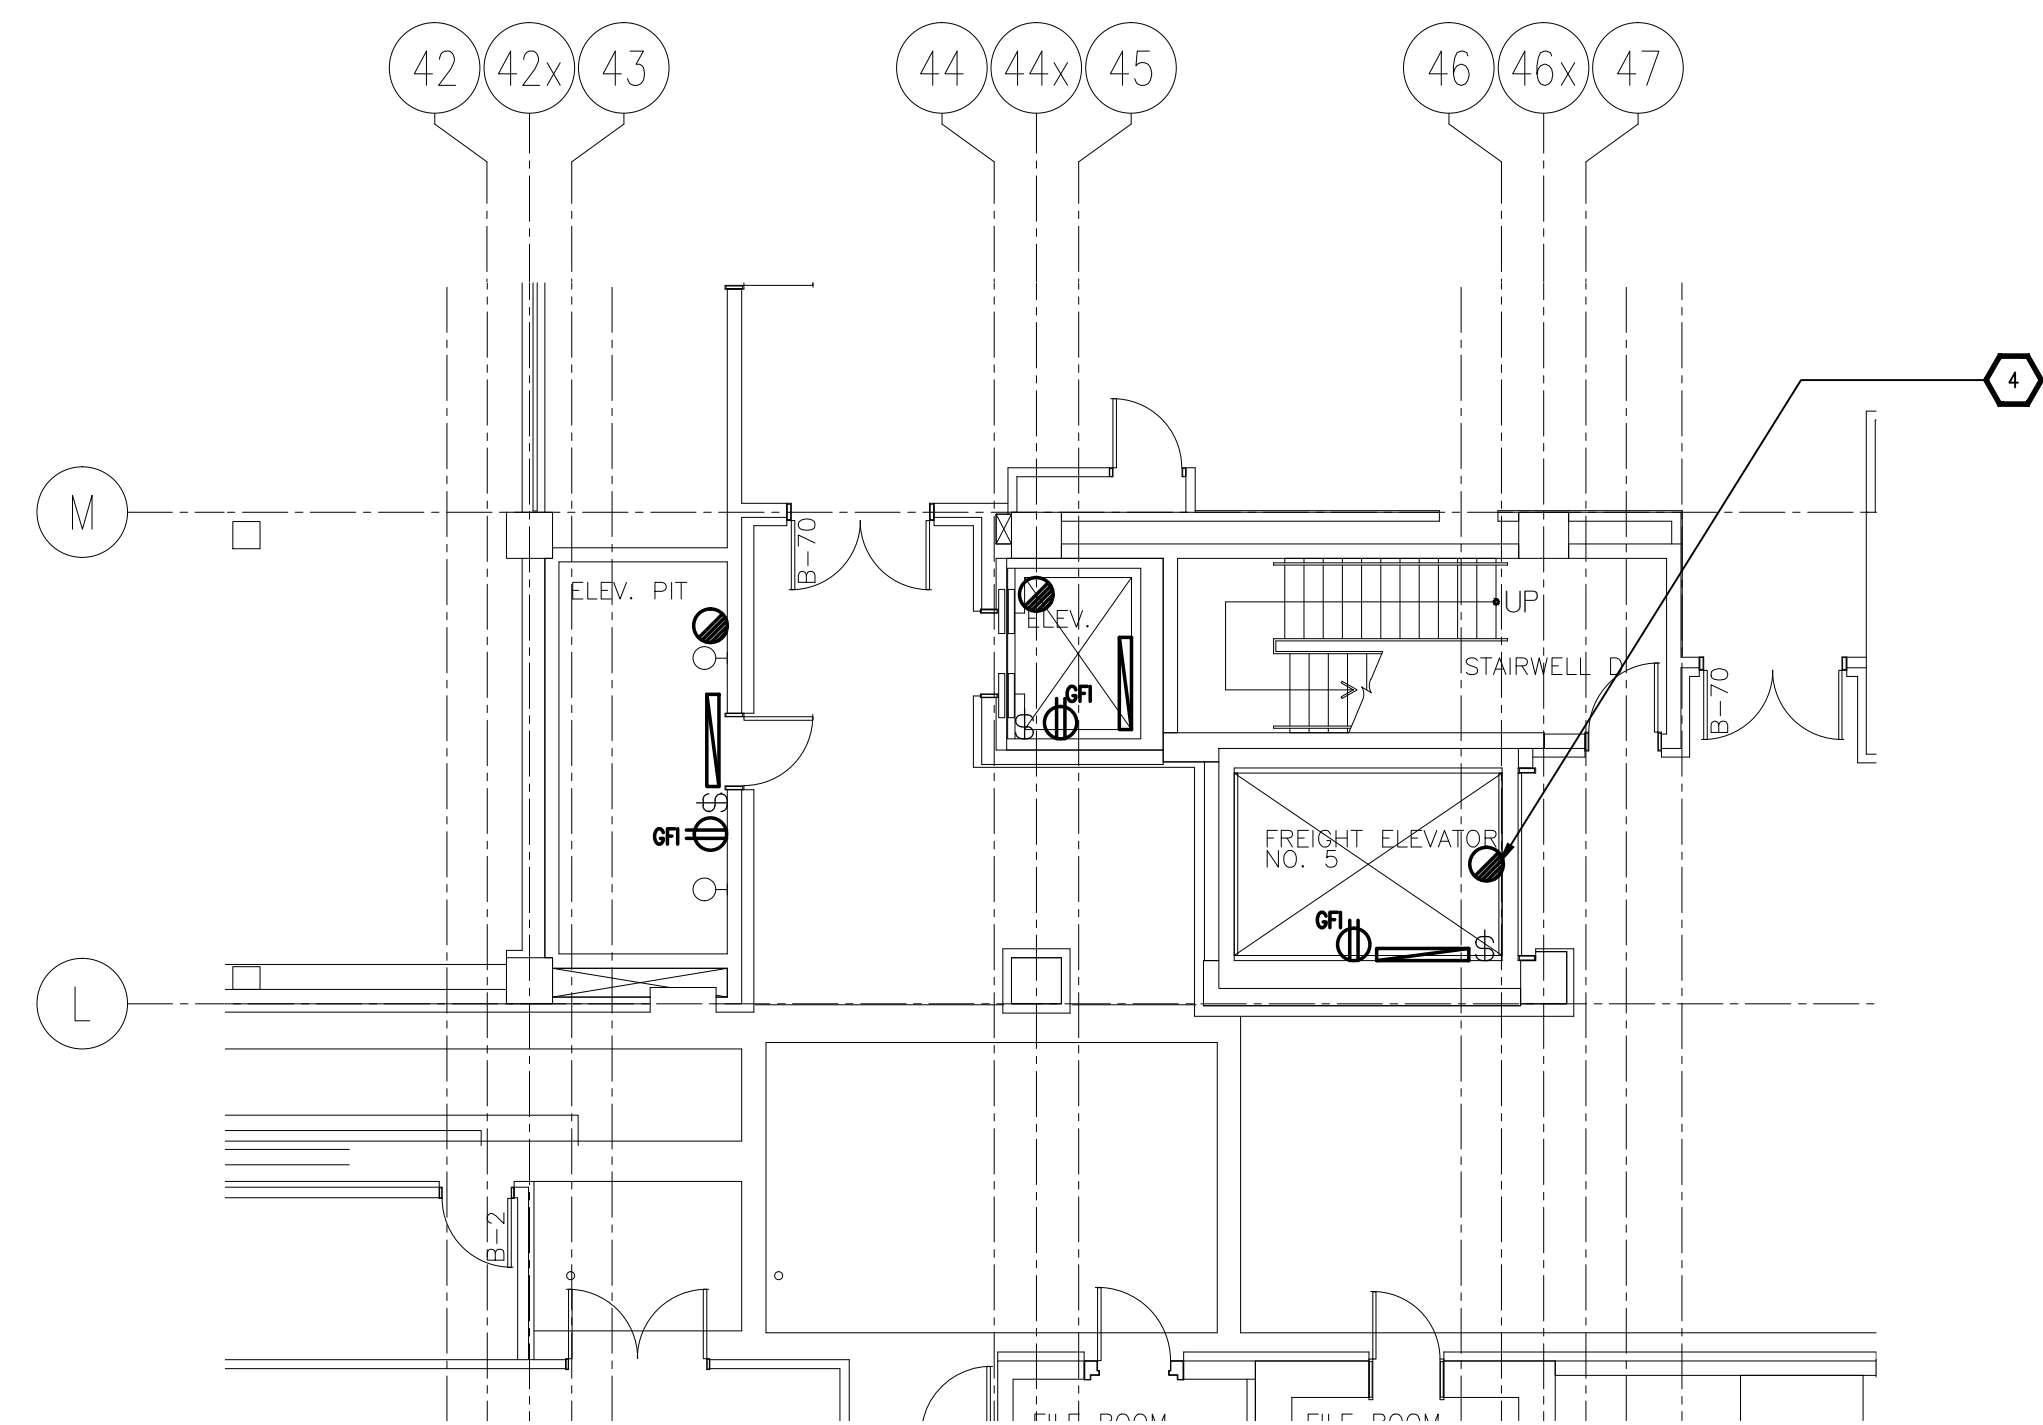

BASEMENT ELEVATOR PITS 3, 4, 5 & 6
NEW WORK

4
E3
1:100