
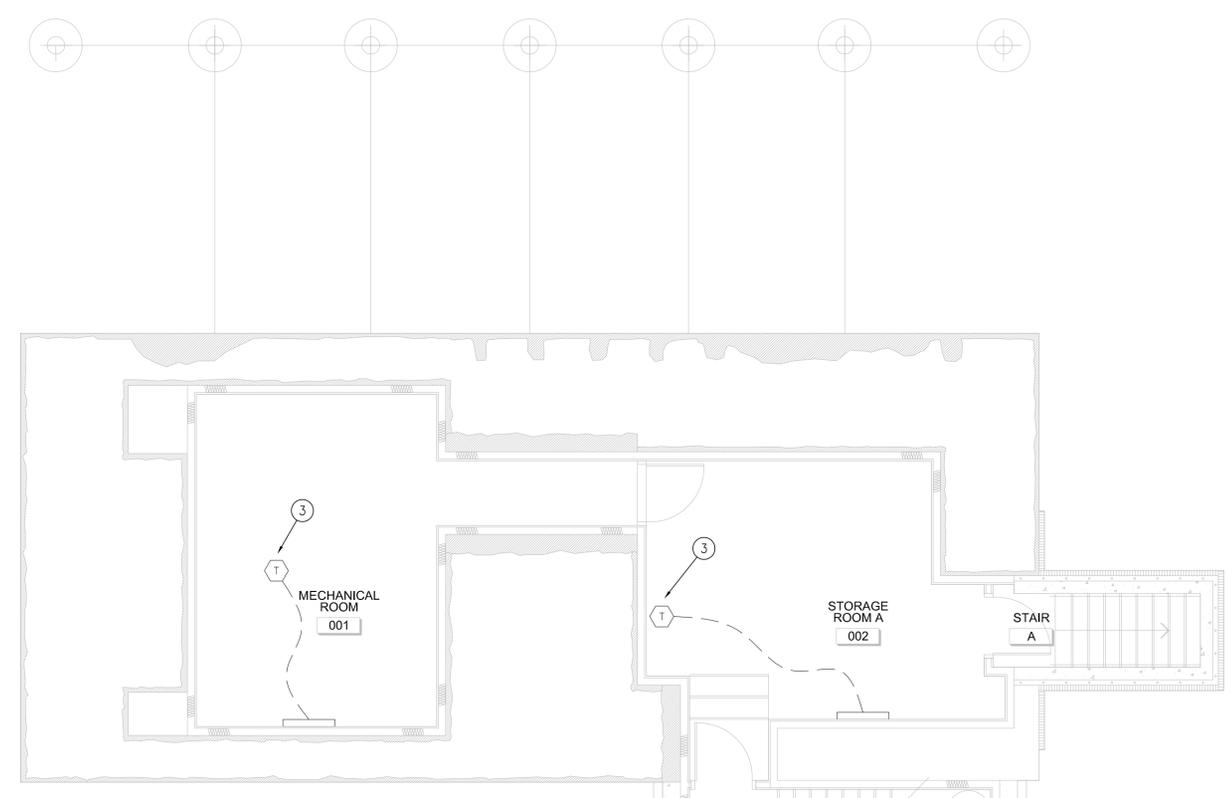


no.	description	date
01	ISSUED FOR TENDER	2013/08/30
00	ISSUED FOR TENDER	2013/06/11
0B	ISSUED FOR 99% REVIEW	2013/04/18
0A	ISSUED FOR REVIEW	2013/03/28

THERMOSTAT SCHEDULE						
TAG	MANUFACTURER	MODEL	VOLTAGE	AMPS	FREQUENCY	COMMENTS
			V	A	HZ	
T-1	STELPRO	STE402NPW	120	16.7	60	1

COMMENTS:  
1. COLOUR: WHITE.

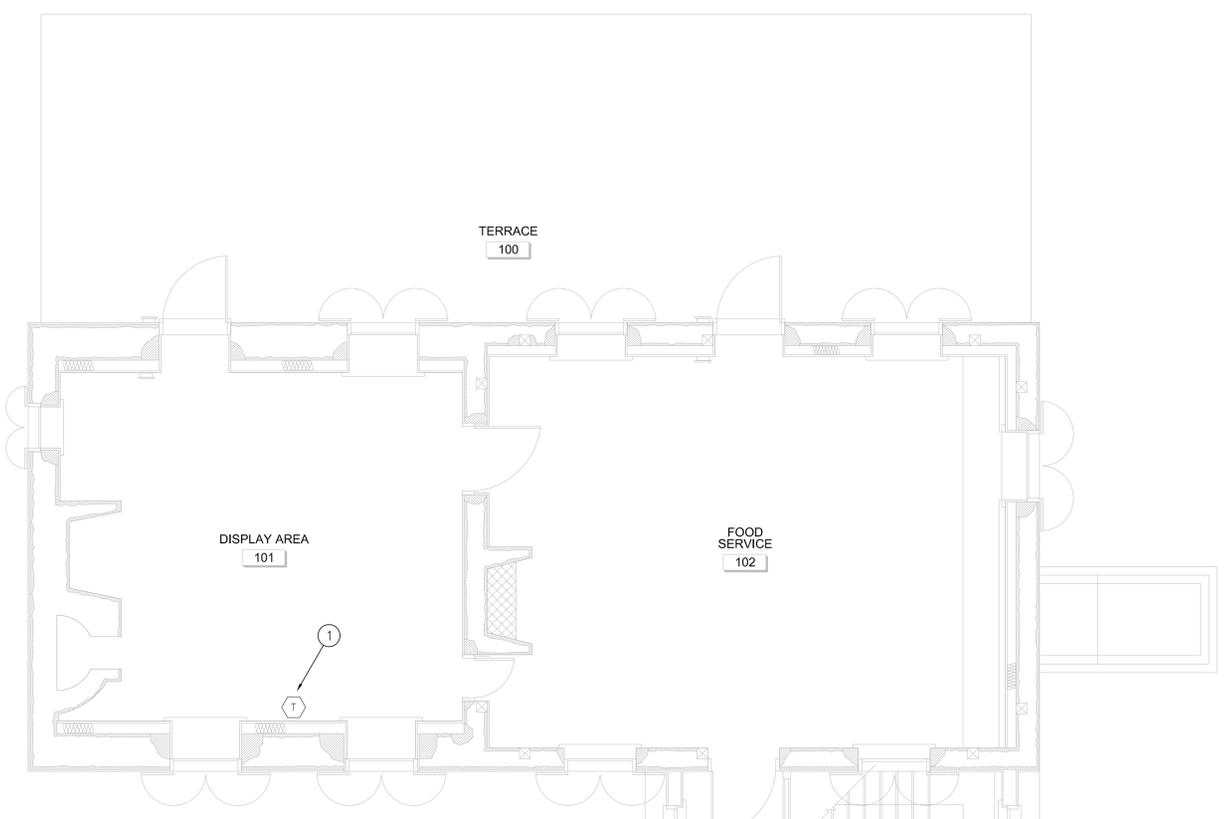


**GENERAL NOTES**

- ALL EXISTING DEVICES AND EQUIPMENT MAY NOT BE SHOWN.

**DRAWING NOTES**

- EXISTING THERMOSTAT FOR BASEMENT AIR HANDLER AHU-1.
- NEW THERMOSTAT TO BE CONNECTED TO EXISTING CABINET UNIT HEATER "STELPRO" #CBB9072. PROVIDE AND INSTALL CONTROL WIRING FROM THERMOSTAT TO CABINET UNIT HEATER.
- EXISTING THERMOSTAT TO REMAIN.
- EXISTING CABINET UNIT HEATER INTEGRATED THERMOSTAT TO BE REMOVED. CONTROL WIRING TO BE INTERCEPTED AND CONNECTED WITH NEW THERMOSTAT.
- THERMOSTAT CONTROL WIRING TO BE ROUTED WITHIN WALL. ROUTE WIRING FROM THERMOSTAT THROUGH ATTIC SPACE AND WITHIN WALL BEHIND CABINET UNIT HEATER. WIRING TO PENETRATE WALL THROUGH TILE INTO ROOM BEHIND CABINET UNIT HEATER INSTALLATION.
- CABINET UNIT HEATER TO BE DISCONNECTED AND REMOVED FROM WALL DURING CONTROL WIRING INSTALLATION. CABINET UNIT HEATER TO BE REINSTALLED AFTER COMPLETION OF CONTROL WIRING INSTALLATION. DISCONNECT AND RECONNECT TO BE COMPLETED BY DIVISION 26. REFER TO ELECTRICAL DRAWINGS.
- NEW THERMOSTAT INSTALLED ON WALL.
- EXISTING CABINET UNIT HEATER.
- TILE ON WALL.
- CONTROL WIRING INSTALLED BEHIND WALL AND IN ATTIC SPACE.
- WASHROOM.

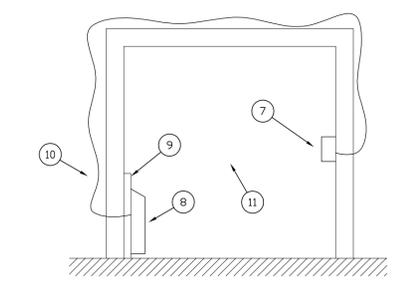

**3 CONTROL WIRING INSTALLATION DETAIL**  
M004 SCALE: NTS

**CONTROLS LEGEND**

- ELECTRICAL THERMOSTAT
- ELECTRIC CONTROL WIRING
- CABINET UNIT HEATER
- NEW EQUIPMENT
- EXISTING EQUIPMENT

**1 MAIN FLOOR PLAN: CONTROLS**  
M004 SCALE: 1:50

**2 BASEMENT FLOOR PLAN: CONTROLS**  
M004 SCALE: 1:50