

NEW 150mm CAST-IN-PLACE CONCRETE CAP TO FILL GAP BETWEEN EXISTING STAIR, LANDING, AND NEW CB WALL (2 HOUR F.R.R. FIRE SEPARATION), PAINTED BOTH SIDES, DOWELED INTO WALL AND SLAB. REFER TO STRUCTURAL.

EXISTING CAST-IN-PLACE CONCRETE LANDING (2 HOUR F.R.R. FIRE SEPARATION)

2 HOUR F.R.R. FIRE SEPARATION - FIRE STOP AT ALL PENETRATIONS TO FIRE SEPARATIONS.

ELECTRICAL CABLE TRAY THROUGH 90-MIN F.R.R. FRAME, C/W FIRE STOP. REFER TO ELECTRICAL.

SAWCUT NEW OPENING IN EXISTING WALL. PROVIDE NEW 2mm (14 GAUGE) HOLLOW METAL DOOR & FRAME WITH 90-MIN F.R.R., CONTINUOUS WELDED CONSTRUCTION, INTEGRAL STOPS, TWO HEAVY-DUTY HINGES, AND CLOSER. PAINT TO MATCH WALL.

PROVIDE PRE-FINISHED METAL FLASHING OVER SAWCUT CONCRETE AROUND PERIMETER OF DOOR OPENING.


EXISTING CONCRETE BLOCK WALL

EXISTING CAST CONCRETE WALL

NEW 150mm CONCRETE BLOCK WALL (2 HOUR F.R.R. FIRE SEPARATION), PAINTED BOTH SIDES, WITH BULLNOSE CORNER.


4 ELECTRICAL CHASE SECTION

A-1 SCALE: 1:10 0 .4m .8m

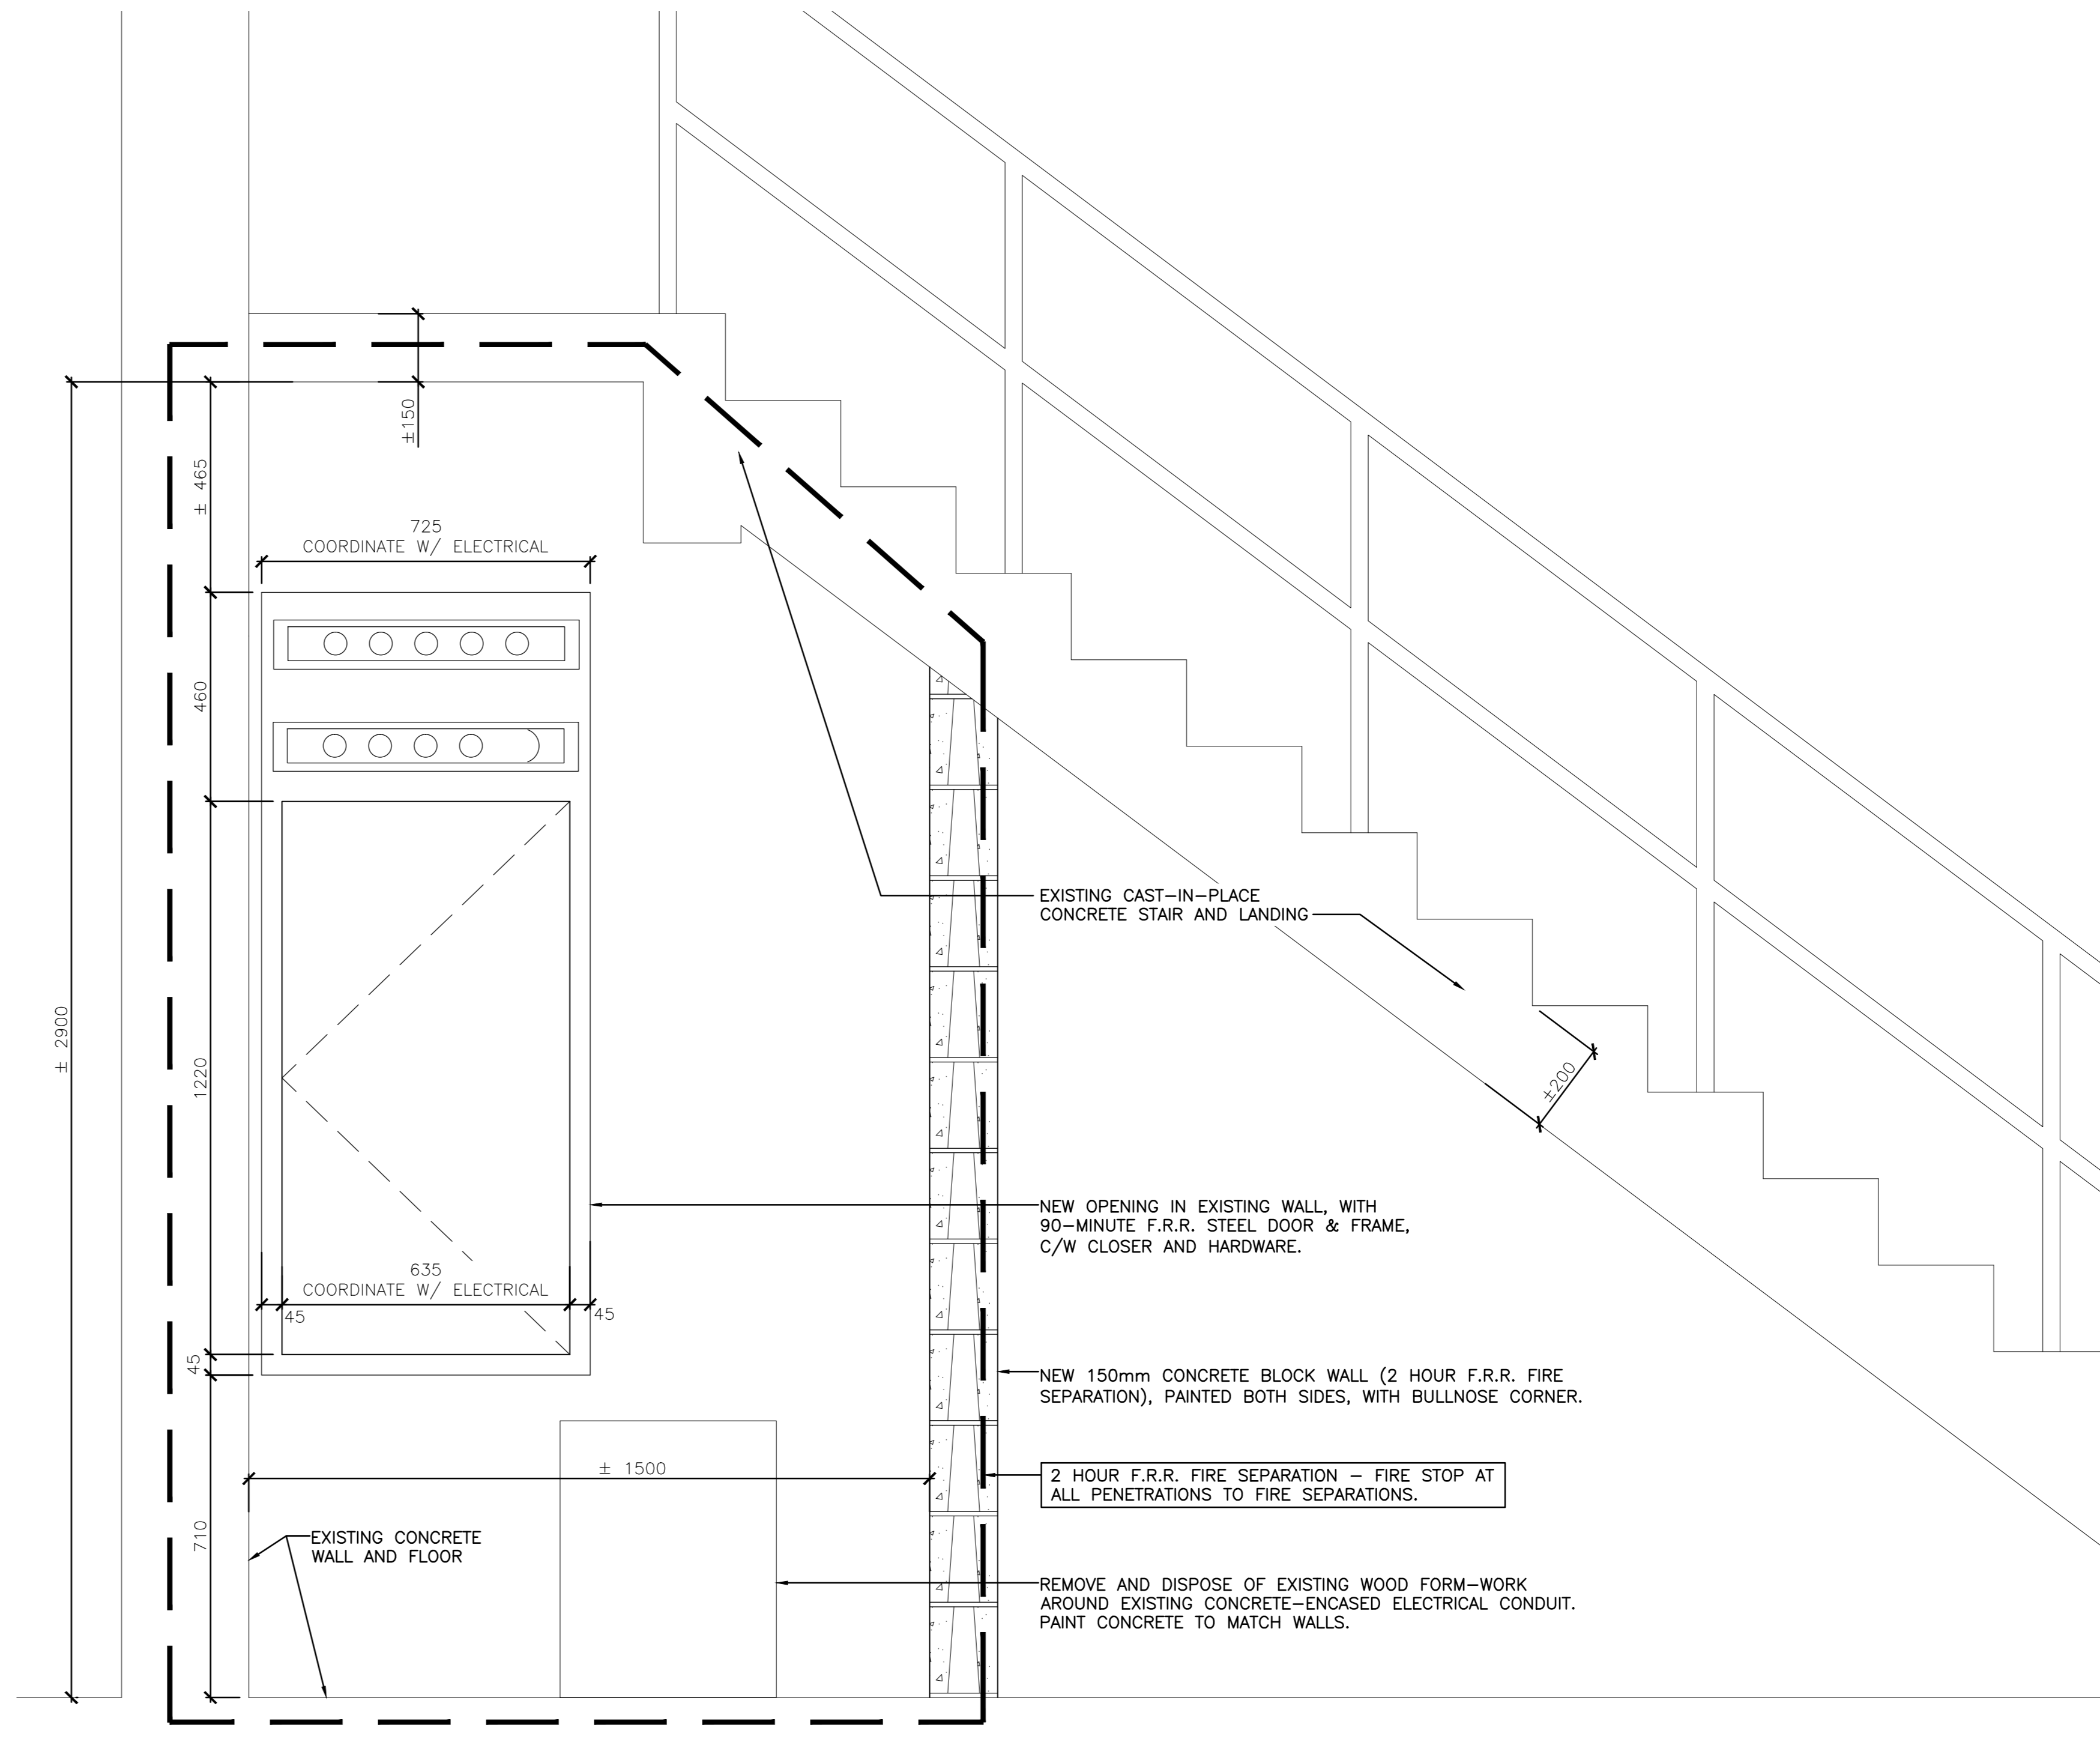


3 ELECTRICAL CHASE SECTION

A-1 SCALE: 1:10 0 .4m .8m

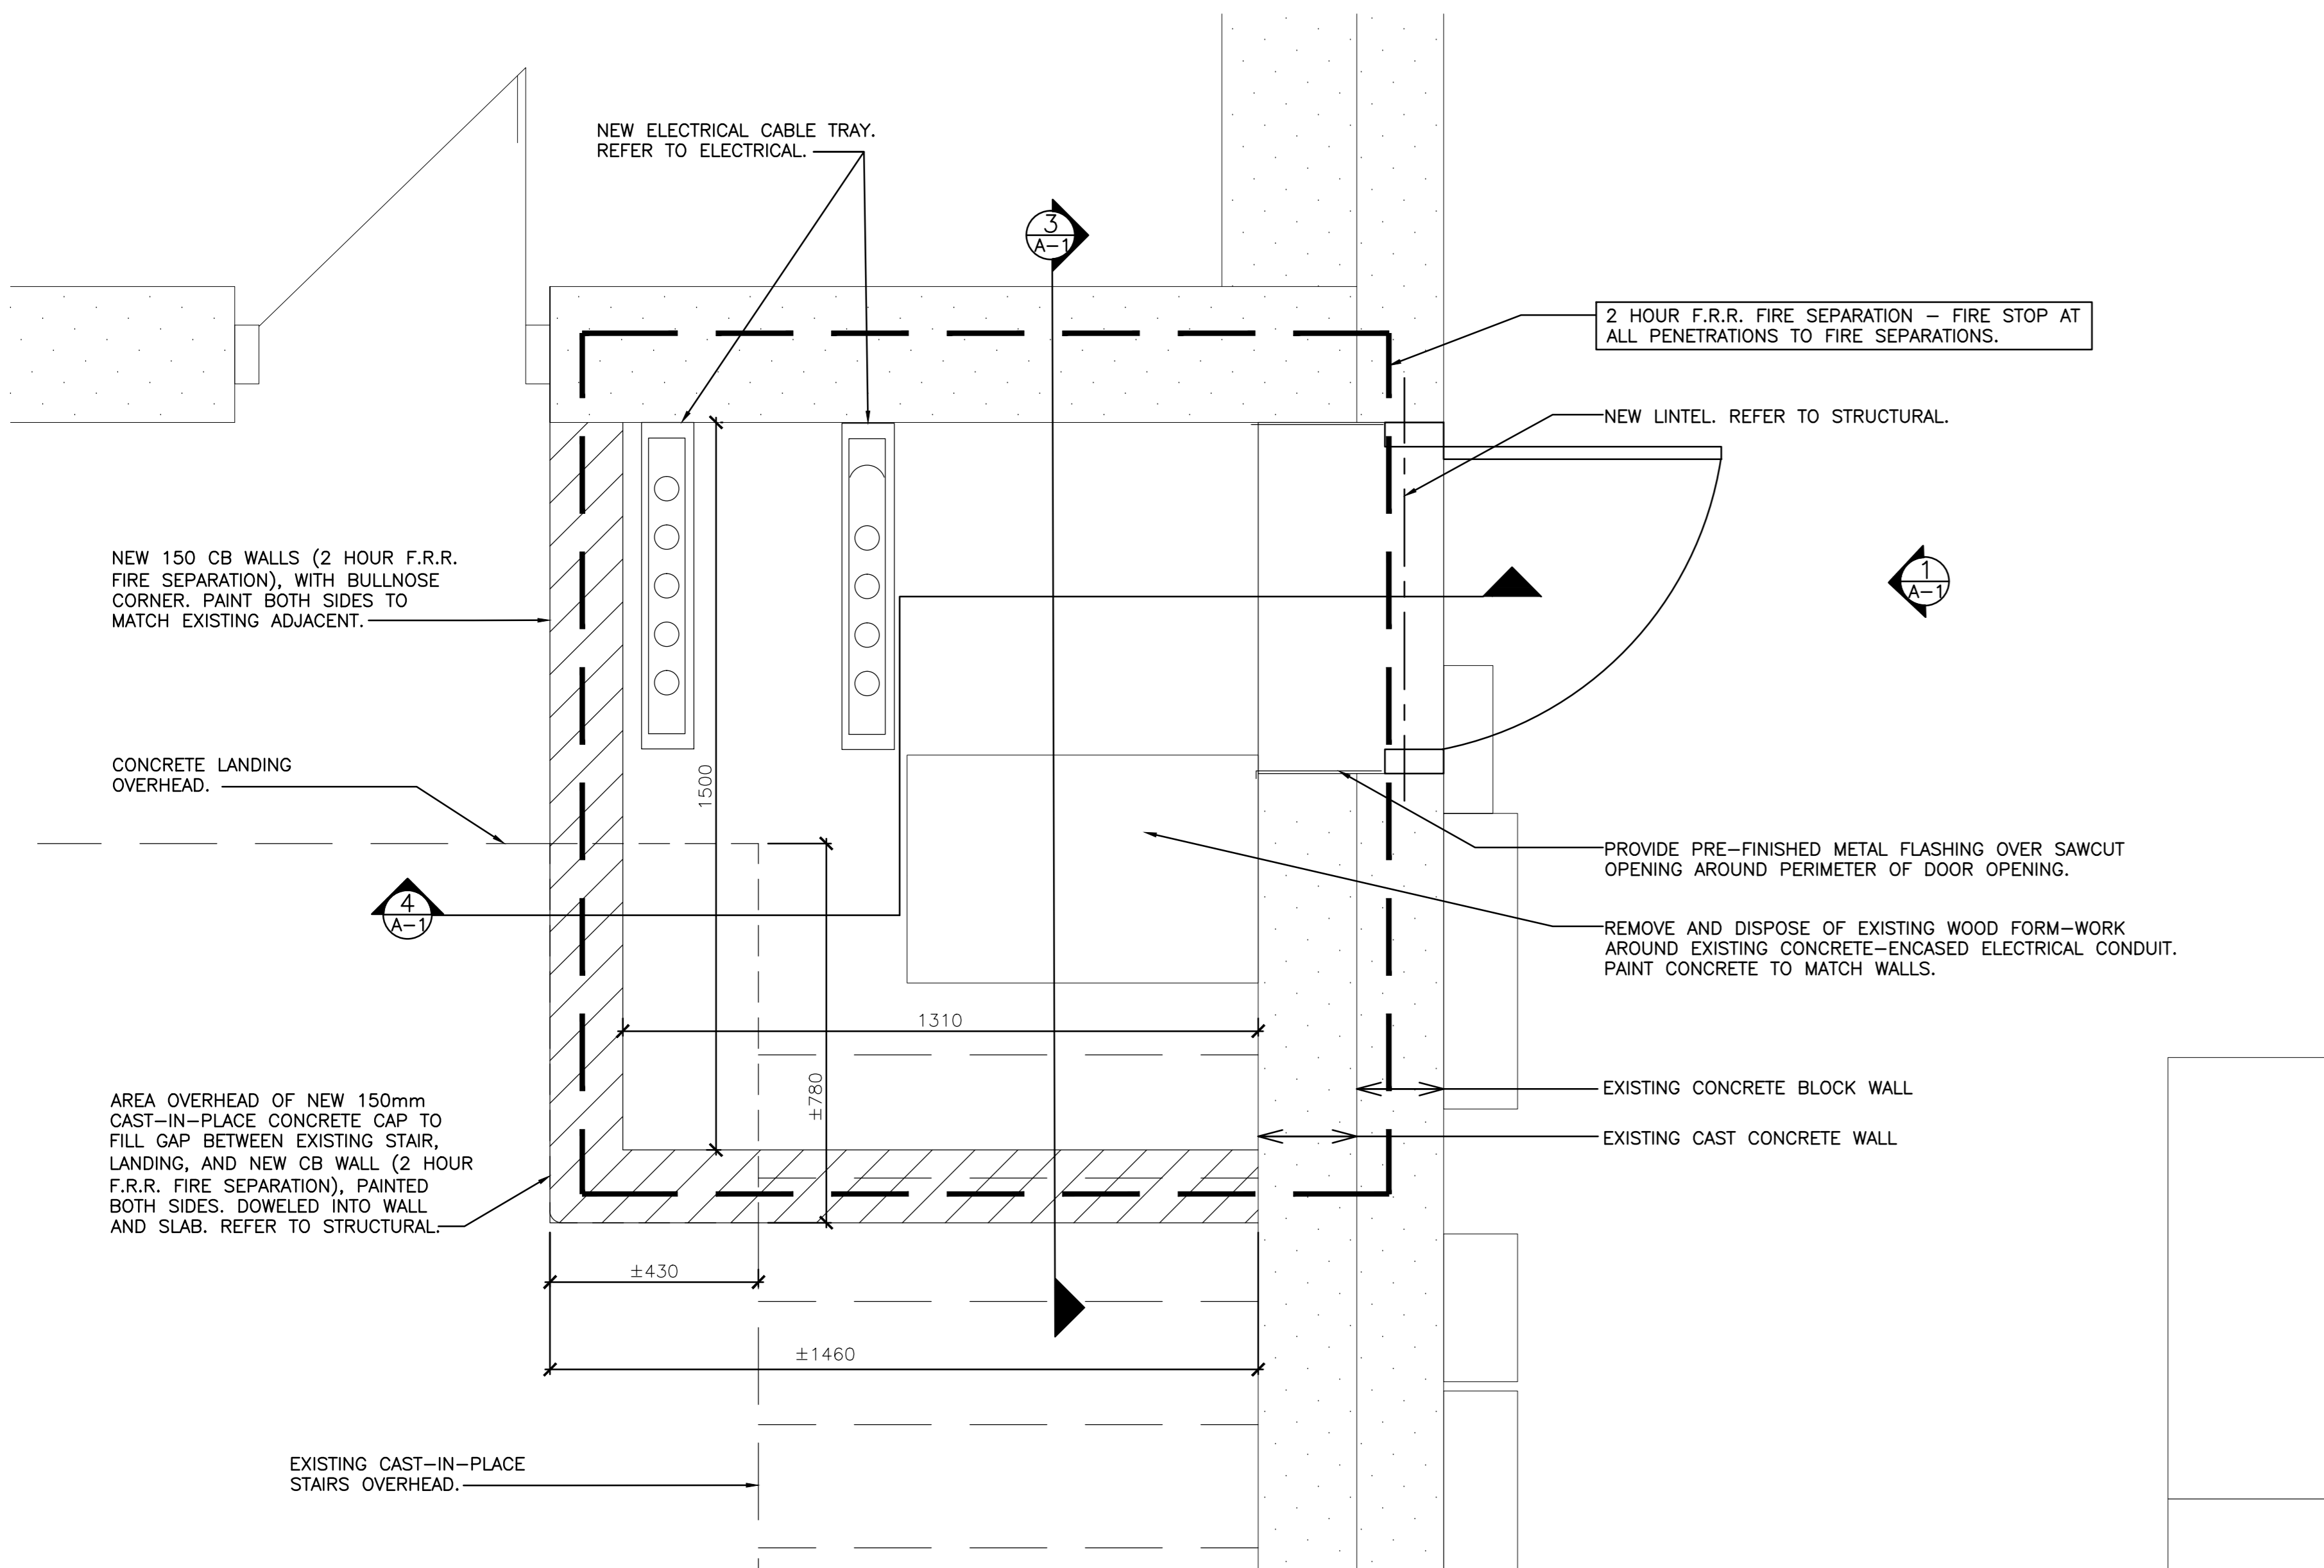


2 ELECTRICAL CHASE PLAN

A-1 SCALE: 1:10 0 .4m .8m

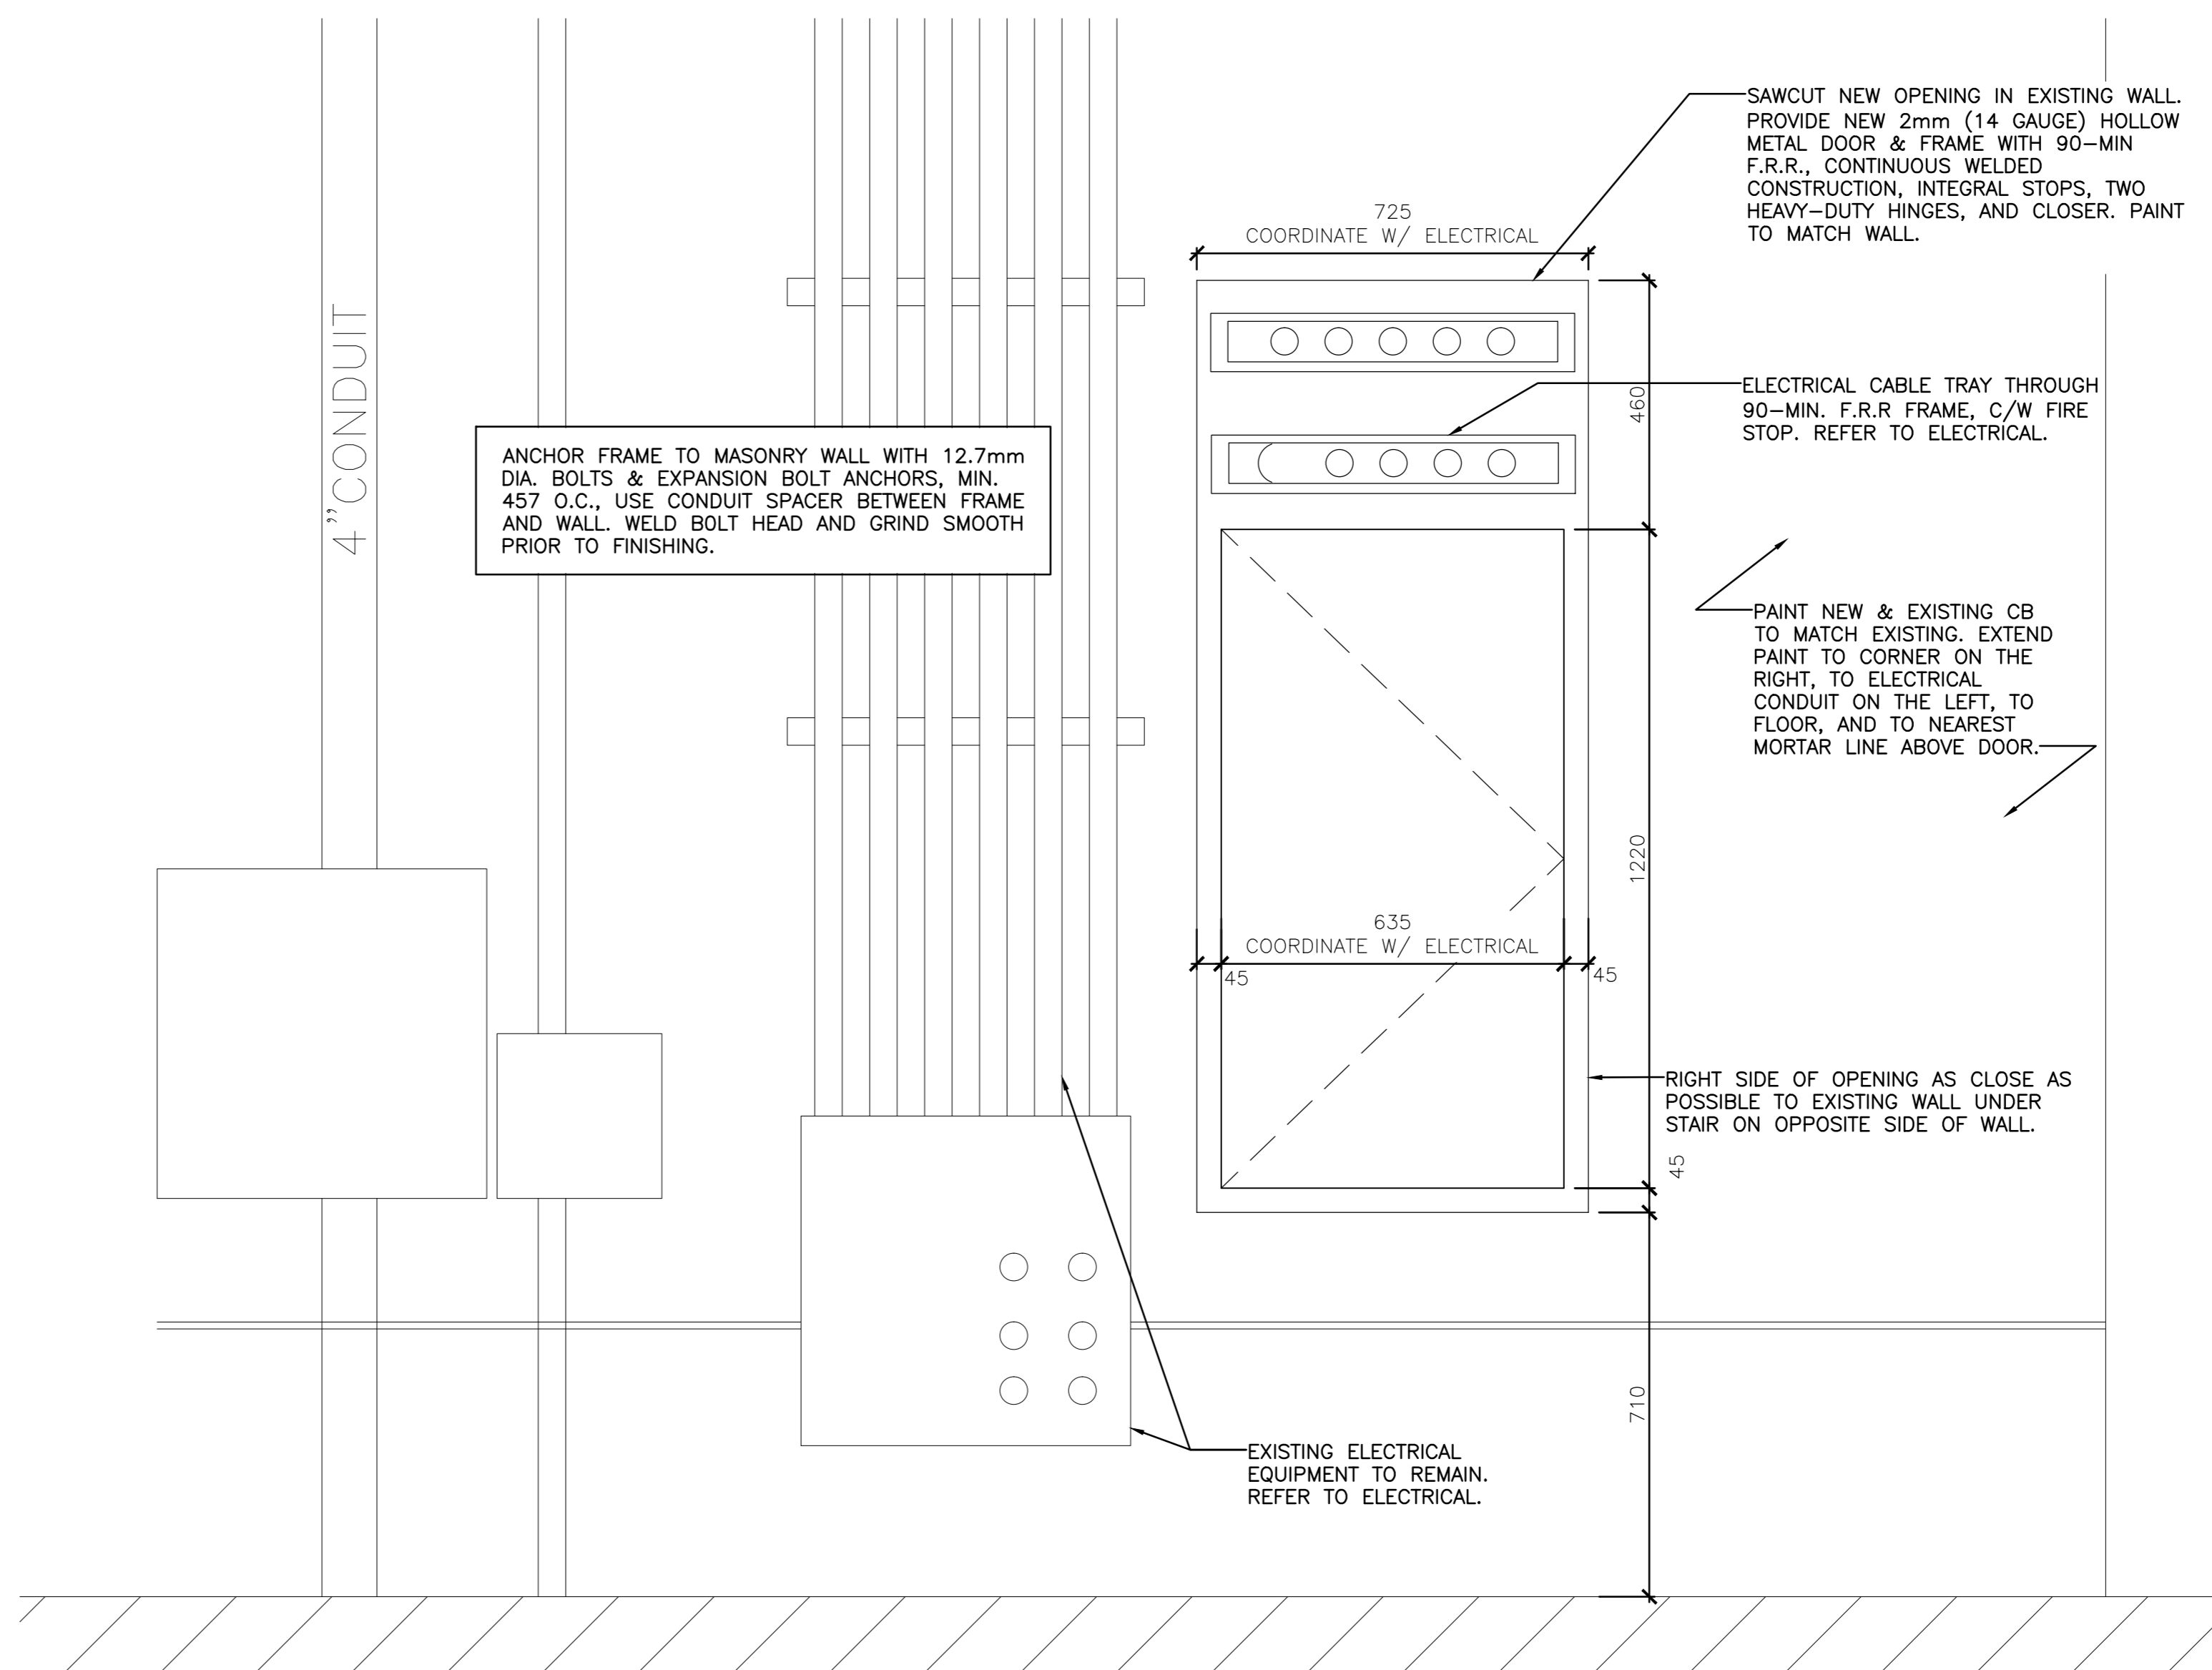

1 DOOR ELEVATION

A-1 SCALE: 1:10 0 .4m .8m

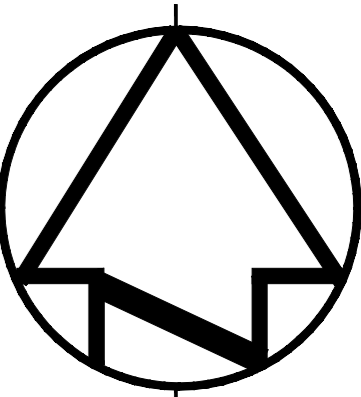

04		
03		
02		
01	ISSUED FOR BID	2013-08-15
revision		date

Do not scale drawings. Verify all dimensions and conditions on site and immediately notify the Departmental Representative of all discrepancies.

A	Detail No.
B	drawing no. - where detail required
C	drawing no. - where detail exists

project title
titre du projet
BATH MILLHAVEN INSTITUTION
HWY. 33, BATH, ON
KOH 1G0
ELECTRICAL DISTRIBUTION SYSTEM UPGRADE

drawing title
titre du dessin
**ARCHITECTURAL DETAILS
NEW ELECTRICAL CHASE**

drawn by
dessiné par
T. KERR

designed by
conc par
R. HORNE-MCQUAY

approved by
approuvé par
R. HORNE-MCQUAY

bid
offre
K. HAQUE

project date
date du projet
2013-05-27

project no.
no. du projet
R.053529.001

drawing no.
dessiné no.
A-1