




1 SUPPORT HANGER PIPE ATTACHMENTS  
M2 NOT TO SCALE

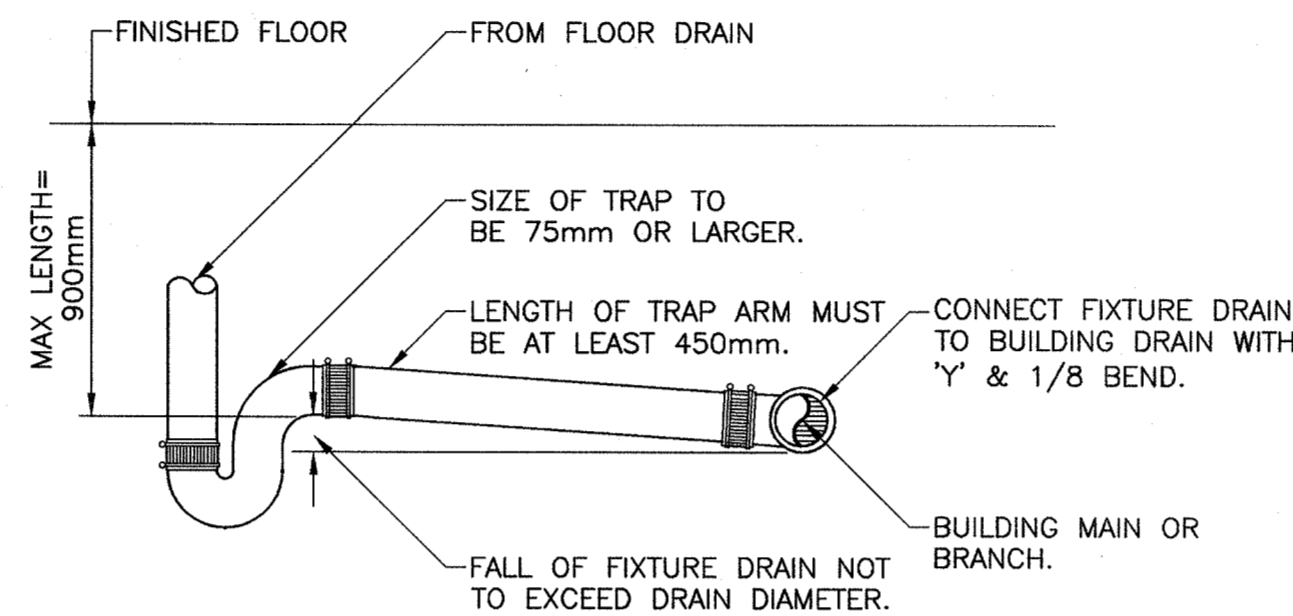

2 TRAPPED FLOOR DRAIN WITHOUT VENT  
M2 NOT TO SCALE

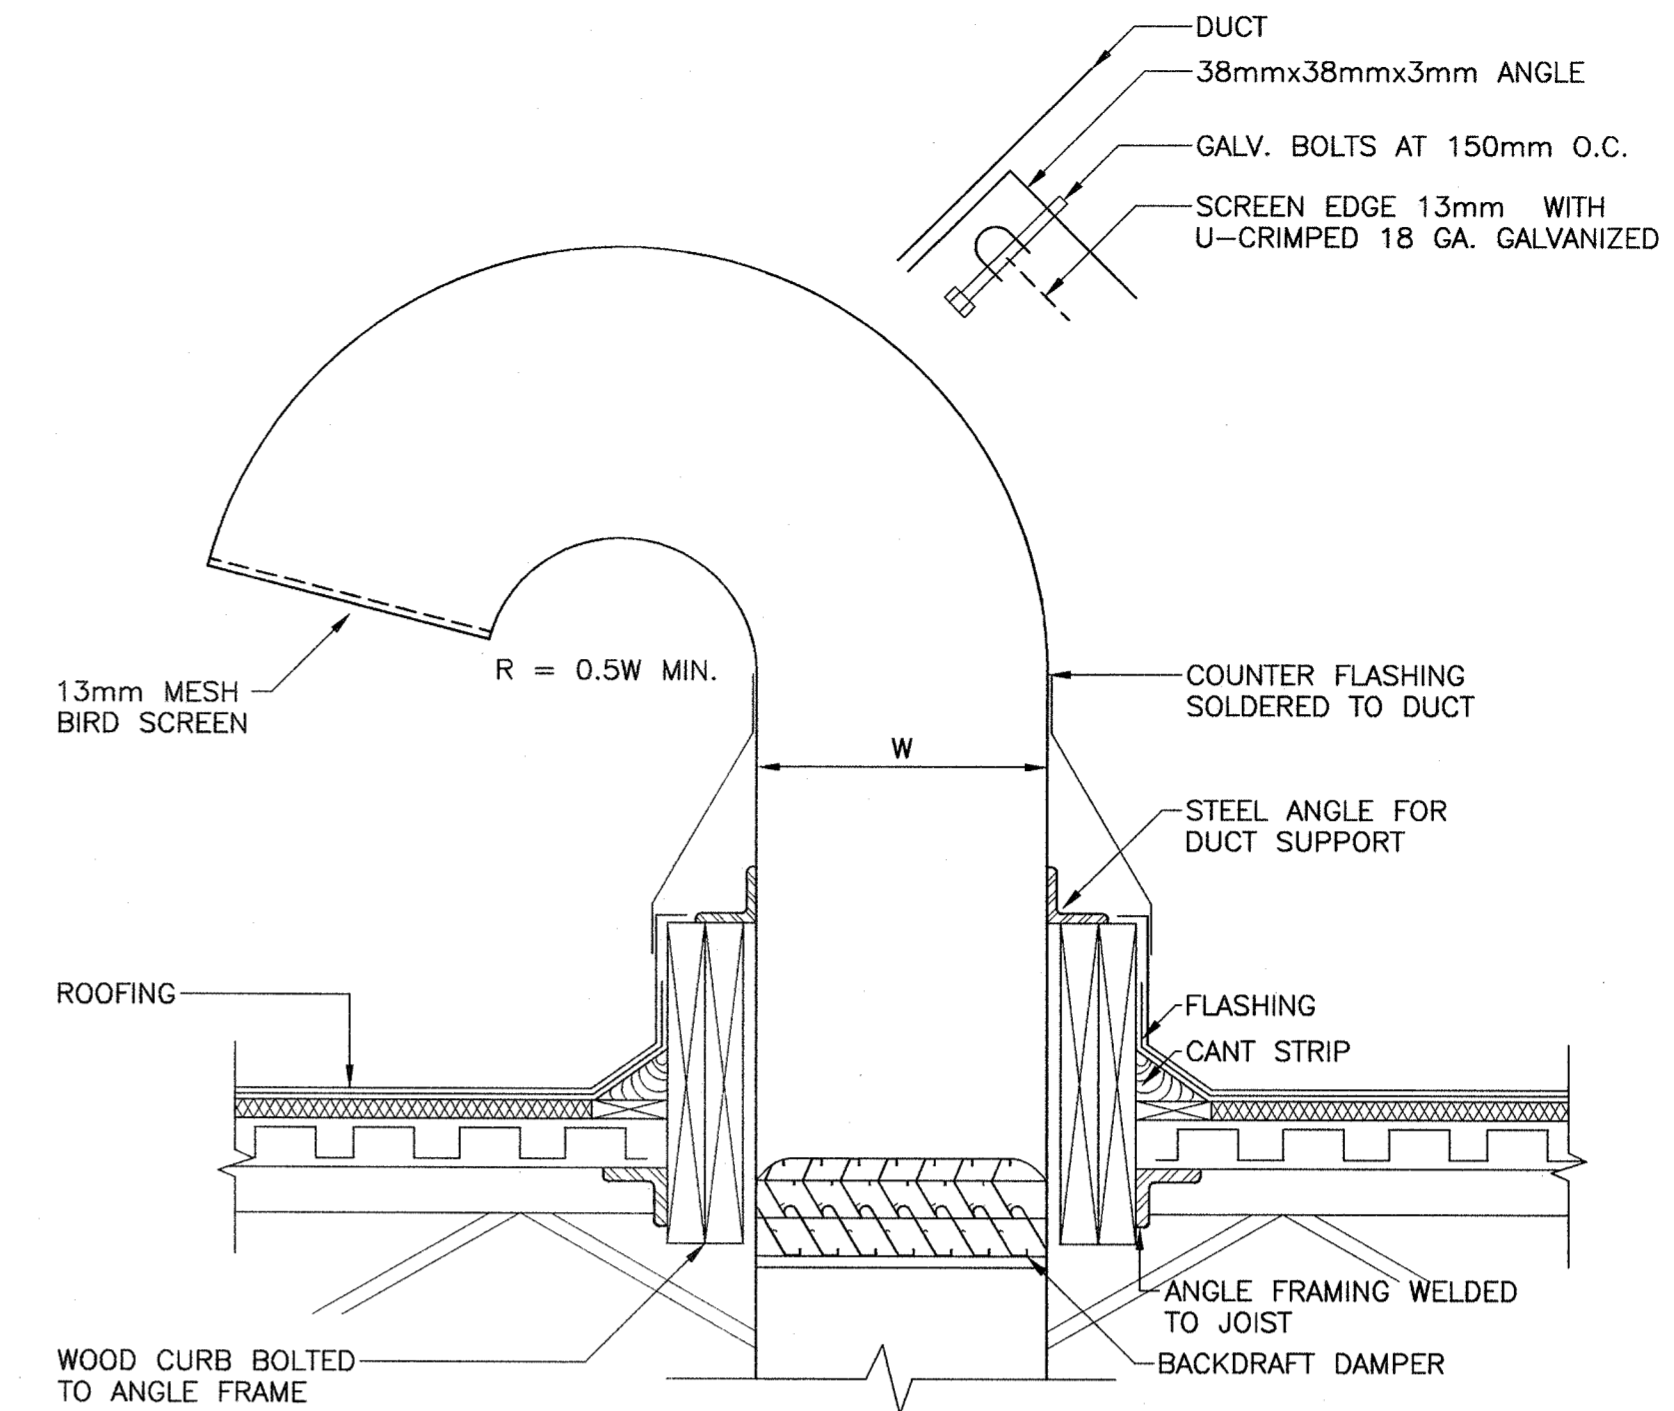

3 GOOSENECK DETAIL  
M2 NOT TO SCALE

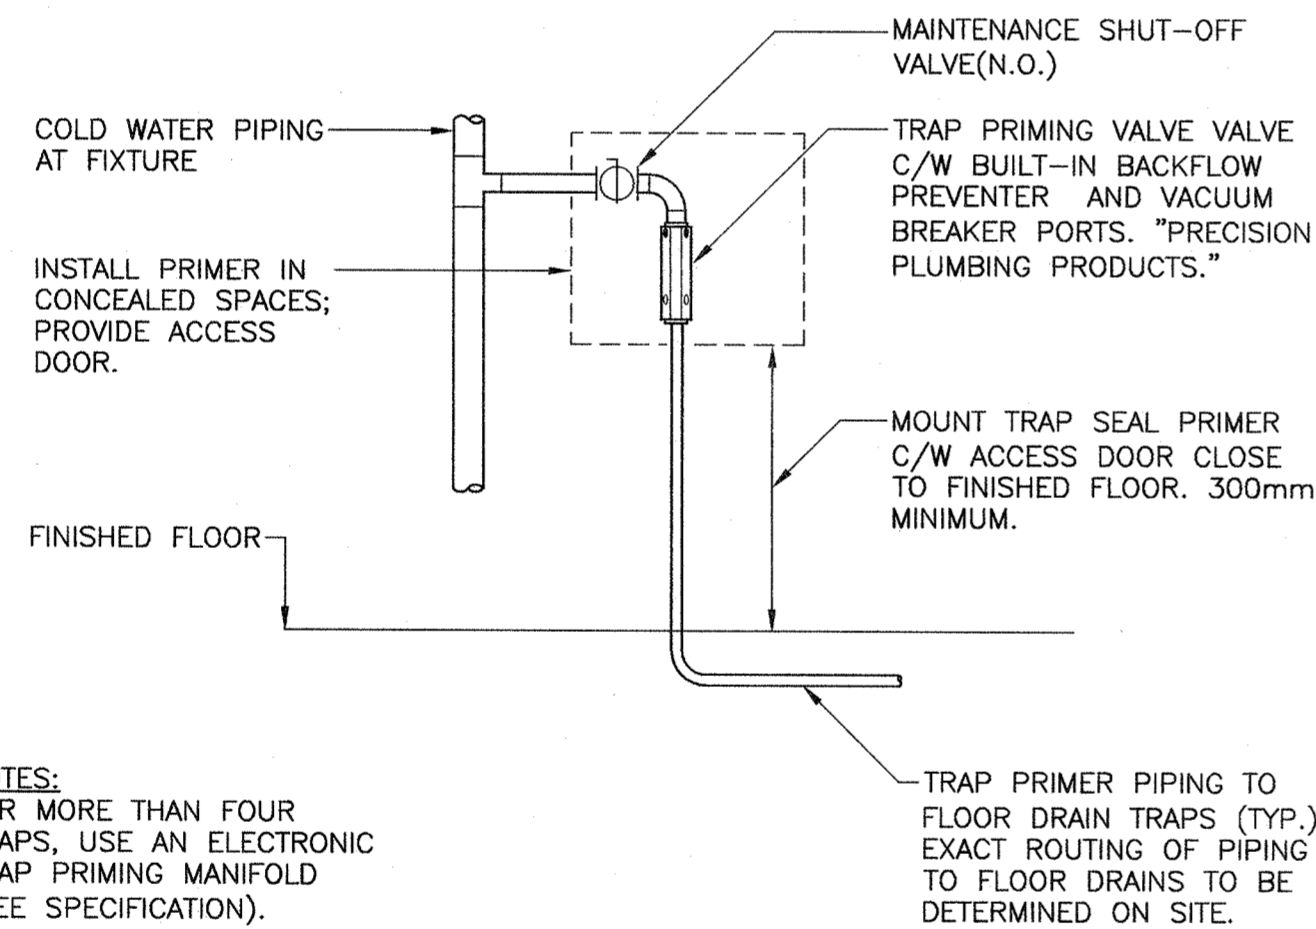

NOTES:  
FOR MORE THAN FOUR TRAPS, USE AN ELECTRONIC TRAP PRIMING MANIFOLD (SEE SPECIFICATION).

4 TRAP SEAL PRIMER - SINGLE SERVICE  
M2 NOT TO SCALE

|           |                       |             |
|-----------|-----------------------|-------------|
| 0         | ISSUED FOR TENDER     | OCT 31 2012 |
| B         | ISSUED FOR 90% REVIEW | MAY 4 2012  |
| A         | ISSUED FOR 66% REVIEW | FEB 27 2012 |
| revisions |                       | date        |

project  
WABUSH AIRPORT, NL  
UPGRADE ATB  
PREBOARDING LOUNGE

drawing  
FLOOR PLANS,  
FIRE PROTECTION,  
DOMESTIC WATER &  
SANITARY DETAILS

|                      |                                 |
|----------------------|---------------------------------|
| designed AD          | conçu                           |
| date FEB. 24, 2012   |                                 |
| drawn AD             | dessiné                         |
| date FEB. 24, 2012   |                                 |
| approved             | approuvé                        |
| date                 |                                 |
| Tender               | Soumission                      |
| PWSC Project Manager | Administrateur de projets TPSCC |
| project number       | no. du projet                   |
| R.038446.001         |                                 |
| drawing no.          | no. du dessin                   |
| M2                   |                                 |