


PUMPING PUMP SCHEDULE							
UNIT No.	DUTY	FLOW RATE (GPM)	TOTAL HEAD (FT) HEAD	TYPE	HP	ELCTRICAL (KWH/HR)	REMARKS
P-1, SUMP PUMP	WATER	50	20	SUMP PUMP	0.4	1500/160	CW DUTHER SUMP CONTROLLER, FLOW SWITCHES, CHECK VALVES, STAINLESS STEEL 304T BR COUPLING, UPPER RAIL SUPPORT, GALVANIZED PUMP LIFT CHAIN, 34" GALVANIZED PUMP GUIDE RAIS, FELL FABRICATED BY CONTRACTOR, SINGLE POINT POWER CONNECTION


PLUMBING FIXTURE SCHEDULE								
SYMBOL	FIXTURE	DESCRIPTION	MATERIAL	DWG	RAW	WASTE	VENT	NOTES
P-1	FIXTURE TOILETS	TWO-PIECE, FLOOR MOUNTED, ELONGATED BOWL, INSULATED	WITRECOUS CHINA	1/2		3	2	
P-2	TOILETS	TWO-PIECE, FLOOR MOUNTED, ELONGATED BOWL, INSULATED FLUSH TANK, 5.0 gph, BARBER-FREE	WITRECOUS CHINA	1/2		3	2	
P-3	BASINS / JAVATUBES	SINGLE QUARTY TUB BASK WITH TWO-HANDLE BODM FAUCET,	WITRECOUS CHINA	1/2	1-1/4	1-1/4		
P-4	SINKS	SINGLE, LEGS BACK, BODM IN KITCHEN SINK WITH TWO-HANDLE DECKMOUNT FAUCET.	STANDARD USE 302/284 5/8" DESS STEEL	1/2	1-1/2	1-1/2		
P-5	SHOWER	BARBER-FREE SHOWER W/ALD HEAD.	BRASS	1/2	1/2	2	1-1/2	

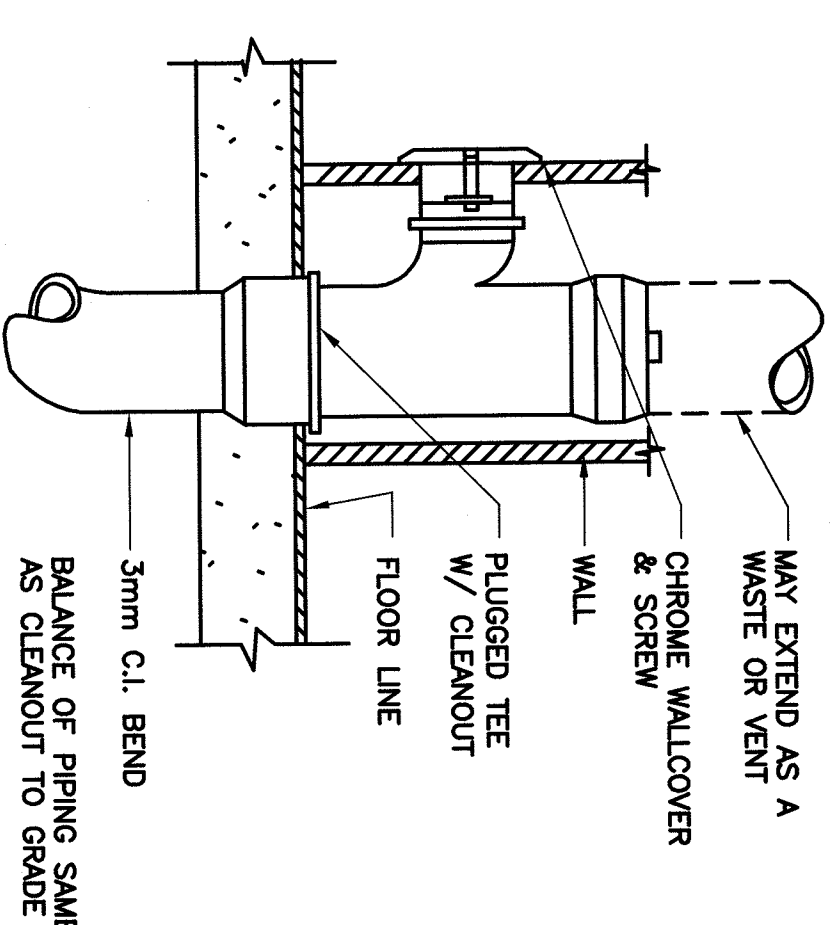

2
—

DETAIL — WALL CLEANOUT


SCALE : N.T.S.

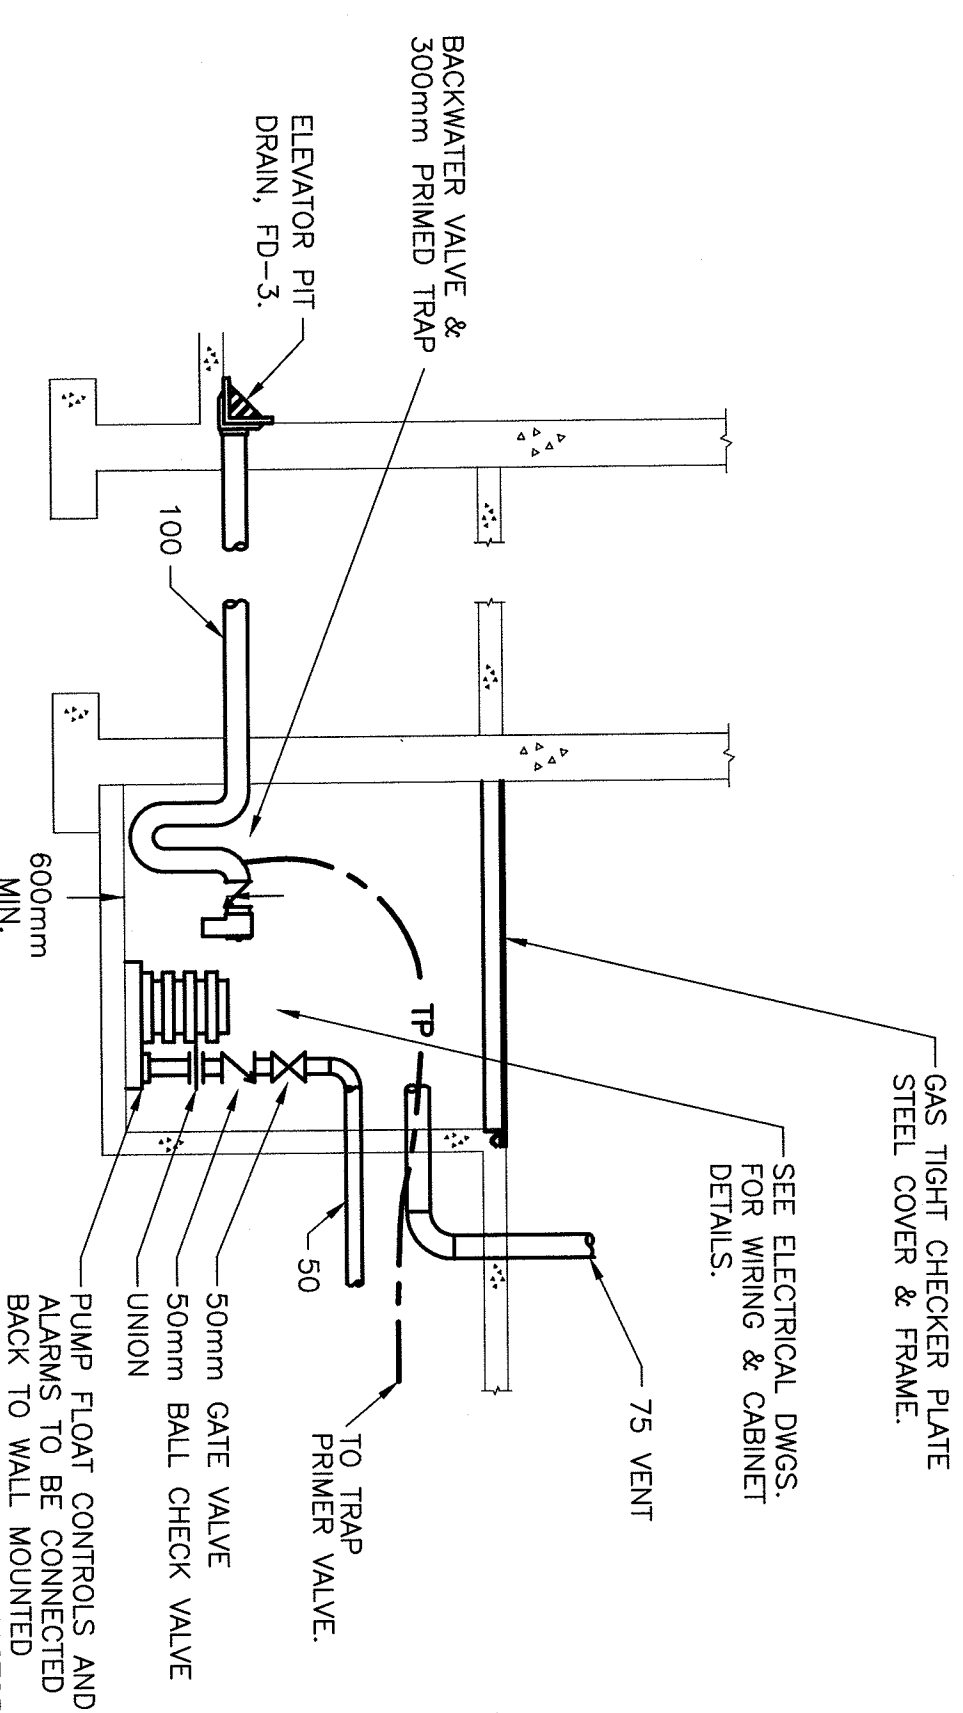

1
DETAIL - ELEVATOR SUMP PIT & PUMP SECTION
—
SCALE : N.T.S.

- PROVIDE ALL PIPE SLEEVES AS REQUIRED FOR LEVEL FLOATS AND POWER WIRING FOR SUMP PUMPS. PIT COVERS ARE NOT TO BE PENETRATED BY PIPING OR WIRING.
- SEE STRUCTURAL DWGS. FOR ELEVATOR SHAFT AND SUMP PIT LOCATIONS AND DIMENSIONS.

NOTES

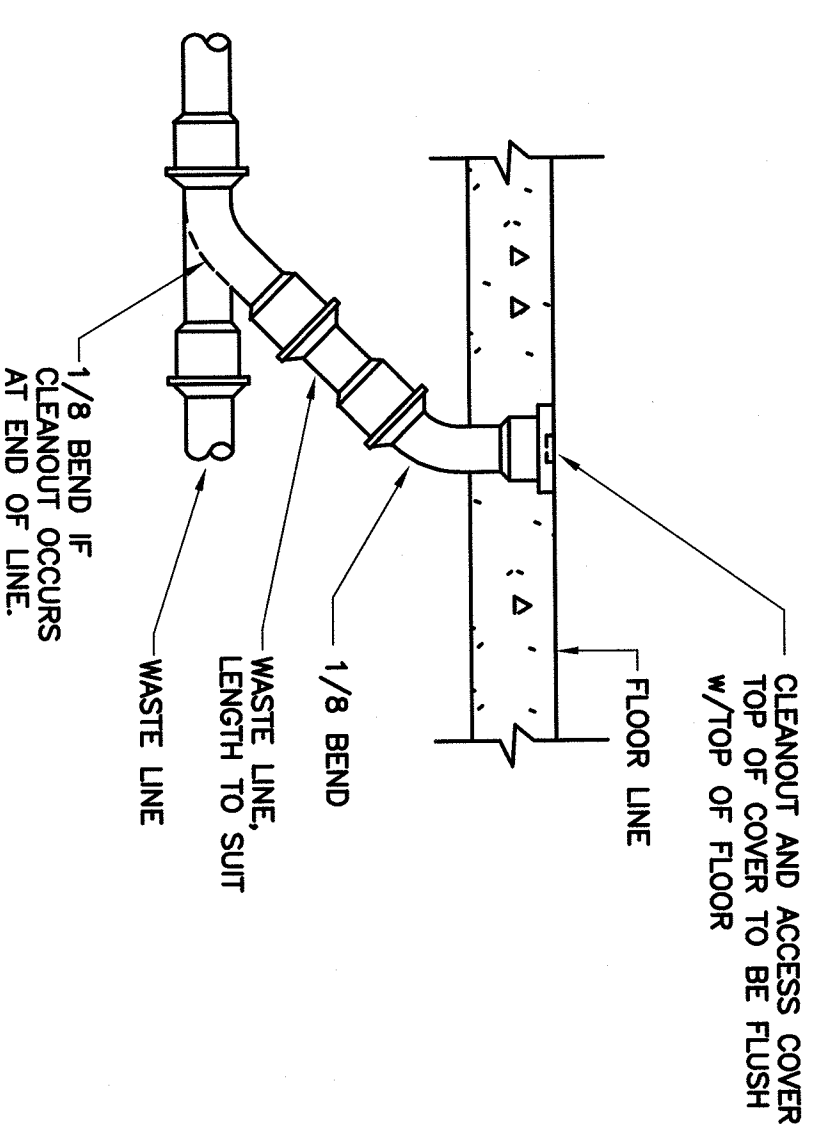

3
—

DETAIL — FLOOR CLEANOUT

SCALE : N.T.S.

SCALE : N.T.S