

stamp



| | | |
|----|----------------|------------|
| 01 | ISSUED FOR BID | 2013/10/04 |
|----|----------------|------------|

| | | |
|----------|-------------|------|
| revision | description | date |
|----------|-------------|------|

Do not scale drawings
Verify all dimensions and conditions on site and
immediately notify the Departmental Representative of all
discrepancies

| | |
|---|---|
| A | detail no. no. du détail |
| B | drawing no. - where detail required dessin no. - où détail exigé |
| C | drawing no. - where detailed dessin no. - où détaillé |

project title
titre du projet
GRAND VALLEY INSTITUTION FOR WOMEN
1575 HOMER WATSON BLVD.
KITCHENER, ONTARIO, N2P 2C5

PRINCIPAL ENTRANCE BUILDING

drawing title
titre du dessin
SECOND FLOOR
PLUMBING UPGRADE
PLAN

drawn by
dessiné par
GR

designed by
conc par
JDB

approved by
approuvé par
RD


bid
offre
RP

project manager
administrateur
de projets

project date
date du projet
2013-04-19

project no.
no. du projet
DIALOG NO. 09487T.02
R.047995.001


drawing no.
dessiné no.
M1.16

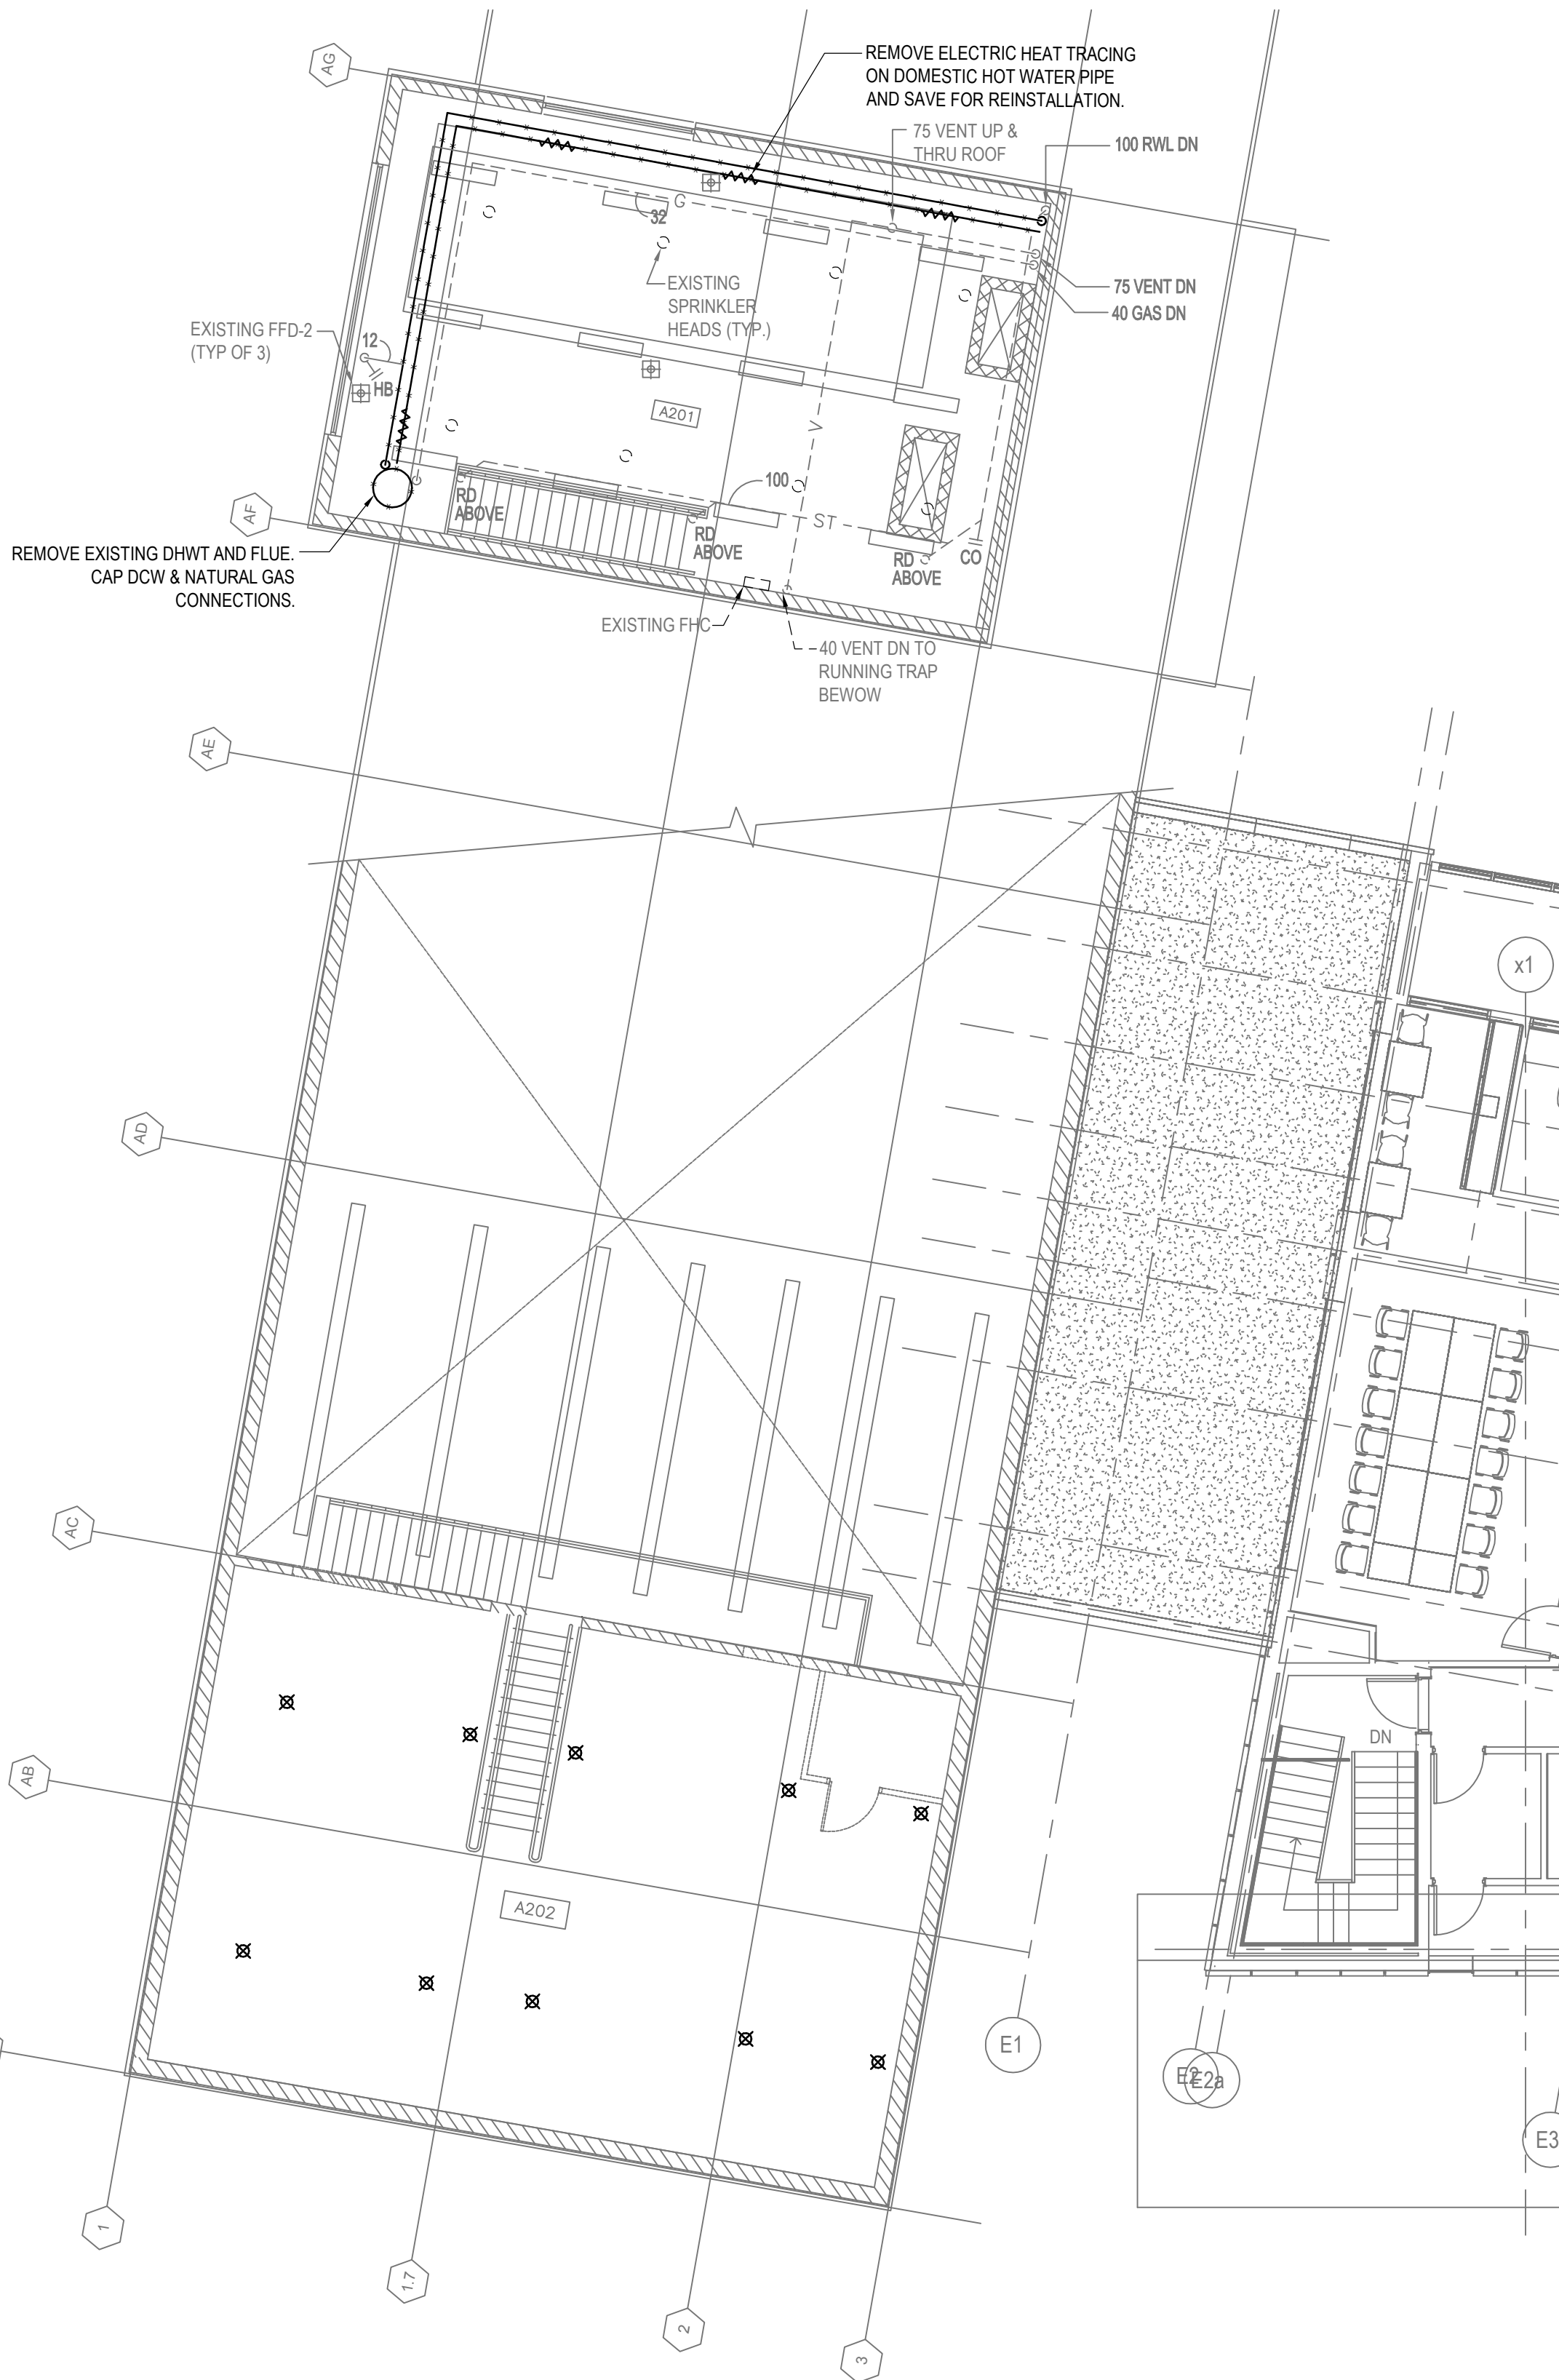

1 SECOND FLOOR PLUMBING & FIRE PROTECTION DEMOLITION
M1.16 SCALE: 1:100

GENERAL NOTES

- THIS DRAWING INDICATES GENERAL INTENT OF DESIGN ONLY. CONTRACTOR TO VERIFY EXISTING SITE CONDITION. PRIOR TO ORDERING MATERIALS AND COMMENCING WORK. REPORT TO DEPARTMENTAL REPRESENTATIVE ANY DISCREPANCIES BETWEEN EXISTING AND DESIGN DRAWINGS.
- DEMOLISH WORK AS INDICATED.
- REMOVE ALL DEBRIS AND RUBBISH ONCE JOB IS COMPLETE.
- COORDINATE DEMOLITION AND REPAIR WITH ALL TRADES.

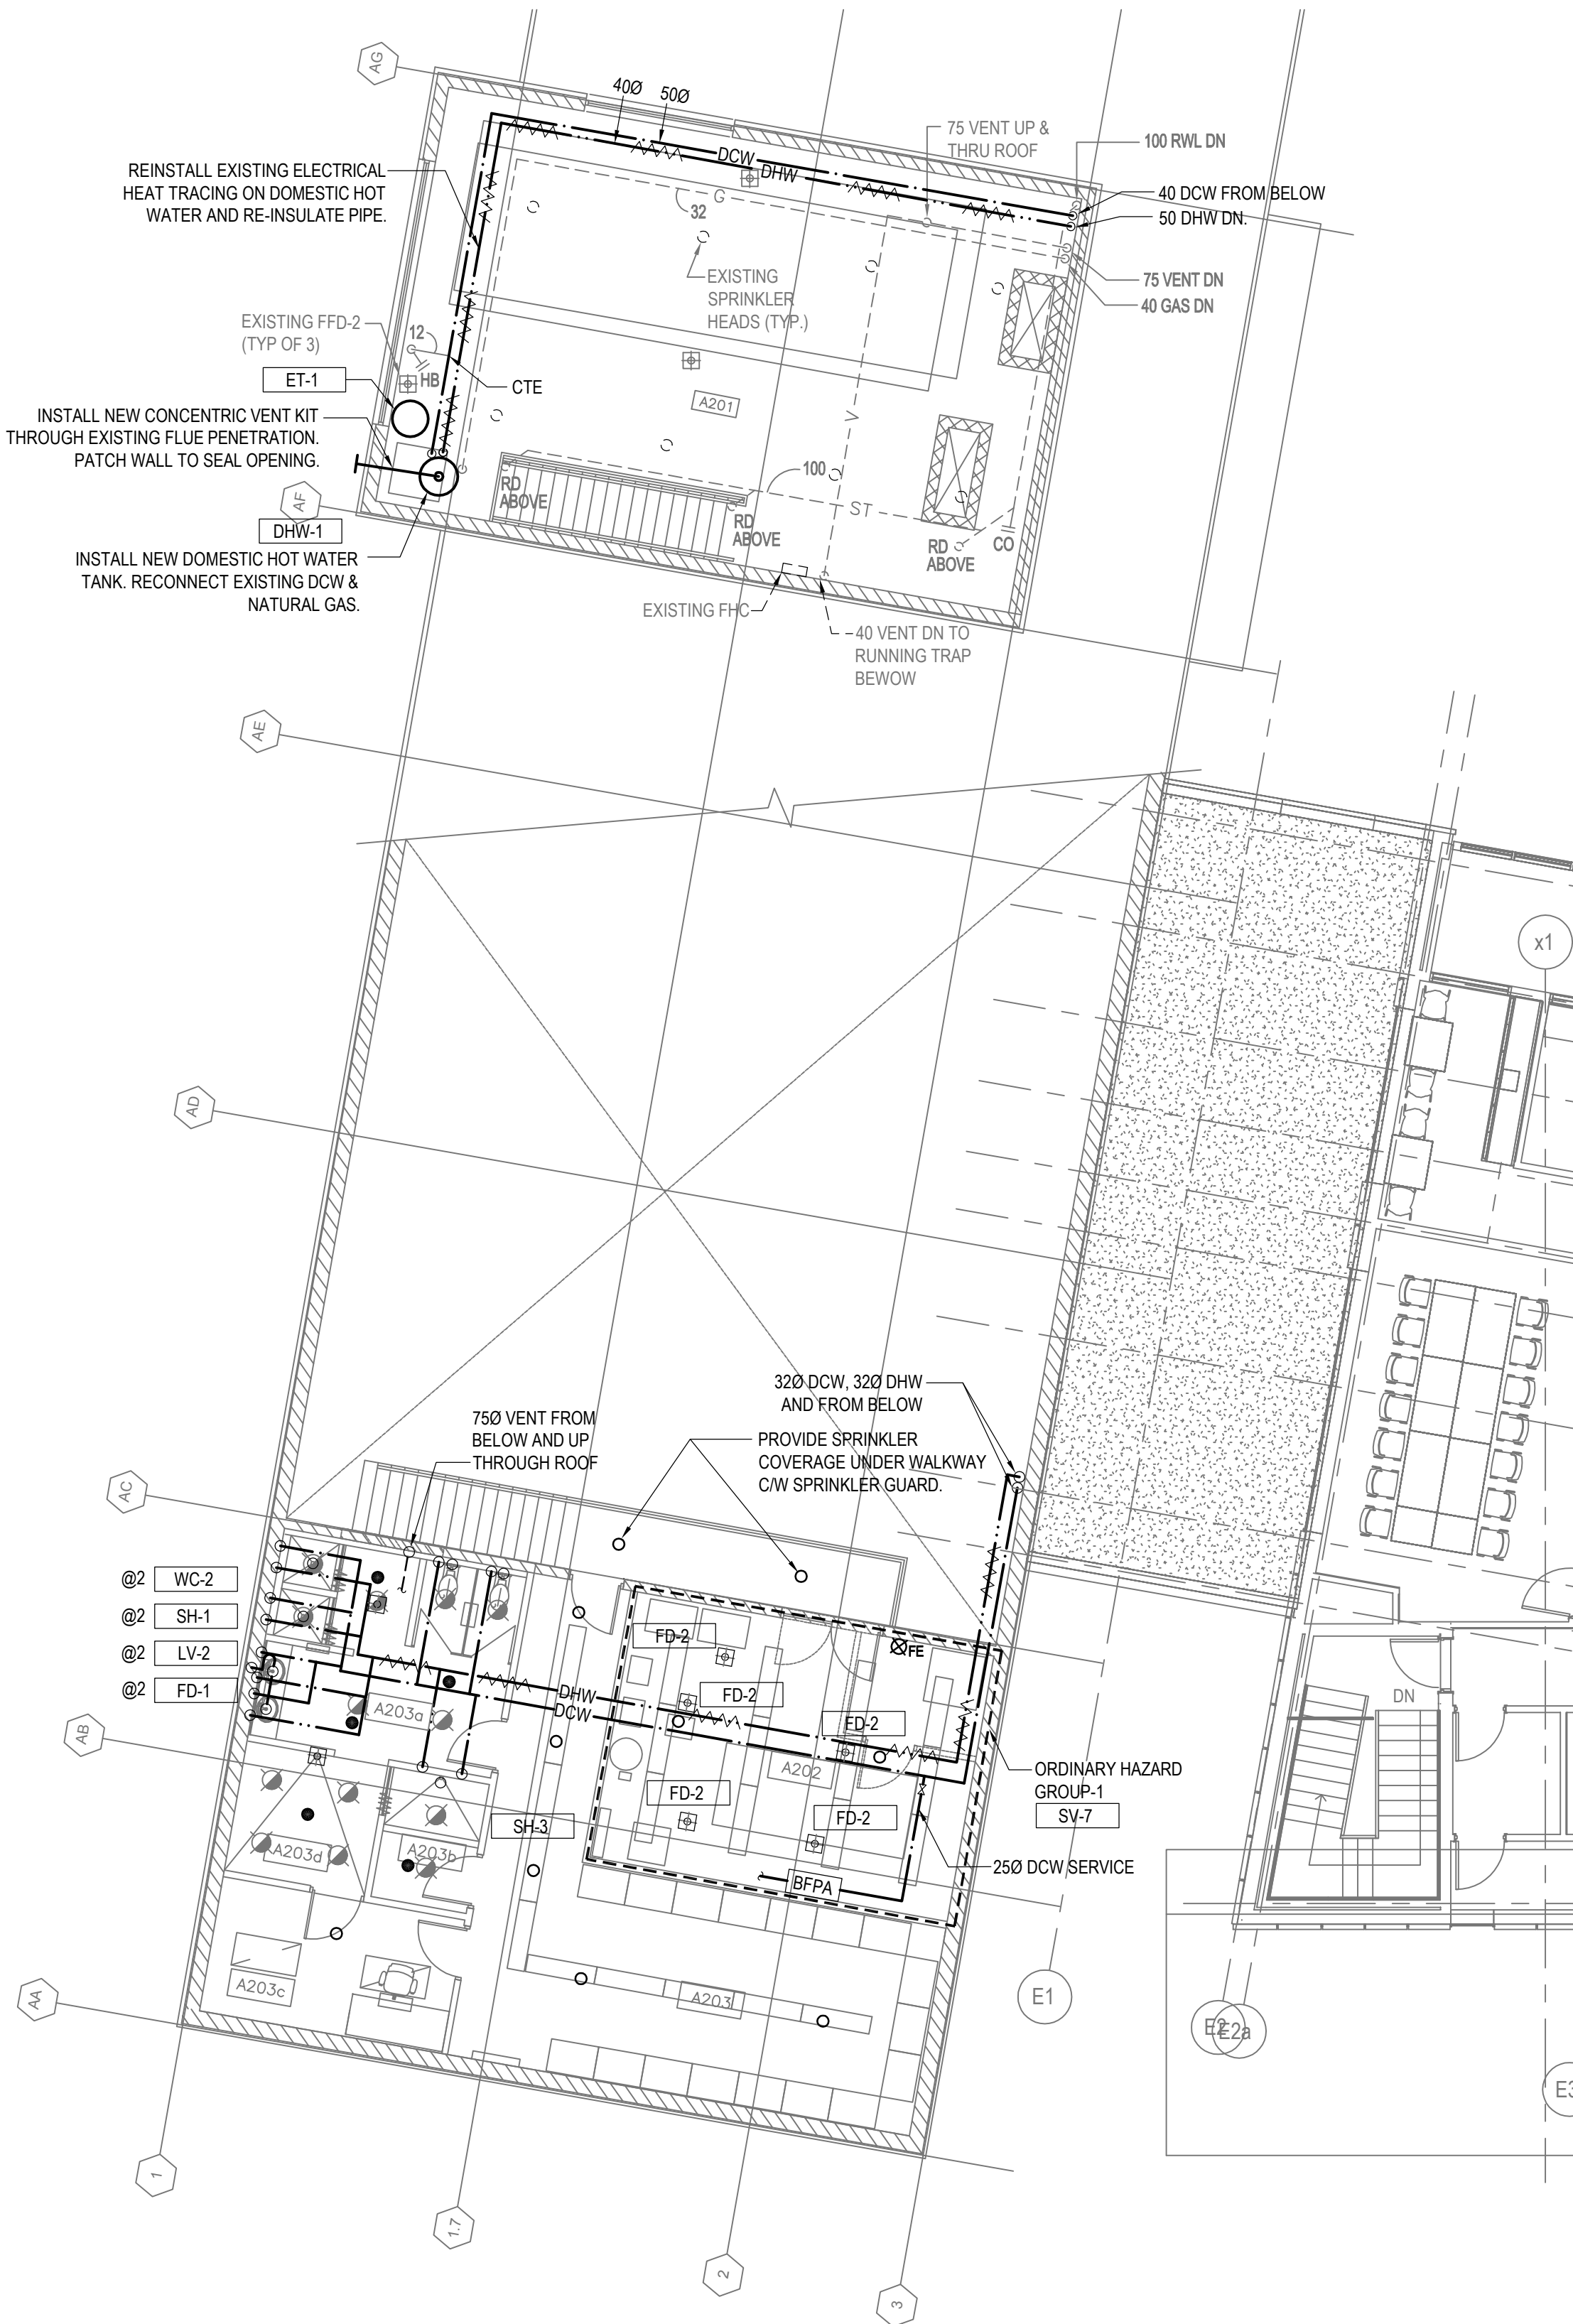

2 SECOND FLOOR PLUMBING & FIRE PROTECTION UPGRADE
M1.16 SCALE: 1:100

MECHANICAL PLUMBING SERVICE REQUIREMENTS

| TAG | DCW | DHW | SANITARY DRAIN | SANITARY VENT | REMARKS |
|-----|-----|-----|----------------|---------------|---------|
| LAV | 15 | 15 | 40 | 32 | |
| WC | 25 | - | 100 | 40 | |
| SH | 15 | 15 | 50 | 40 | |
| FD | - | - | 75 | 40 | |

GENERAL NOTES

- PROVIDE NEW FIXTURES INCLUDING PIPING, VALVES, FITTINGS AND ACCESSORIES AS INDICATED.
- ALL PLUMBING FIXTURES SHALL BE VENTED AND ALL TRAPS SHALL BE PRIMED AS PER NATIONAL PLUMBING CODE.
- MECHANICAL CONTRACTOR TO COORDINATE POWER SUPPLIES FOR DOMESTIC HOT WATER TEMPERATURE MAINTENANCE WITH ELECTRICAL CONTRACTOR.