


2
E2.04
1:100
DEMOLITION LIGHTING PLAN

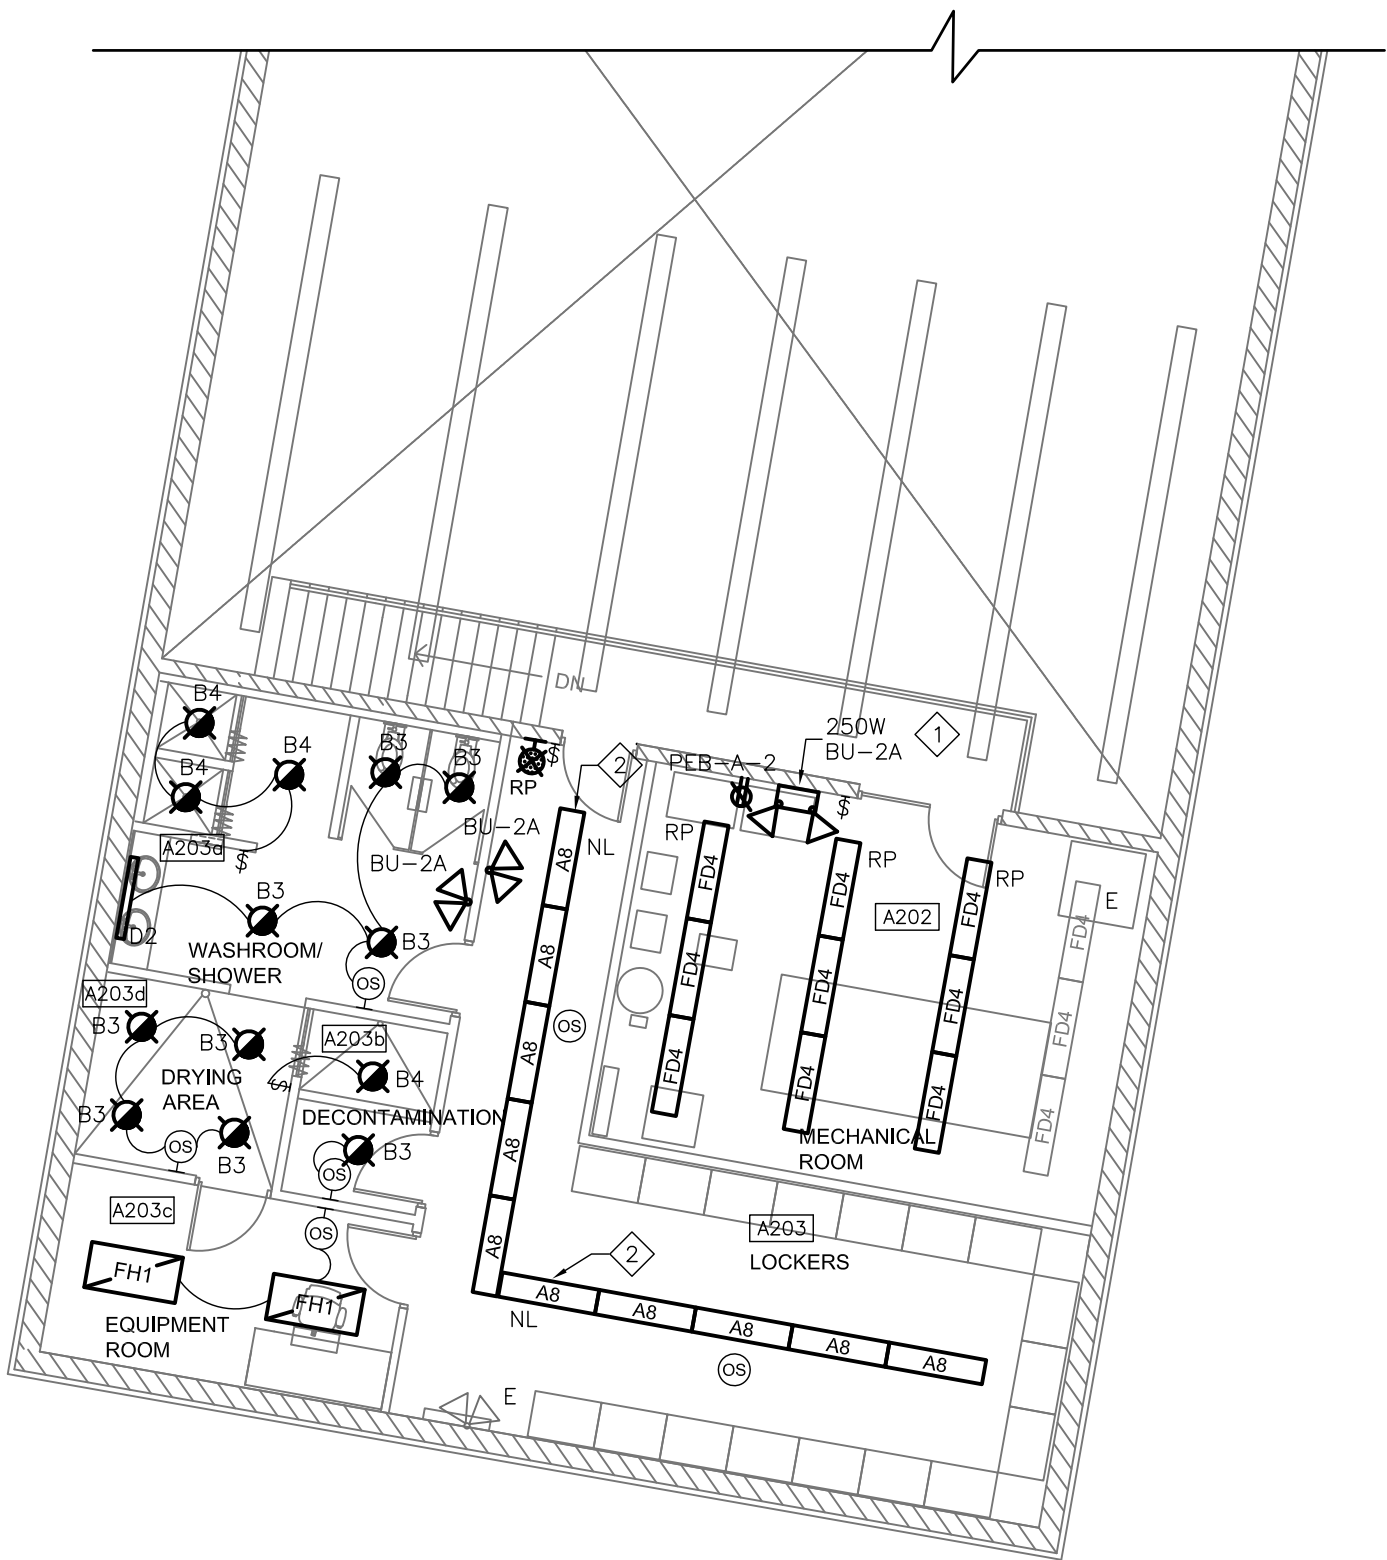

1
E2.04
1:100
LIGHTING PLAN

GENERAL NOTES:

- RE-USE EXISTING 347V LIGHTING CIRCUIT TO FEED NEW AND RELOCATED LUMINAIRES, ENSURE MAXIMUM LOAD ON 15A BREAKER IS 4000W.

KEYNOTES

- PROVIDE NEW EMERGENCY BATTERY PACK TO MATCH EXISTING IN BUILDING 'A'.
- CONNECT ONE TYPE 'A8' LUMINAIRE INTO THE NEAREST AVAILABLE CIRCUIT DESIGNATED FOR NIGHT LIGHTING.

DIALOG™

stamp



revision	description	date
01	ISSUED FOR BID	2013/10/04

Do not scale drawings
Verify all dimensions and conditions on site and
Immediately notify the Departmental Representative of all
discrepancies

A	detail no. no. du détail
B	drawing no. - where detail required dessin no. - où détail exigé
C	drawing no. - where detailed dessin no. - où détaillé

project title
titre du projet
GRAND VALLEY INSTITUTION FOR WOMEN
1575 HOMER WATSON BLVD.
KITCHENER, ONTARIO, N2P 2C5
PRINCIPAL ENTRANCE BUILDING

drawing title
titre du dessin
2ND FLOOR
LIGHTING PLAN 'A'

drawn by
dessiné par
OS

designed by
conçu par
OS

approved by
approuvé par
NA

bid
offre
RP

project manager
administrateur
de projets

project date
date du projet
2012-11-06

project no.
no. du projet
DIALOG NO. 09487T.02
R.047995.001

drawing no.
dessiné no.
E2.04