


stamp



01	ISSUED FOR BID	2013/10/04
revision		date

Do not scale drawings
Verify all dimensions and conditions on site and
immediately notify the Departmental Representative of all
discrepancies

	A	detail no. no. du détail
	B	drawing no. - where detail required dessin no. - où détail exigé
	C	drawing no. - where detailed dessin no. - où détaillé

project title
titre du projet

**GRAND VALLEY INSTITUTION FOR WOMEN
1575 HOMER WATSON BLVD.
KITCHENER, ONTARIO, N2P2C5**

PRINCIPAL ENTRANCE BUILDING

drawing title
titre du dessin

GROUND FLOOR HVAC
PLAN-PEB

drawn by
dessine par

designed by
conc par

JDB

approved by
approuvé par

RD


bid	
offre	RP

project date	
date du projet	2013-04-19

project no. DIALOG NO. 09487T.02
no. du projet R.047995.001

drawing no.
dessine no.

M2.03

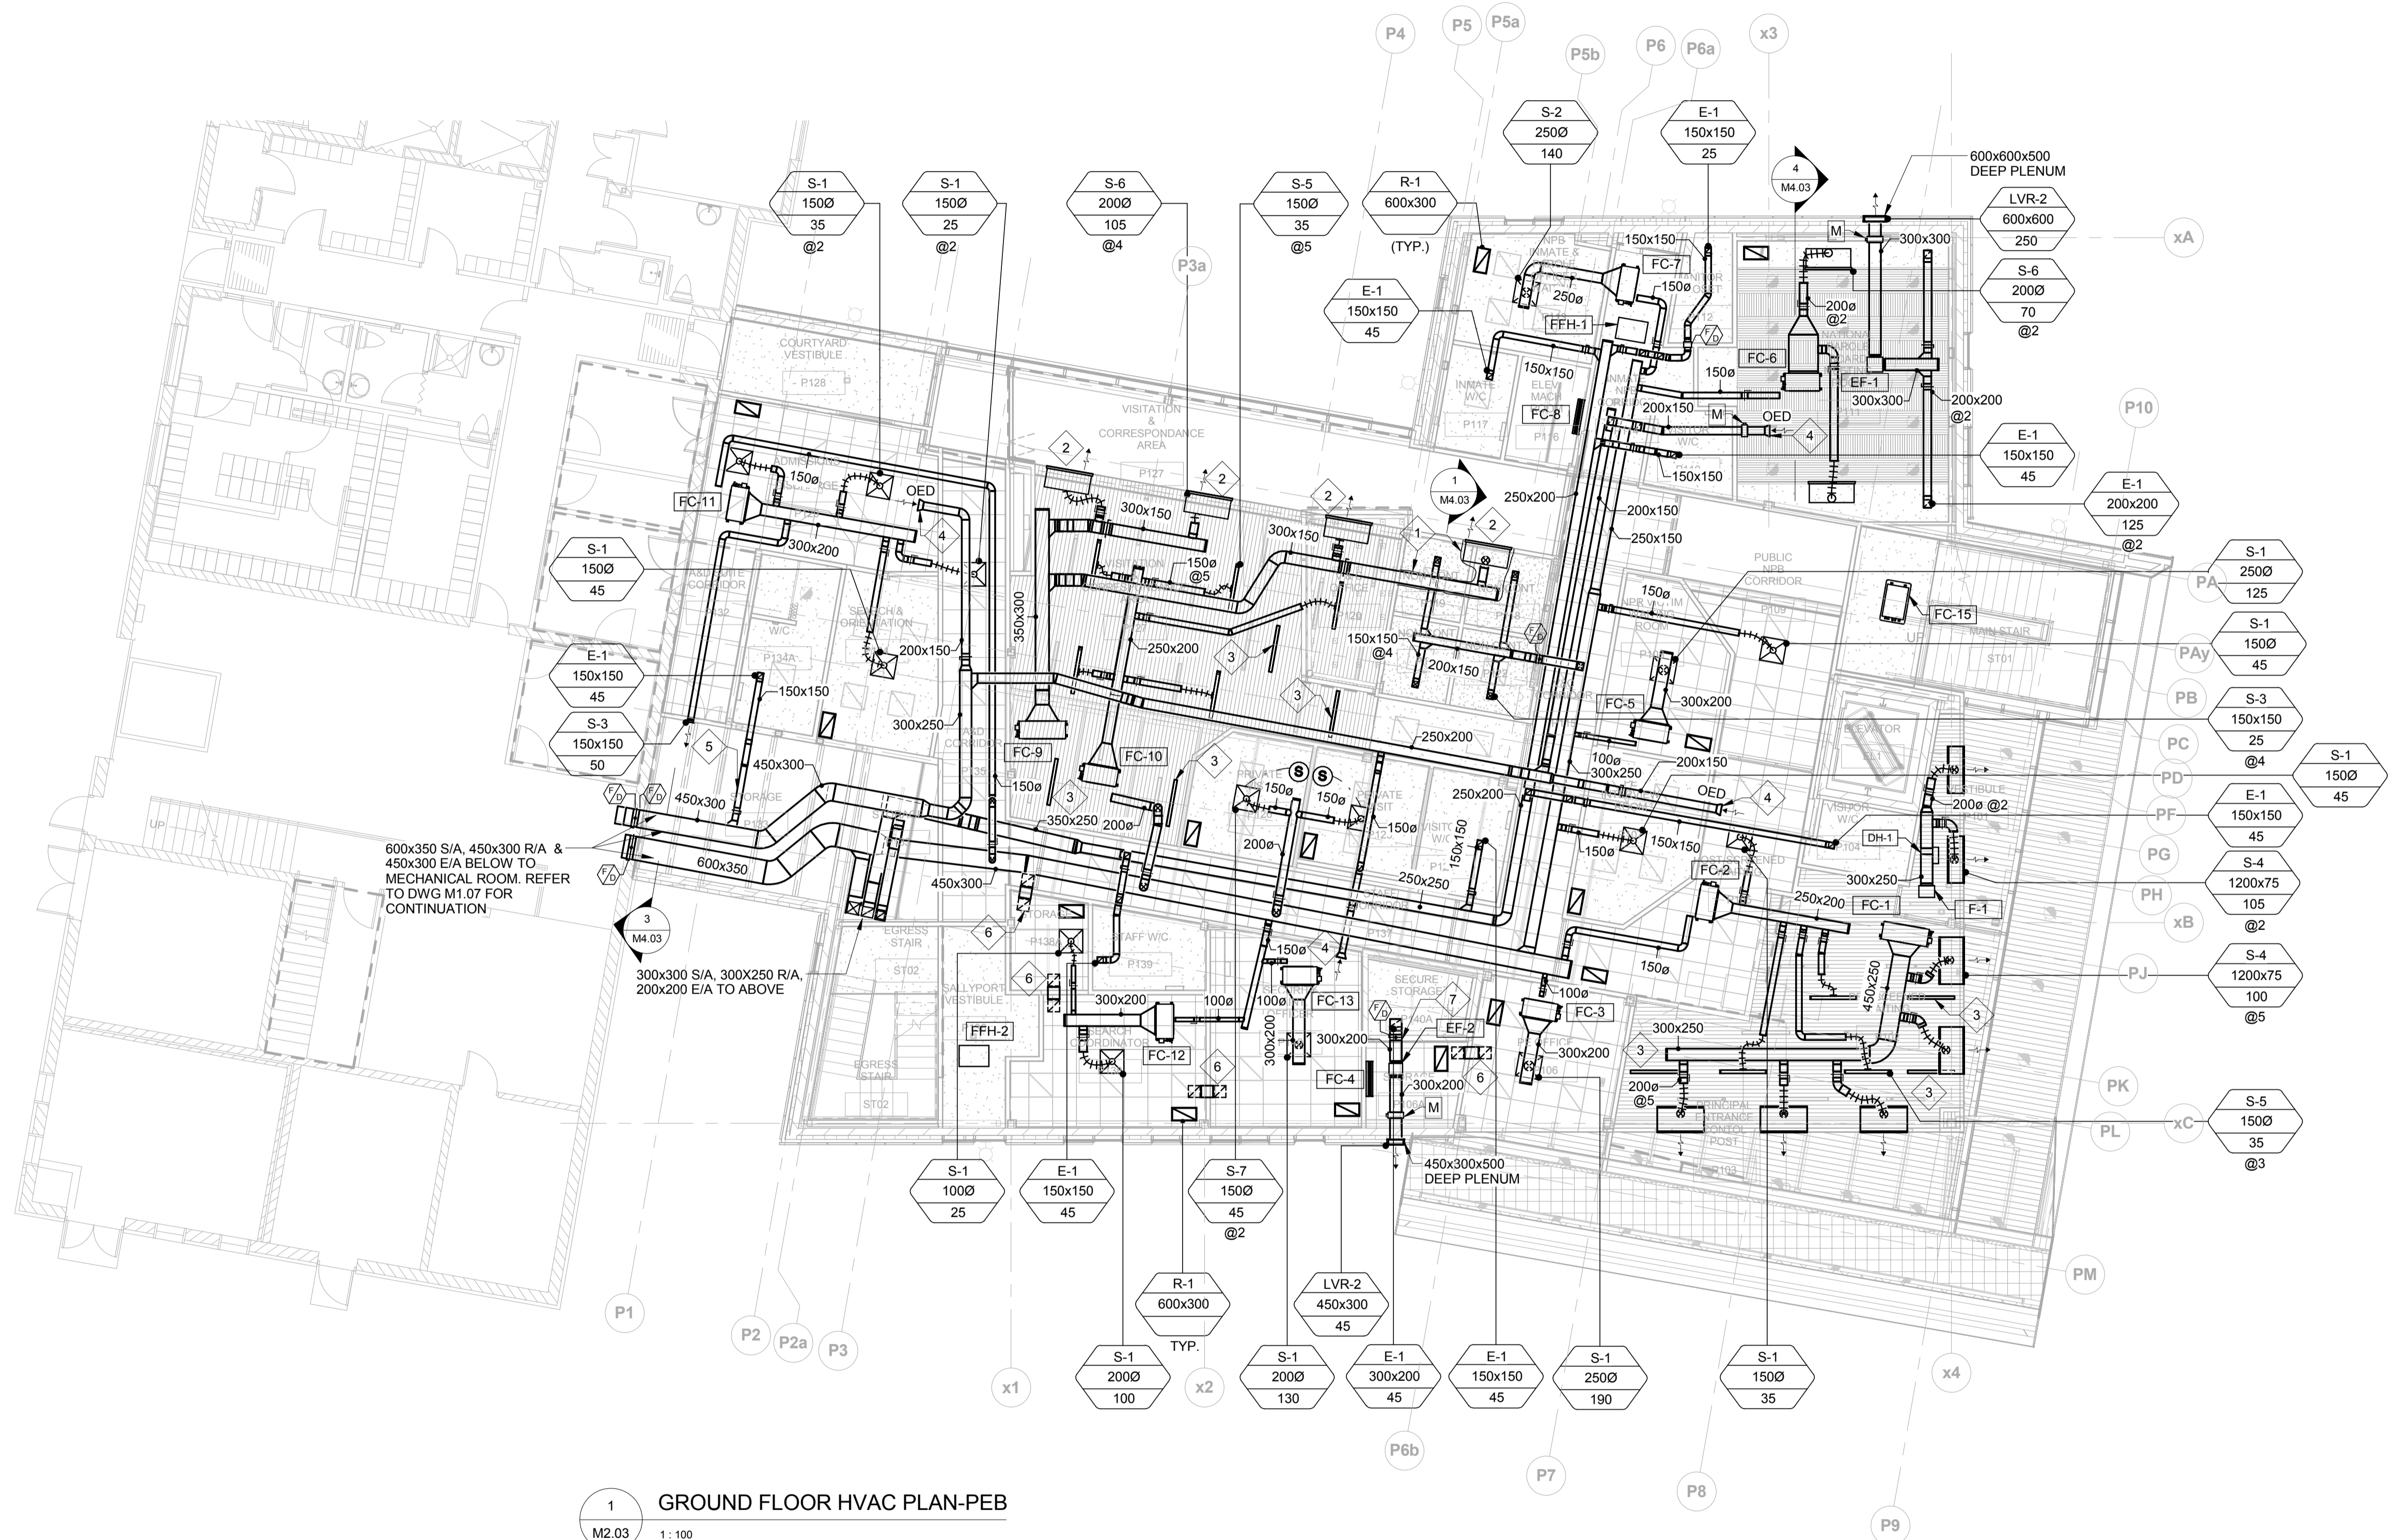

GENERAL NOTES

1. PROVIDE ALL MATERIALS AND EQUIPMENT AND PERFORM ALL LABOUR AS INDICATED TO COMPLETE THE WORK.
2. REFER TO DETAIL 6/M5.01 FOR FANCOIL INSTALLATION DETAIL.
3. REFER TO DETAIL 2/M5.02 FOR INLINE FAN INSTALLATION DETAIL.

KEY NOTES

- 1 DUCT BRANCH AND LINEAR DIFFUSER ENCLOSED IN FIRE WRAP.
- 2 DIFFUSER TO BE CENTERED FOR SECOND STOREY OFFICE WINDOW ABOVE. INSTALL DIFFUSER IN BETWEEN STEEL BEAM AND STEEL DECK. REFER TO DETAIL 1/M4.03.
- 3 PROVIDE 1200mm RETURN AIR SIGHT BAFFLE. PAINT MATTE BLACK. COORDINATE WITH ARCHITECTURAL CEILING.
- 4 BALANCE TO 70 L/S.
- 5 SANITARY EXHAUST BRANCH TO CONNECT TO SANITARY EXHAUST DUCT UNDER GENERAL EXHAUST DUCT.
- 6 REFER TO DETAIL 3/M5.02 OPENING SIZES TO BE 300x300.
- 7 PROVIDE SECURITY BARS ON SECURE SIDE OF ROOM.