

stamp




GENERAL NOTES:

1. RE-USE EXISTING 347V LIGHTING CIRCUITS TO FEED NEW AND RELOCATED LUMINARIES. ENSURE MAXIMUM LOAD ON 15A BREAKER IS 4000W.
2. RE-USE ALL LUMINARIES MADE AVAILABLE FROM DEMOLITION AND PROVIDE NEW TO MATCH EXISTING WHERE REQUIRED.

KEYNOTES


1. RELOCATE THREE EXISTING SWITCHES AS SHOWN. MAINTAIN SAME LIGHTING GROUPING FOR TWO SWITCHES SERVING FLUORESCENT STRIPS MOUNTED IN COVE.
2. PROVIDE NEW REMOTE EMERGENCY HEADS TO MATCH EXISTING AND CONNECT INTO THE NEAREST AVAILABLE EMERGENCY BATTERY PACK WITH SPARE CAPACITY.
3. PROVIDE NEW EMERGENCY BATTERY PACK TO MATCH EXISTING.
4. RELOCATE EIGHT (8) 2X4' RECESSED FLUORESCENT LIGHTING FIXTURES (NOT SHOWN ON PLAN) IN CHANGE ROOMS A128a AND A129a.

FOR CONTINUATION OF DRAWING REFER TO DETAIL 2/E2.03

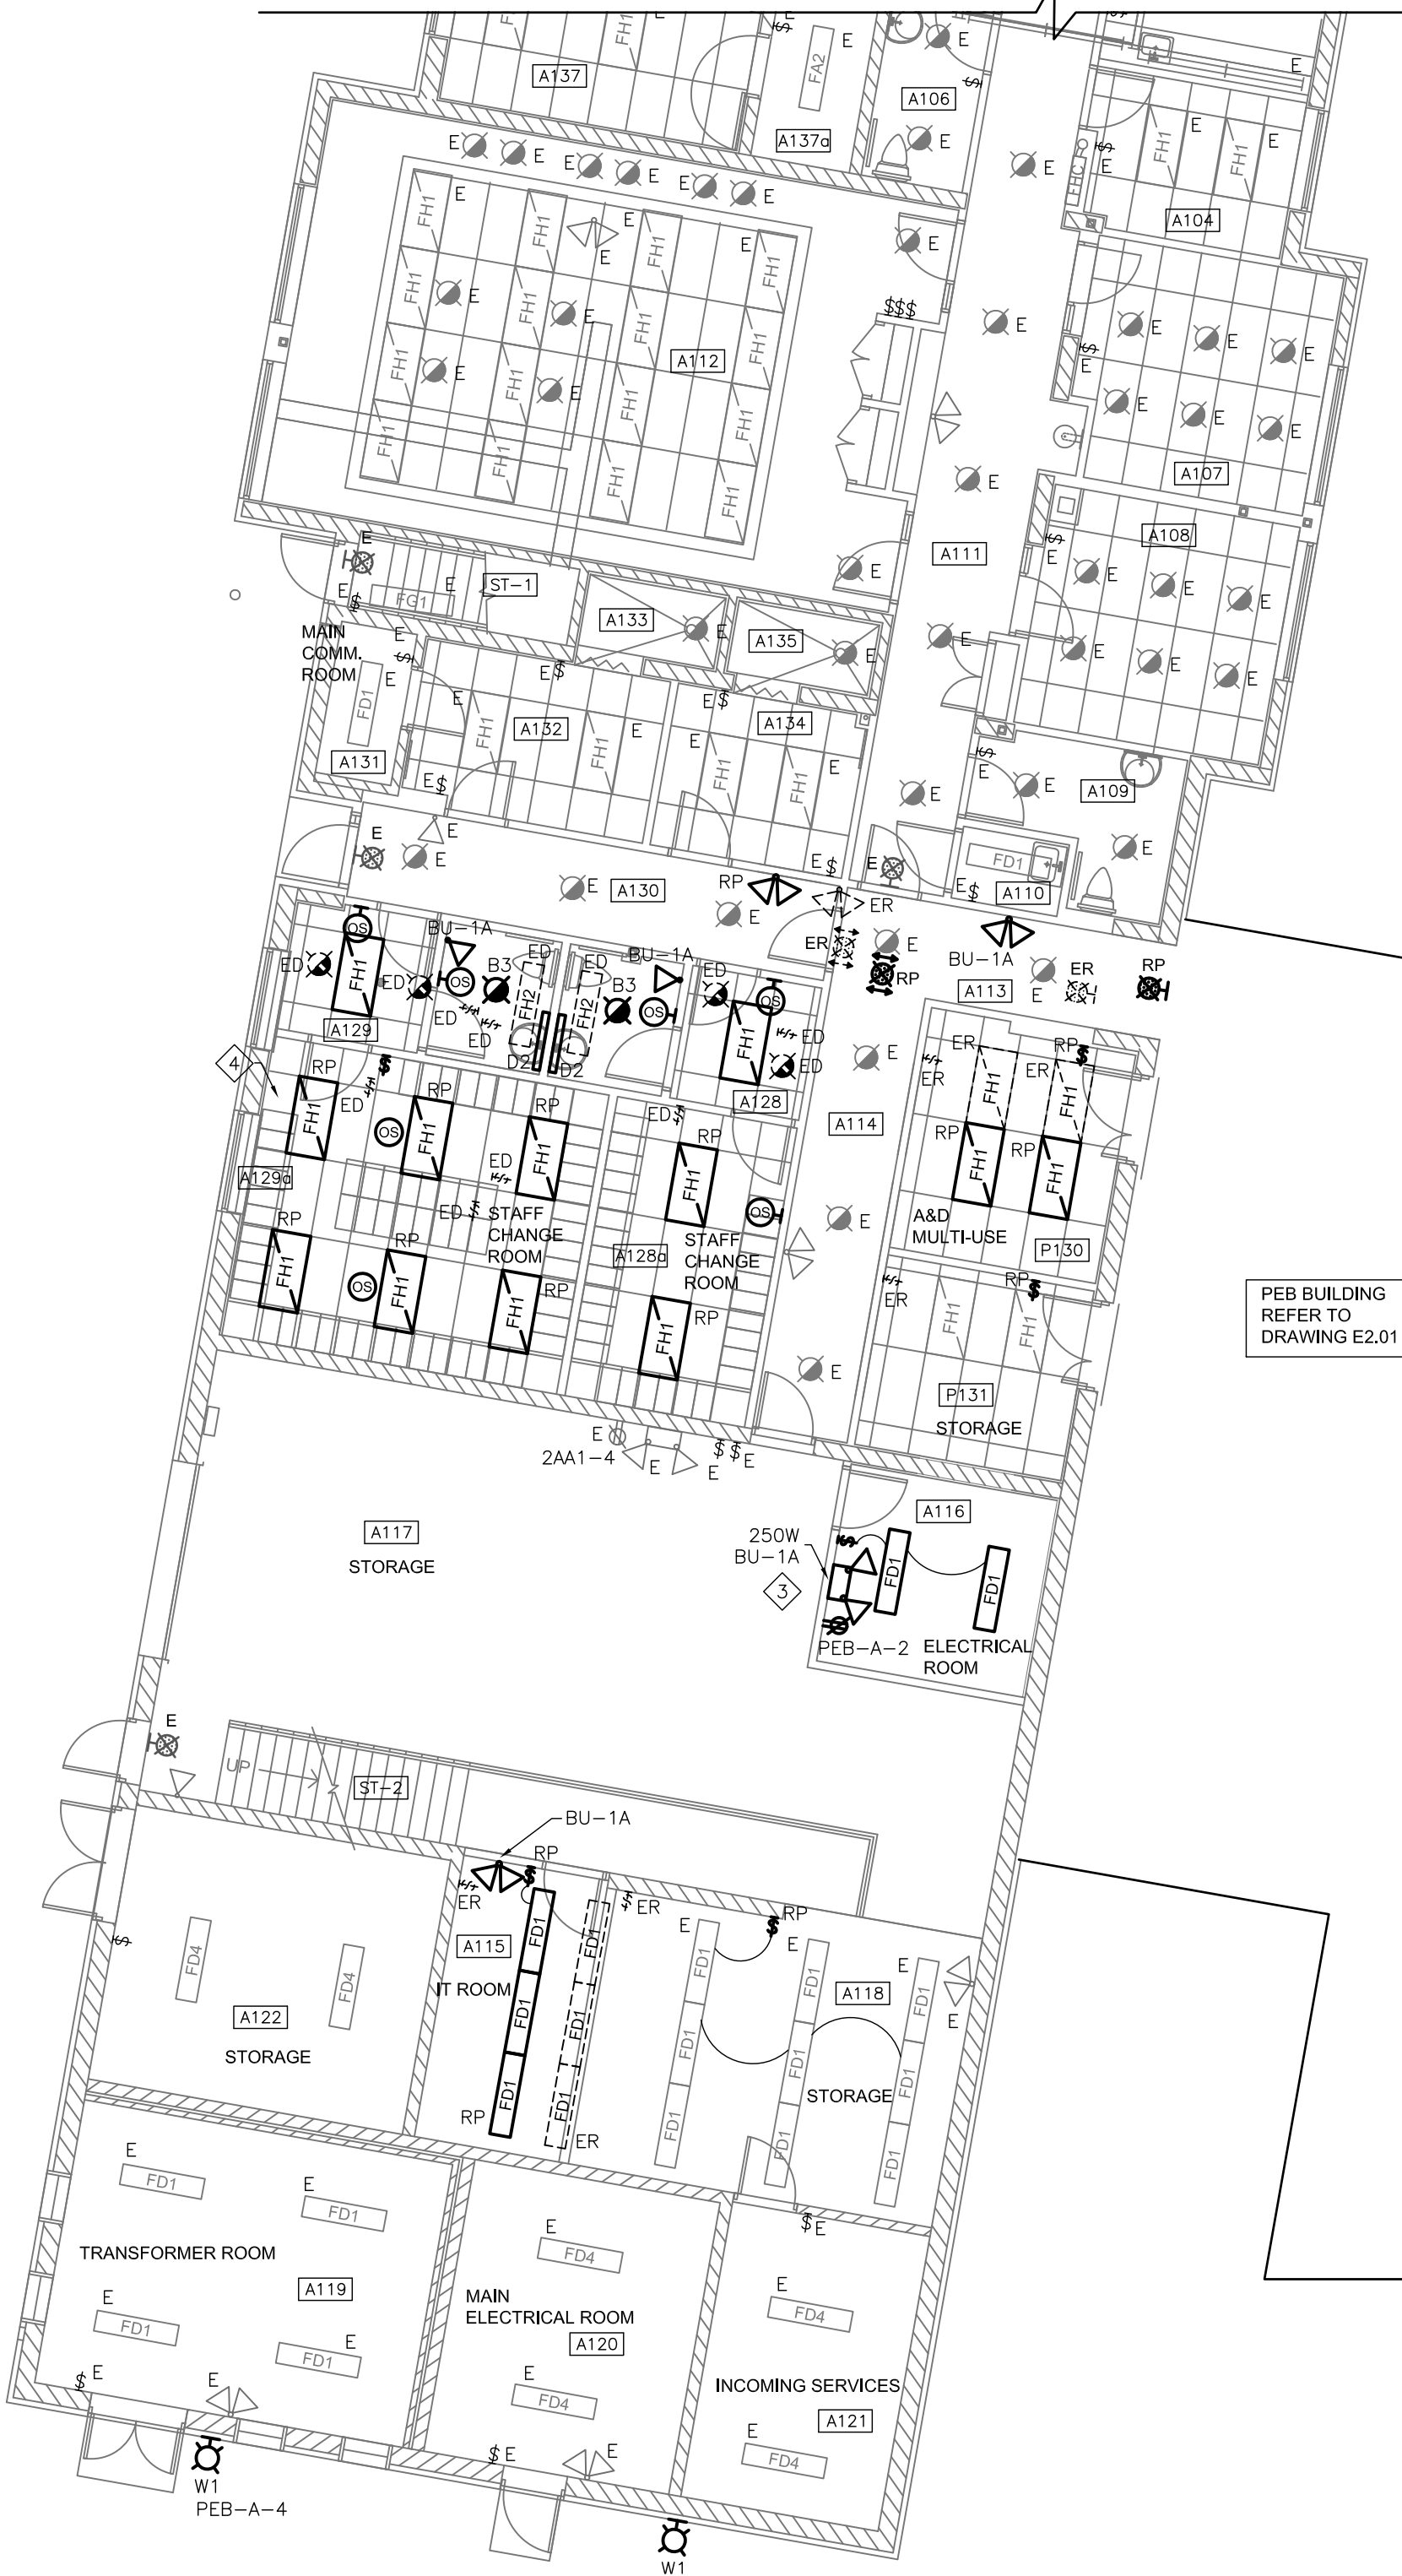

1 LIGHTING PLAN 'A'  
E2.03 1:100

FOR CONTINUATION OF DRAWING REFER TO DETAIL 1/E2.03

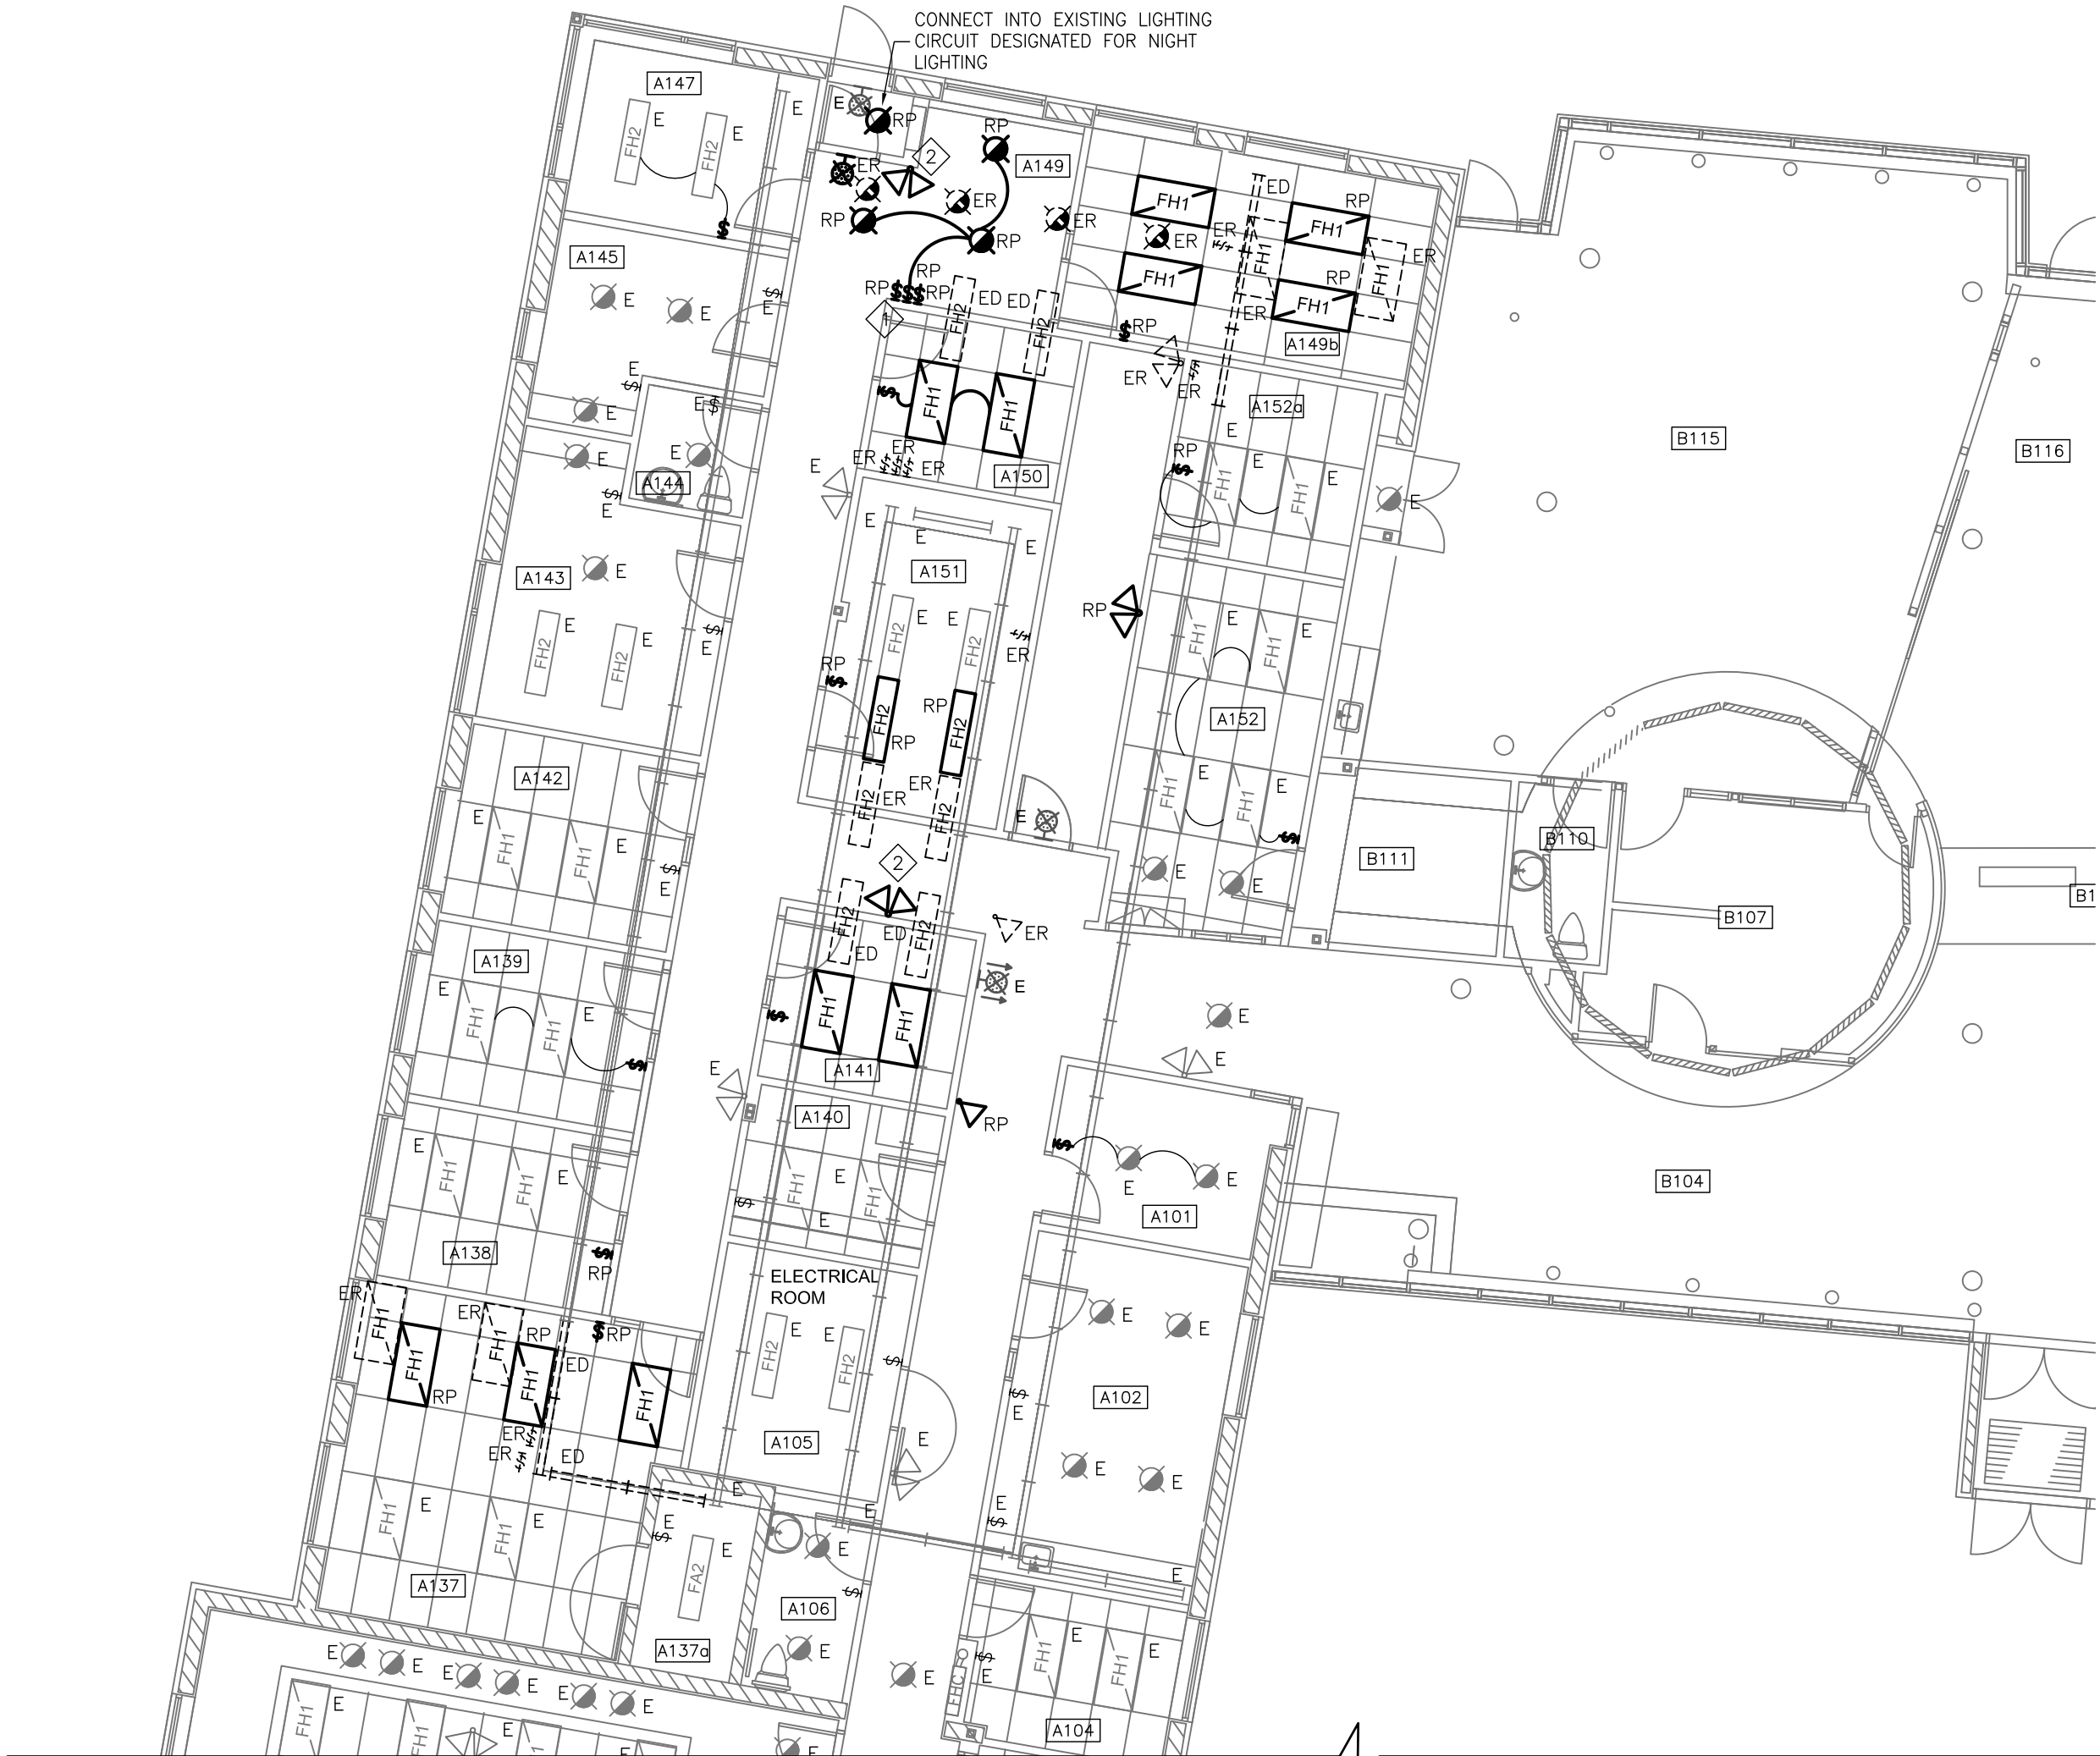

2 LIGHTING PLAN 'B'  
E2.03 1:100

01	ISSUED FOR BID	2013/10/04
----	----------------	------------

revision	description	date
----------	-------------	------

Do not scale drawings  
Verify all dimensions and conditions on site and  
Immediately notify the Departmental Representative of all  
discrepancies

A	detail no.
B	drawing no. - where detail required
C	drawing no. - where detailed

project title  
titre du projet  
GRAND VALLEY INSTITUTION FOR WOMEN  
1575 HOMER WATSON BLVD.  
KITCHENER, ONTARIO, N2P 2C5

PRINCIPAL ENTRANCE BUILDING

drawing title  
titre du dessin  
GROUND FLOOR  
LIGHTING PLANS 'A' AND 'B'

drawn by  
dessiné par OS

designed by  
conçue par OS

approved by  
approuvée par NA

bid  
offre RP project manager  
administrateur de projets

project date  
date du projet 2012-11-06

project no.  
no. du projet DIALOG NO. 09487T.02  
R.047995.001

drawing no.  
dessiné no. E2.03