

DIALOG™

stamp



04		
03		
02		
01	ISSUED FOR BID	2013/10/04
revision		date

Do not scale drawings
Verify all dimensions and conditions on site and
immediately notify the Departmental Representative of all
discrepancies

A	detail no.
B	no. du détail
C	drawing no. - where detail required dessin no. - où détail exigé
	drawing no. - where detailed dessin no. - où détaillé

project title
titre du projet

GRAND VALLEY INSTITUTION FOR WOMEN
1575 HOMER WATSON BLVD.
KITCHENER, ONTARIO, N2P 2C5

PRINCIPAL ENTRANCE BUILDING

drawing title
titre du dessin

**GROUND FLOOR
LIGHTING PLAN PEB**

drawn by
dessiné par

OS

designed by
conçu par

OS

approved by
approuvé par

NA

bid
offre

RP

project manager
administrateur
de projets

project date
date du projet

2012-11-06

project no.
no. du projet

DIALOG NO. 09487T.02
R.047995.001

drawing no.
dessiné no.


E2.01

GENERAL NOTES:

1. UNLESS DENOTES OTHERWISE, OCCUPANCY SENSORS SHALL BE 347V LINE VOLTAGE, (CEILING TYPE - 360 DEGREE, 2000 SQFT RANGE, WALL TYPE - 300 SQFT), PASSIVE INFRARED/ULTRASONIC, PROGRAMMED FOR 30 MINUTE TIMEOUT.
2. ALL EMERGENCY BATTERY PACKS TO BE 144W, 120/347VAC, 12V C/W TWO 4W LED HEADS, WHITE FINISH.
3. ALL REMOTE EMERGENCY LIGHTING HEADS TO BE SURFACE DECORATIVE LUMINARIES 12V, 4W LED, WHITE FINISH.
4. ALL EXIT SIGNS TO BE INTERNATIONAL GREEN PICTOGRAM ALUMINUM SLIM EDGE-LIT SIGN 120/347VAC, 12V C/W LONG-LIFE WHITE LED LIGHT SOURCE.

KEYNOTE: #

1. PROVIDE TWO TYPE 'P' LUMINARIES AND ONE LIGHTING SWITCH IN ELEVATOR PIT.
2. LED STRIP INTEGRATED INTO HANDRAIL. REFER TO ARCHITECTURAL DRAWINGS A5.10 - A5.13 FOR EXACT LOCATION AND DIMENSIONS. PROVIDE ONE REMOTE 200W POWER DRIVER PER 4.5 METER OF HANDRAIL. INSTALL ALL DRIVERS IN THE CEILING SPACE OF THE CORRIDOR P109 AND AS PER MANUFACTURER'S RECOMMENDATIONS.

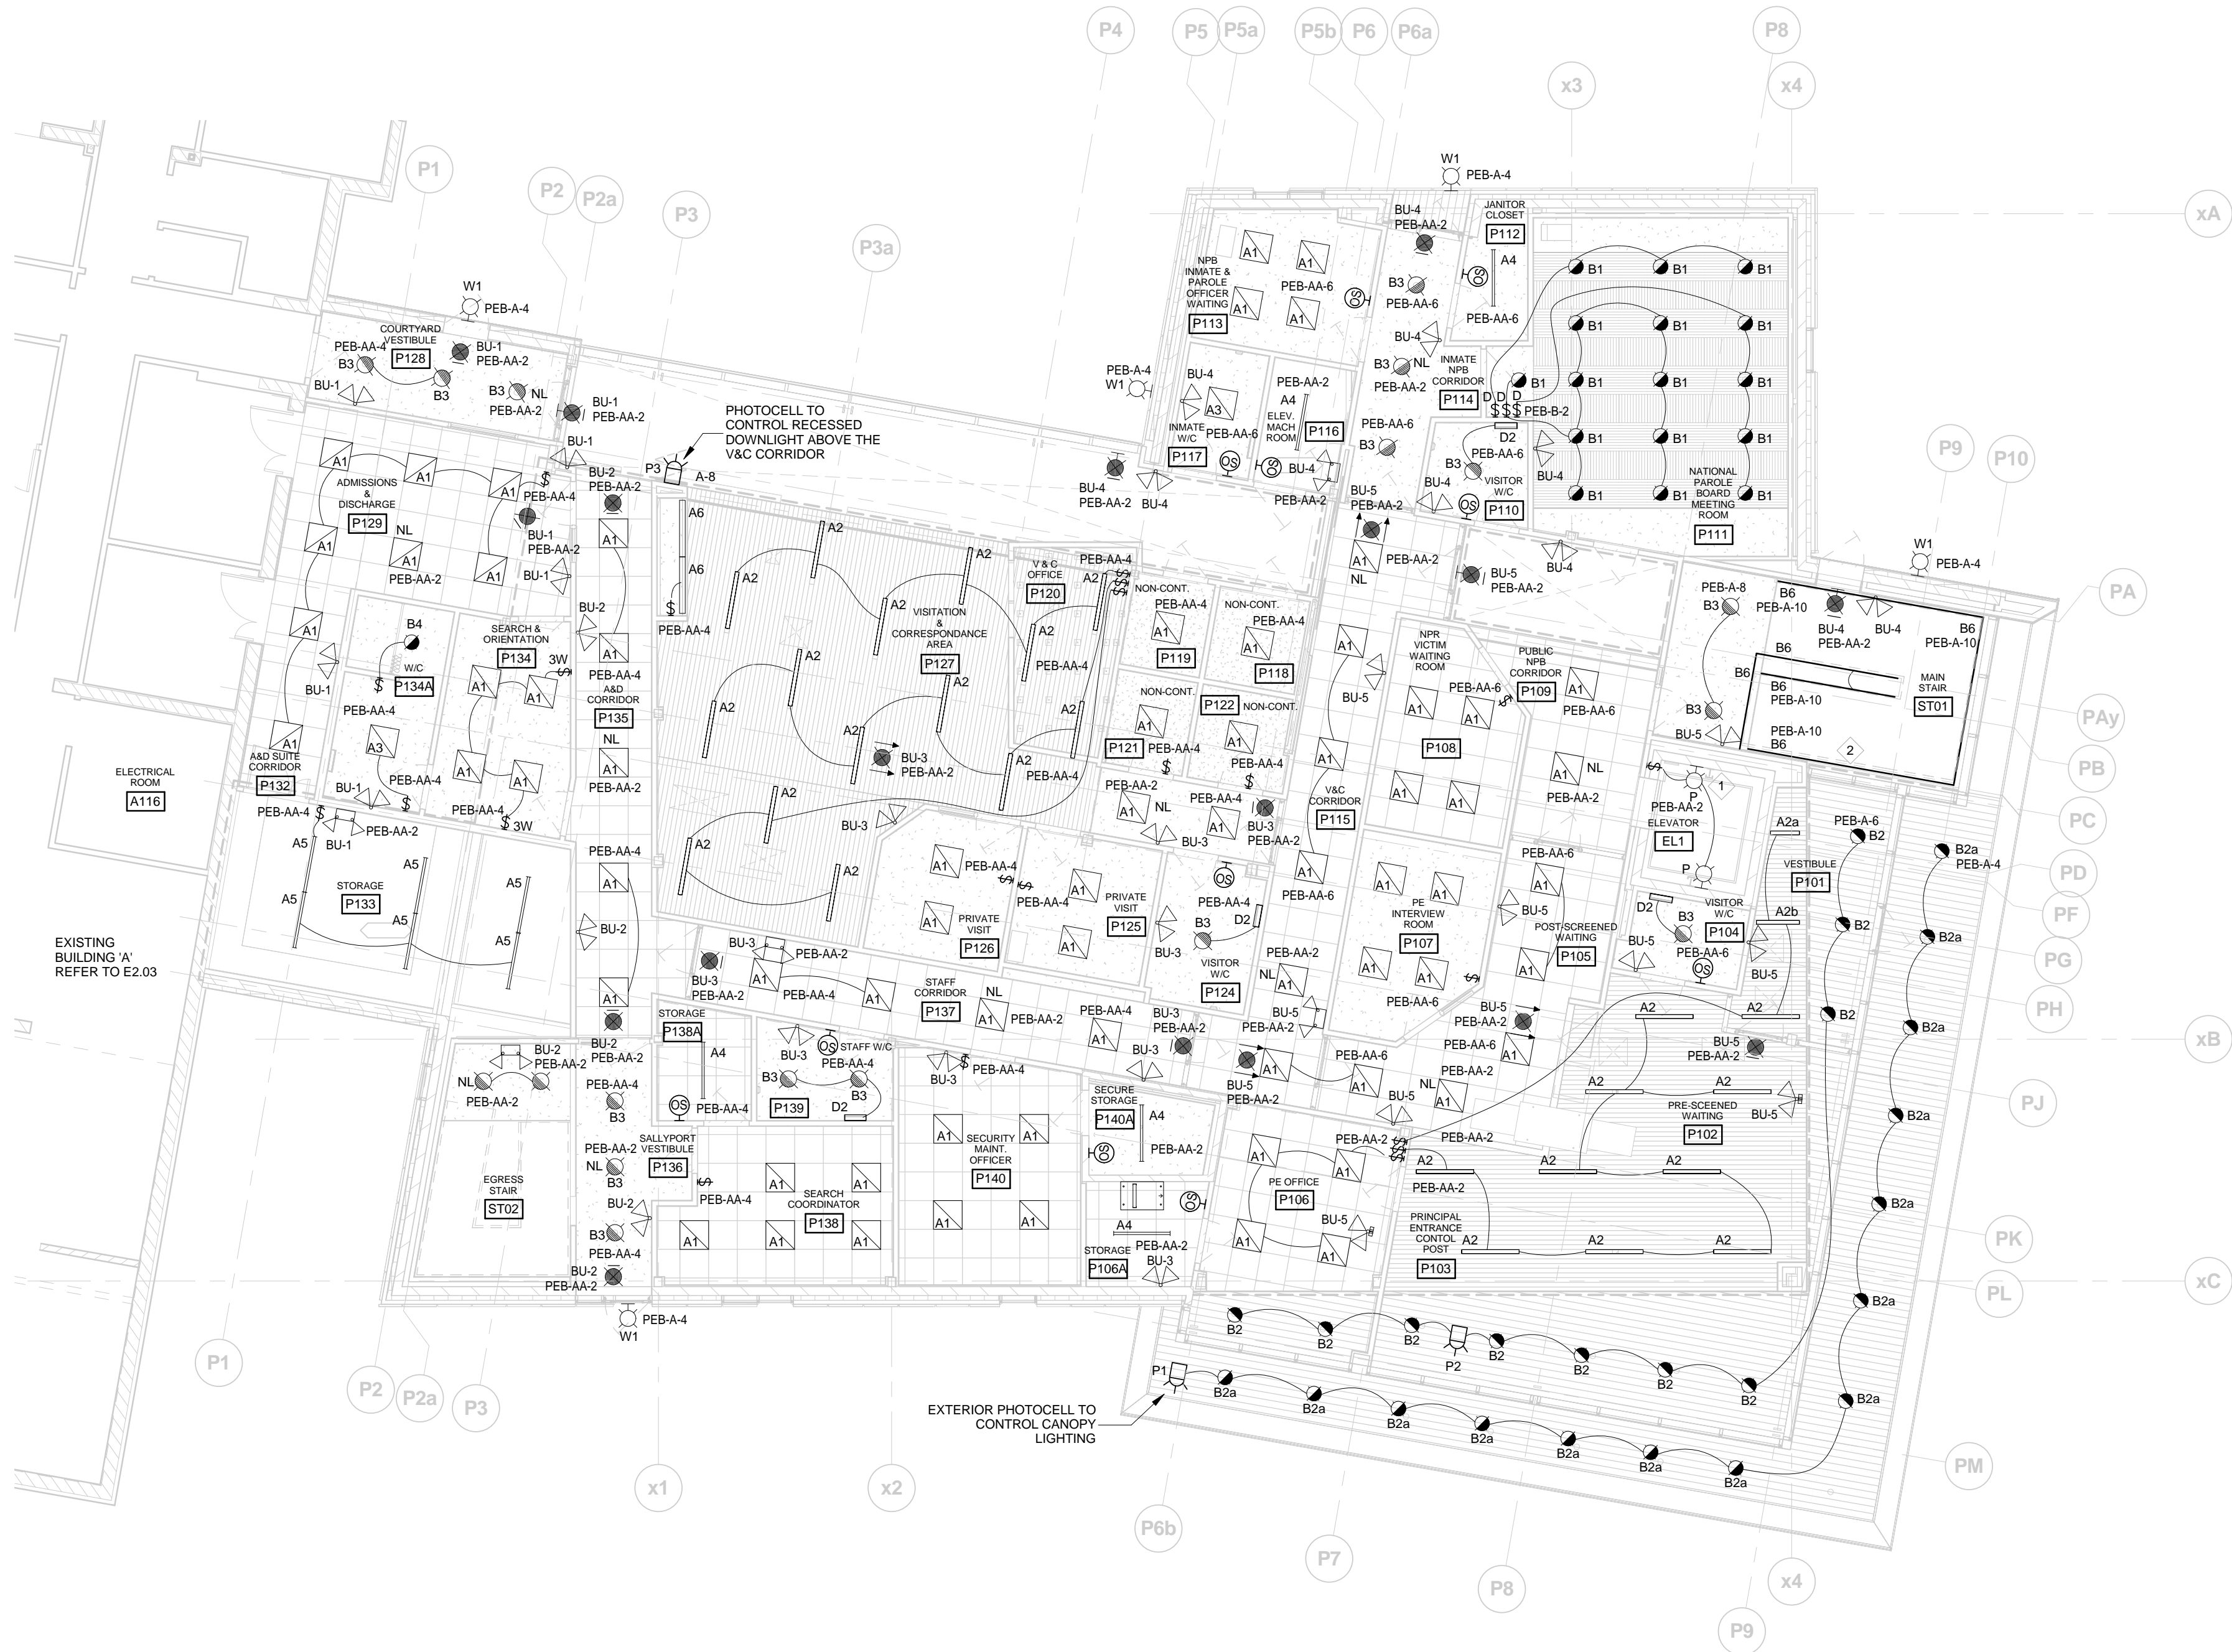

1 LIGHTING PLAN
E2.01 1:100