



SECTION 1 H03 1:20 400 0 400 800 1200mm

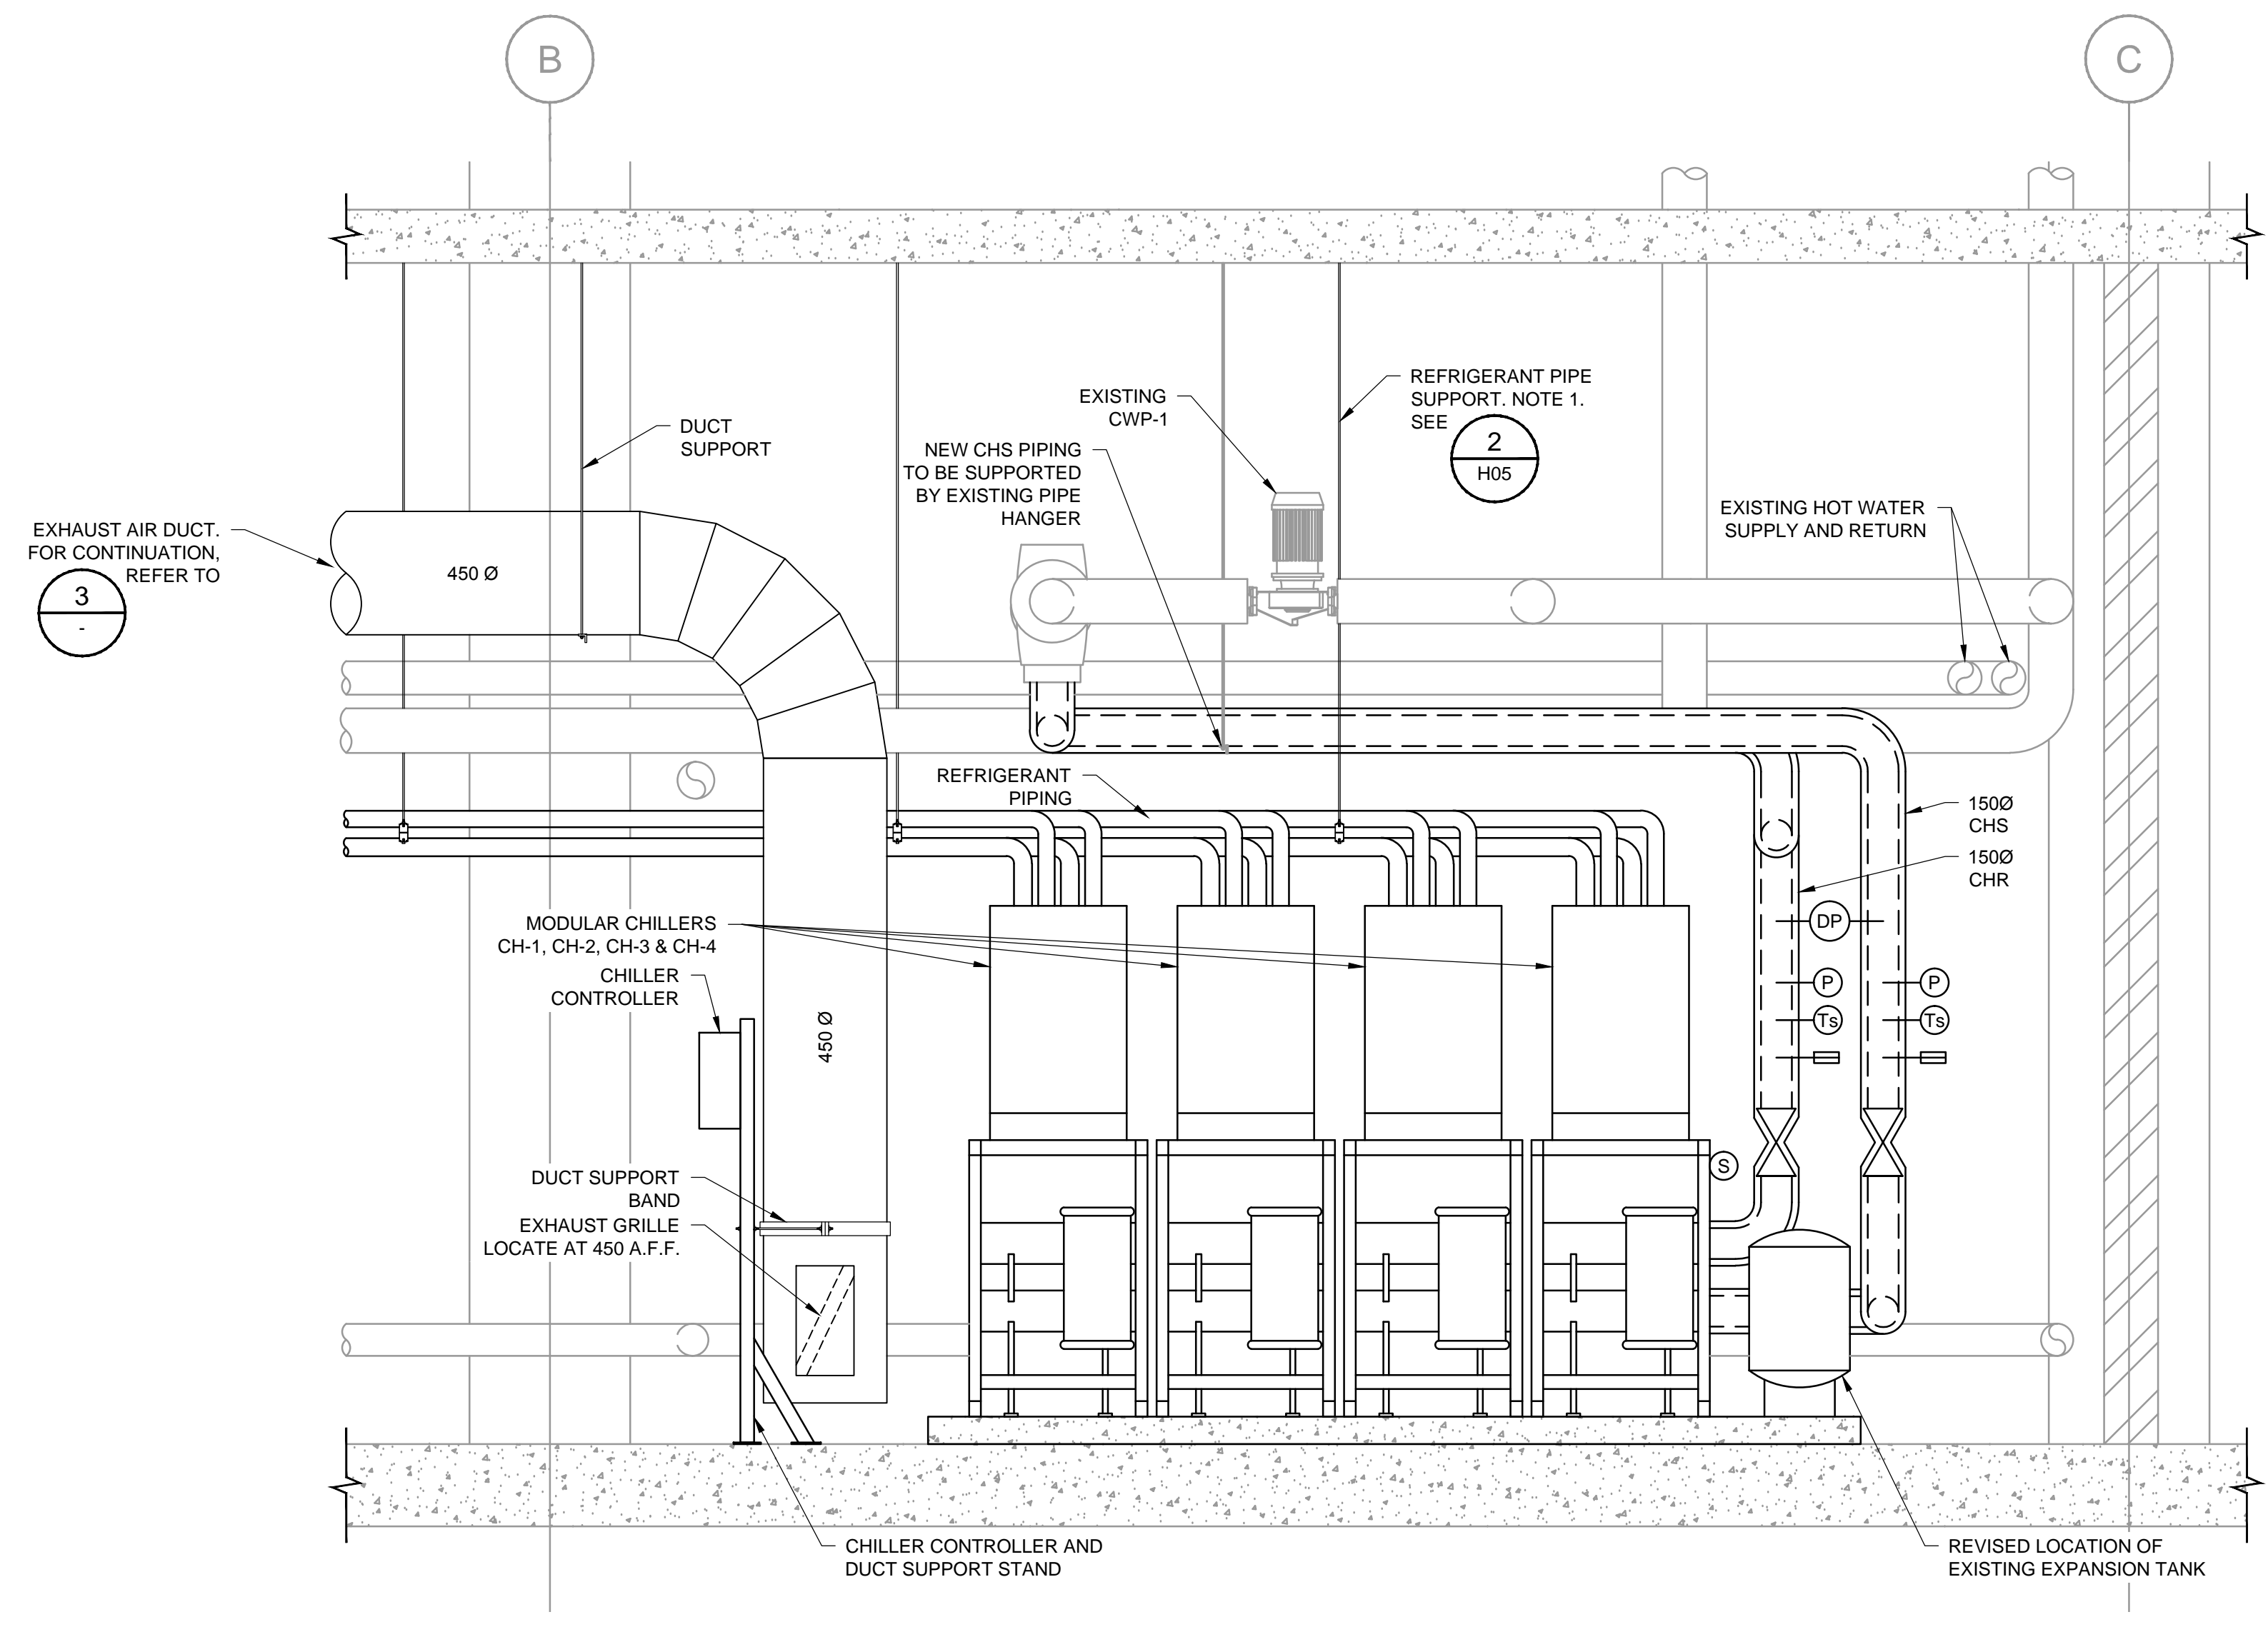

SECTION 2 H03 1:20 400 0 400 800 1200mm

- NOTES
- COORDINATE INSTALLATION WITH EXISTING MECHANICAL AND ELECTRICAL AND NEW ELECTRICAL WHERE ALTERATIONS TO THE PROPOSED LAYOUT ARE REQUIRED. SUBMIT PROPOSED CHANGES TO DEPARTMENTAL REPRESENTATIVE FOR APPROVAL, PRIOR TO PROCEEDING TO THE INSTALLATION.
 - REFRIGERANT PIPING SUPPORT SPAN TO BE 1800 mm MAXIMUM.

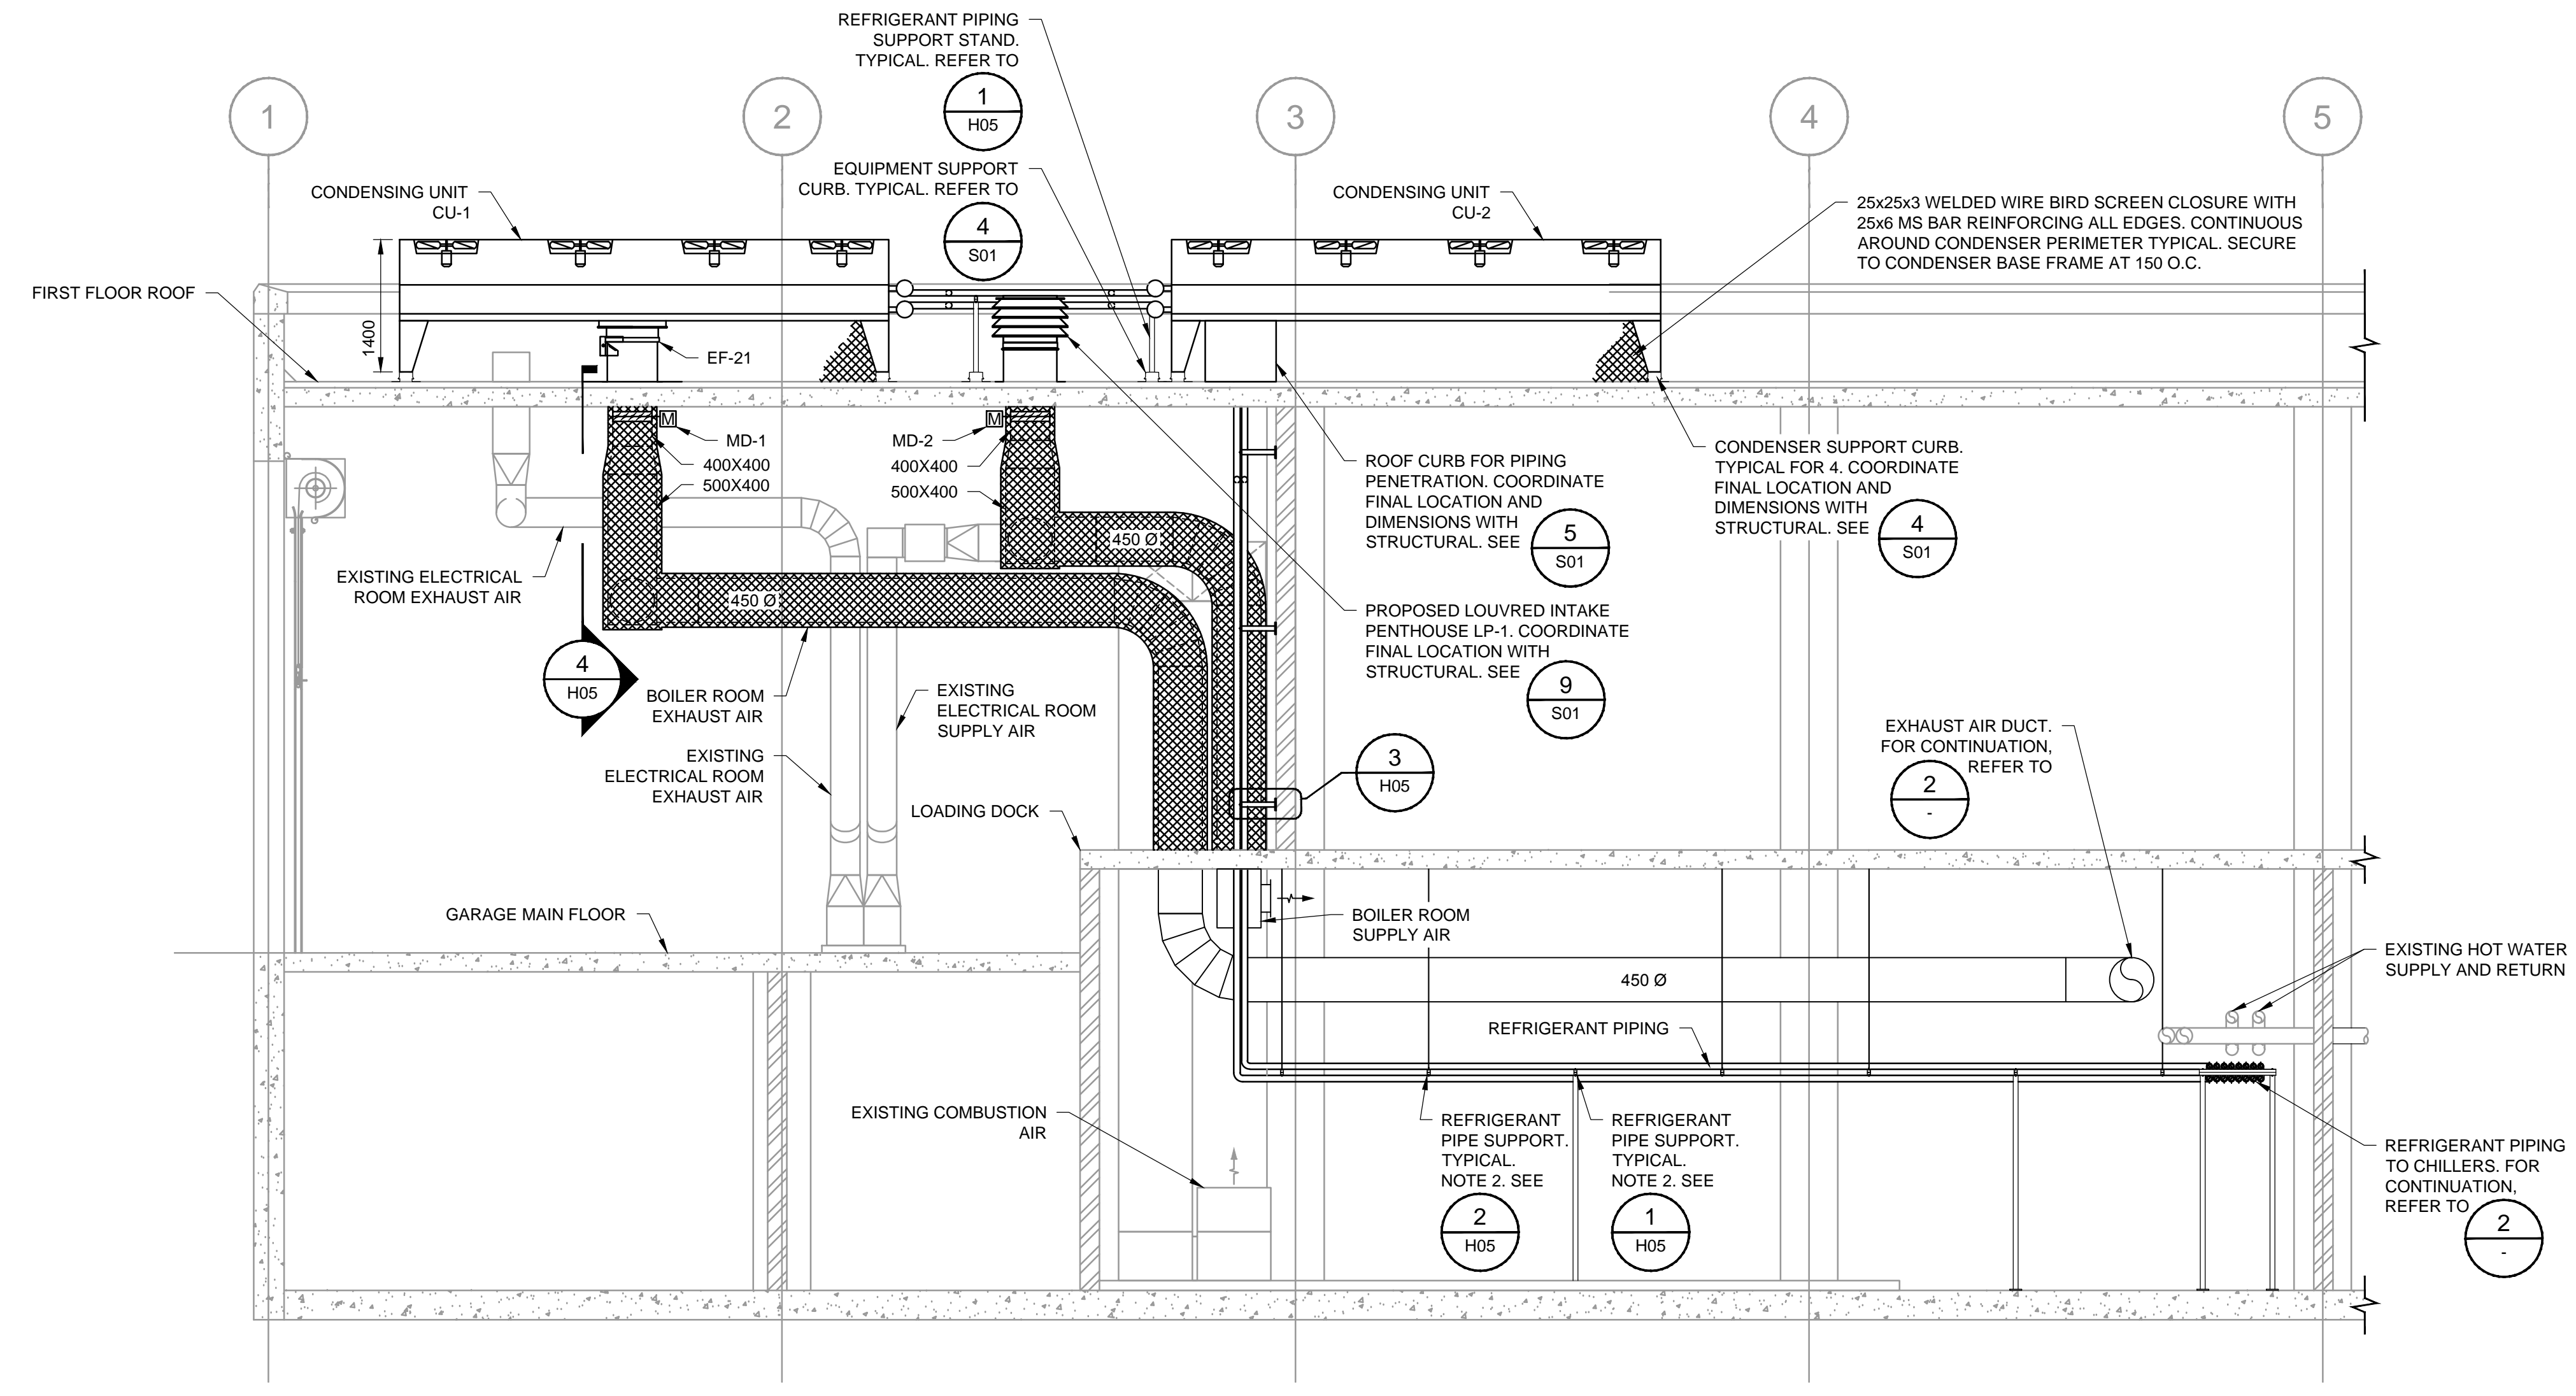

SECTION 3 H03 1:50 1 0 1 2 3m

REVISIONS	DESCRIPTION	DATE
0	ISSUED FOR TENDER	14/JUN/2013

A	A detail number
B	B source drawing no. de dessin no.

project title / titre du projet

CHILLER REPLACEMENT
GOC BUILDING

drawing title / titre du dessin

SECTIONS -
PROPOSED

designed by / conçu par
M. CLAASSEN

drawn by / dessinée par
K. ERKER

approved by / approuvée par
M. AKISTER

PWSC Project Manager / Administrateur de Projets TPSGC
DAVE CHERKEWICH

scale / échelle
AS NOTED

project no. / projet no.
R.058058.001

date / date
14/JUN/2013

H04

4 OF 7