


KEY PLAN

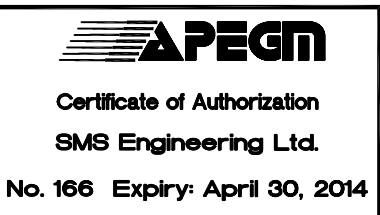

**SMS ENGINEERING**

SMS Engineering Ltd. Consulting Engineers  
770 Bradford Street Winnipeg MB Canada R3M 0K3  
Telephone: 204.775.0291 Fax: 204.772.2153  
sms@smseng.com

13-130-01

DO NOT SCALE DRAWINGS

Revised/	Description/Description	Date/Date
5		
4	Issued for Tender and Construction	Oct 10/13
3	99% Construction Documents	Aug 30/13
2	50% Construction Document Submission	Jul 19/13
1	Design Development Submission	Jun 21/13
0	Pre Design	Jun 21/13
Revision/	Description/Description	Date/Date

Client/client

Public Works and  
Government Services  
Canada

167 Lombard Avenue  
Winnipeg, Manitoba

Project title/Titre du projet

Lab Renovations  
Morden Research Station  
Morden, Manitoba

Agriculture and Agri-Food  
Canada

Approved by/Approuvé par

CO

Designed by/Concept par

RE

Drawn by/Dessiné par

JPL

PWGSC Project Manager/Administrateur de Projets TP50C

Steve Milville

PWGSC, Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TP50C

Client/client

PWGSC

Drawing title/Titre du dessin

HVAC Demolition Plan  
Laboratory Rooms:  
141,143,144,145,146,147,148,148-1,149,  
150,151

Project No./No. du projet

R.059536.001



Sheet/Feuille

M1.5

6 OF 14

Revision no./  
La Révision  
no.

4

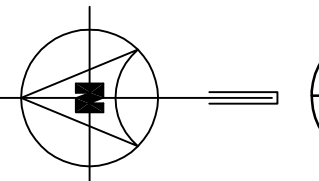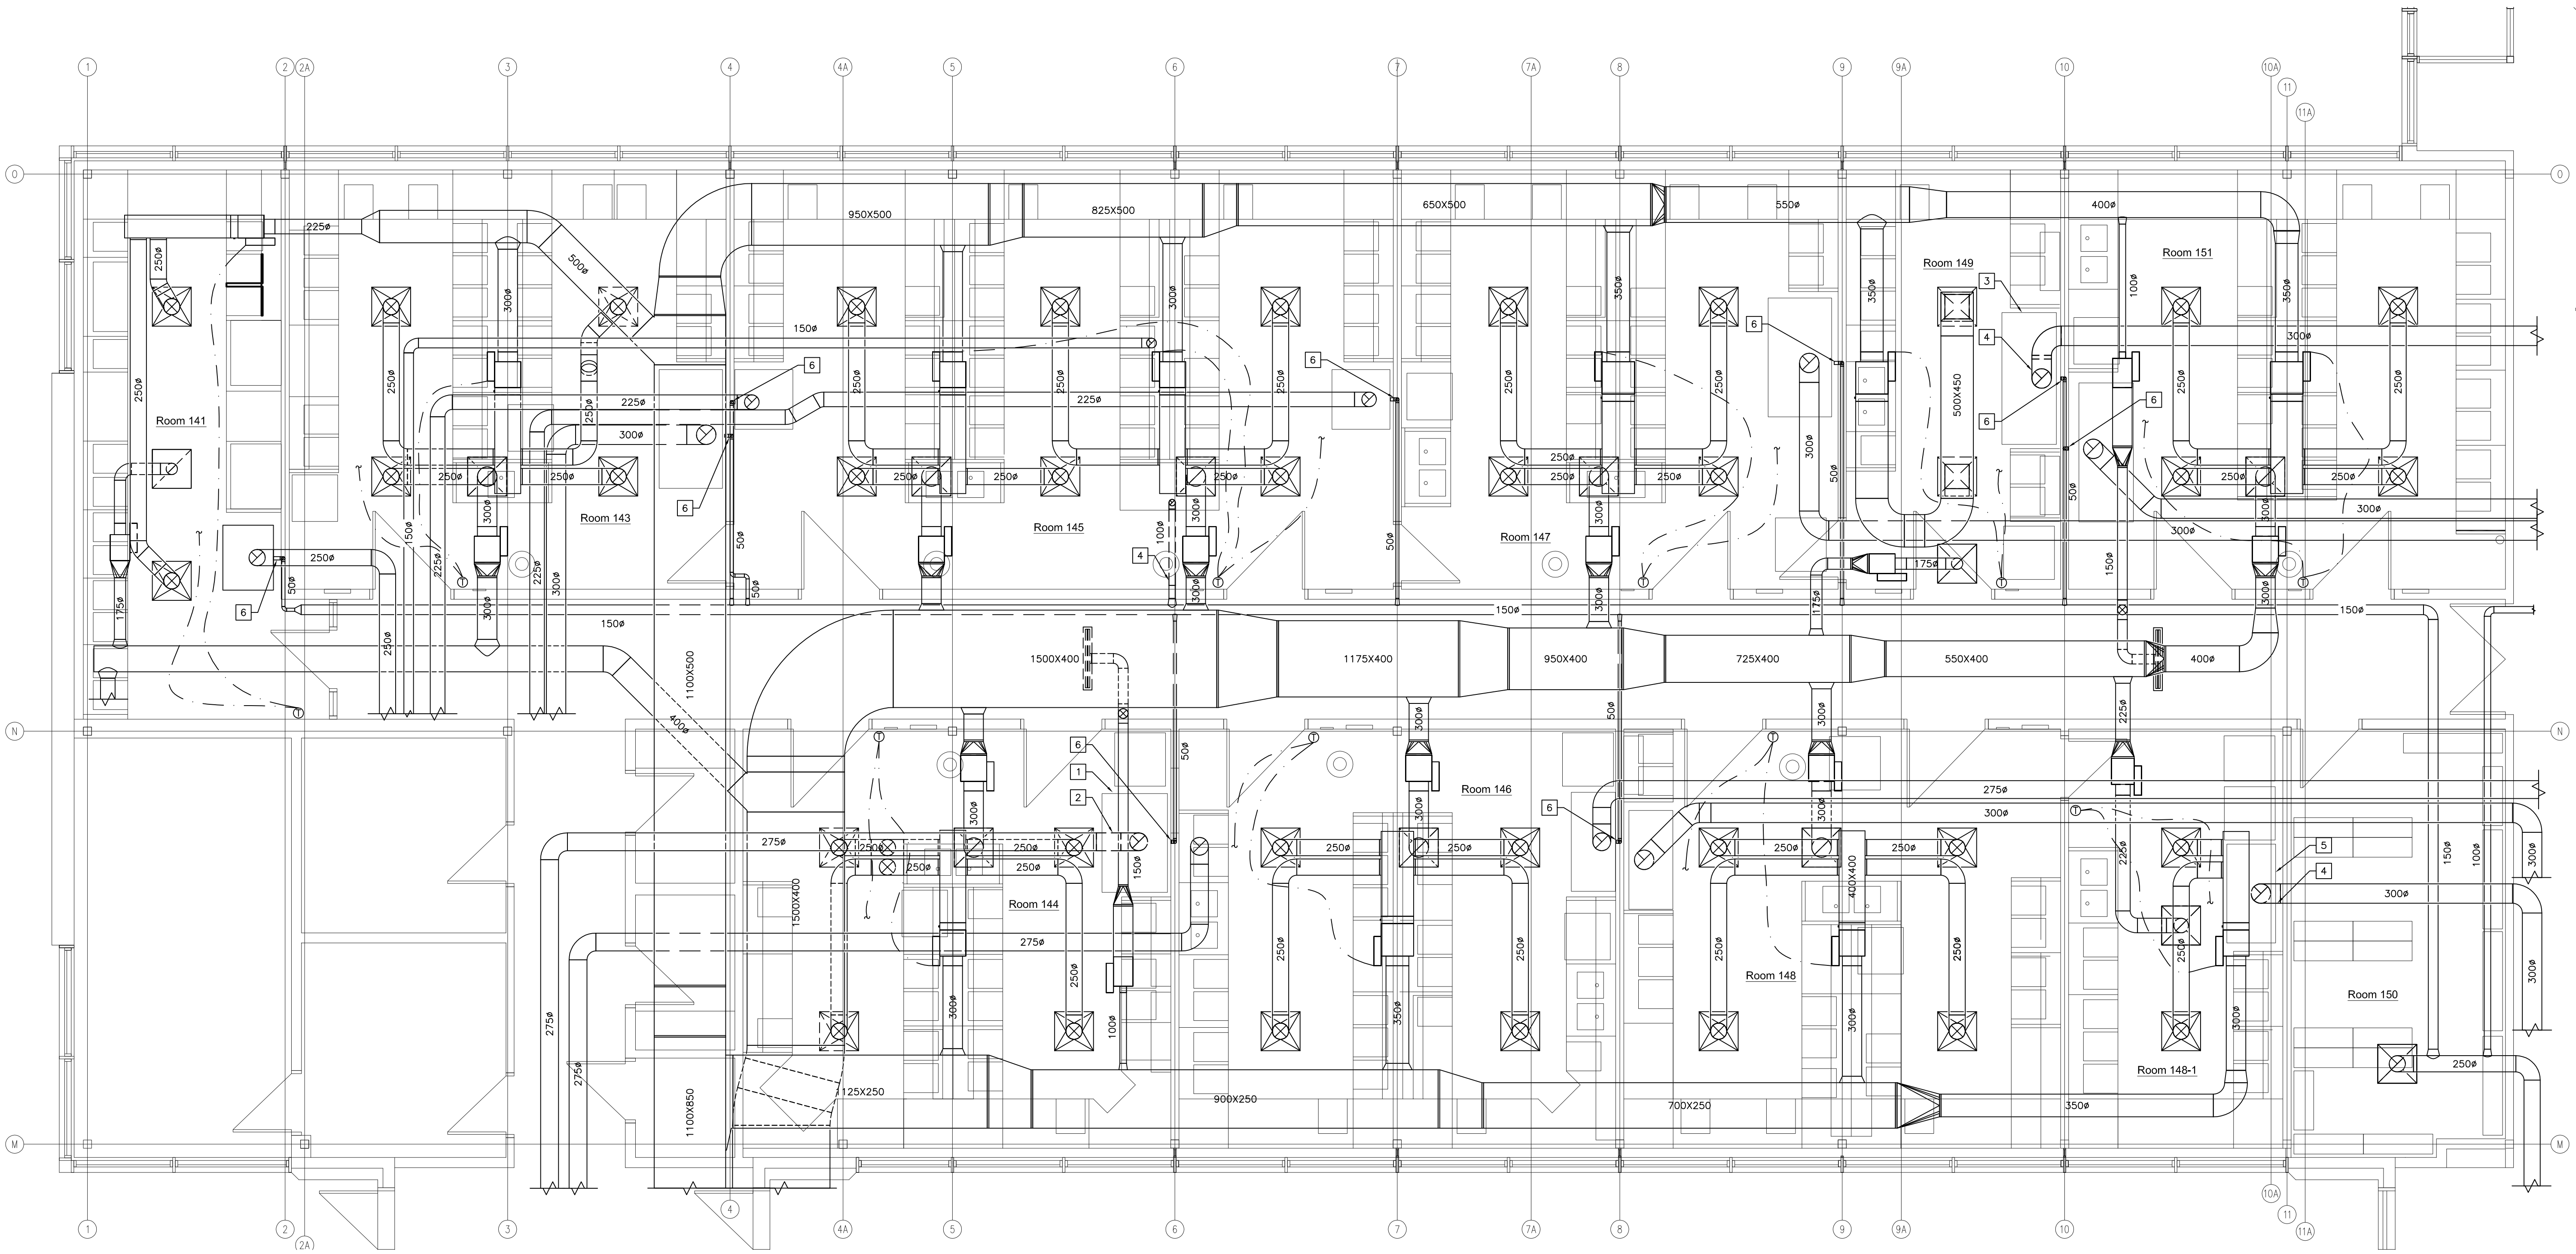

1 HVAC MAIN FLOOR DEMOLITION PLAN  
SCALE: 1:50

GENERAL NOTES

- DO NOT SCALE OFF THIS DRAWING. CONTRACTOR TO VERIFY ALL DIMENSIONS PRIOR TO INSTALLATION AND SHALL REPORT ANY DISCREPANCY TO DEPARTMENTAL REPRESENTATIVE.
- ALL EXISTING EQUIPMENT AND ASSOCIATED PIPES AND DUCTWORK TO REMAIN UNLESS OTHERWISE NOTED.
- CONFIRM EXACT SIZES AND LOCATIONS FOR ALL EXISTING SERVICES.

DEMOLITION KEY NOTES

- EXISTING FUME HOOD TO BE RELOCATED BY GENERAL CONTRACTOR. REFER TO DRAWING M3.2 FOR LOCATION.
- DISCONNECT EXISTING STAINLESS STEEL EXHAUST DUCT FROM FUME HOOD TO APPROXIMATELY AS SHOWN. REFER TO DRAWING M3.2 FOR RECONNECTION OF DUCT.
- EXISTING FUME HOOD TO BE REMOVED BY AAFIC PRIOR TO CONSTRUCTION.
- EXISTING STAINLESS STEEL EXHAUST DUCT TO BE REMOVED AND CAPPED-OFF APPROXIMATELY AS SHOWN. REFER TO DRAWING M3.2 FOR LOCATION OF NEW DUCT CAP.
- EXISTING FUME HOOD TO BE RELOCATED TO ROOM 1-70 BY GENERAL CONTRACTOR. REFER TO DRAWING M3.3.
- TEMPORARILY DISCONNECT EXISTING EXHAUST DROPS CONNECTED TO EXISTING STORAGE CABINET LOCATED BELOW FUME HOOD.