


KEY PLAN

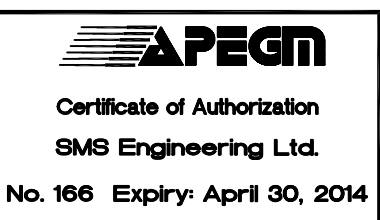

**SMS ENGINEERING**

SMS Engineering Ltd. Consulting Engineers  
770 Bradford Street Winnipeg MB Canada R3M 0K3  
Telephone: 204.775.0291 Fax: 204.772.2153  
sms@smseng.com

13-130-01

DO NOT SCALE DRAWINGS

Revisions	Description/Description	Date/Date
5		
4	Issued for Tender and Construction	Oct 10, 13
3	99% Construction Documents	Aug 30, 13
2	50% Construction Document Submission	Jul 19, 13
1	Design Development Submission	Jun 21, 13
0	Pre Design	Jun 21, 13
Revision/Revision	Description/Description	Date/Date

Client/client

Public Works and  
Government Services  
Canada

167 Lombard Avenue  
Winnipeg, Manitoba

Project title/Titre du projet  
**Lab Renovations  
Morden Research Station  
Morden, Manitoba**

**Agriculture and Agri-Food  
Canada**

Approved by/Approuvé par

CO

Designed by/Concept par

RE

Drawn by/Dessiné par

JPL

PWGSC Project Manager/Administrateur de Projets TPSC

Steve Milville

PWGSC Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TPSC

-

Client/client

PWGSC

Drawing title/Titre du dessin

**HVAC Demolition Plan  
Laboratory Rooms:  
163, 164, 166, 167, 168, 169, 170,  
171**

Project No./No. du projet

**R.059536.001**



Sheet/Feuille

**M1.6**

7 OF 14

Revision no./  
La Révision  
no.

**4**

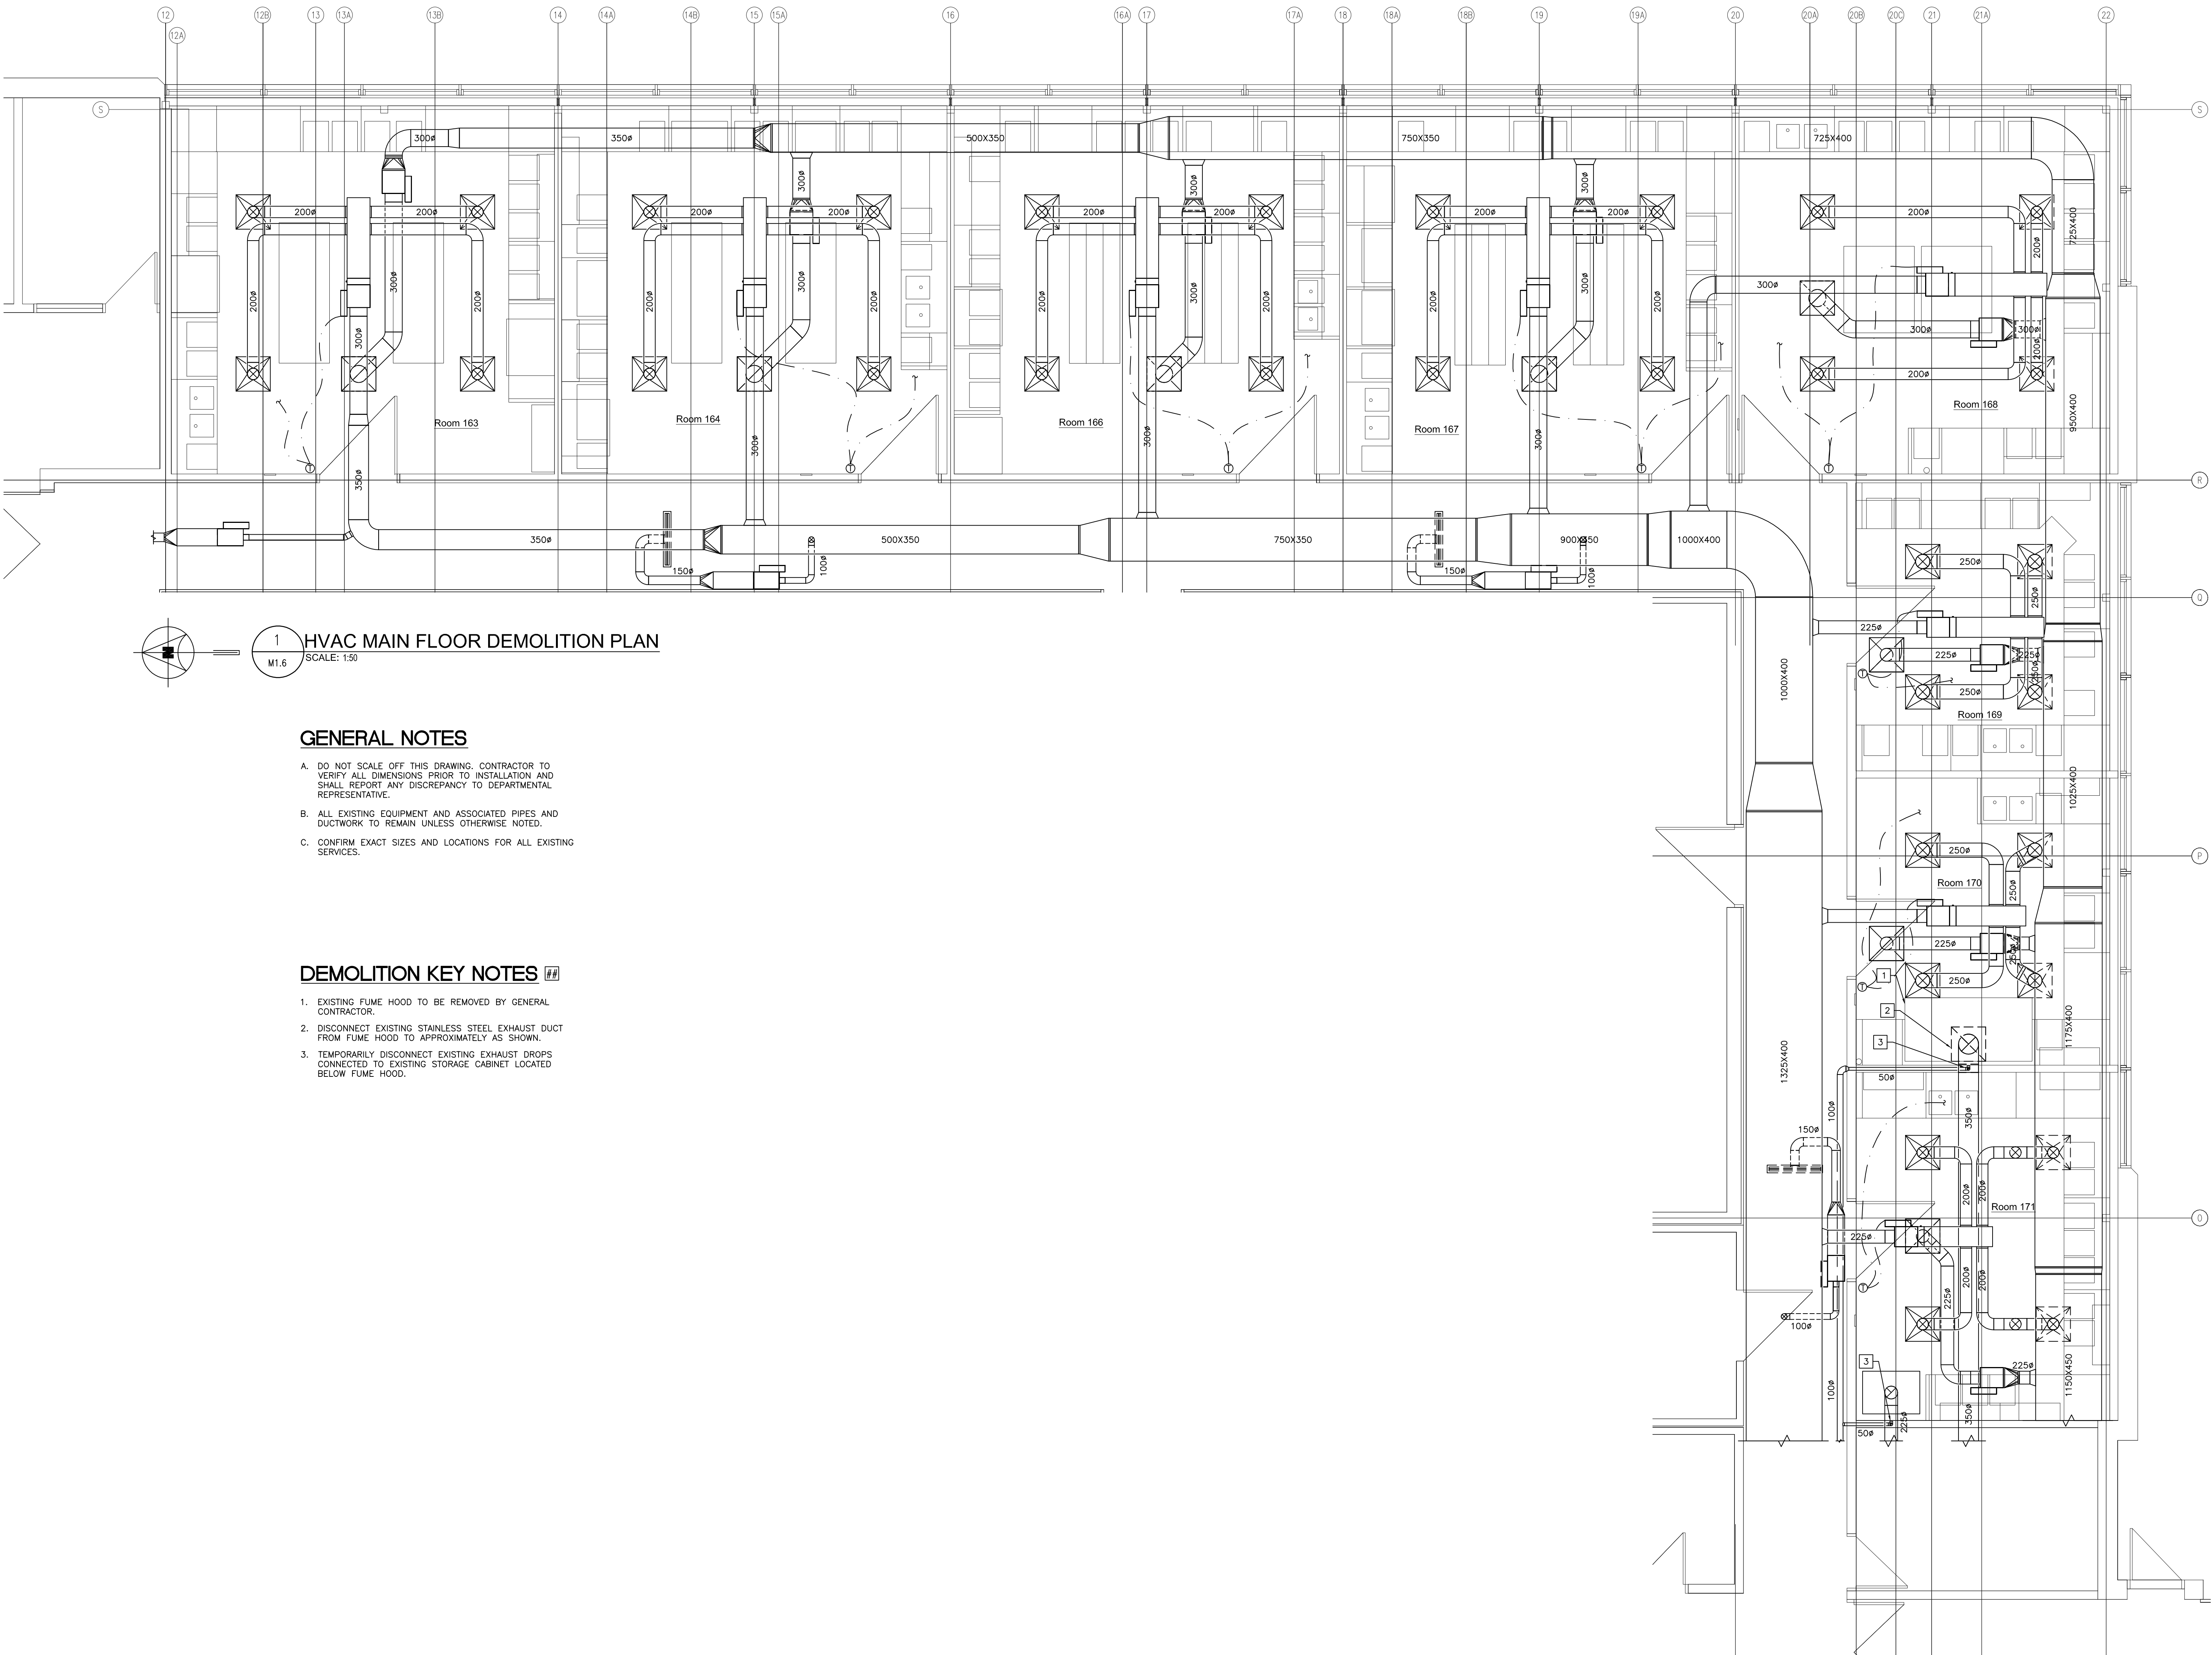

1 HVAC MAIN FLOOR DEMOLITION PLAN  
SCALE: 150

GENERAL NOTES

- DO NOT SCALE OFF THIS DRAWING. CONTRACTOR TO VERIFY ALL DIMENSIONS PRIOR TO INSTALLATION AND SHALL REPORT ANY DISCREPANCY TO DEPARTMENTAL REPRESENTATIVE.
- ALL EXISTING EQUIPMENT AND ASSOCIATED PIPES AND DUCTWORK TO REMAIN UNLESS OTHERWISE NOTED.
- CONFIRM EXACT SIZES AND LOCATIONS FOR ALL EXISTING SERVICES.

DEMOLITION KEY NOTES ##

- EXISTING FUME HOOD TO BE REMOVED BY GENERAL CONTRACTOR.
- DISCONNECT EXISTING STAINLESS STEEL EXHAUST DUCT FROM FUME HOOD TO APPROXIMATELY AS SHOWN.
- TEMPORARILY DISCONNECT EXISTING EXHAUST DROPS CONNECTED TO EXISTING STORAGE CABINET LOCATED BELOW FUME HOOD.