

This drawing and all its contents are protected by copyright and shall not be reproduced, in whole or in part, without the expressed written consent of Field, Field & Field Architecture - Engineering Ltd. These drawings are not to be scaled. All dimensions are to face of stud or sheathing unless noted otherwise. Contractor must verify all job dimensions, all drawings, details, and specifications. Any discrepancies are to be reported to the Architect prior to proceeding with work; this includes any errors and/or omissions.

ARCHITECT
FIELD FIELD & FIELD

Architecture - Engineering Ltd.
No. 100 WINDSOR COURT 9835 - 101 AVENUE,
GRANDE PRAIRIE ALBERTA T8V 5V4
PHONE (780) 532-3690



PERMIT TO PRACTICE
FIELD FIELD & FIELD
Signature _____
Date _____
PERMIT NUMBER P 205
The Association of Professional Engineers,
Geologists and Geophysicists of Alberta.

#	####	####
#	####	####
3	TENDER	NOV 4/13
2	99% REVIEW	OCT 21/13
1	66% REVIEW	SEPT 17/13
0	PRELIMINARY	AUG 22/13
Revision/	Description/Description	Date/Date
Revision/		

Client/client
CORRECTIONAL SERVICES CANADA

Project title/Titre du projet
**GRANDE CACHE INSTITUTION
Bag 4000
GRANDE CACHE, ALBERTA
FOOD SERVICES
DISH ROOM REVITALIZATION**

Approved by/Approuvé par
JRF
Designed by/Concepté par
YMO
Drawn by/Dessiné par
YMO
PWGSC Project Manager/Administrateur de Projets TPSCG
YVON LABRECQUE
PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPSCG
Client/client
RON J. FAHL
Drawing title/Titre du dessin
**DISH WASH ROOM DEMOLITION PLAN
DISH WASH ROOM RENOVATION PLAN**


Project No./No. du projet	Sheet/Fauille	Revision no./La Révision no.
R.061948.001	M3 OF 3	2

ASSEMBLY NOTES


- 1 REMOVE EXISTING EXHAUST AIR DUCT & GRILLE AS NOTED BY HIDDEN LINES. REMOVE ALL ABANDONED MATERIAL FROM THE SITE.
- 2 REMOVE EXISTING SUPPLY AIR GRILLE AS DENOTED BY 'A'. REMOVE ALL ABANDONED MATERIAL FROM THE SITE.
- 3 CONNECT NEW EXHAUST AIR BRANCH TO EXISTING 406Ø EXHAUST AIR MAIN, IN CEILING SPACE, AT THIS APPROXIMATE LOCATION. CONFIRM CONDITIONS/LOCATIONS ON THE SITE.
- 4 MAKE REQUIRED EXHAUST AIR DUCTWORK CONNECTIONS TO NEW AUTOMATIC DISHWASHER UNIT. NEW EXHAUST DUCTWORK SHALL BE EXPOSED IN KITCHEN AND RUN STRAIGHT UP INTO CEILING SPACE TO CONNECT TO EXISTING EXHAUST AIR MAIN. ALL EXPOSED DUCTWORK SHALL BE CONSTRUCTED FROM 'STAINLESS STEEL'.
- 5 CONNECT NEW SUPPLY AIR DIFFUSER AS REQUIRED. CONFIRM EXACT CONDITIONS/REQUIREMENTS ON THE SITE.
- 6 PROVIDE NEW BALANCING DAMPERS AT THIS APPROXIMATE LOCATION. CONFIRM CONDITIONS/LOCATIONS ON THE SITE.

GENERAL NOTES:


- DRAWINGS ARE DIAGRAMMATIC. CONTRACTORS SHALL BE RESPONSIBLE FOR CONFIRMING ALL SITE CONDITIONS AND COORDINATION WITH OTHER TRADES PRIOR TO COMMENCING WORK.
- CONFIRM ALL REQUIREMENTS, LOCATIONS, CONDITIONS AND DIMENSIONS PRIOR TO COMMENCING WORK. COORDINATE ALL MECHANICAL INSTALLATIONS WITH ARCHITECTURAL, STRUCTURAL AND ELECTRICAL LAYOUTS PRIOR TO COMMENCING ANY WORK AND MAKE ANY MINOR ADJUSTMENTS IN LAYOUTS AS NECESSARY TO ACCOMMODATE NEW INSTALLATIONS.
- CONFIRM EXACT LOCATIONS AND METHODS FOR PIPING, DUCTWORK AND EQUIPMENT SUPPORTS ON THE SITE PRIOR TO INSTALLATIONS.
- CONFIRM ALL GRADE, ELEVATIONS AND ROUTES OF PIPING AND DUCTWORK SYSTEMS PRIOR TO COMMENCING INSTALLATION OF ALL WORK.
- ALL WORK AND MATERIALS SHALL COMPLY WITH THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS.
- REMOVE FROM THE SITE ALL ABANDONED MATERIALS.
- SUFFIXES:
'A' - EXISTING FIXTURE TO BE DISCONNECTED AND REMOVED FROM THE SITE.
'E' - EXISTING FIXTURE TO REMAIN
'N' - NEW FIXTURE TO BE SUPPLIED AND INSTALLED UNDER THIS SCOPE OF WORK

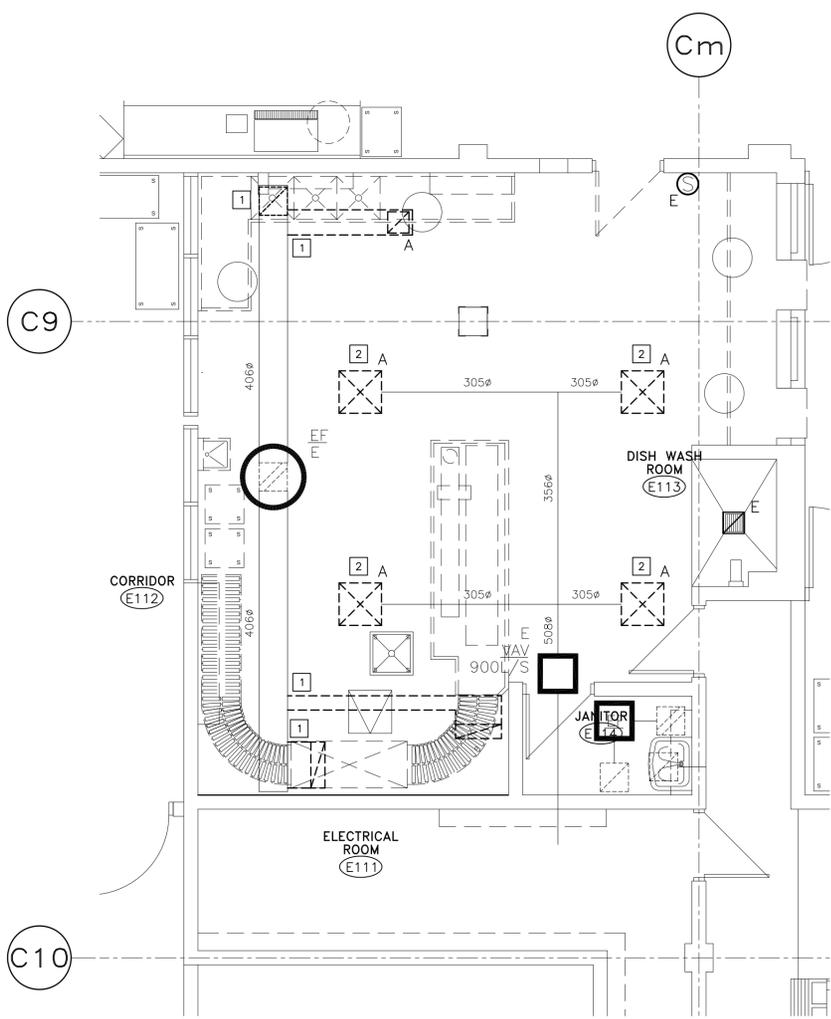


1
DISH WASH ROOM
HVAC DEMOLITION PLAN
SCALE: 1:50
M3

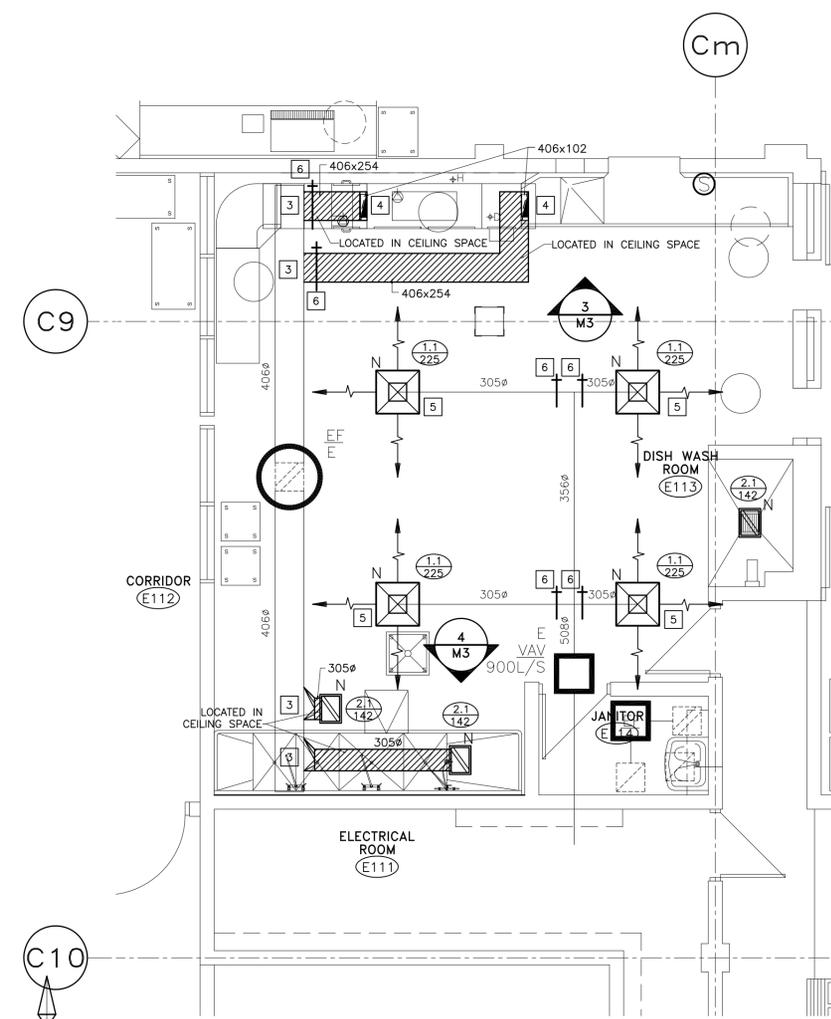

2
DISH WASH ROOM
HVAC RENOVATION PLAN
SCALE: 1:50
M3

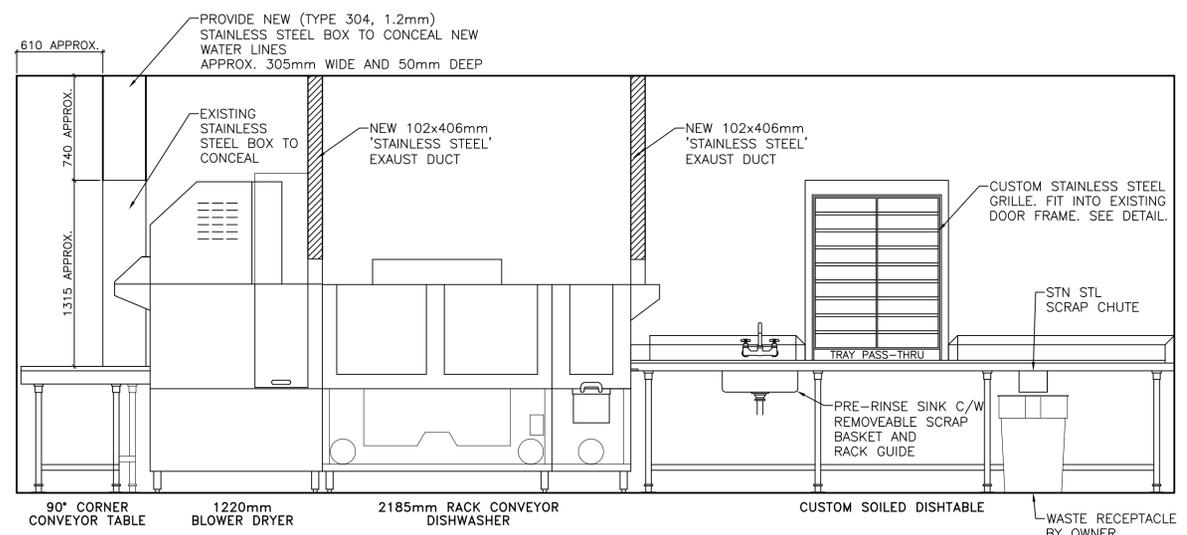

3
DISH WASH ROOM
ELEVATION
SCALE: 1:25
M3

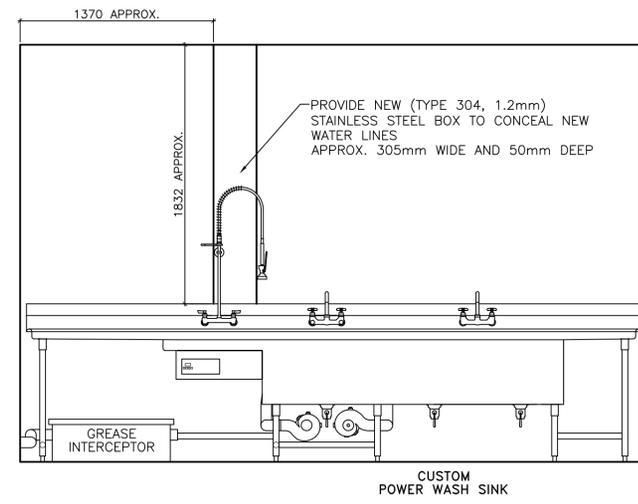

4
DISH WASH ROOM
ELEVATION
SCALE: 1:25
M3

