


GENERAL NOTES

- 1 DIVISION 26 SHALL COORDINATE WITH DIVISION 23 TO TAKE DOWN AND REINSTALL EXISTING ELECTRICAL DEVICES, EQUIPMENT, LUMINAIRES AND SPEAKERS ON THE CEILING WHERE REQUIRED TO FACILITATE MECHANICAL INSTALLATION. DRAWINGS DO NOT SHOW EXISTING INSTALLATION. DIVISION 26 SHALL VERIFY ON SITE.
- 2 REMOVE ELECTRICAL CABLES OF EXISTING RE-HEAT COILS (2) BACK TO SOURCE. COORDINATE DEMOLITION WORK WITH DIVISION 23.
- 3 PROVIDE A 15A/120V CIRCUIT IN A JUNCTION BOX IN MECHANICAL FAN ROOM FOR USE BY DIVISION 23 FOR CONTROLS AND VAV BOXES. COORDINATE DIVISION 23 TO DETERMINE LOCATION OF JUNCTION BOX.
- 4 REMOVE ELECTRICAL CABLES FOR EXISTING RE-HEAT COIL (1) BACK TO SOURCE. COORDINATE DEMOLITION WORK WITH DIVISION 23.
- 5 DEMOLISH/REPLACE EXISTING PANEL BE-6-4-1 WITH NEW 42 CIRCUIT PANEL. FED FROM PANEL BE-6-4 C/W NEW BREAKERS AS SHOWN IN DETAIL 1/E-02. PANEL FEEDER SHALL BE MINIMUM 4#3 RW90 PLUS #6 BONDING WIRE IN 35mm EMT.
- 6 PROVIDE 15A 1 POLE BREAKERS (4) IN EXISTING FEDERAL PIONEER PANEL BE6-6. BREAKER SHALL BE COMPATIBLE WITH EXISTING PANEL.
- 7 PROVIDE 15A, 600V, 2 POLE BREAKERS (3) IN EXISTING FEDERAL PIONEER PANEL LE6-6. BREAKER SHALL BE COMPATIBLE WITH EXISTING PANEL.
- 8 DIVISION 26 SHALL REVISE PANEL DIRECTORY TO REFLECT CHANGES.
- 9 RECONNECT EXISTING CIRCUITS TO NEW PANEL BE 6-4-1. BREAKERS ARE 1-POLE 15-20 AMP RATED. CONTRACTOR SHALL VERIFY ON SITE AND INDICATE THE BREAKER RATING ON SHOP DRAWINGS.
- 10 FED THROUGH LUGS FROM PANEL BE-6-4
- 11 WIRE UNIT TO LE-7-5 LOCATED IN ELECTRICAL ROOM ON FLOOR ABOVE. RE-USE EXISTING CONDUIT.

NEW PANEL BE-6-4-1

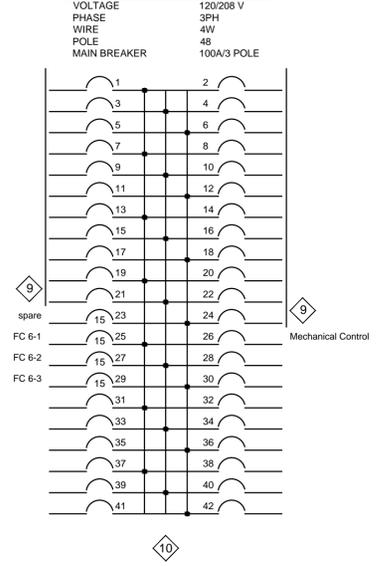

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

revisions	description	date
A	A detail no. du detail	A
C	B location drawing no. sur dessin no.	B C
	C drawing no. dessin no.	

project **6TH FLOOR EDDY MECHANICAL SERVICES** projet

15 EDDY STREET GATINEAU, QC

ELECTRICAL PLAN - WEST

scale 1:100

Designed By	A. NG	01/08/18
Date		(2013/03/31)
Drawn By	C. REDDEN	01/08/18
Date		(2013/03/31)
Reviewed By	P. SEGUIN	01/08/18
Date		(2013/07/18)
Approved By	LAN CHI NGUYEN WEEKES	01/08/18
Date		(2013/07/18)
Tender		Soumission

Project Manager / Administrateur de projets
Project no. / No. du projet
R.059180.005
Drawing no. / No. du dessin
E-2