




1 MECHANICAL DETAIL -- ROOM 102-103 (NEW)
M-6 1:50

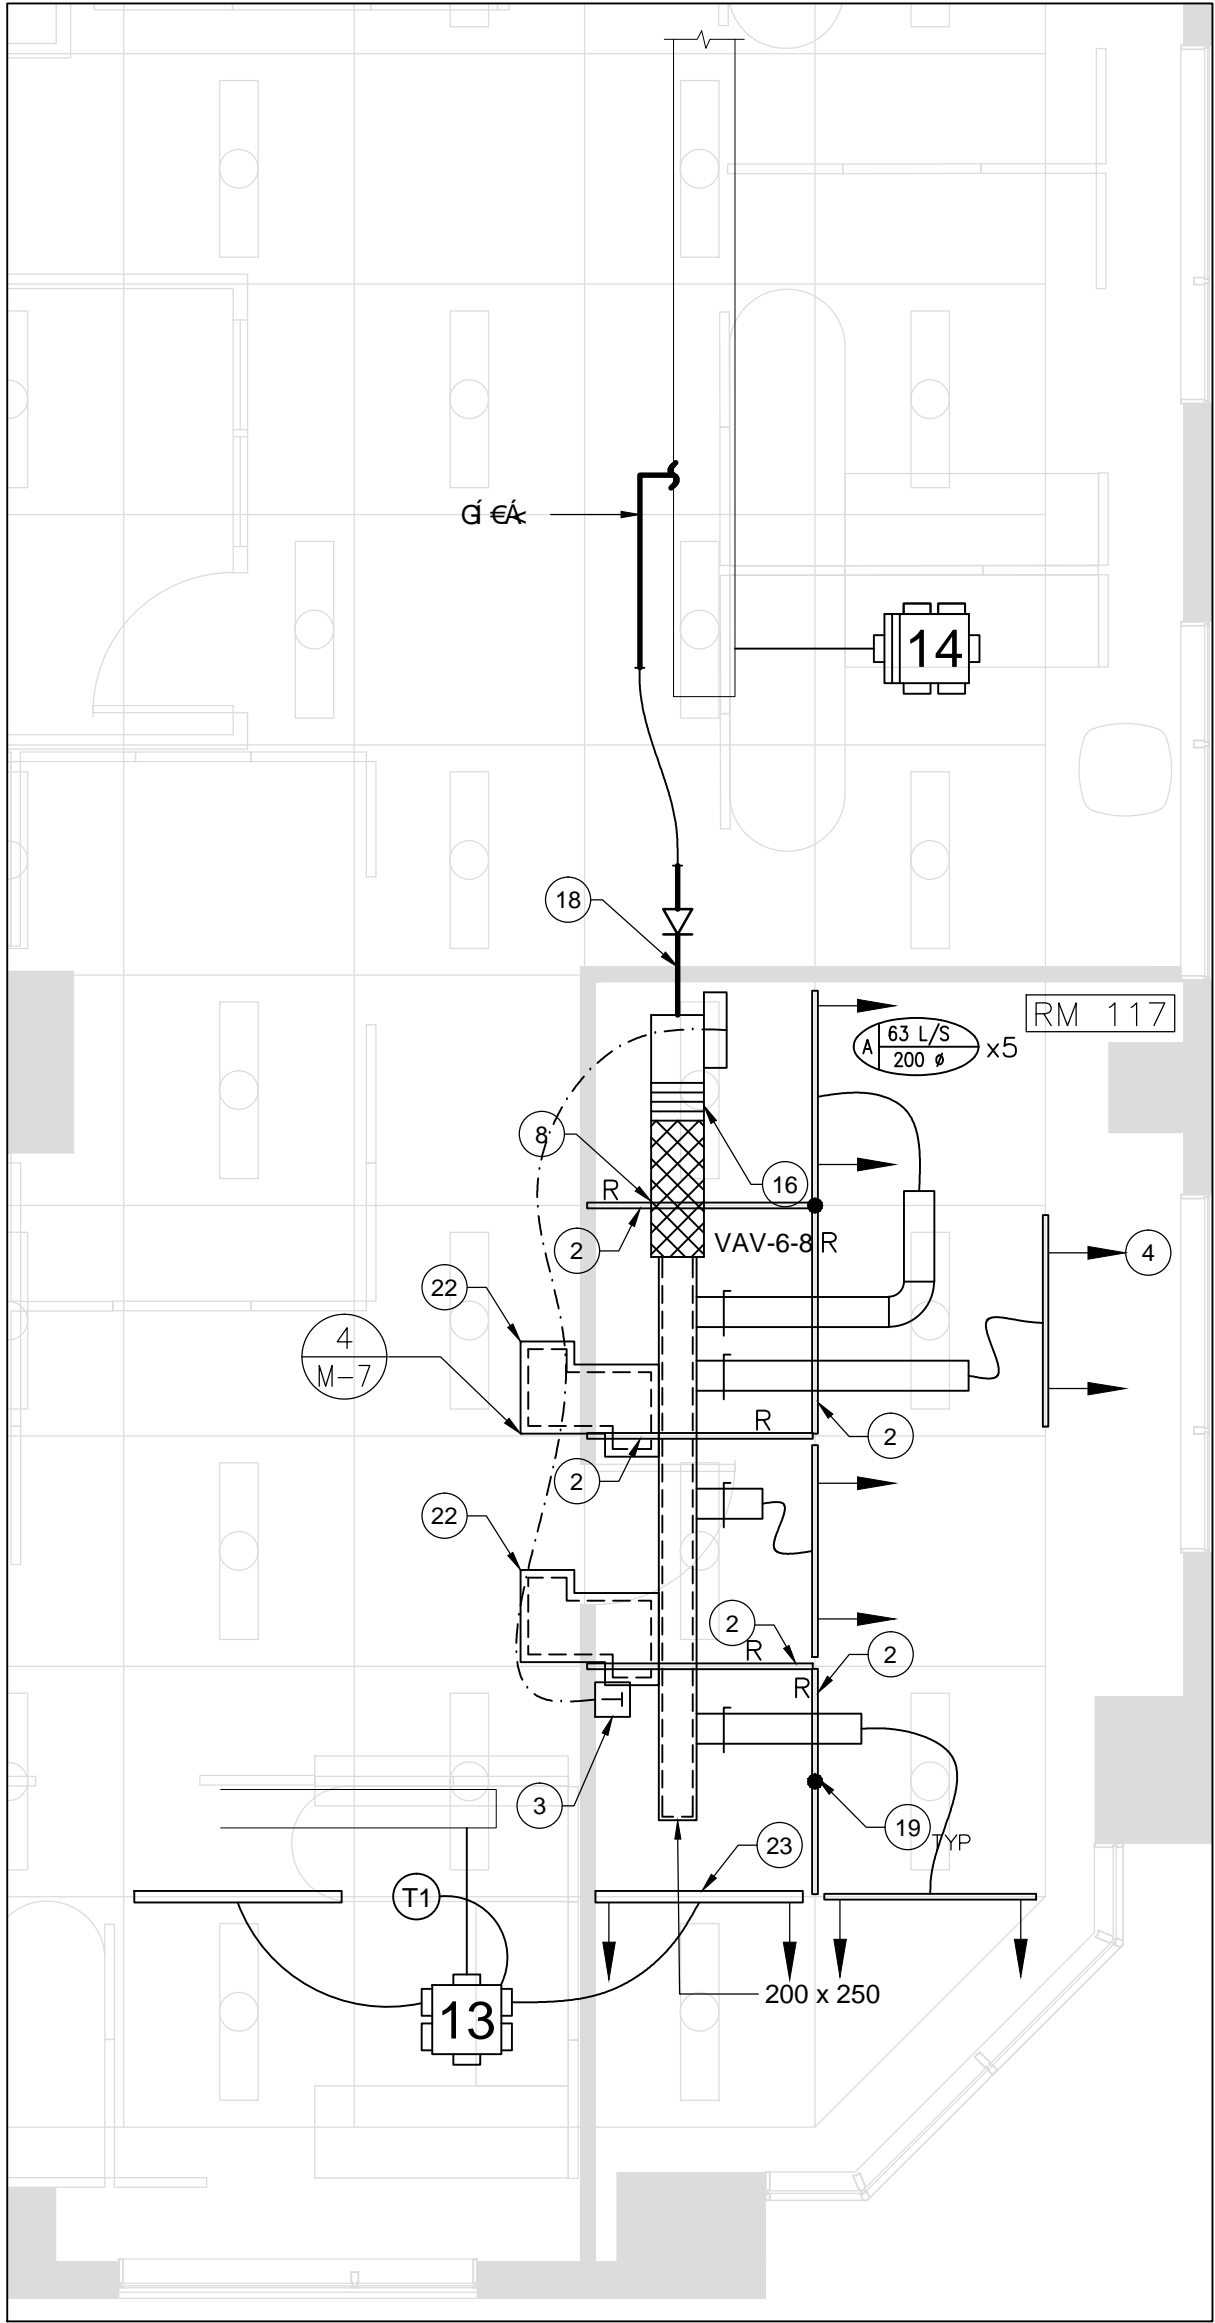

2 MECHANICAL DETAIL -- ROOM 117-118 (NEW)
M-6 1:50

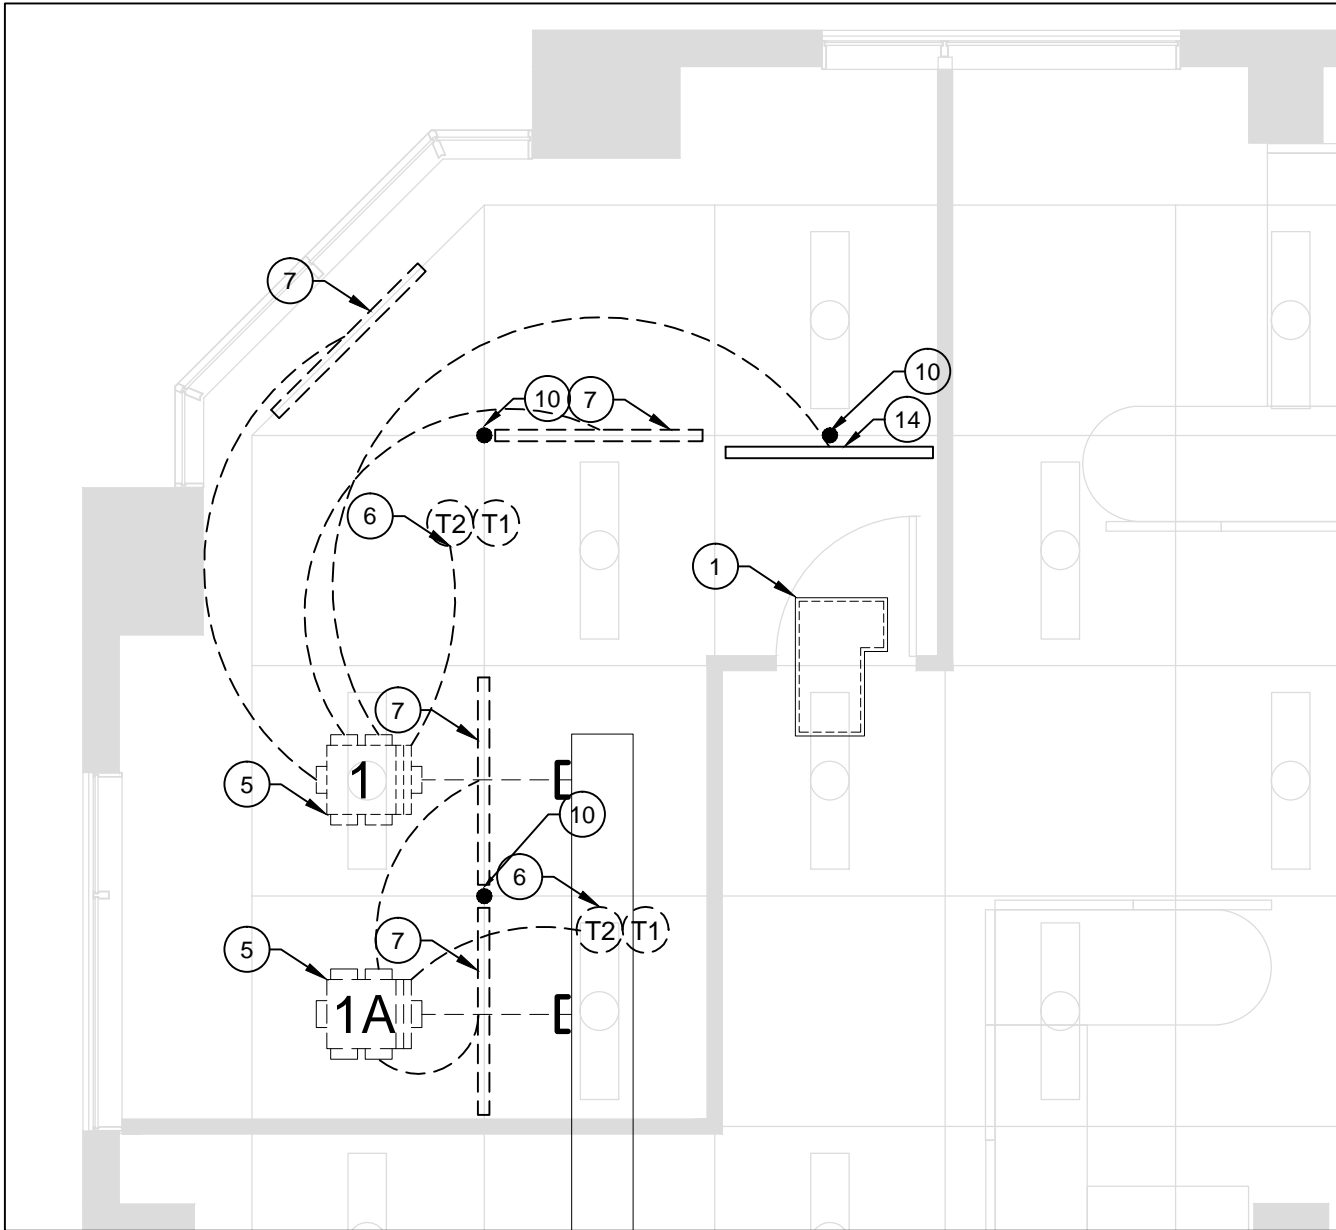

3 MECHANICAL DETAIL -- ROOM 102-103 (DEMOLITION)
M-6 1:50

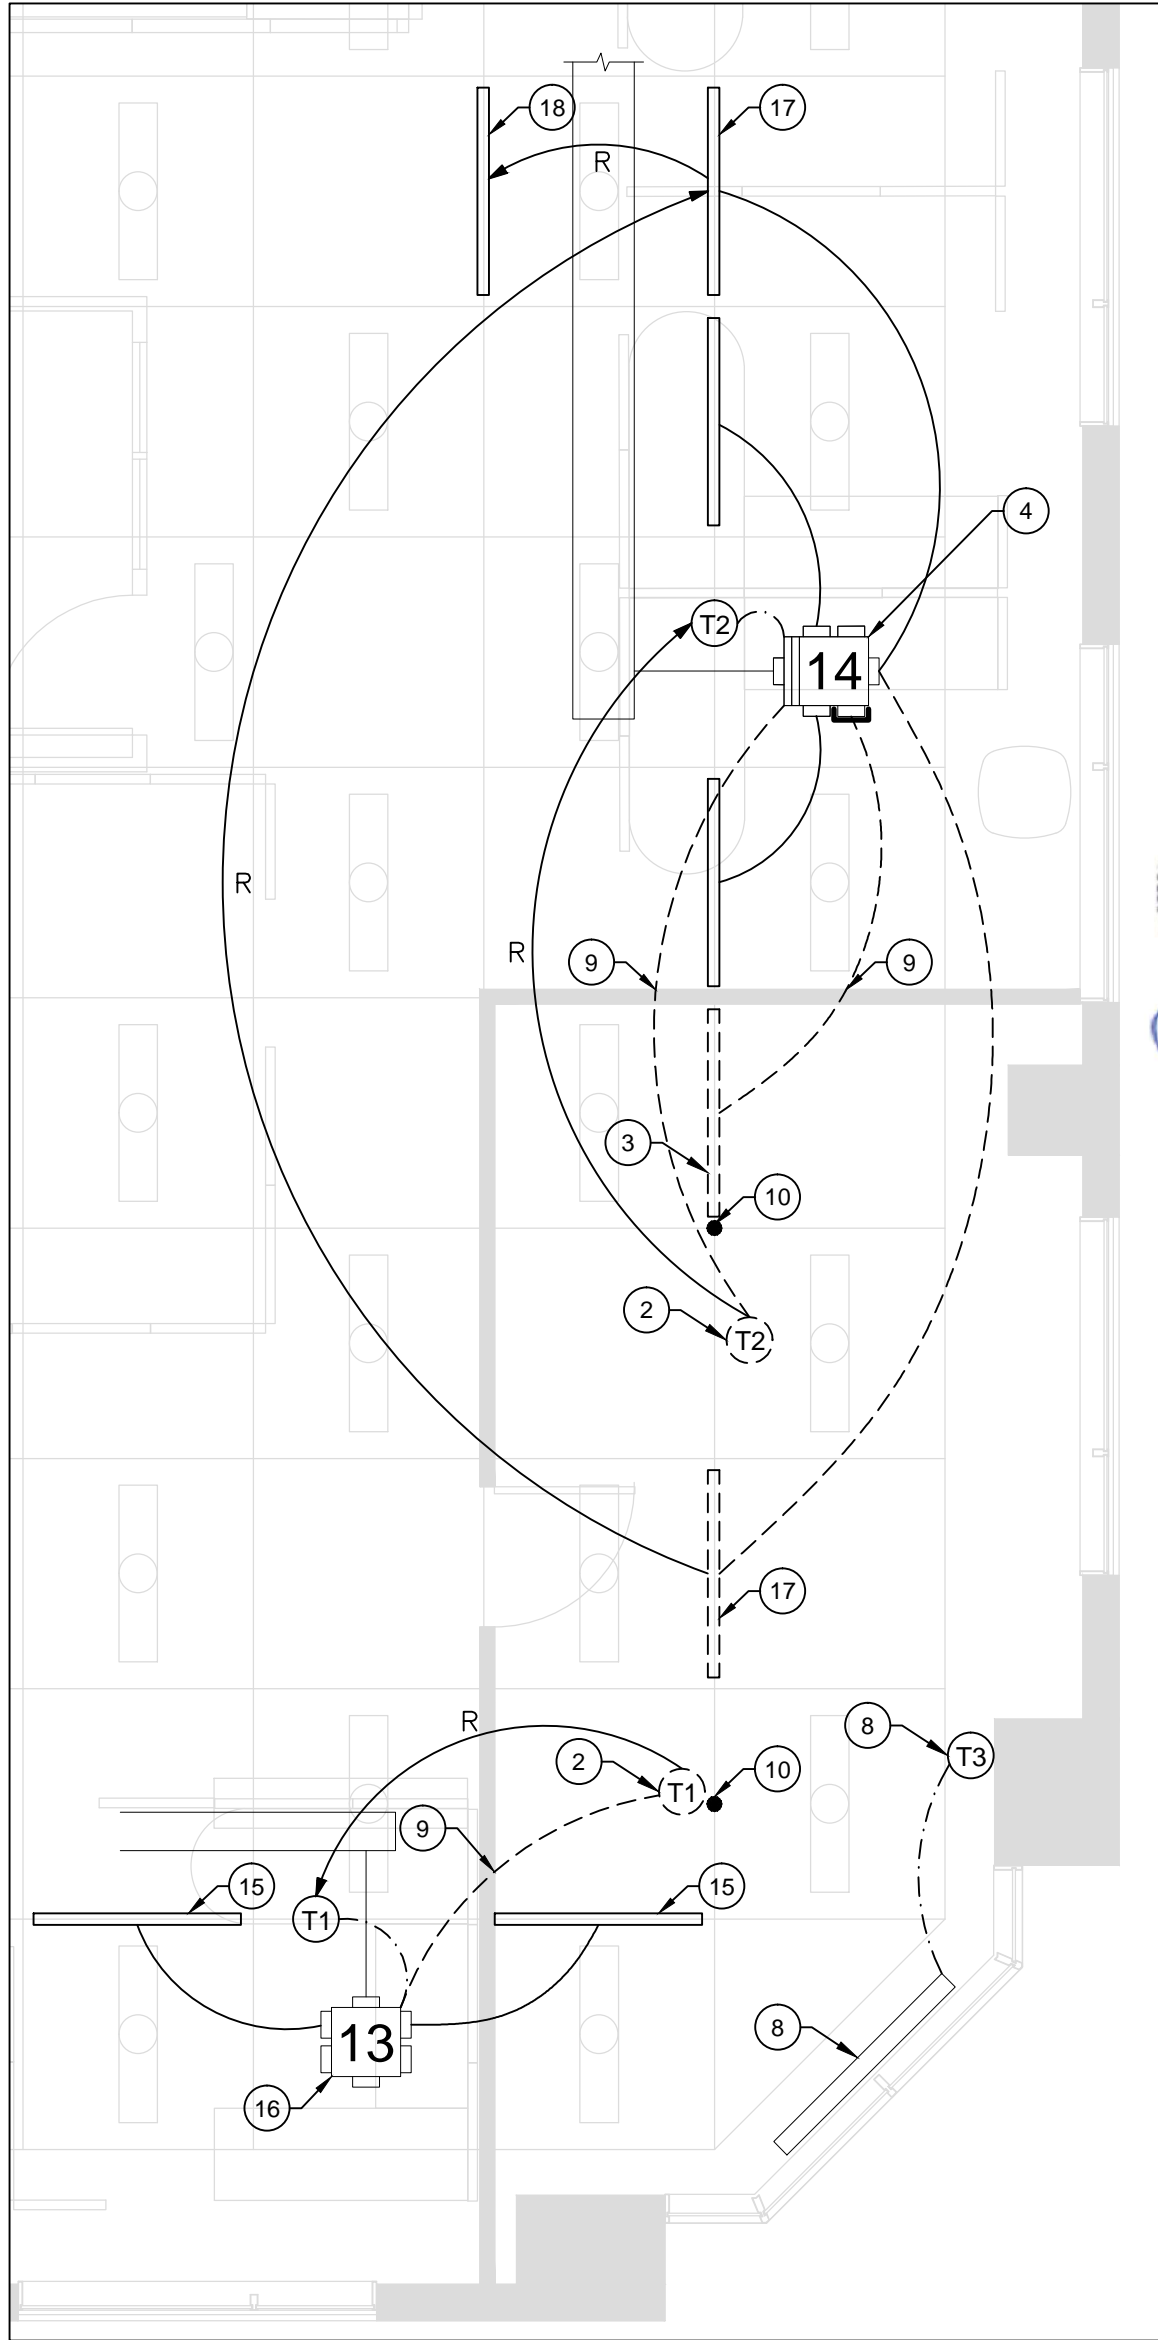

4 MECHANICAL DETAIL -- ROOM 117-118 (DEMOLITION)
M-6 1:50

DRAWING NOTES - NEW

- 1 - Acoustically lined transfer duct
- 2 - Return air slot to be left in ceiling grid
- 3 - BAS temperature sensor
- 4 - Airflow to be directed towards exterior wall
- 5 - Airflow to be directed towards interior
- 6 - Not used
- 7 - VAV box attenuator
- 8 - Not used
- 9 - Not used
- 10 - Not used
- 11 - Not used
- 12 - Not used
- 13 - Not used
- 14 - Not used
- 15 - New VAV box c/w reheat
- 16 - Not used
- 17 - Not Used
- 18 - Provide new opening in partition, make good drywall, fit tightly, provide non-hardening sealant.
- 19 - Existing Sprinkler and piping to remain.
- 20 - Not used
- 21 - Existing diffuser. Reuse
- 22 - New transfer duct.
- 23 - Existing diffuser to remain.

DRAWING NOTES - DEMOLITION


- 1 - Transfer Duct to Remain
- 2 - Relocate T-stat as shown
- 3 - Remove Existing diffuser and cap at VAV box. Turn over diffuser to owner on site
- 4 - Rebalance VAV box
- 5 - Remove existing VAV box and associated wiring/tubing. Turn over to owner on site. Cap supply duct at main.
- 6 - Remove existing T-stat
- 7 - Remove existing diffuser. Turn over to owner on site
- 8 - Existing baseboard heater & T-stat to remain
- 9 - Make good wall both sides, to existing standard.
- 10 - Existing sprinklers and sprinkler piping to remain.
- 11 - Not used
- 12 - Not used
- 13 - Not used
- 14 - Existing diffuser to remain. Remove duct.
- 15 - Existing diffuser to remain.
- 16 - Existing VAV box to remain.
- 17 - Relocate existing diffuser as shown.
- 18 - Relocate return slot as shown.

Canada



Public Works and
Government Services
Canada
Real Property
Branch

Travaux publics et
Services gouvernementaux
Canada
Où s'ajoute le
des biens immobiliers

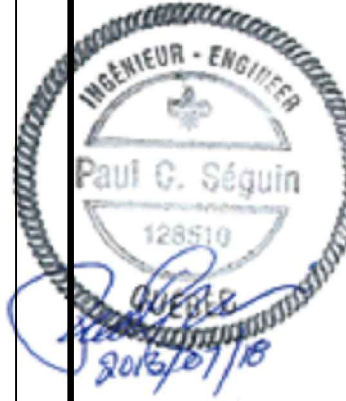

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

revisions	description	date
-----------	-------------	------

A	A detail no. no. du detail	A
C	B location drawing no. sur dessin no.	B
	C drawing no. dessin no.	C

project projet

6TH FLOOR 15 EDDY MECHANICAL SERVICES

15 EDDY STREET
GATINEAU, QC

drawing dessin

MECHANICAL HVAC PART PLANS

Designed By P. SEGUIN Ô() 8' Å æ

Date (2013/03/31)

Drawn By G. HEBB Ô•••• Å æ

Date (2013/03/31)

Reviewed By P. SEGUIN Ôæ Å. Å æ

Date (2013/07/18)

Approved By LAN CHI NGUYEN WEEKES Ô() Å. Å æ

Date (2013/07/18)

Tender Soumission

Project Manager Administrateur de projets

Project no. No. du projet

R.059180.005

Drawing no. No. du dessin

M-6