
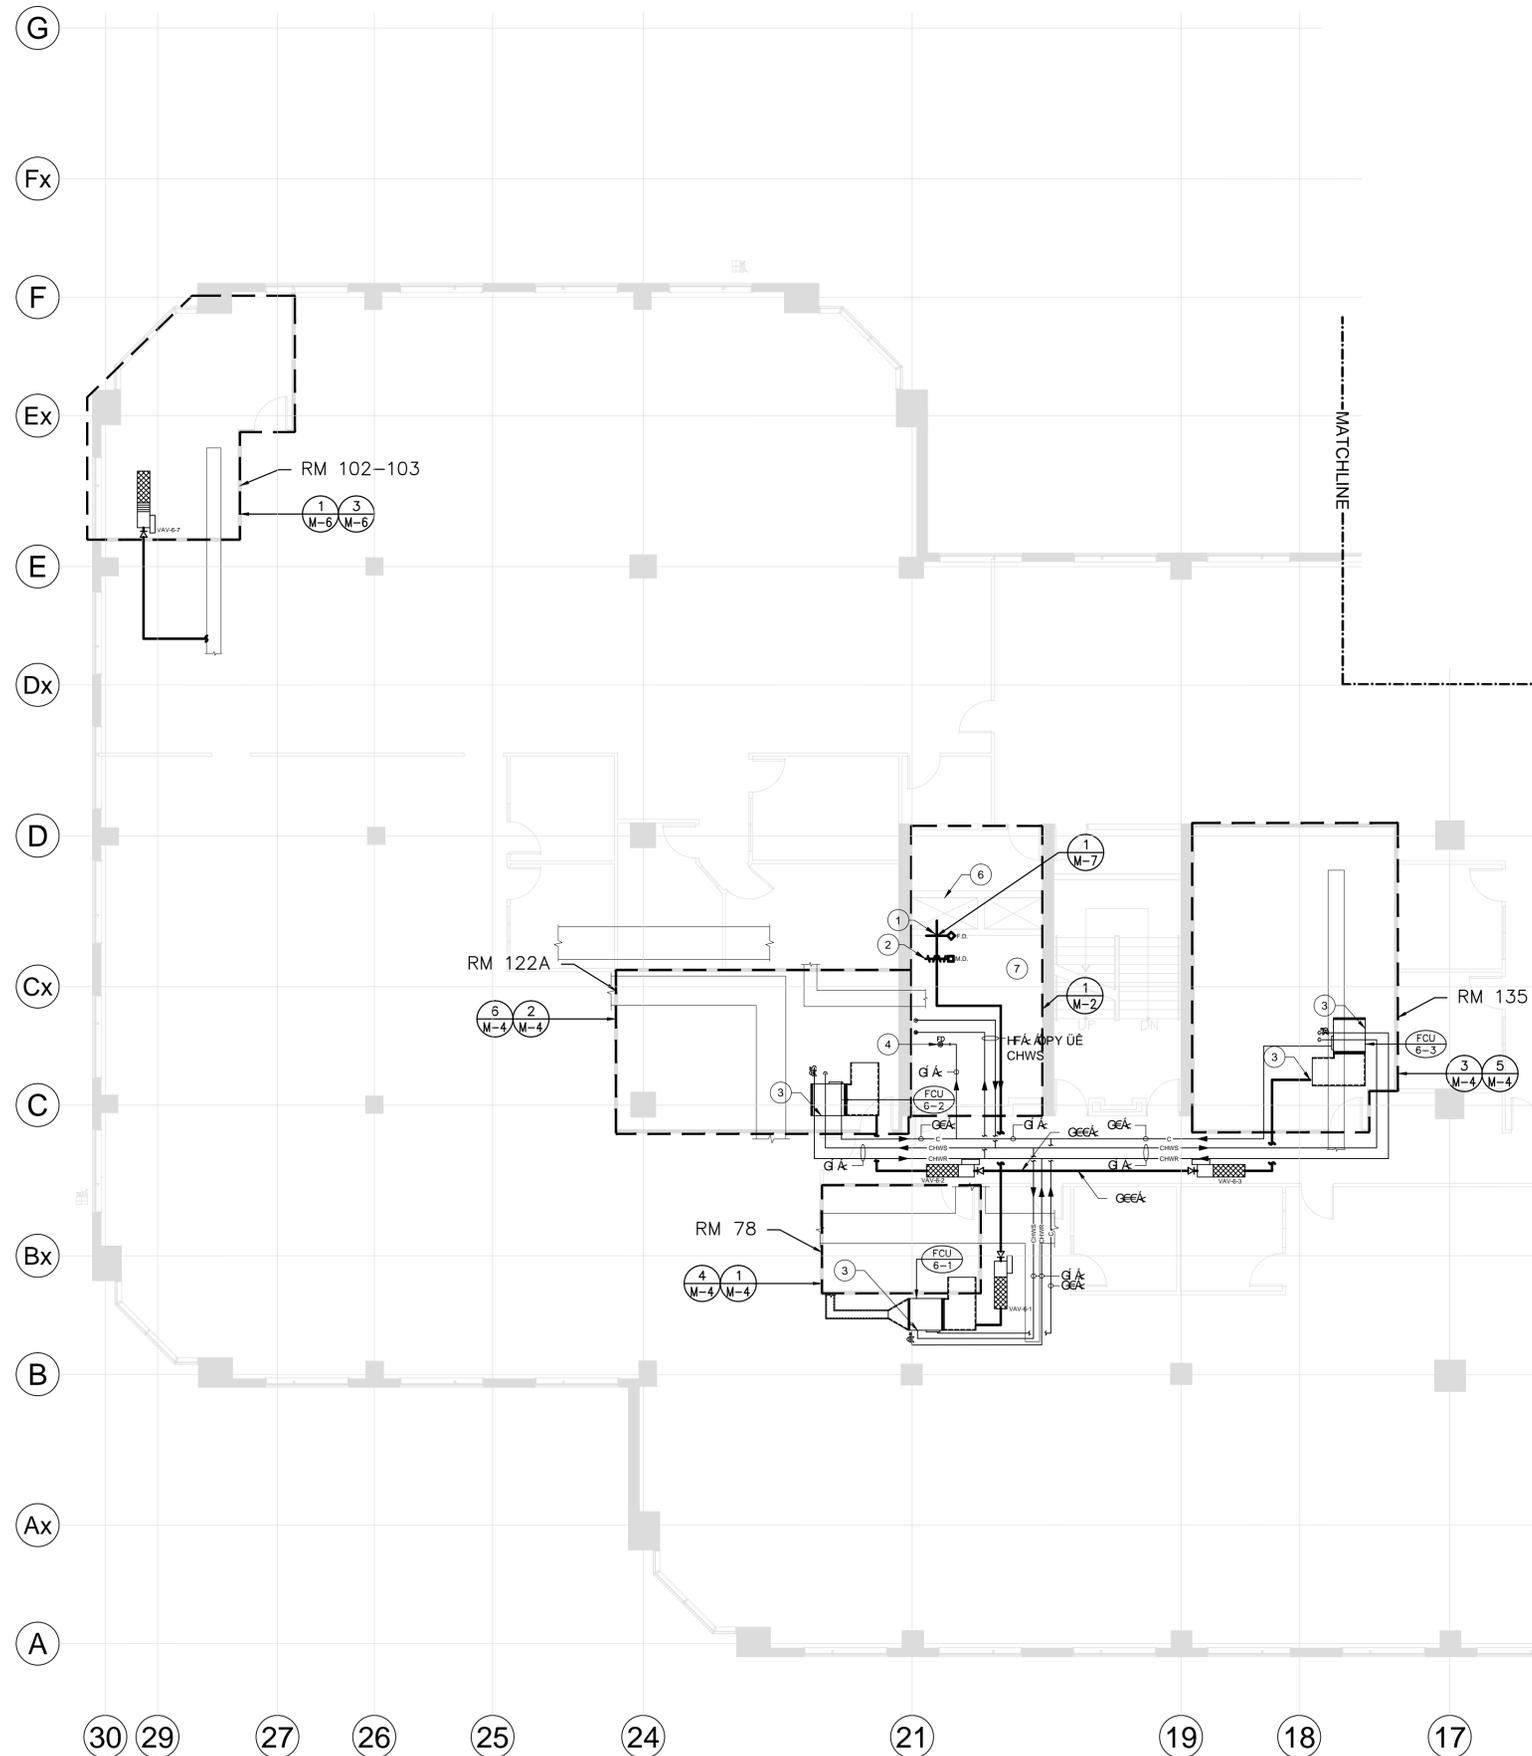


DRAWING NOTES

- 1 - Provide new fire damper into ventilation air shaft, 2 hrs rated.
- 2 - Provide new on/off ventilation air damper. This damper is to be pneumatic and connected to air handler fire alarm system interlock. Damper to close when air handler "off".
- 3 - Coordinate exact location of services with part plans on drawings M-4 & M-5.
- 4 - Route fan coil condensate drain line to existing floor drain in fan room. Cut pipe outlet at 45 degree angle. maintain 25 mm air gap. Do not obstruct air handler access panels/doors.
- 5 - Tie into existing chilled water risers using hot tap method. Connect as high as possible.
- 6 - Outdoor air supply shaft
- 7 - Install piping, ductwork, wiring & equipment as high as possible.

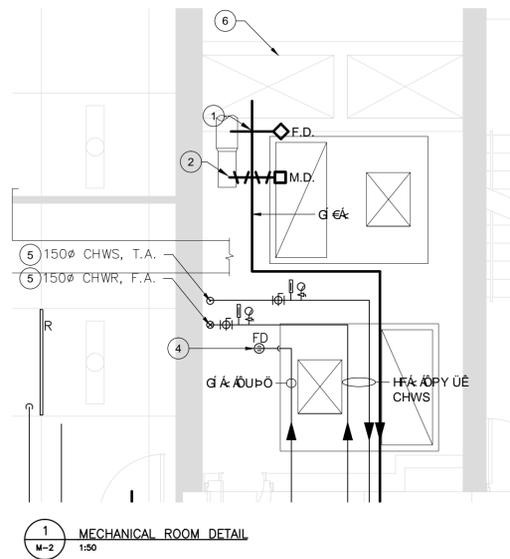

Canada

Public Works and Government Services Canada  
Travaux publics et Services gouvernementaux Canada  
Real Property Branch  
C.A. des biens immobiliers



Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

revisions	description	date
A	A detail no. du detail	A
B	B location drawing no. sur dessin no.	B
C	C drawing no. dessin no.	C

project  
**6TH FLOOR 15 EDDY MECHANICAL SERVICES**

15 EDDY STREET  
GATINEAU, QC

drawing  
**MECHANICAL KEY PLAN, PIPING MAINS & DUCT MAINS**

Designed By	P. SEGUIN	Ö[ ] 8' Å ß
Date	(2013/03/31)	
Drawn By	G. HEBB	Ö***å .Å ß
Date	(2013/03/31)	
Reviewed By	P. SEGUIN	Öçå å .Å ß
Date	(2013/07/18)	
Approved By	LAN CHI NGUYEN WEEKES	Ö]]    ç .Å ß
Date	(2013/07/18)	
Tender	Soumission	

Project Manager  
Project no. **R.059180.005**

Drawing no. **M-2**