

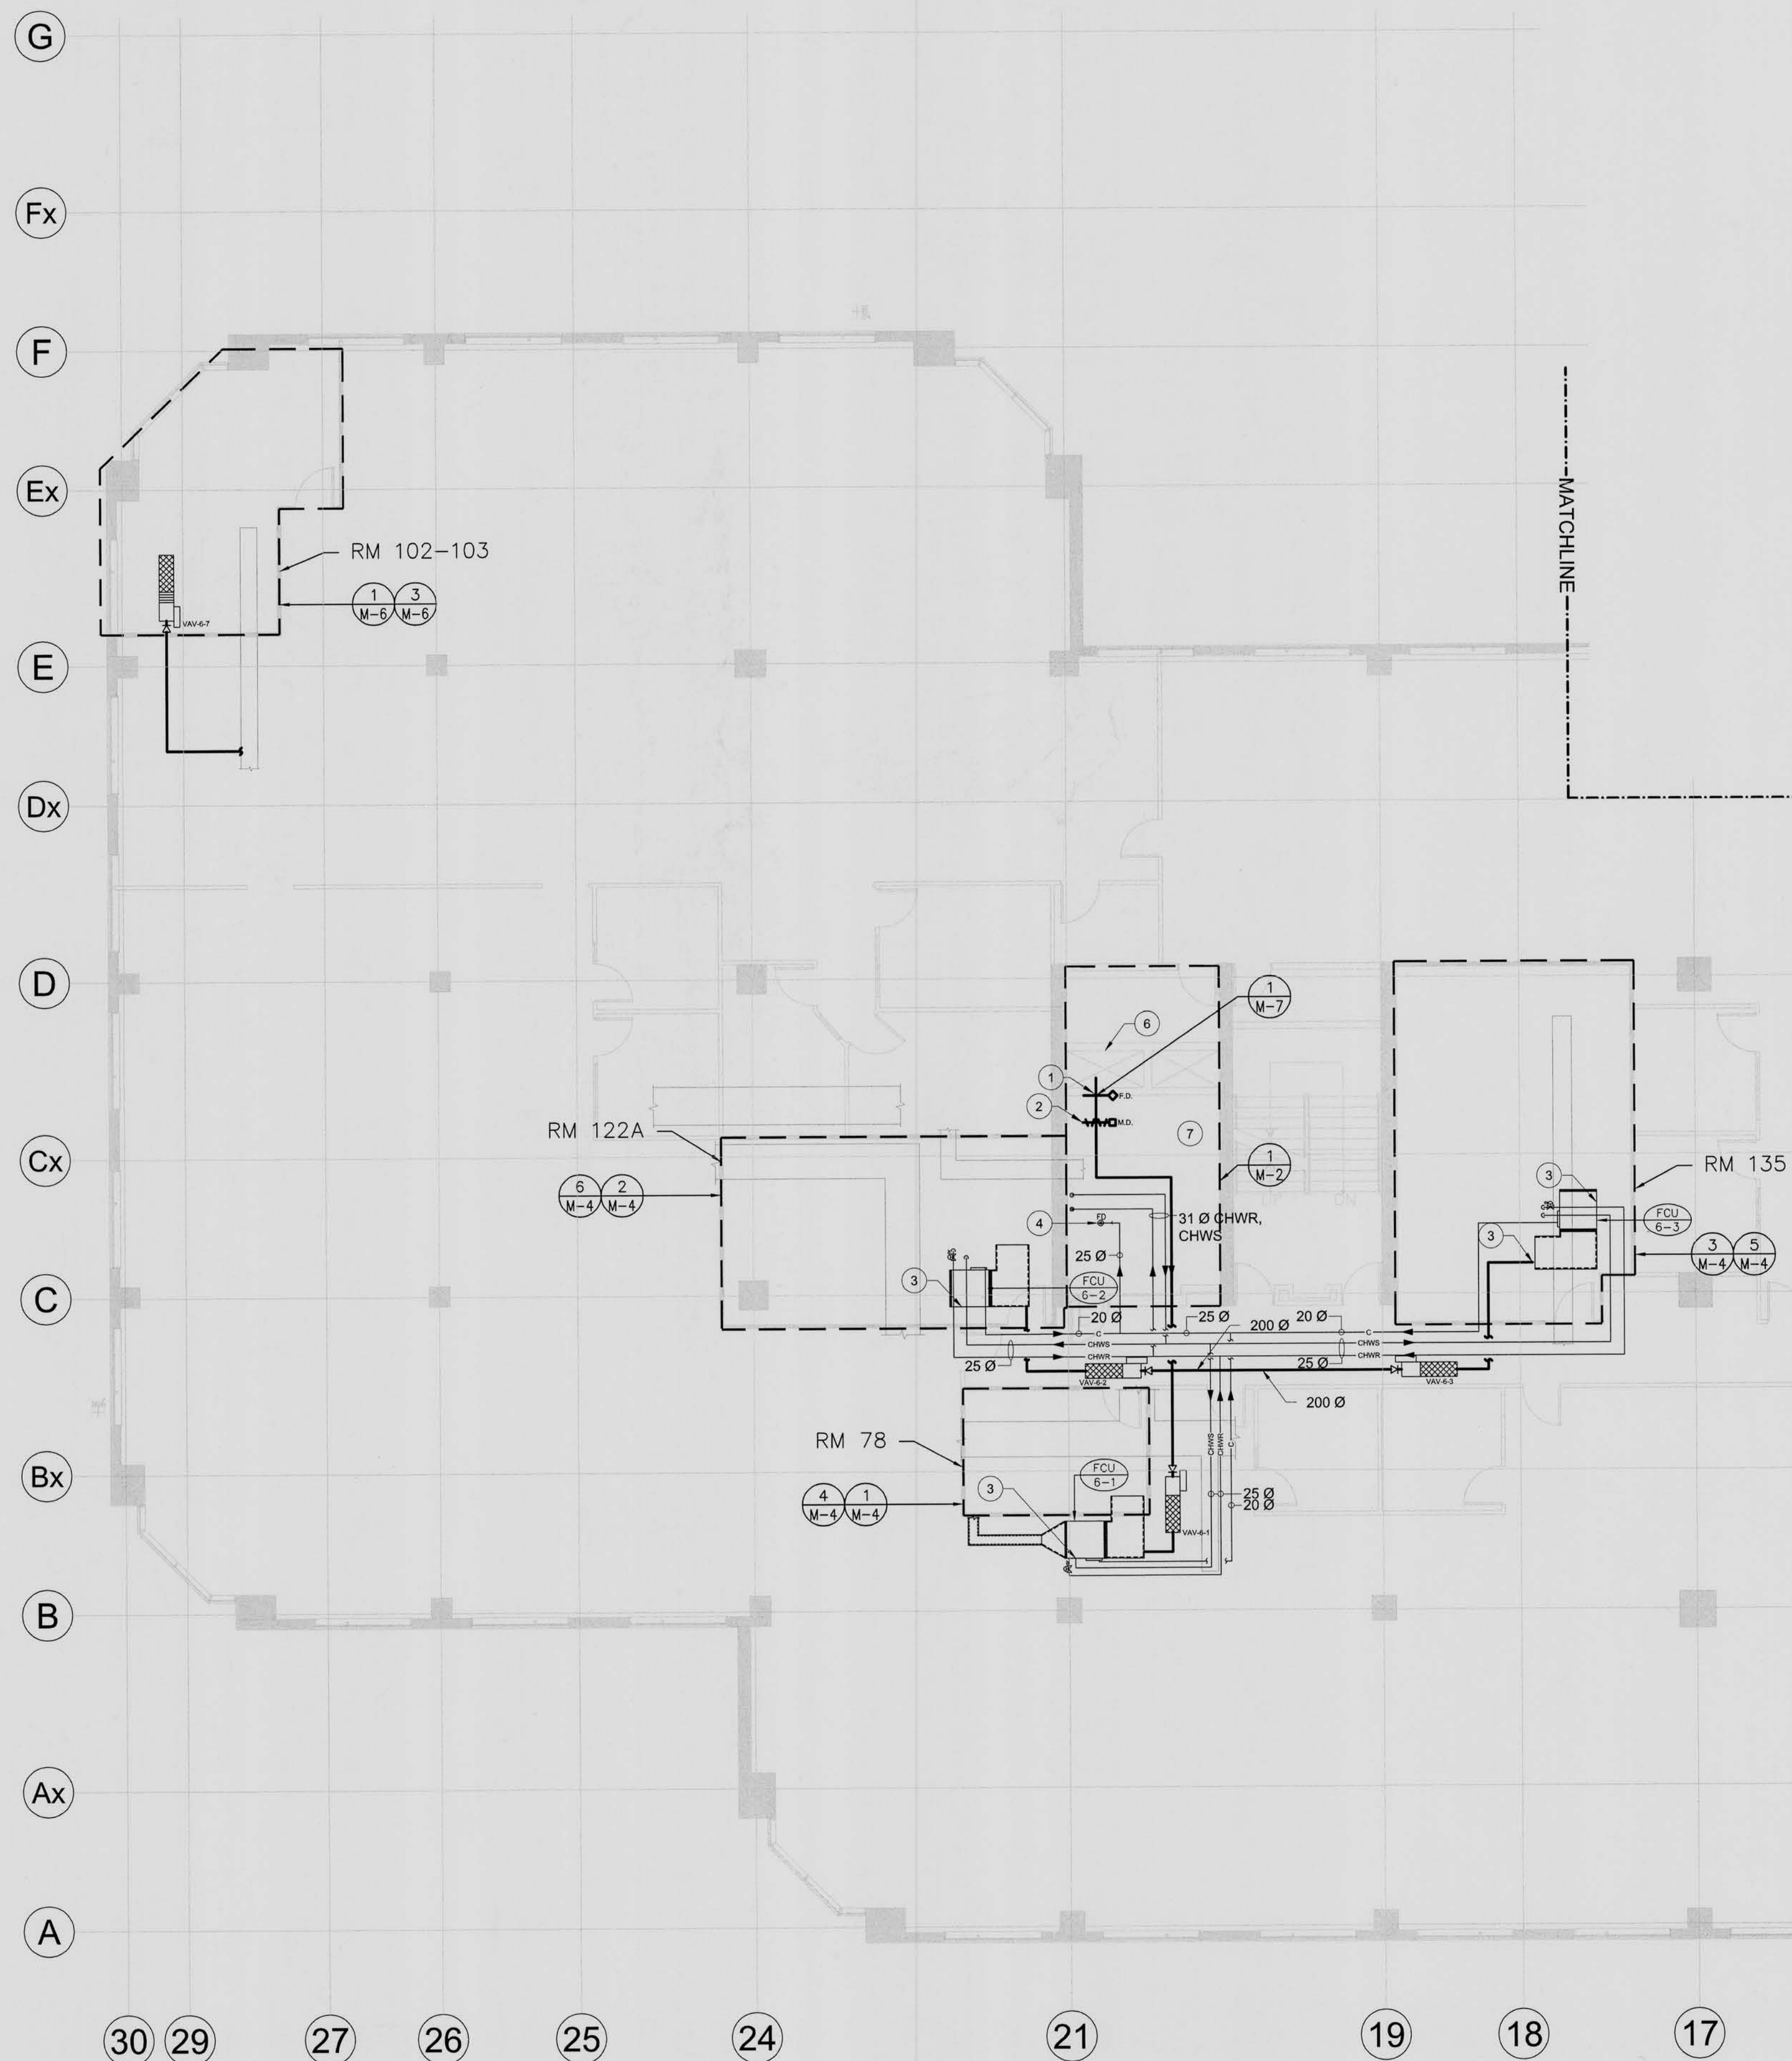


- ① - Provide new fire damper into ventilation air shaft, 2 hrs rated.
- ② - Provide new on/off ventilation air damper. This damper is to be pneumatic and connected to air handler fire alarm system interlock. Damper to close when air handler "off".
- ③ - Coordinate exact location of services with part plans on drawings M-4 & M-5.
- ④ - Route fan coil condensate drain line to existing floor drain in fan room. Cut pipe outlet at 45 degree angle. maintain 25 mm air gap. Do not obstruct air handler access panels/doors.
- ⑤ - Tie into existing chilled water risers using hot tap method. Connect as high as possible.
- ⑥ - Outdoor air supply shaft
- ⑦ - Install piping, ductwork, wiring & equipment as high as possible.

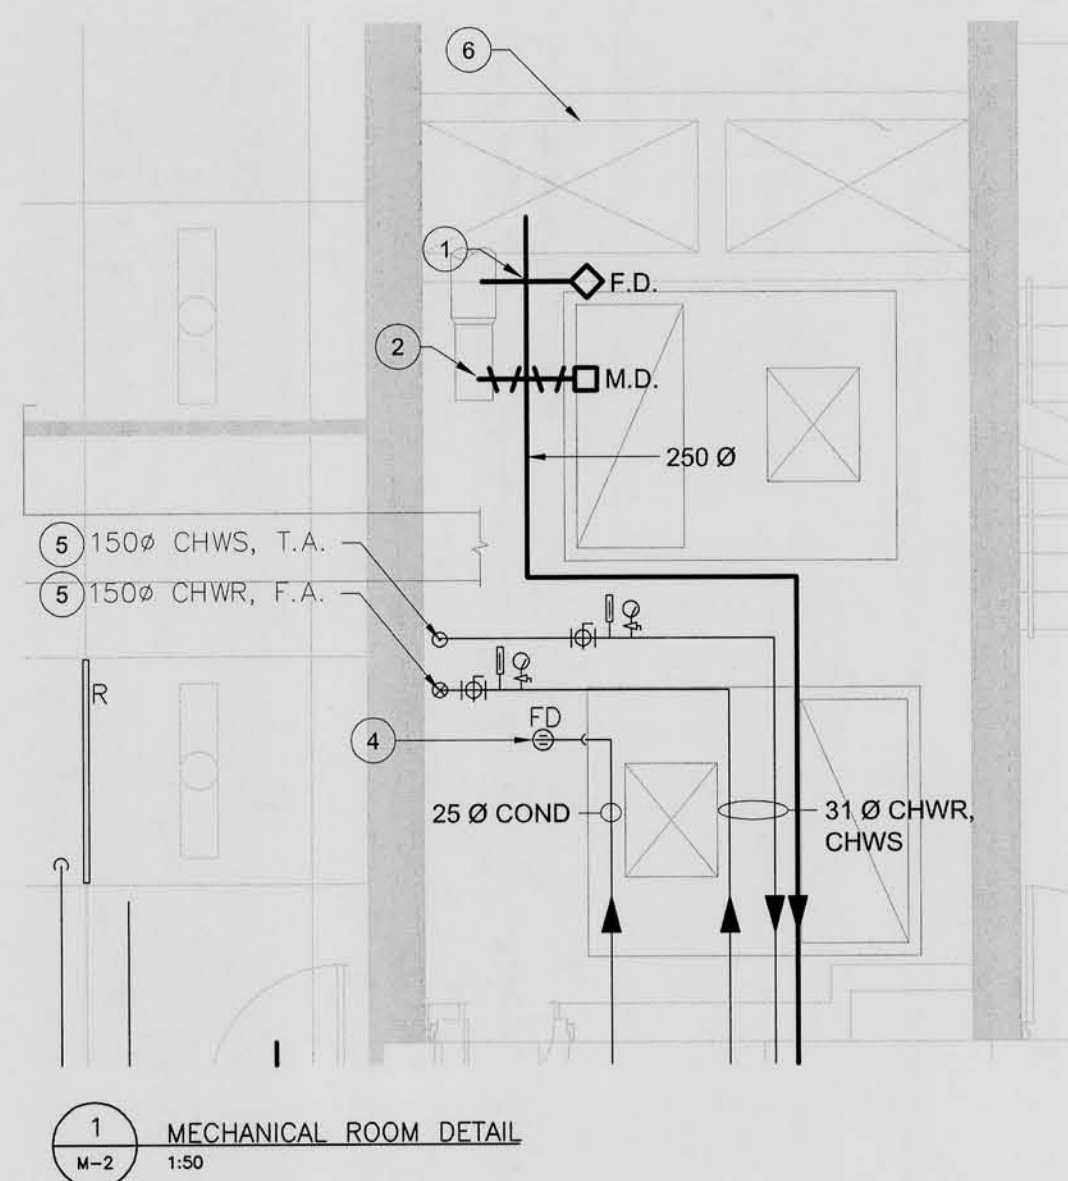



 Public Works and Government Services Canada
 Travaux publics et services gouvernementaux Canada
 Real Property Branch
 Direction générale des biens immobiliers



Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

revisions	description	date
-----------	-------------	------

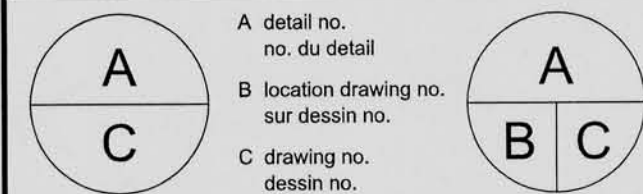

project	project
---------	---------

6TH FLOOR 15 EDDY
MECHANICAL SERVICES

15 EDDY STREET
GATINEAU, QC

drawing	dessin
---------	--------

MECHANICAL
KEY PLAN,
PIPING MAINS &
DUCT MAINS

Designed By	R. SEGUIN	Conçu par
-------------	-----------	-----------

Date (2013/03/31)

Drawn By G. HEBB Dessiné par

Date (2013/03/3)

Reviewed By	P. SEGUIN	Examiné par
-------------	-----------	-------------

Date (2013/07/11)

Approved By LAN CHINGUYEN WEEKES Approuvé par

Date (2013/07/14)

Tender	Soumission
--------	------------

Project Manager Administrateur de projet

Project no.	No. du proj
-------------	-------------

R.059180.005

Drawing no.	No. du dessin
-------------	---------------

M-2