


Drawing name: K:\A\A000234 580 Booth Controls\400\440\A000234-M15 13F.dwg Oct 01, 2013 - 10:59am

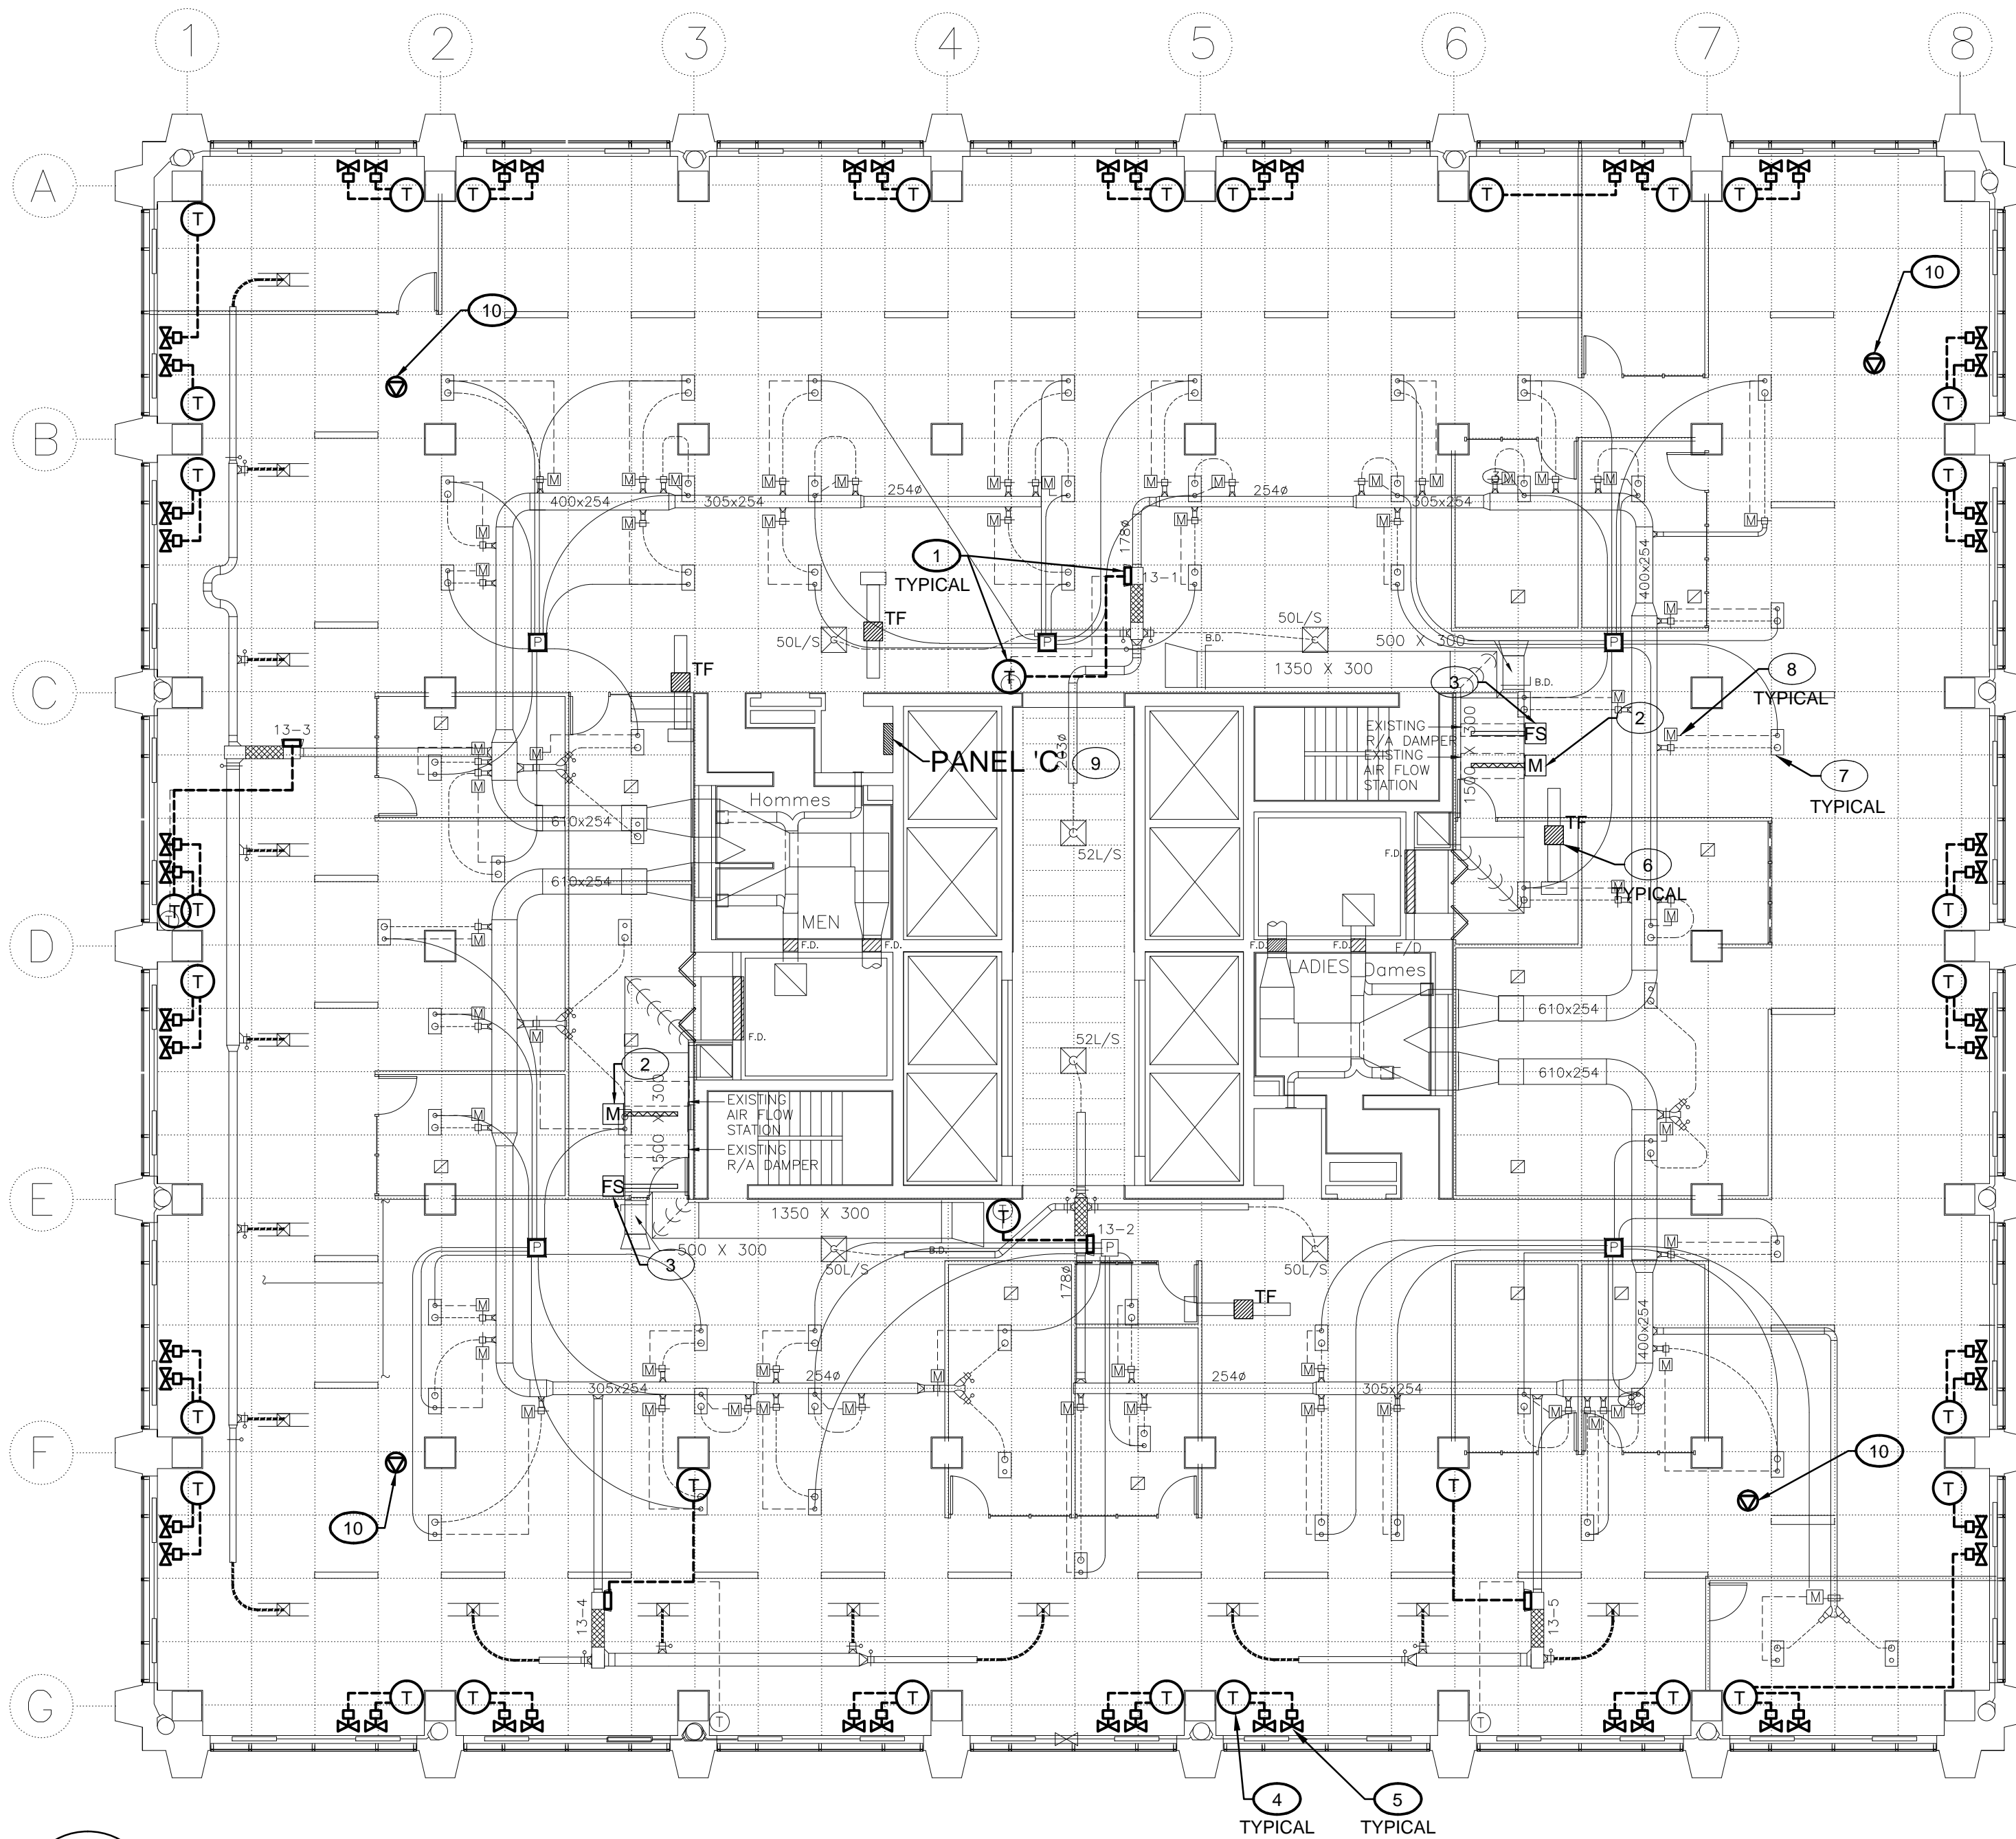

DRAWING NOTES:

- 1 REPLACE EXISTING VAV CONTROLLER AND EXISTING TEMPERATURE SENSOR WITH BTL LISTED VAV CONTROLLER AND BTL LISTED TEMPERATURE SENSOR. REPLACE EXISTING CONTROL WIRING FROM TEMPERATURE SENSOR TO VAV CONTROLLER AND FROM VAV CONTROLLER TO BUILDING CONTROLLER. REFER TO SCHEMATIC D1/M31 FOR DETAILS.
- 2 EXISTING RETURN AIR MOTORIZED DAMPER TO REMAIN. REPLACE WIRING TO CONTROLLER. REFER TO SCHEMATIC D1/M28 FOR DETAILS
- 3 EXISTING RETURN AIR FLOW METERING STATION TO REMAIN. REPLACE EXISTING CONTROL WIRING TO CONTROLLER. REFER TO SCHEMATIC D1/M28 FOR DETAILS.
- 4 PROVIDE AND INSTALL NEW BTL LISTED TEMPERATURE SENSOR AND WIRE IT TO TWO (2) CONTROL VALVES VIA CONTROLLER.
- 5 REPLACE EXISTING PNEUMATIC CONTROL VALVE WITH NEW CONTROL VALVE C/W ELECTRONIC ACTUATOR.
- 6 EXISTING TRANSFER FAN.
- 7 EXISTING JET DIFFUSER SYSTEM SERVING 13TH FLOOR
- 8 EXISTING JET DIFFUSER SYSTEM LOCAL CONTROLS TO REMAIN. THE LOCAL CONTROLS OF JET DIFFUSER SYSTEM SHALL NOT BE CONNECTED TO THE NEW BUILDING AUTOMATION SYSTEM FOR CONTROL NOR MONITORING.
- 9 EXISTING 120/208V 3Ø 4W ELECTRICAL PANEL. PROVIDE ONE 15A-1P BREAKER AND CONNECT THE BAS CONTROL CIRCUIT
- 10 PROVIDE 15A/1/120V HARD WIRED ELECTRICAL OUTLET FOR BAS

GENERAL NOTES:

1. INDUCTION UNITS SENSOR TO BE MOUNTED UNDER INDUCTION UNIT.
2. ONE CONTROLLER WILL CONTROL THE INDUCTION UNIT CONTROL VALVE AND THE VAV BOX WHERE INSTALLED CLOSE TO PERIMETER.

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

revisions	description	date
E	Issued for 100% review	2013-10-04
D	Issued for 99% review	2013-05-03
C	Issued for 66% review	2013-02-08
B	Issued for 33% review	2013-01-04
A	Issued for design development review	2012-11-02

A	A detail no. no. du detail	A
C	B location drawing no. sur dessin no.	B C
	C drawing no. dessin no.	

project project

BUILDING AUTOMATION SYSTEM CONSOLIDATION

580 BOOTH, OTTAWA, ON

drawing dessin

THIRTEENTH FLOOR PLAN - CONTROLS

Designed By	CHRISTIAN WORKMAN	Conçu par
Date	AUGUST 2012	(yyyy/mm/dd)
Drawn By	HANI KARAM	Dessiné par
Date	AUGUST 2012	(yyyy/mm/dd)
Reviewed By	GREG SANTYR	Examiné par
Date	SEPTEMBER 2012	(yyyy/mm/dd)
Approved By	DANIEL ROY	Approuvé par
Date	SEPTEMBER 2012	(yyyy/mm/dd)
Tender	CORY CAMPBELL	Soumission
Project Manager	Administrateur de projets	
Project no.	R.041796.002	No. du projet
Drawing no.	M15 of 53	No. du dessin