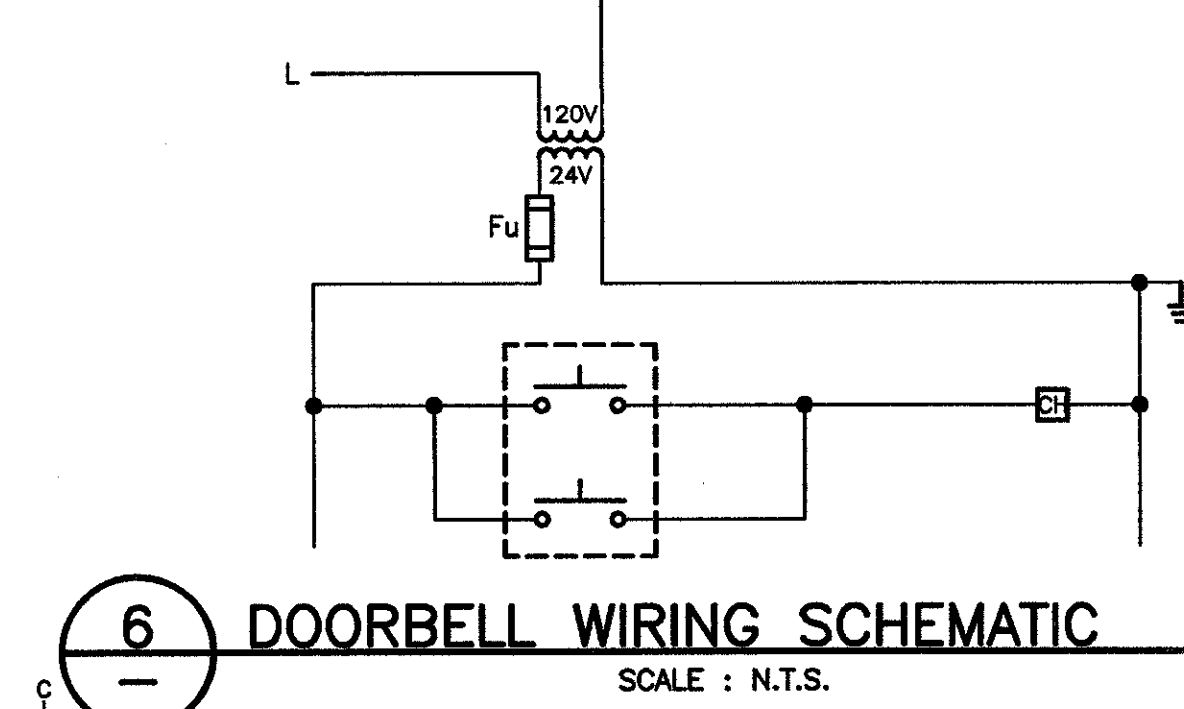
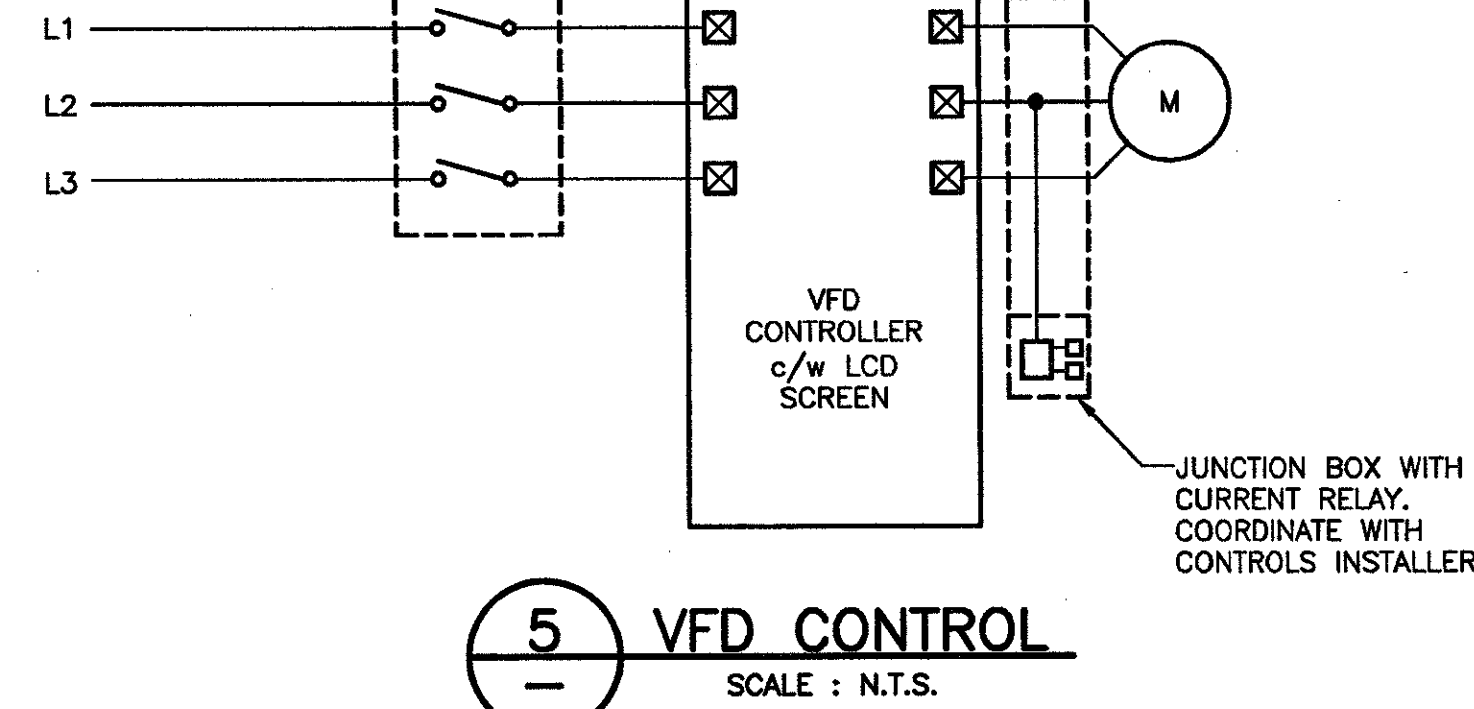
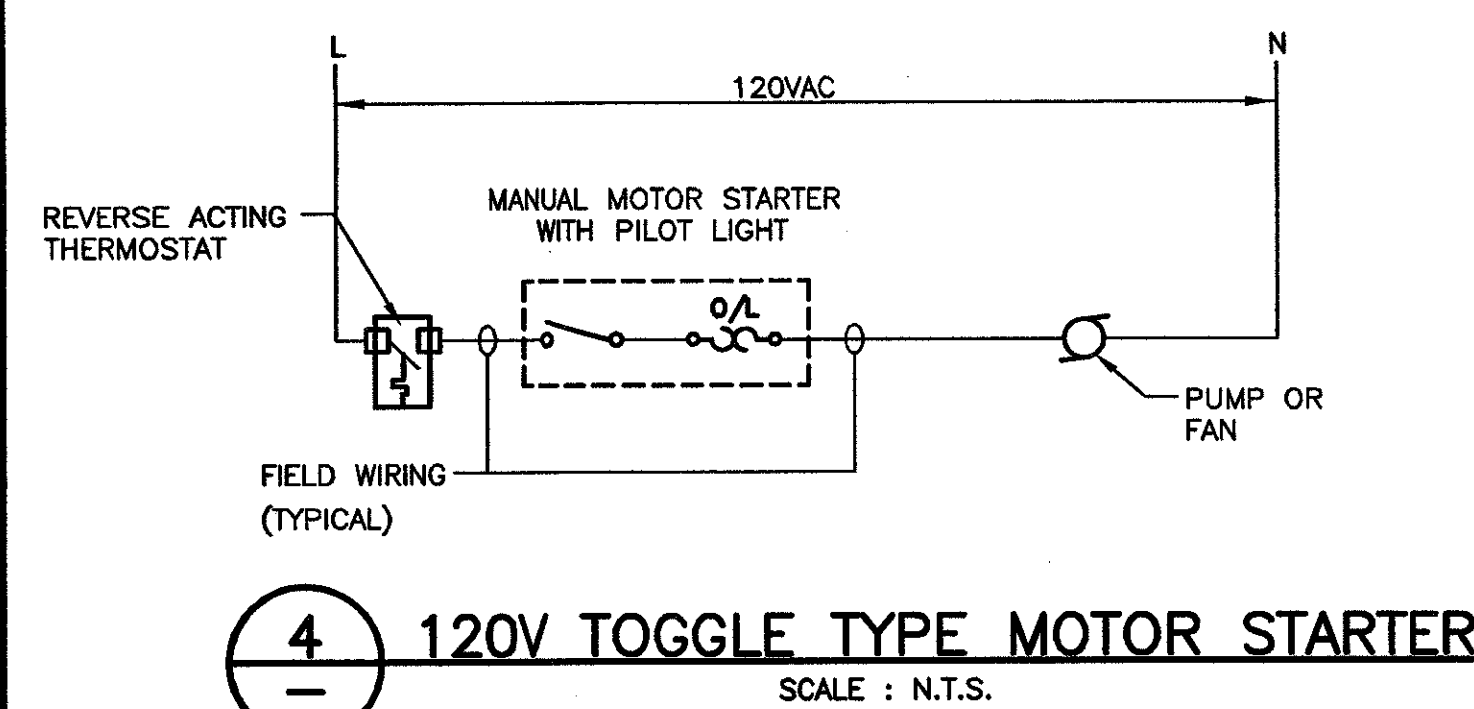
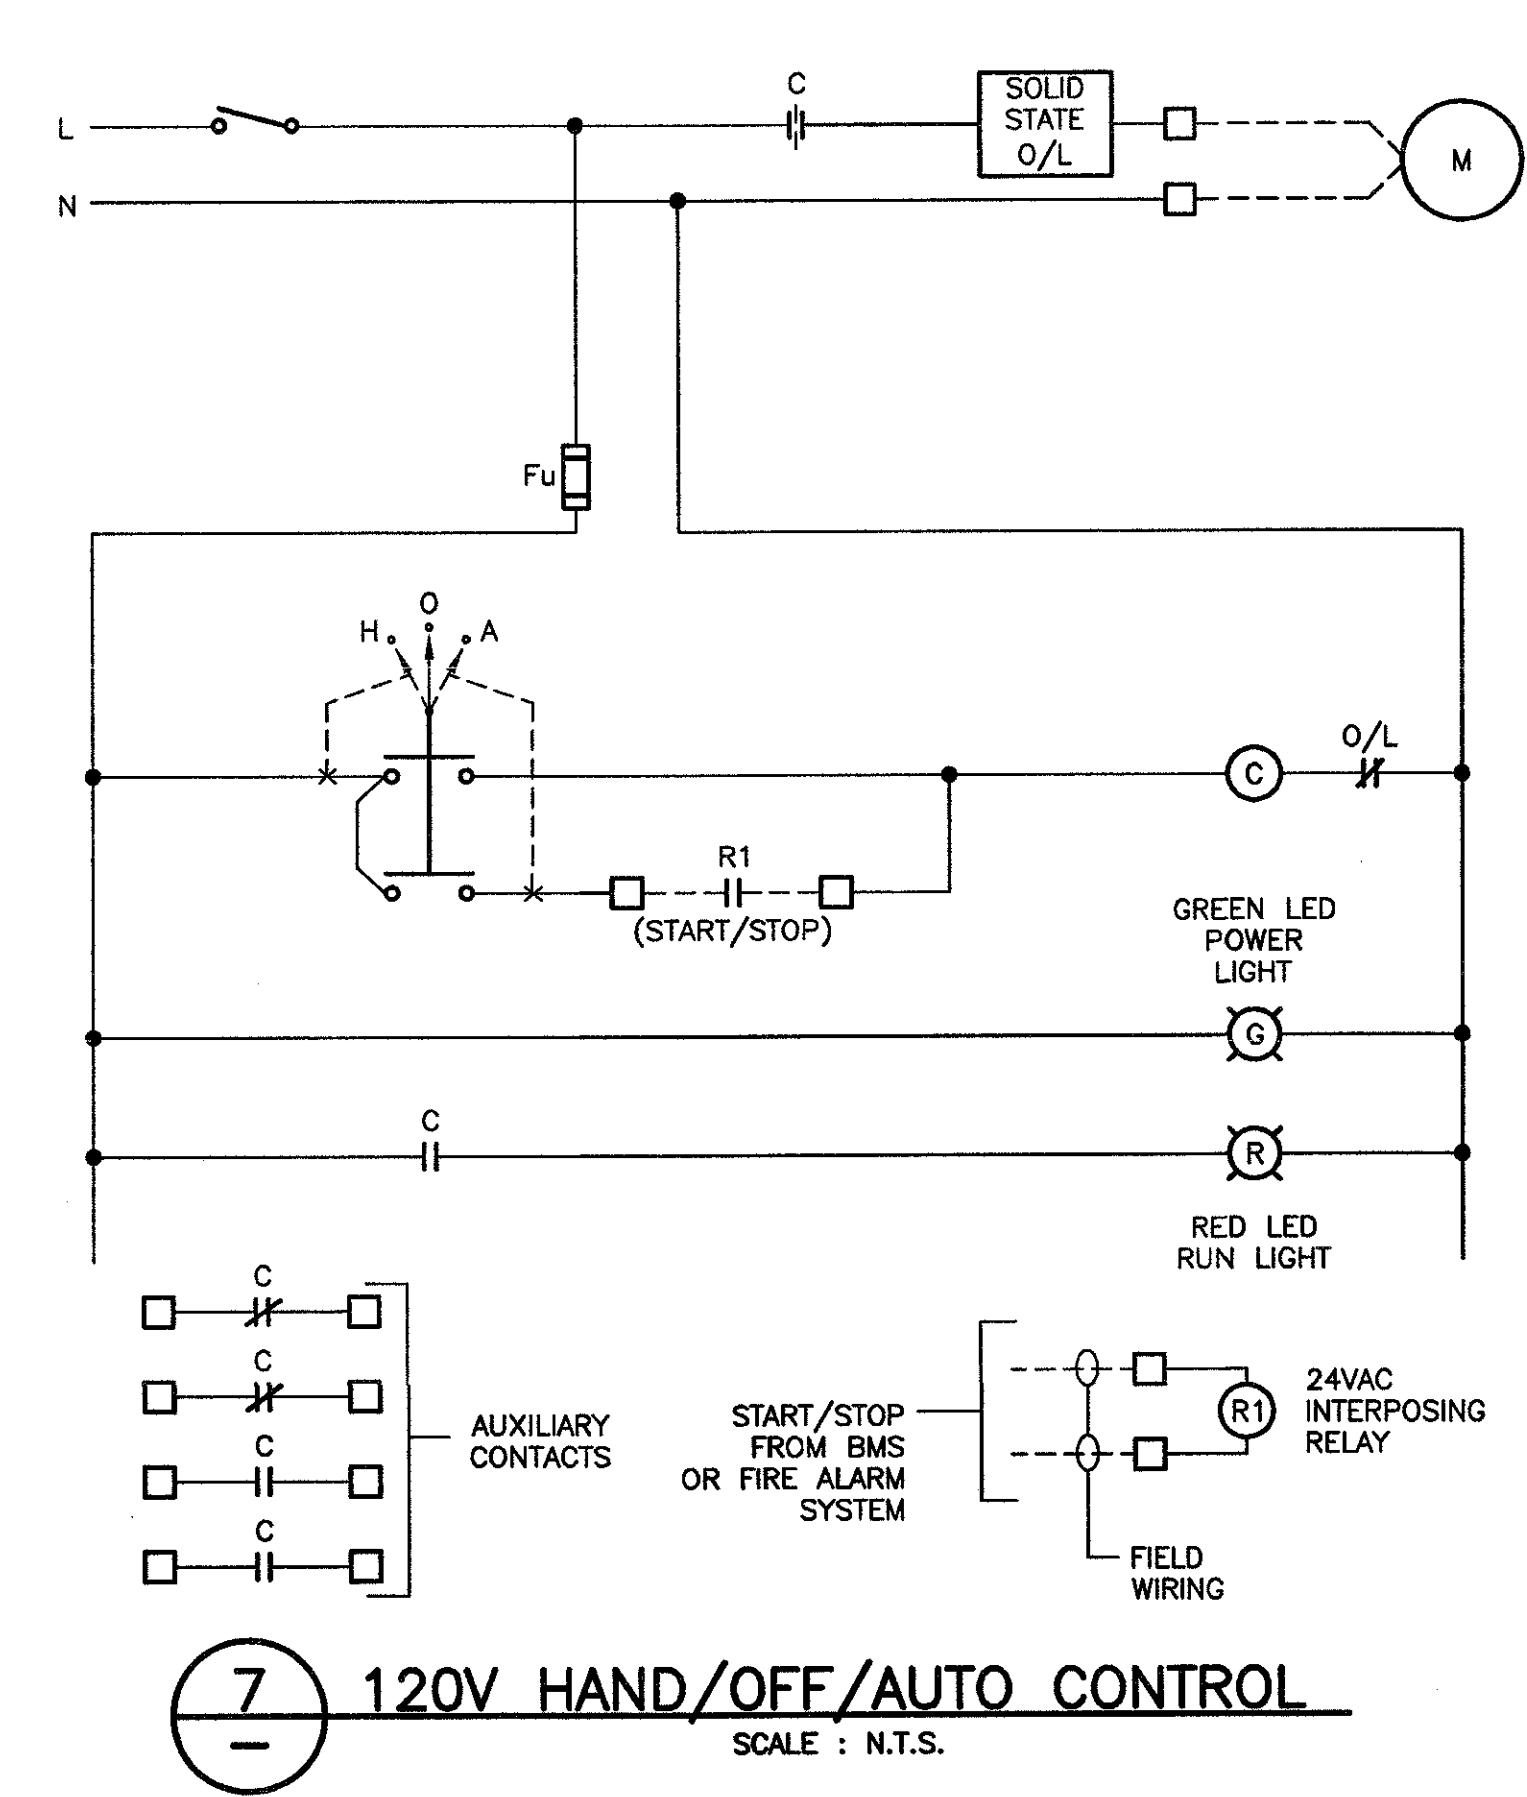
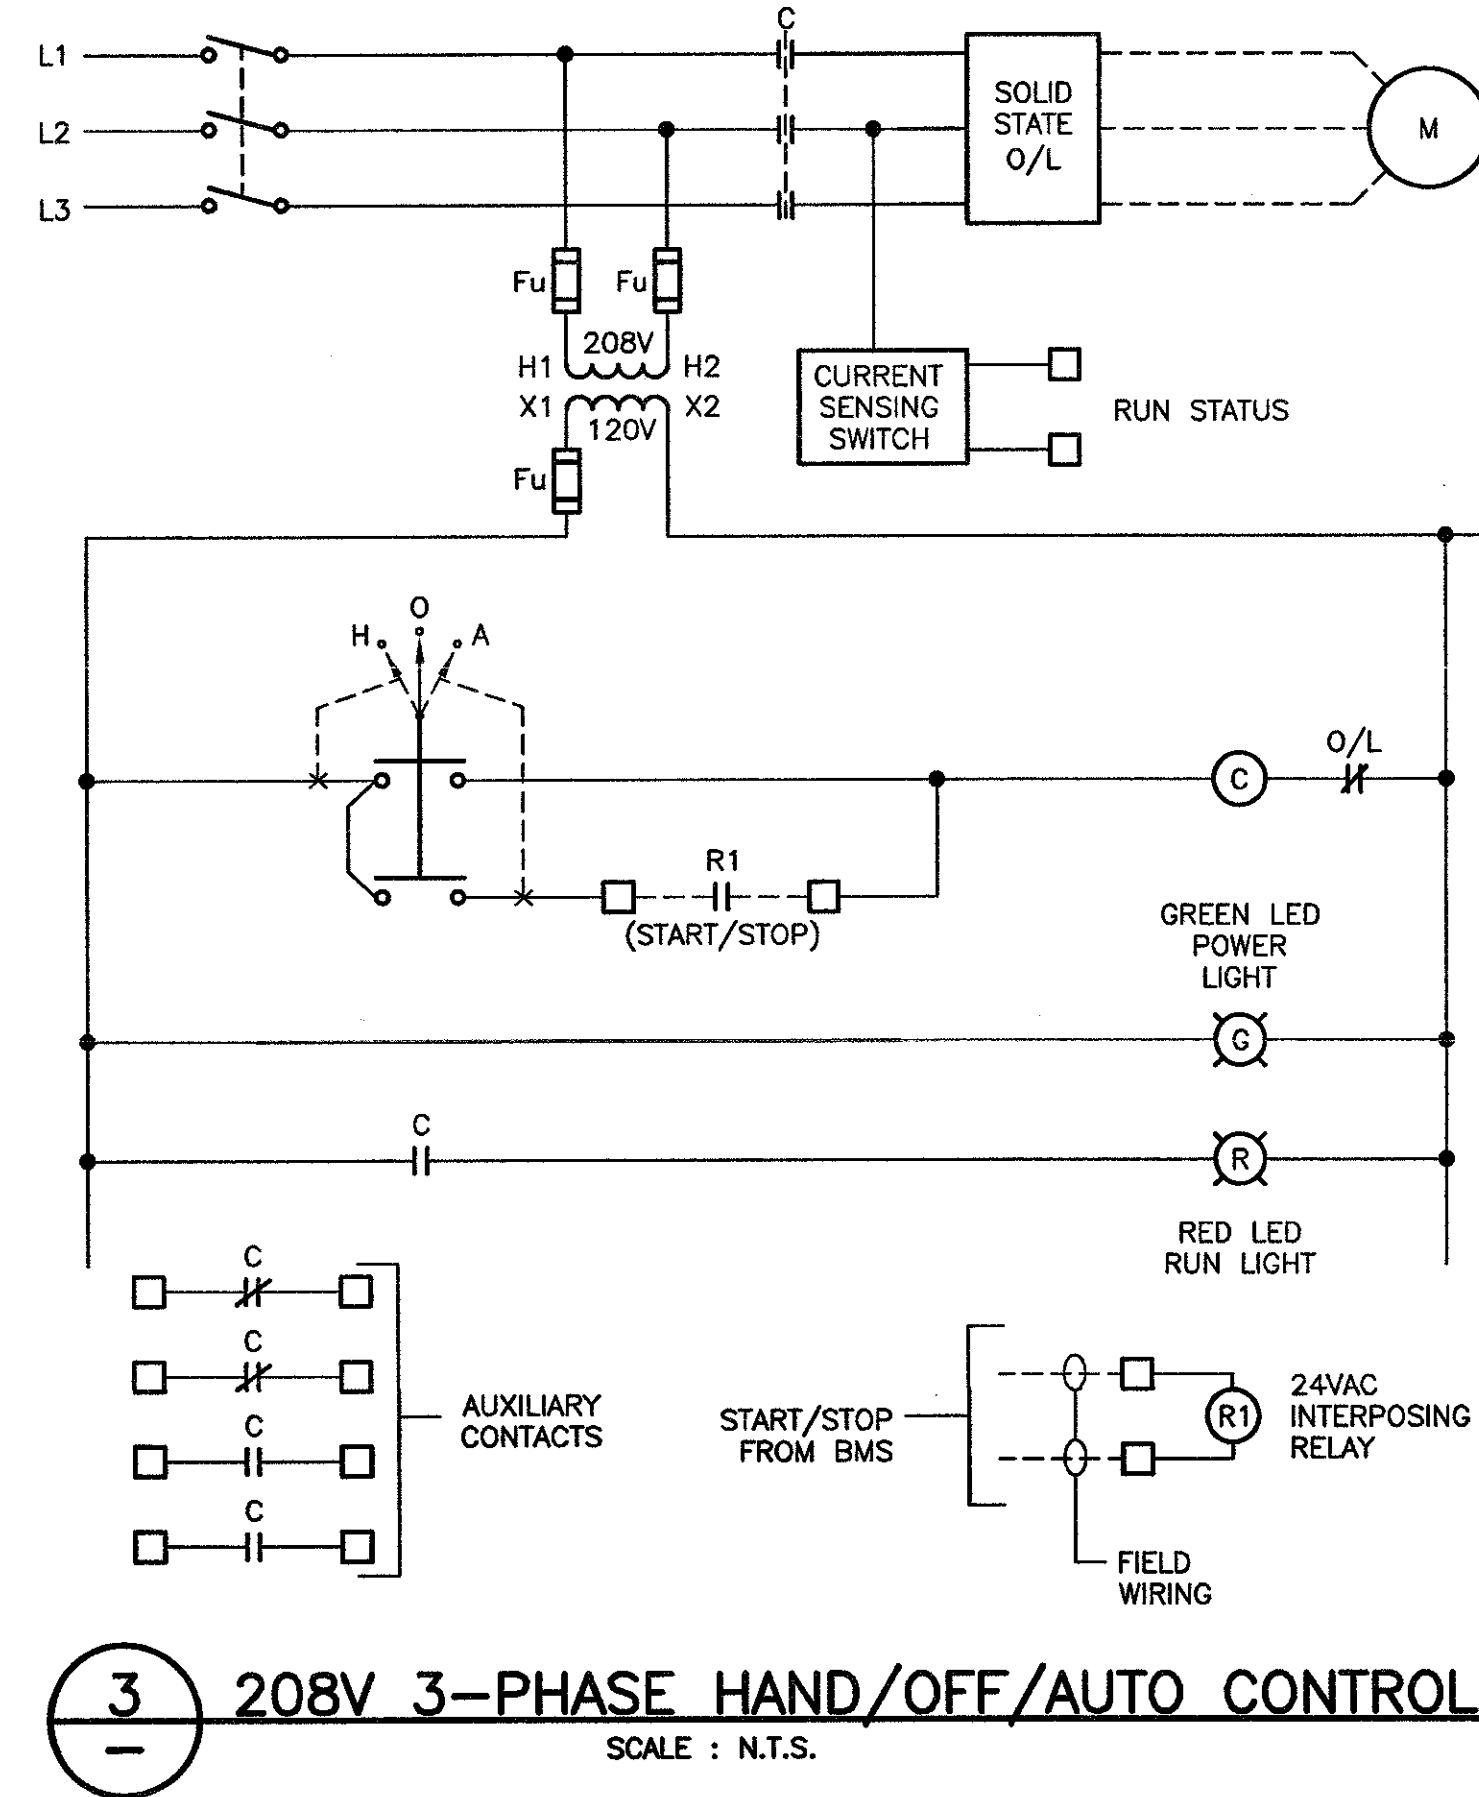
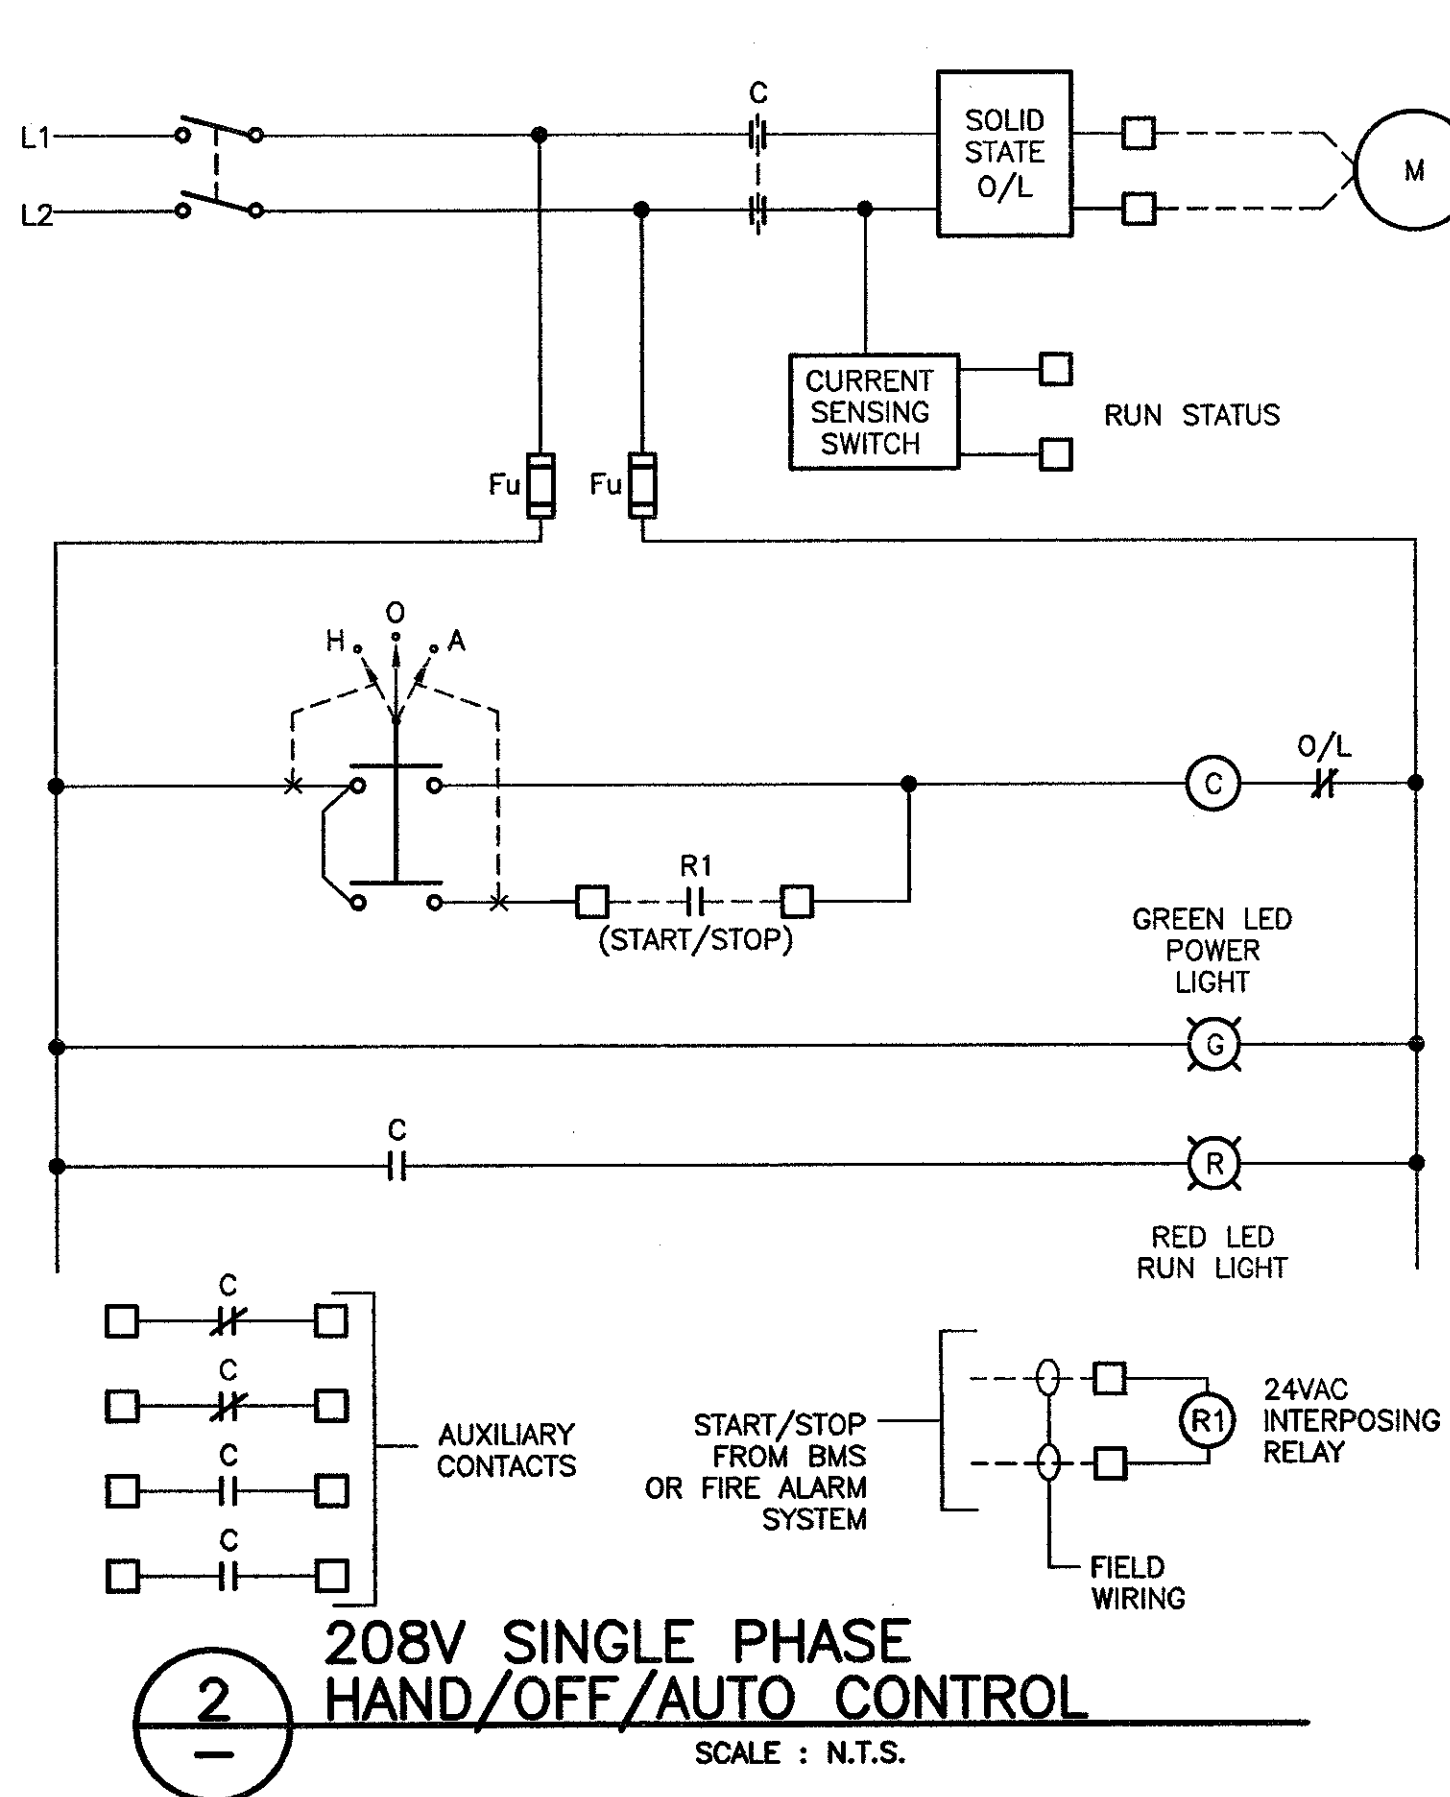
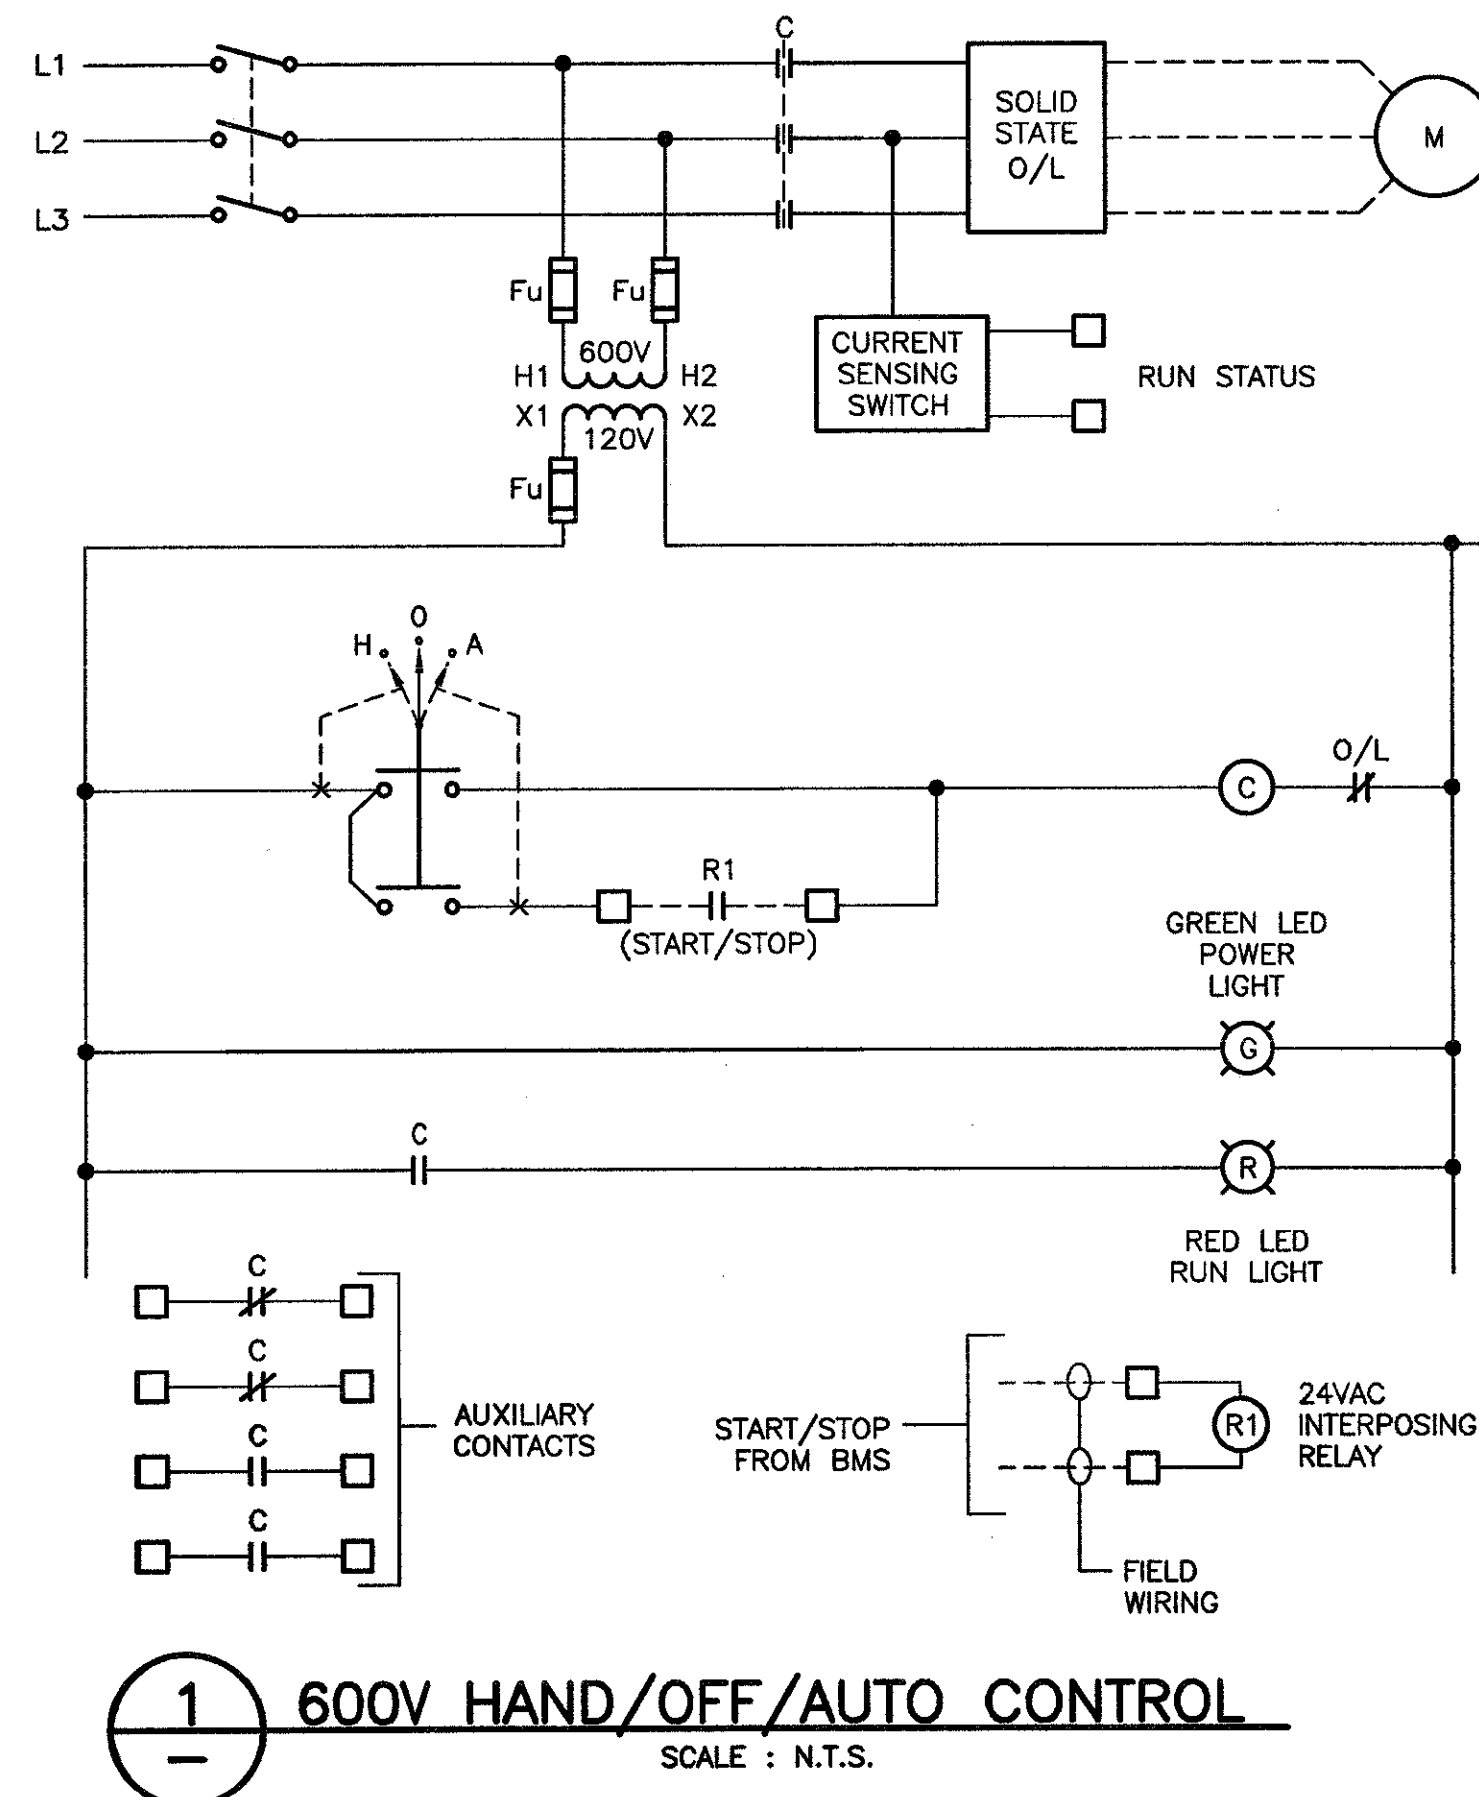


EQUIPMENT NO.	LOCATION	EQUIPMENT	EQUIP. RATING		FLA	VOLTAGE	PHASE	STARTER/CONTROL TYPE																				LOCATE AT EQUIPMENT							SCHEMATIC No. THIS DRAWING	FEEDER DETAILS	RELATED COMMENTS								
								DIRECT ELECTRICAL CONNECTION	MANUAL	IN COVER				MAGNETIC	COMBINATION	VFD	VFD BYPASS CONTACTOR	TWO SPEED	BREAKER TYPE	FUSE TYPE	120V. CONTROL XFMR	DISCONNECT TYPE	STOP-START	IN COVER				POWER ON LIGHTING-GREEN	24VAC INTERPOSING RELAY	CSA ENCL. TYPE	NOTES	EEMAC SIZE	EQUIPMENT CONTROL PANEL	DISC. SWITCH				TOGGLE SWITCH	JUNCTION BOX	RECEPTACLE	EEMAC ENCL. TYPE	SMOKE EXHAUST START-UP	FIRE ALARM START-UP	FIRE ALARM SHUT DOWN	NOTES
										TOGGLE	KEY	PUSH BUTTON	PILOT LIGHT																																

| AHU-1 | Mechanical Room | Air Handling Unit | 11.2 | | 14 | 575 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |


0	ISSUED FOR TENDER	NOV. 28 2013
revisions		date

project **NEW FOOD SERVICES BUILDING**
WESTMORLAND INSTITUTION
DORCHESTER, NB

drawing **ELECTRICAL LOAD LIST AND SCHEMATICS** dessin

designed MM	conçu
date Aug. 3, 2013	
drawn MM	dessiné
date Aug. 3, 2013	
approved TL	approuvé
date Nov. 29, 2013	
Signature: <i>Troy M. Langlois</i>	Signature: <i>Troy M. Langlois</i>
Project Manager	Administrateur de projet
project number R.061828.001	no. du projet
drawing no. E3.3	no. du dessin

