

**RETURN BIDS TO:
RETOURNER LES SOUMISSIONS À:**
**Public Works Government Services Canada- Bid
Receiving / Réception des soumissions**
189 Prince William Street
Room 421
Saint John
New Brunswick
E2L 2B9

SOLICITATION AMENDMENT MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
**Raison sociale et adresse du
fournisseur/de l'entrepreneur**

Issuing Office - Bureau de distribution
**Public Works Government Services Canada- Bid
Receiving / Réception des soumissions**
189 Prince William Street
Room 421
Saint John
New Bruns
E2L 2B9

Title - Sujet Food Service Bldg Westmorland Inst	
Solicitation No. - N° de l'invitation EC016-141832/A	Amendment No. - N° modif. 001
Client Reference No. - N° de référence du client EC016-141832	Date 2014-01-14
GETS Reference No. - N° de référence de SEAG PW-\$PWB-020-3350	
File No. - N° de dossier PWB-3-36100 (020)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2014-01-23	Time Zone Fuseau horaire Atlantic Standard Time AST
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Donovan, Janine PWB	Buyer Id - Id de l'acheteur pwb020
Telephone No. - N° de téléphone (506) 636-5347 ()	FAX No. - N° de FAX (506) 636-4376
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

This Tender Amendment No. One (1) is raised to include the following Addendum No. One (1).

The following Addendum to the tender is effective immediately. This addendum shall form part of the contract documents.

All other terms and conditions remain the same.

Addendum No. 1

QUESTIONS AND CLARIFICATIONS:

1. Which cast-irons are required for the manholes? Should they just be the provincial standard or something else?
Answer: *Cover and Frame for manholes shall be per the New Brunswick Department of Transportation Standard Specifications Item 407 and Standard Drawing 407-2. Solid covers shall be used unless plans state otherwise.*
2. Do the storm manholes have sump or are they benched?
Answer: *Storm manholes shall be benched.*
3. Do the storm manholes have gasketed holes for the outlet and inlet pipes or are they to be formed holes and grouted on-site by the contractor?
Answer: *Storm manholes shall have gasketed holes for inlet and outlet pipes.*
4. Is HDPE an acceptable pipe product for the storm sewer applications?
Answer: *This question will be clarified by revisions to Specification Section 33 41 00.*
5. Will the boilers be purchased by the contractors or directly from PWGSC?
Answer: *The boilers will be purchased by the General contractor.*

SPECIFICATIONS:

1. **SECTION 07 21 19 - FOAMED IN PLACE INSULATION.**
 - .1 **PART 2 - PRODUCTS, Sub-Section 2.1 - INSULATION:**
 - .1 Add the following product to Sentence .1.1 Acceptable Materials:
 - .4 Quik-Shield 112, by SWD Urethane.

2. SECTION 11 40 10 - FOOD SERVICE STOCK EQUIPMENT

.1 PART 2 - Products, Sub-Section 2.5 - ITEMIZED EQUIPMENT:

.1 Item # 87 - Fire Extinguishing System:

.1 Revise sentence under "Coverage" to read as follows:

"The fire protection system shall be an integral part with hoods, **items # 85A & 85B**".

3. SECTION 11 40 10 - FOOD SERVICE STOCK EQUIPMENT

.1 PART 2 - Products, Sub-Section 2.5 - ITEMIZED EQUIPMENT:

.1 Item # 1 - High Density Storage System on Rails:

.1 Revise last sentence in paragraph "Shelves" to read as follows:

"Complete with **4 fixed and 14 mobile shelves**, each 915 mm x 610 mm wide".

4. SECTION 11 41 10 - WALK-IN COOLERS AND FREEZERS

.1 Page 18: Correct Part 3 Section Heading:

.1 Revise "**Execution**" to read "**PART 3 - Execution.**"

.2 Page 18: Correct Sub-Section numbering:

.1 Revise **2.6 INSTALLATION** to read "**3.1 INSTALLATION.**"

.3 Page 19: Correct Sub-Section numbering:

.1 Revise **2.7 CLEANING AND ADJUSTING** to read "**3.2 CLEANING AND ADJUSTING.**"

.4 Page 19: Correct Sub-Section numbering:

.1 Revise **2.8 COMMISSIONING** to read "**3.3 COMMISSIONING.**"

5. SECTION 11 41 20 - FOOD SERVICE CUSTOM EQUIPMENT

.1 PART 2 - Products, Sub-Section 2.10 - ITEMIZED EQUIPMENT.

Revise as follows:

.1 Item # 29 - Stainless steel double pot sink w/ drainboard & faucet.

.1 Quantity: revise from 1 to 2. Refer to attached sketch layout FSK-01.

.2 Services: Clarification that services listed are for each unit (total 2).

6. **SECTION 33 41 00 - STORM UTILITY DRAINAGE PIPING.**

- .1 Replace PART 2, Subsection 2.1.1 with the following:
 - .1 Storm sewer mains 300mm and larger in diameter shall be reinforced concrete pipe meeting the requirements of the latest CAN/CSA Standard A257.2, Class 65D (ASTM Standard C76 Class III), 100D (ASTM Standard C76 Class IV), 140D (ASTM Standard C76 Class V) for reinforced concrete pipe (pipe class as indicated on the drawings).
OR
Polyvinyl Chloride (PVC) sewer pipe and fittings meeting the requirements of the latest ASTM Standard D3034, DR35, and CAN/CSA Standard B182.2.
OR
Profile PVC sewer pipe and fittings meeting the requirements of the latest ASTM Standard F794-97 and CAN/CSA Standard B182.4.
OR
Profile High Density Polyethylene (HDPE) pipe and fittings meeting the requirements of the latest CAN/CSA Standard B182.8, with a minimum pipe stiffness of 320Kpa and Type 1 (water-tight) joints with integrated bells.
- .2 Delete "PVC DR35" from Part 2, Subsection 2.1.3.

DRAWINGS:

1. **DRAWING FS.2 - GROUND FLOOR EQUIPMENT LAYOUT**

- .1 Change equipment layout in Food Prep Area (125) as indicated on sketch FS SK-01 (attached).
 - .1 Add 1 additional item # 29 as shown.
- .2 Relocate the following items as shown on sketch FS SK-01 (attached).
 - .1 Item #31 Vegetable processor
Services: 10 Amp - 208 v - 1 phase outlet on wall.
Floor drain.
 - .2 Item #33 Vacuum clipper w/nozzle
Services: Verify with Owner.
6 amp - 208 volt - 1 phase electric outlet on wall.
Compressed air inlet.

Solicitation No. - N° de l'invitation

EC016-141832/A

Client Ref. No. - N° de réf. du client

EC016-141832

Amd. No. - N° de la modif.

001

File No. - N° du dossier


PWB-3-36100

Buyer ID - Id de l'acheteur

pwb020

CCC No./N° CCC - FMS No/ N° VME

-
- | | | |
|----|-----------|------------------------------|
| .3 | Item #34 | Cart for Vegetable Processor |
| | Services: | No Services. |
| .4 | Item #65 | Garbage container |
| | Services: | No Services. |
| .5 | Item #79 | Stainless steel utility cart |
| | Services: | No Services. |

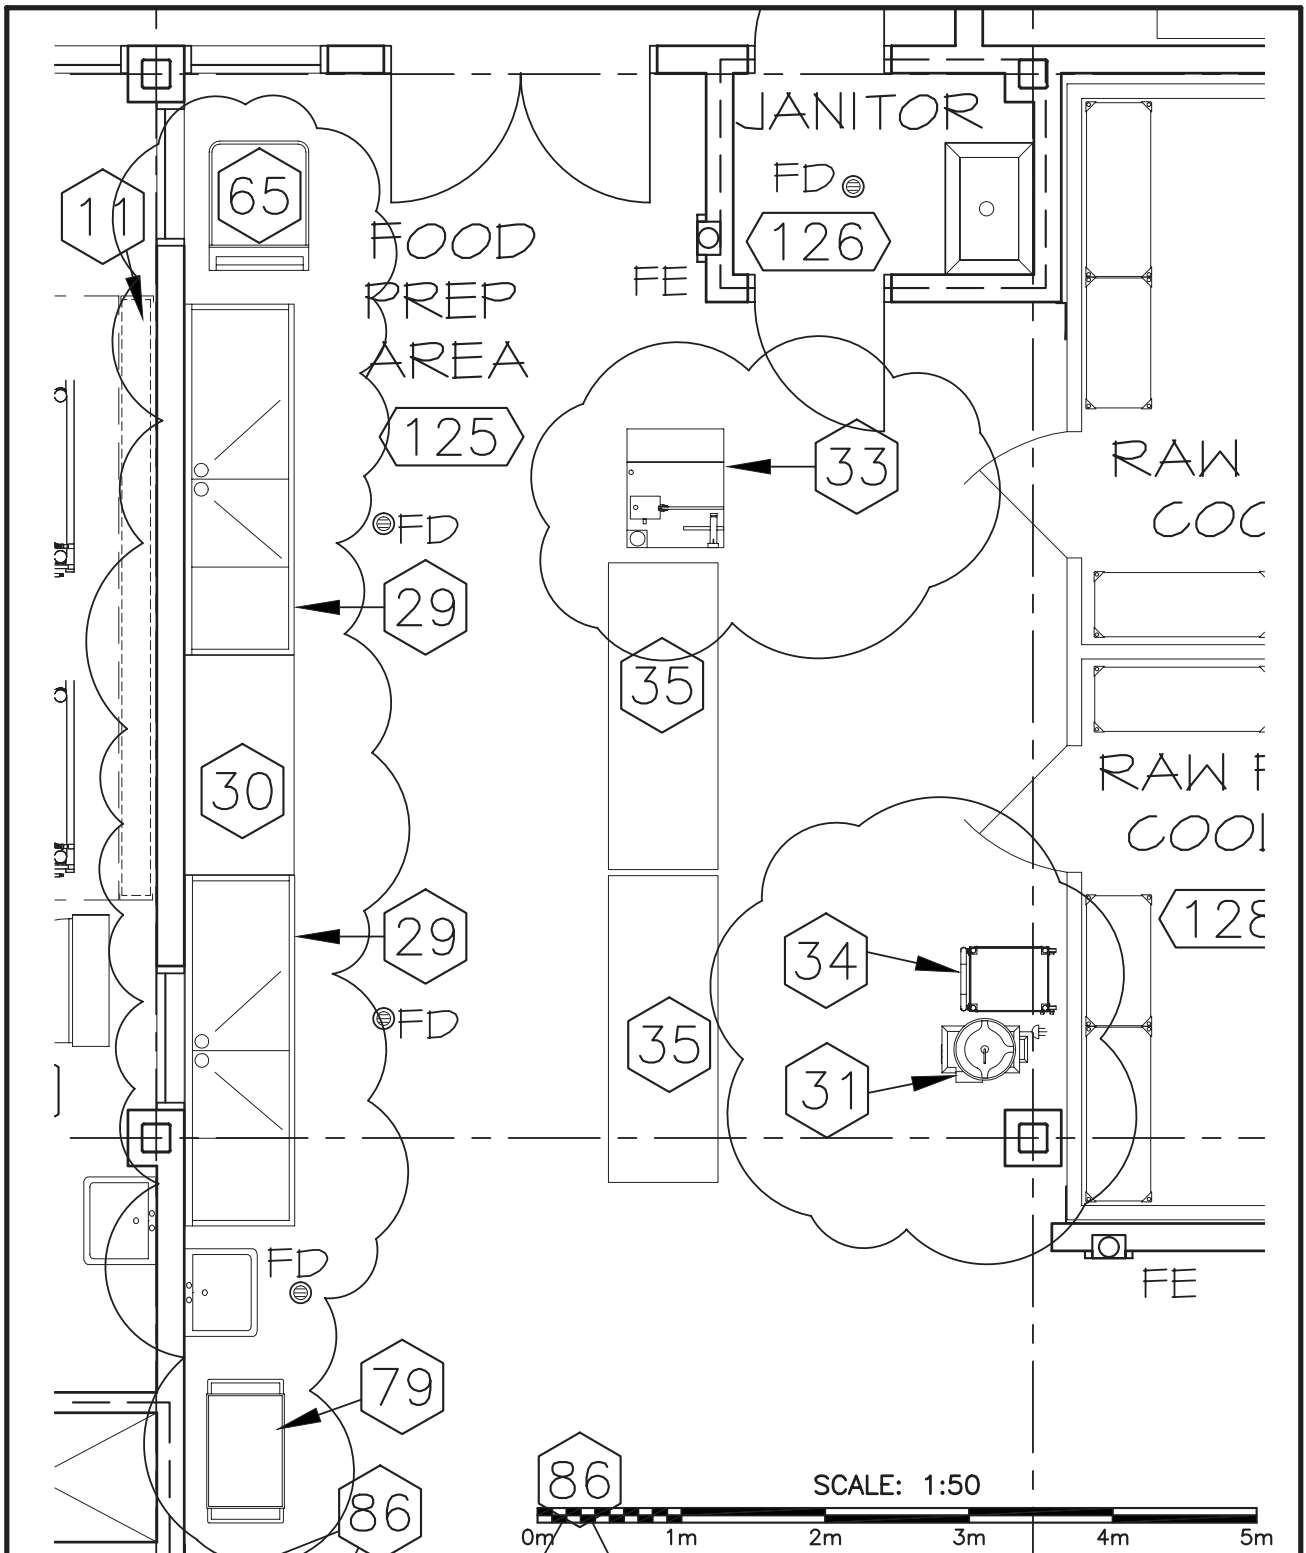

Public Works and Government Services Canada / Travaux publics et Services gouvernementaux Canada		Drawing title / Titre du dessin CHANGES TO RM.125 FOOD SERVICE EQUIPMENT LAYOUT		designed / conçu G.LUMMIS	date
project / projet NEW FOOD SERVICE BUILDING, WESTMORLAND INSTITUTION		Tender / Soumission		drawn / dessiné CADD	date
project number / no. du projet R.061828.001		drawing no. / no. du dessin FS SK-01		approved / approuvé	date