

RETURN BIDS TO:
RETOURNER LES SOUMISSIONS À:
Bid Receiving Public Works & Government Services
Canada/Réception des soumissions Travaux publics et
Services gouvernementaux Canada
1713 Bedford Row
Halifax, N.S./Halifax,(N.E.)
B3J 1T3
Halifax
Bid Fax: (902) 496-5016

SOLICITATION AMENDMENT MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Real Property Contracting
1713 Bedford Row
P.O. Box 2247/C.P.2247
Halifax, N.S./Halifax, (N.E.)
B3J 3C9
Halifax

Title - Sujet CHURCH SPRINKLER INSTALLATION	
Solicitation No. - N° de l'invitation E0225-142283/A	Amendment No. - N° modif. 001
Client Reference No. - N° de référence du client 20142283	Date 2014-01-31
GETS Reference No. - N° de référence de SEAG PW-\$PWA-123-5054	
File No. - N° de dossier PWA-3-70117 (123)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2014-02-06	Time Zone Fuseau horaire Atlantic Standard Time AST
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input checked="" type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Lockyer (PWA), Jeff	Buyer Id - Id de l'acheteur pwa123
Telephone No. - N° de téléphone (902) 496-5636 ()	FAX No. - N° de FAX (902) 496-5016
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

Amendment 001 is being created for the following:

NOTES:

- .1 The following additional instructions and amendments shall apply to, and form part of, the contract documents. The cost of this work shall be included in the Contract Price.
- .2 It is the responsibility of the Bidder to bring this Addendum to the attention of all subcontractors and material suppliers.
- .3 Each bidder shall acknowledge that this Addendum has been incorporated into the tender by noting such on the Bid Form.

.1 SPECIFICATION MODIFICATIONS

.1 Section 26 52 00.01 - Unit Equipment for Emergency Lighting

- .1 Revise item 2.1.2, supply voltage, originally indicated as 347V to be 120V.

.2 Section 28 31 02 - Multi-Plex Fire Alarm System

- .1 Delete requirement listed in 1.3.9.16 (Church System), indicating a remote annunciator located in the church.
- .2 Revise Item 1.3.9.1 (Visitors Centre System) to include: "or upgrade existing to accept and annunciate additional points as indicated on drawings".

.2 DRAWING MODIFICATIONS

.1 E802 - Electrical Basement and Main Floor Plans

- .1 Existing emergency lighting indicated on detail 1 is not emergency lighting but existing spot lighting. Spot lighting is to remain (no existing emergency lighting to be removed).

.2 Drawing 901 - Fire Protection Basement and Main Floor Plans

- .1 Detail 1 - The dry pendant sprinkler located in the vestibule to the wheel-chair ramp is to be fed from the dry-pipe system serving the basement. The vestibule ceiling space is not accessible from the church attic.

- .2 Detail 1 - Provide one dry sidewall sprinkler to be located on the partition between the Main Church and the Sacristy. This sprinkler is to be fed from the attic dry-pipe system. The intent of this sprinkler is to protect the bulkhead space between the two spaces.
- .3 Detail 2 – Contractor may use upright heads in lieu of side-wall heads in basement. This may require re-spacing of branch piping.
- .4 Detail 2 – The intent in the basement is to run sprinkler piping as high as possible and close to overhead beams to maintain as much space as possible below for use in storage.

.3 **Drawing 903 - Fire Protection Details**

- .1 Detail 1 – Add a check valve and supervised isolation valve on the incoming line from underground feeding the dry-pipe valve header.
- .2 Detail 1 – Add a Fire Department Connection (FDC) and check valve feeding into the dry-pipe valve supply header. For location of FDC refer to Detail 2 Drawing 901.
- .3 Detail 2 – Add a check valve after the zone supervised isolation valve in the new 150 mm line in the Visitor's Center.

Specification Section 01 14 10, sentence 1.3.1: Delete *"Most of the work can happen during regular hours (7 am – 5 pm) ...* substitute: ***"Working hours are 8:00 am to 4:30 pm ... "***

Include the following into Specification

The Contractor will be responsible for protection of, and reimbursement for repairs made to, all fixed items, statues, memorial plaques and monuments, etc. left on any space or level of the museum where work has occurred or affected, and which has been damaged as a result of the construction.

The Contractor will be responsible for protection and repair of damages to all interior and exterior materials to the satisfaction of the Department Representative.

All cutting, drilling, removal or other alteration in the public spaces is not to be done without permission from the Department Representative 24 hrs in advance.

Washrooms will be available in the Visitor's Centre.

Electricity for small tools, but not heaters required for work, is available to the Contractor on site.

The following is to address question(s) from potential bidder(s)**Question 1**

Is there Asbestos in any of the areas in which we have to make holes?

Answer 1

We have no knowledge of asbestos in the building. Specification section 01 10 10, para. 1.17 indicates procedures if asbestos is discovered in the work.

Question 2

At the site visit, I asked if the exterior pipe feeding the attic would have to be hot galv dipped after the welds were completed. However after further investigation I found out they cannot hot galv dip the complete riser at once (due to the length) and there for you would be no further ahead. So I assume we can touch up the welds with cold galv paint.

Answer 2

I would say for the pipe and welded fittings to be galvanized and the all galvanized pipe and fittings that are galvanized to painted with an epoxy primer (2 coats) and paint (2 coats - color to be approved by the Owner) that is designed for galvanized pipe.

Question 3

Would the attic space be considered as CONFINED SPACE?

Answer 3

We do not consider it a confined space. The hazard assessment will have to acknowledge and respond to the safety issues associated with working in this space.

Question 4

I am going out for pricing for the ULC listed air compressor with tank and decissent air dryer. Please provide the electrical requirements for the compressor.

Answer 4

The compressor is shown on drawing 801, 1HP, 240V, single-phase.

Solicitation No. - N° de l'invitation

E0225-142283/A

Amd. No. - N° de la modif.

001

Buyer ID - Id de l'acheteur

pwa123

Client Ref. No. - N° de réf. du client

20142283

File No. - N° du dossier


PWA-3-70117

CCC No./N° CCC - FMS No/ N° VME

Include the following illustrations;

Historical Photos have been included as a reference. (See attached herein)

*** All other terms and conditions remain the same.**

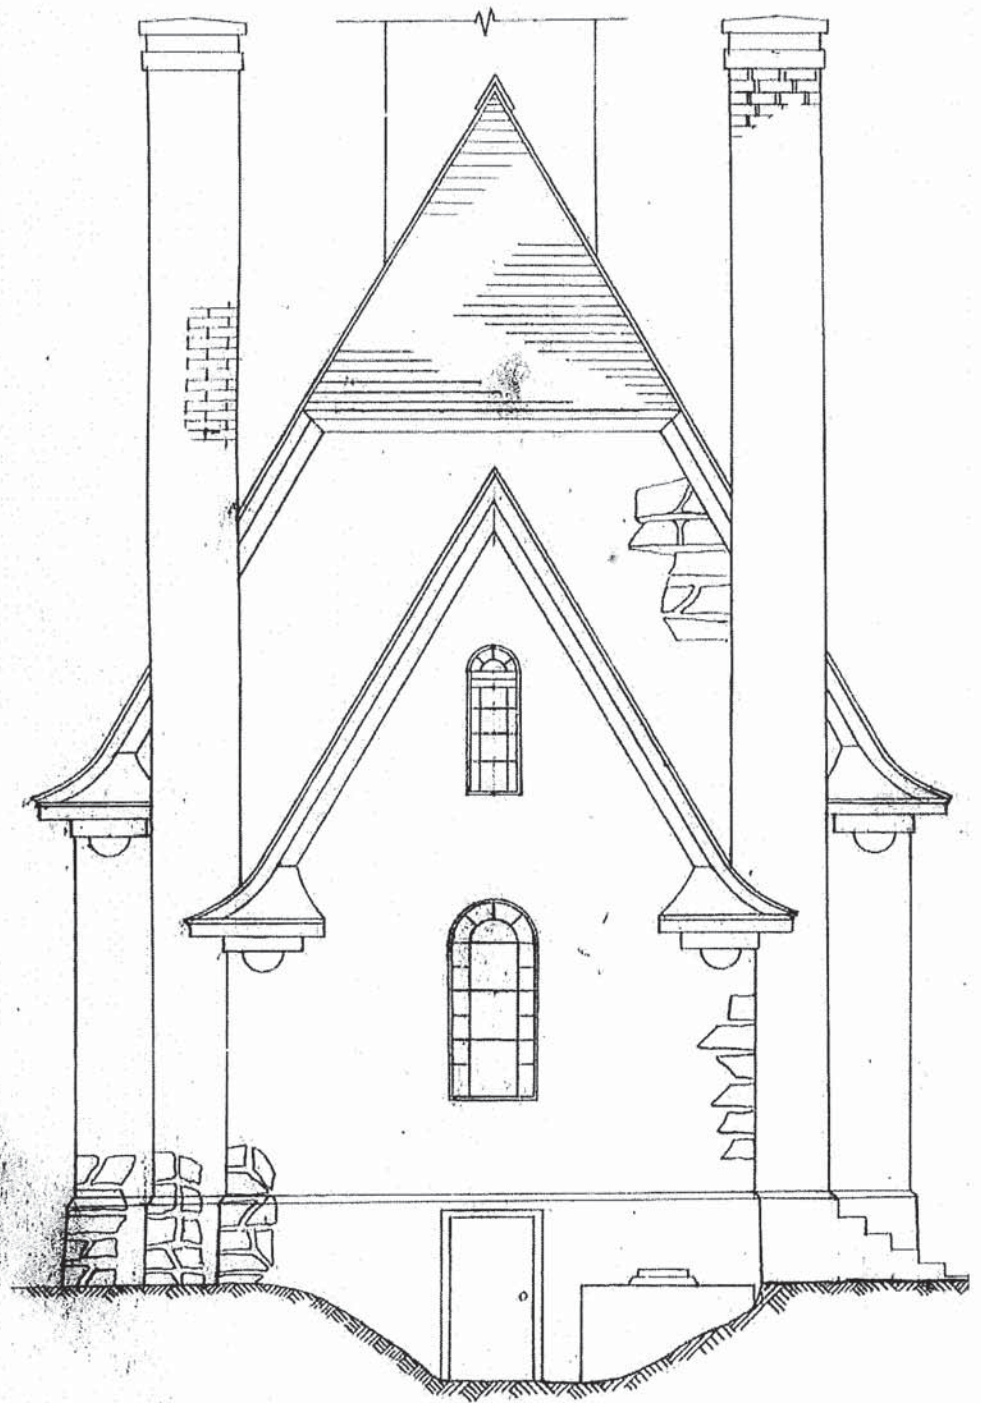

REAR ELEVATION





REAR ELEVATION

