


- NOTES**
- S/S CABINET FOR PANEL A.
 - PLYWOOD BACKBOARD.
 - CONTRACTOR TO RUN ONE (1) EXTRA WIRE WITH CIRCUITS #A-20 AND A-22 FOR FUTURE CCTV CAMERA CONNECTIONS AT TOP OF POLE INDICATED.
 - POWER CONNECTION FOR CCTV TO BE WIRED SEPARATE TO LIGHTING CONTROL AS IT IS TO OPERATE 24/7.
 - SEE SPECIFICATION SECTION 01 00 50 FOR WORK PREVIOUSLY COMPLETED.

SYMBOL	LEGEND
	TYPE 'A' POLE MOUNTED LIGHT FIXTURE. REFER TO DETAILS AND FIXTURE SCHEDULE FOR MORE INFORMATION.
	UNDERGROUND ELECTRICAL SERVICE.
	ELECTRICAL SHROUD. '1'-INDICATES SHROUD NUMBER.
	METERED ELECTRICAL SERVICE EQUIPMENT. '1'-INDICATES SERVICE NUMBER.
	20A, 120V TWISTLOCK MARINE GRADE WEATHER PROOF RECEPTACLE C/W WEATHERPROOF COVERPLATE.
	50A, 120/240V, 1φ, 3W BUYER WINCH.
	120/240V, 1φ, 3W FUEL PUMP.
	120V, 1φ, FUEL DISPENSER AND GAS BOY PAY STATION.
	FUEL PUMP EMERGENCY STOP BUTTON.
	EXISTING 250W HPS ROADWAY LIGHT FIXTURE ON 3M BRACKET MOUNTED ON WOOD POLE.
	EXISTING WOOD POWER / LIGHT POLE.
	EXISTING CCTV CAMERA ON WOOD POLE.
	OVERHEAD NB POWER 12.47KV; 120/240V 1φ POWER WIRES; ALUMINUM TELEPHONE CABLE AND/OR HARBOUR AUTHORITY CCTV CABLE AS NOTED.
	POLE MOUNTED TRANSFORMER.
	GROUND ROD 3m LONG X 19mm Ø.
	120V PHOTOCCELL.
	LIGHTING CONTACTOR.
	15A, 120V DUPLEX MARINE GRADE RECEPTACLE C/W MARINE GRADE COVERPLATE.
	MARINE GRADE TELEPHONE OUTLET RECEPTACLE.
	LIGHTING BYPASS SWITCH.
	400A, 240V, 1φ, 3W DISCONNECT SWITCH FUSED AT 400A.
	NB POWER SERVICE METER.
	PANEL HEATER STRIP.

- NOTES**

SYMBOL	LEGEND
	TYPE 'A' POLE MOUNTED LIGHT FIXTURE. REFER TO DETAILS AND FIXTURE SCHEDULE FOR MORE INFORMATION.
	UNDERGROUND ELECTRICAL SERVICE.
	ELECTRICAL SHROUD. '1'-INDICATES SHROUD NUMBER.
	METERED ELECTRICAL SERVICE EQUIPMENT. '1'-INDICATES SERVICE NUMBER.
	20A, 120V TWISTLOCK MARINE GRADE WEATHER PROOF RECEPTACLE C/W WEATHERPROOF COVERPLATE.
	50A, 120/240V, 1φ, 3W BUYER WINCH.
	120/240V, 1φ, 3W FUEL PUMP.
	120V, 1φ, FUEL DISPENSER AND GAS BOY PAY STATION.
	FUEL PUMP EMERGENCY STOP BUTTON.
	EXISTING 250W HPS ROADWAY LIGHT FIXTURE ON 3M BRACKET MOUNTED ON WOOD POLE.
	EXISTING WOOD POWER / LIGHT POLE.
	EXISTING CCTV CAMERA ON WOOD POLE.
	OVERHEAD NB POWER 12.47KV; 120/240V 1φ POWER WIRES; ALUMINUM TELEPHONE CABLE AND/OR HARBOUR AUTHORITY CCTV CABLE AS NOTED.
	POLE MOUNTED TRANSFORMER.
	GROUND ROD 3m LONG X 19mm Ø.
	120V PHOTOCCELL.
	LIGHTING CONTACTOR.
	15A, 120V DUPLEX MARINE GRADE RECEPTACLE C/W MARINE GRADE COVERPLATE.
	MARINE GRADE TELEPHONE OUTLET RECEPTACLE.
	LIGHTING BYPASS SWITCH.
	400A, 240V, 1φ, 3W DISCONNECT SWITCH FUSED AT 400A.
	NB POWER SERVICE METER.
	PANEL HEATER STRIP.

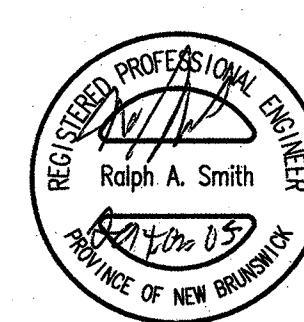

rsmith@rsei.ca
electrical consultant



Electrical Consulting Engineers
564 Prospect St, Fredericton, NB Canada E3B 9M3 • 506.451.0005

revisions	description	date
-----------	-------------	------

project
ELECTRICAL REPAIRS
STRUCTURE 402
PIGEON HILL, NB
COMITÉ DE GLOUCESTER COUNTY

drawing
ELECTRICAL POWER SERVICES, POLE LAYOUTS & DETAILS

designed RALPH SMITH, P.ENG
date 2014.02.05
drawn GERALD FANJOY
date 2014.02.05
approved RALPH SMITH, P.ENG
date 2014.02.05
Tender
PWSCC Project Manager
project number
R.067938.001
drawing no.
E2 of/de E3