


DRAWING TO BE USED FOR GUIDANCE ONLY  
ALL MEASUREMENTS SHALL BE VERIFIED BY CONTRACTOR



- NOTES:
- 1) NEW MATERIAL TO BE 316L SS
  - 2) ALL WELDING TO BE CONTINUOUS TO ENSURE WATERTIGHTNESS.
  - 3) GALVANIC ISOLATION INSTALLED WHERE REQUIRED.

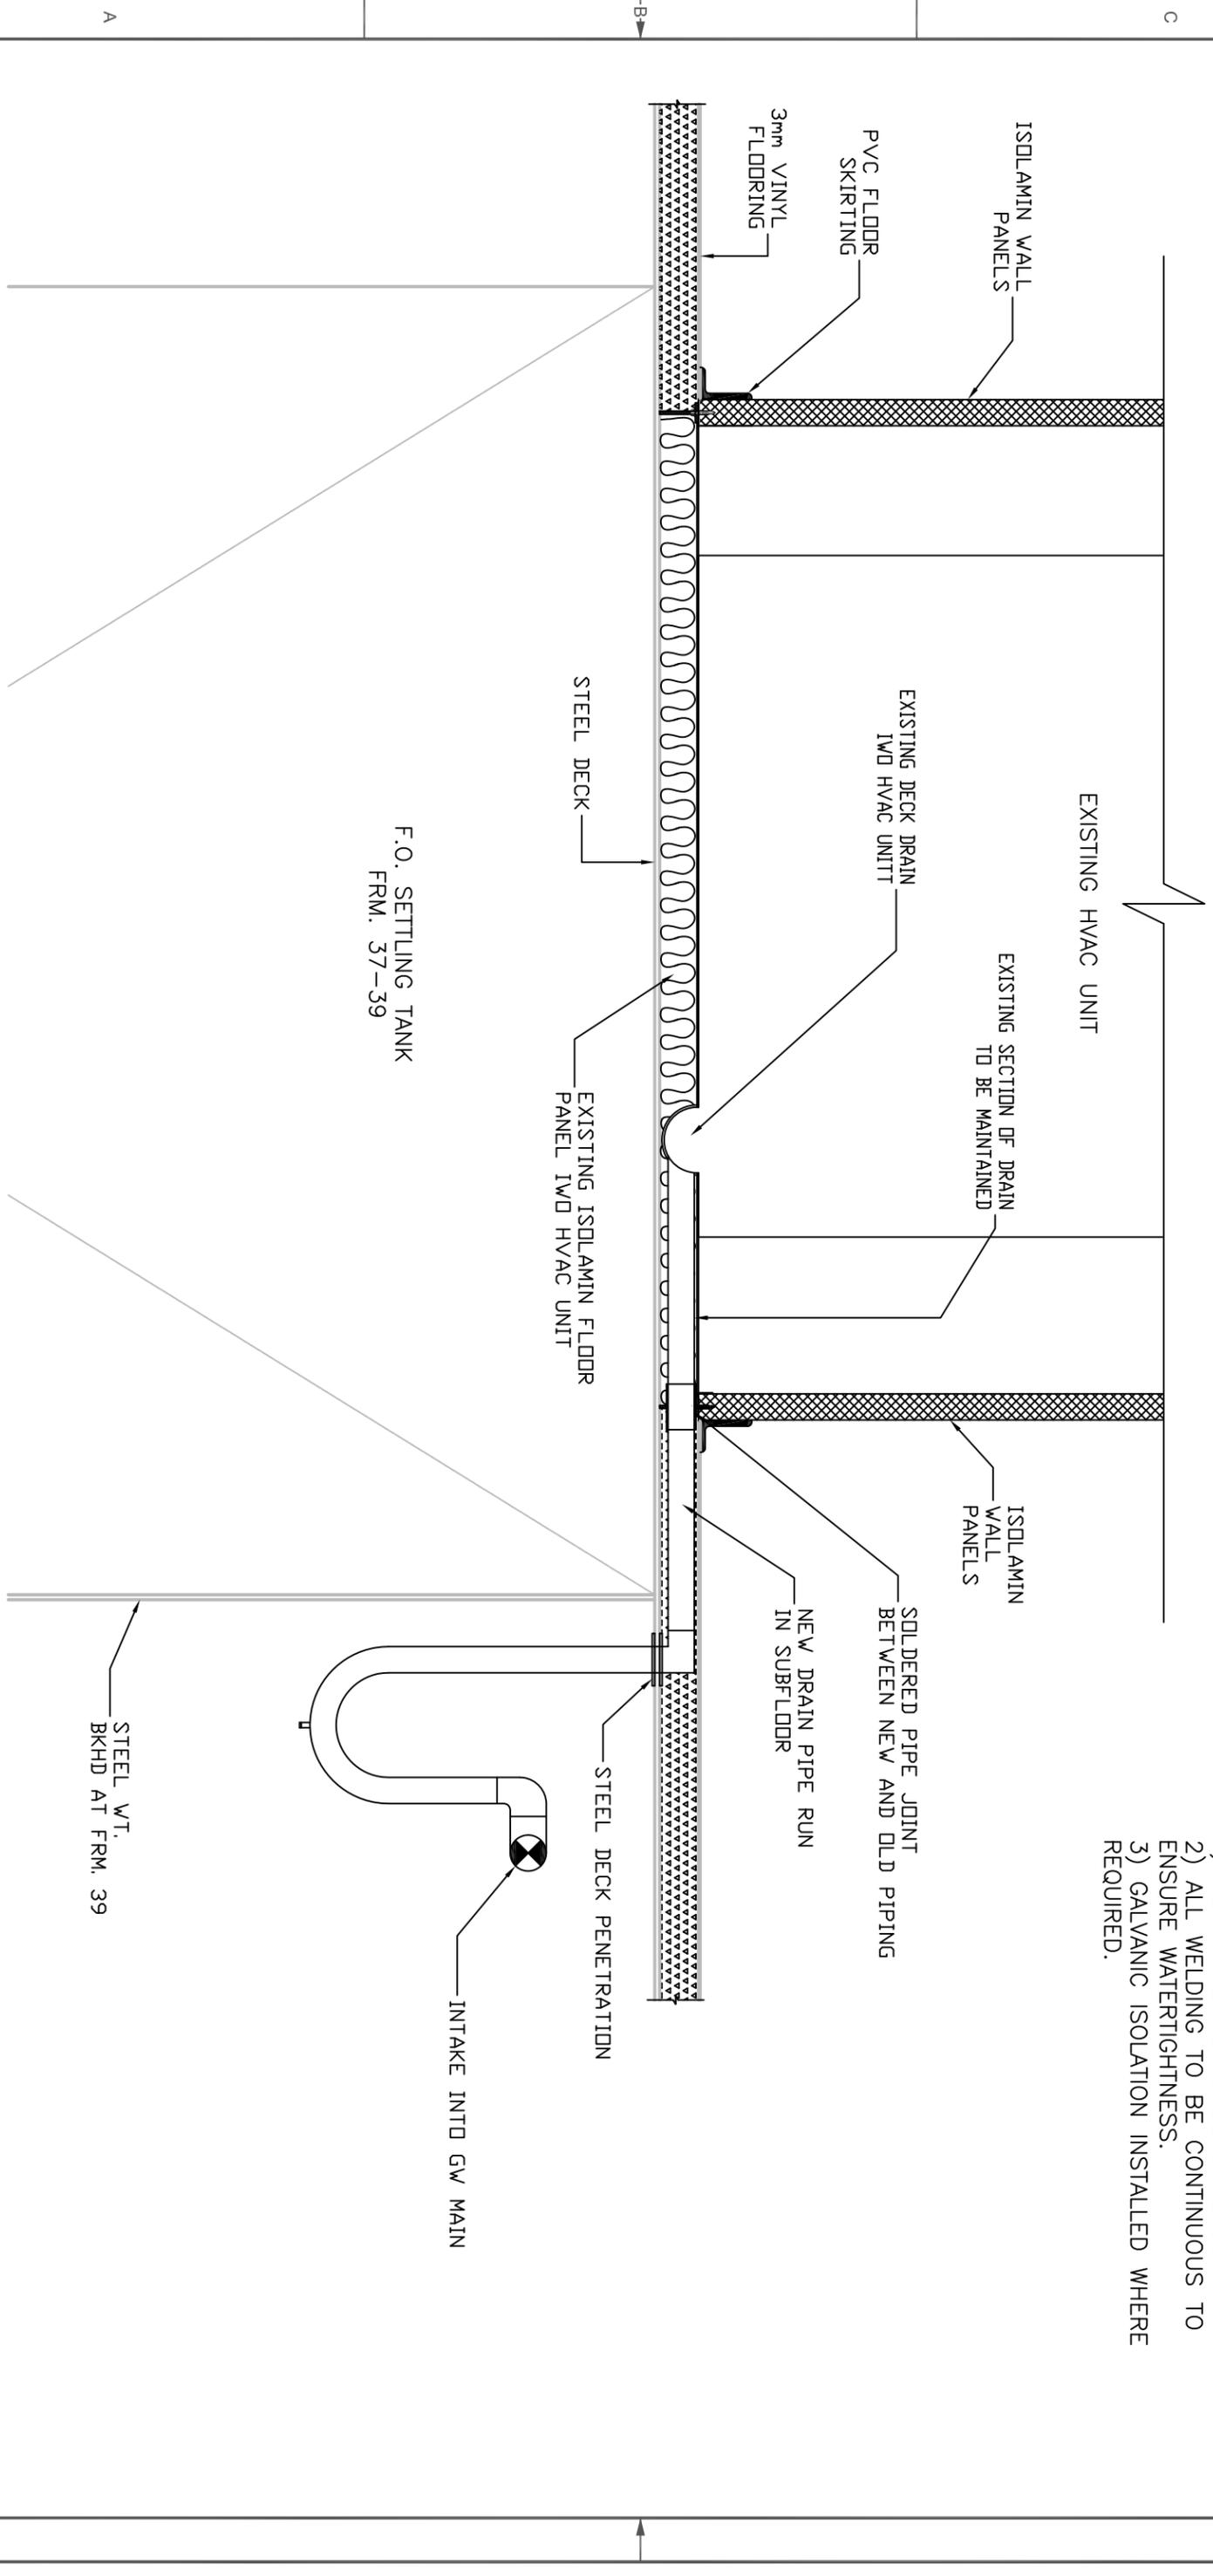

F.O. SETTLING TANK  
FRM. 37-39

STEEL WT.  
BKHD AT FRM. 39

INTAKE INTO GW MAIN

Fisheries and Oceans Canada		Pêches et Océans Canada		designed - conception		date checked - vérifié		date		Asset - Actif	
Canadian Coast Guard		Garde côtière Canadienne		drawn - dessiné		date approved - approuvé		date		CCGS-SAMUEL RISLEY	
				CJ		CJ		1		HVAC FLOOR DRAIN	
				CCG ref. no. - no. réf. GCC		scale - échelle		rev		drawing no. - no. dessin	
				2014-02-26		1"=1' UNO		0		OSK2	
				2014-02-26						sheet-feuille	
										01/01	
										1	

4 3 2 1 0 millimeters 2 1 0 millimeters