




GROUND LEVEL PLAN 1  
1:30

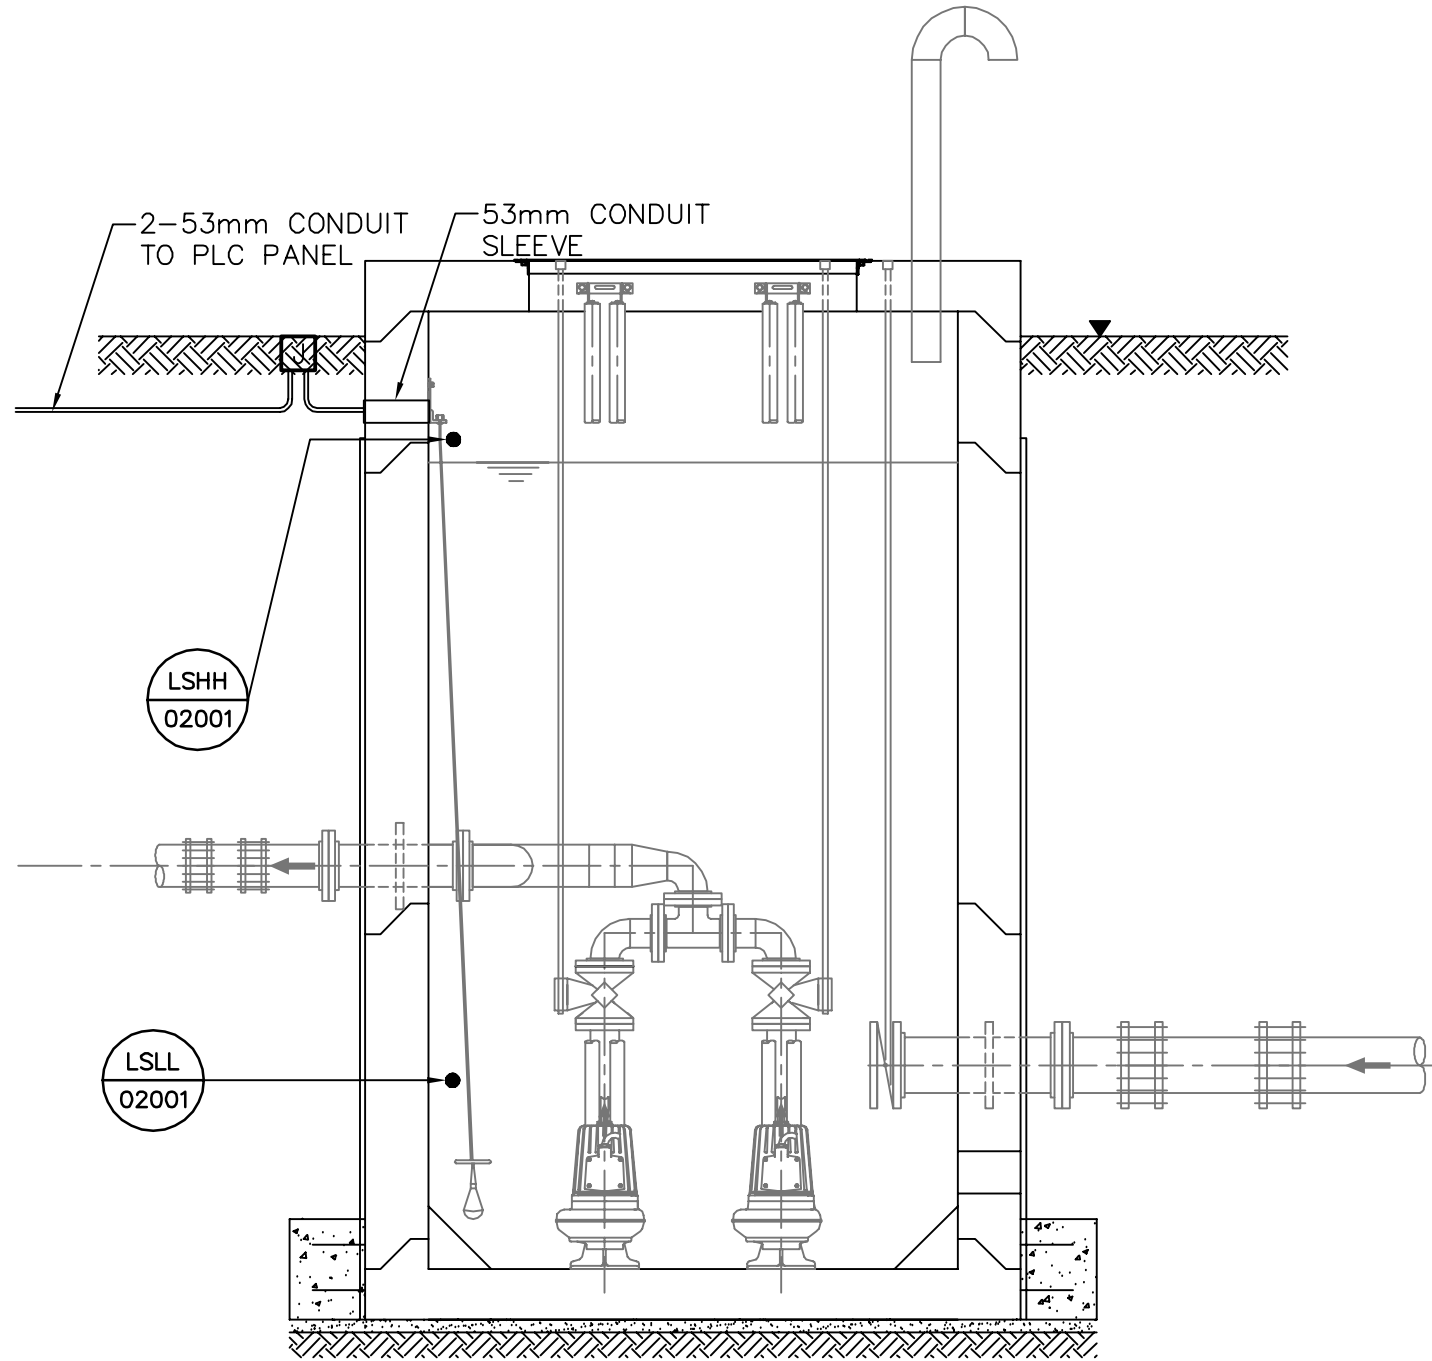


SECTIONS A  
1:30

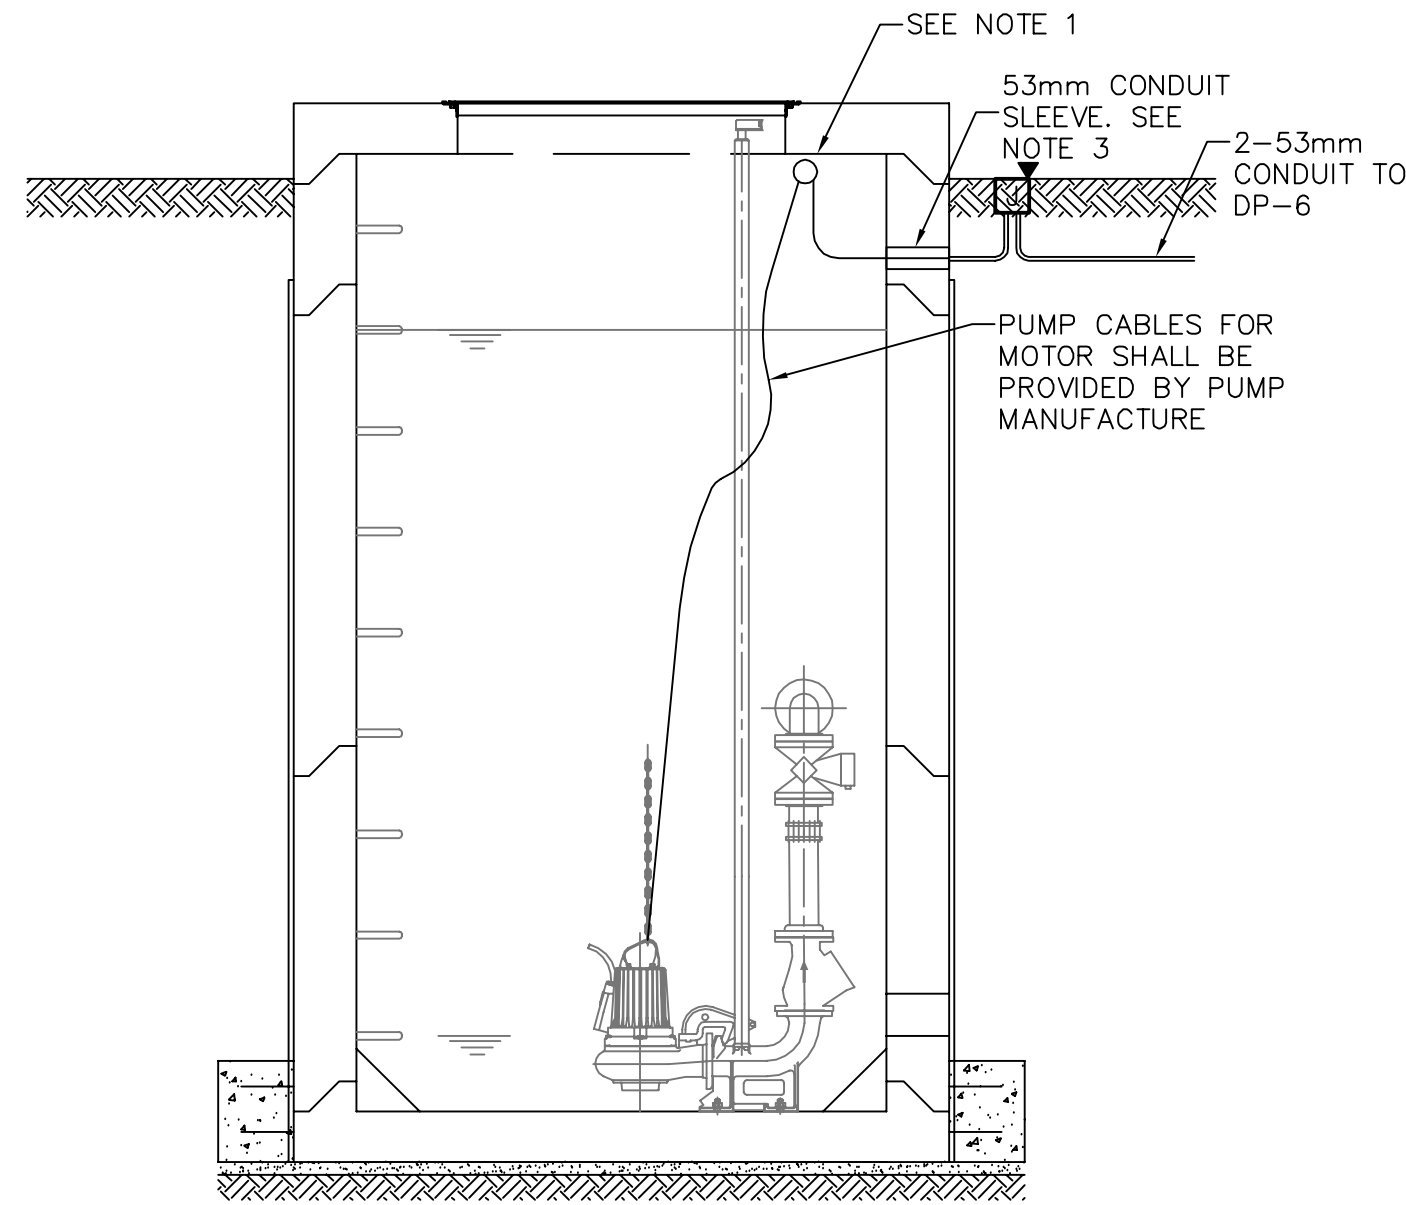

SECTIONS B  
1:30

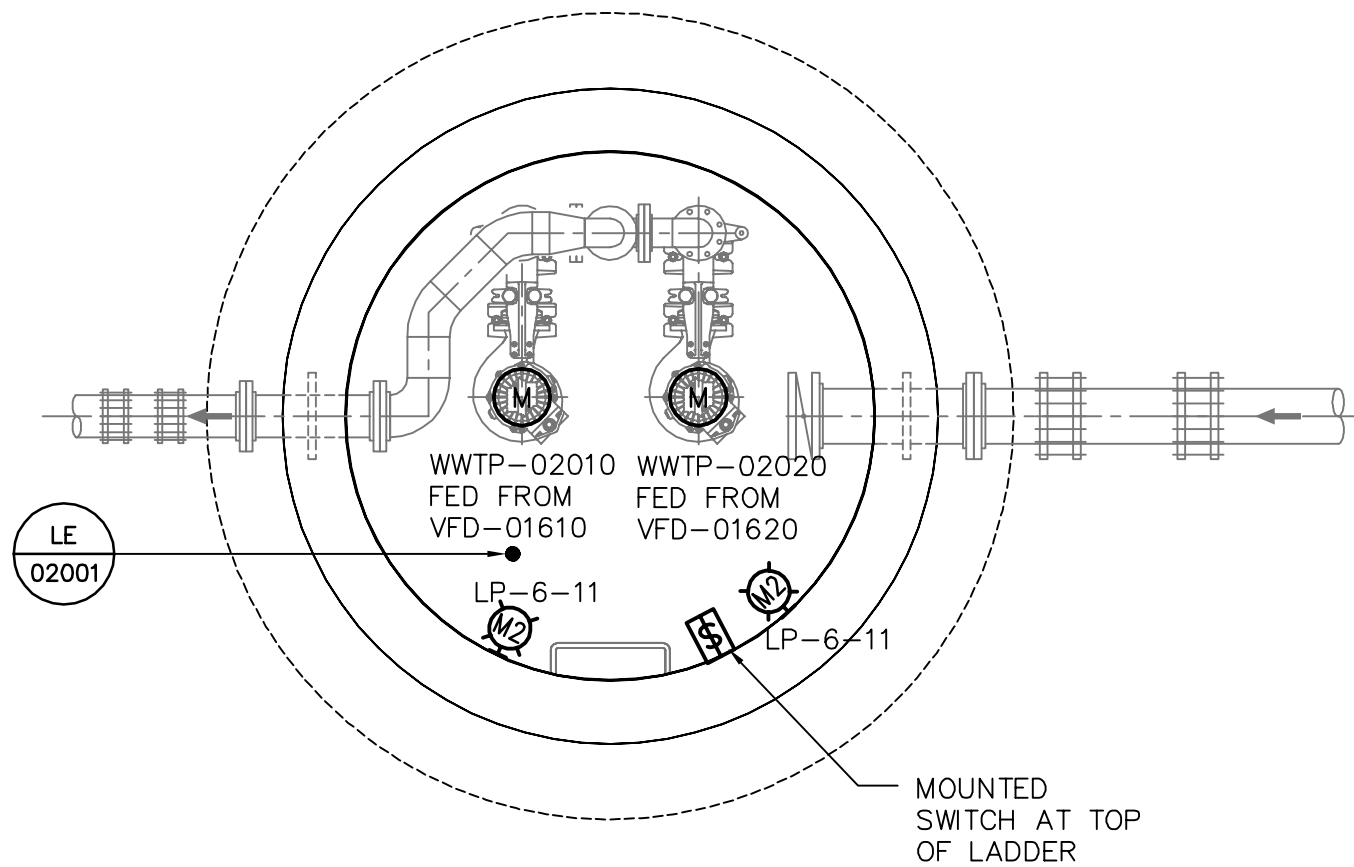



WET WELL PLAN 2  
1:30

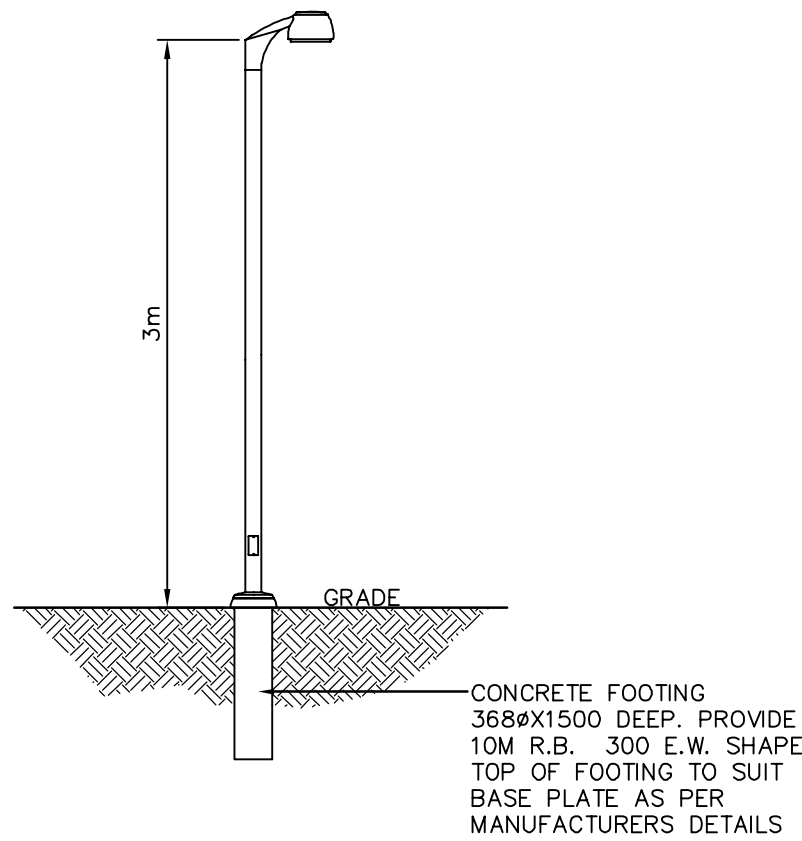

LIGHTING POLE DETAIL 3  
1:30

NOTE

1. PROVIDE "J" HOOK MOUNTED AS HIGH AS POSSIBLE UNDER HATCH OPENING
2. PROVIDE 6"x6"x5" DEEP JUNCTION BOX FLUSH WITH GRADE. INSTALL 53mm CONDUIT FOR PUMP POWER/FLOAT CABLE. SEAL CONDUITS TO BUILDING. CONTRACTOR TO COORDINATE EXACT LOCATION OF THE JUNCTION BOX ON SITE PRIOR TO INSTALLATION
3. PROVIDE 53mm CONDUIT SLEEVE THROUGH WET WELL DECK. PROVIDE STAINLESS STEEL STRAIN RELIEF FITTINGS (EACH CABLE)
4. LIT-02001 MOUNTED ON FACE OF LCP-02010

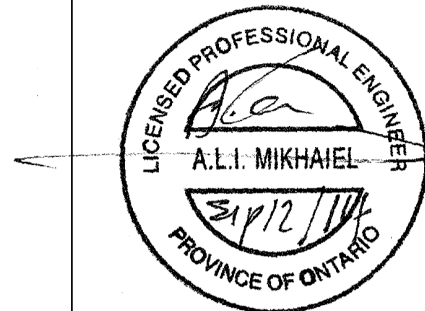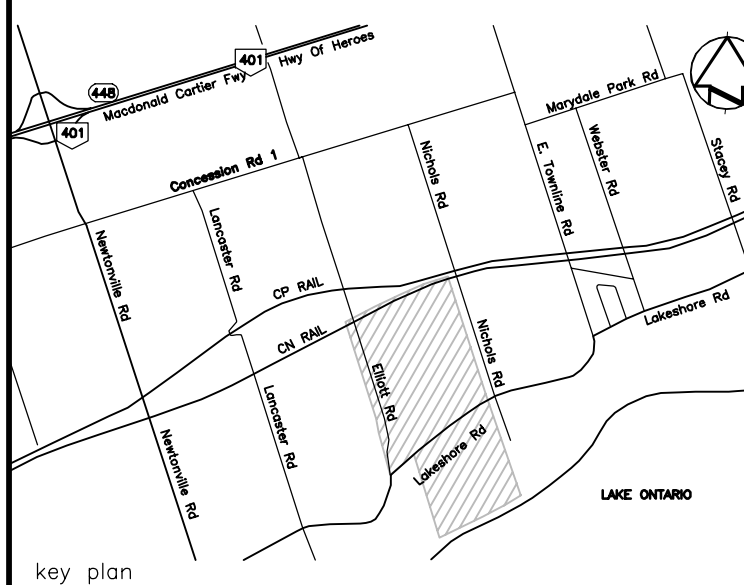

04		
03		
02	TENDER ADDENDUM No. 1	2014/10/01
01	ISSUED FOR TENDER	2013/06/28
revision		date

Do not scale drawings.  
Verify all dimensions and conditions on site and immediately  
notify the Departmental Representative of all discrepancies.

**AECOM**

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or  
relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use  
by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability  
whatsoever, to any party that modifies this drawing without AECOM's express written consent.  
Do not scale this document. All measurements must be obtained from stated dimensions.

project title  
titre du projet  
**PORT GRANBY, ONTARIO  
PORT HOPE AREA INITIATIVE**

**PORT GRANBY PROJECT  
LTMWF CONSTRUCTION AND  
PGWMF REMEDIATION**

drawing title  
titre du dessin  
**EQUALIZATION POND  
PUMP STATION  
POWER AND LIGHTING LAYOUT**

drawn by  
dessiné par  
**AJS**

designed by  
conc par  
**JL**

approved by  
approuvé par  
**YC/CH**

bid  
offre  
**J.A., P.ENG.** project manager  
administrateur de projets

project date  
date du projet  
**2013-07-15**

project no.  
no. du projet  
**R.023276.217**

drawing no.  
dessiné no.  
**LTMWF-E-32**