


- NOTE
1. ALL ELECTRICAL CIRCUIT SHALL BE FED FROM LP-4.
 2. REFER TO DRAWING LTWMF-E-03 FOR DETAIL OF LIGHTING FIXTURES
 3. COORDINATE EXACT LOCATIONS OF LOCAL CONTROL PANELS AND POWER PANELS ON SITE PRIOR TO INSTALLATION

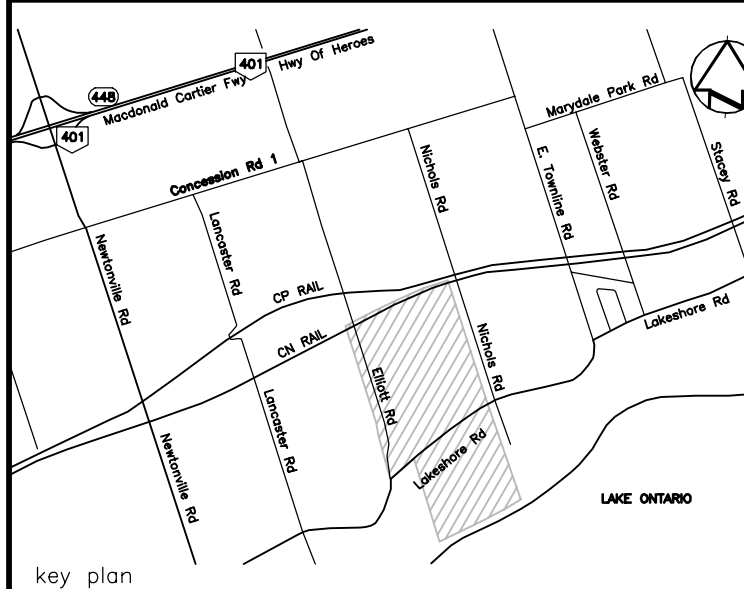

04		
03		
02	TENDER ADDENDUM No. 1	2014/10/01
01	ISSUED FOR TENDER	2013/06/28
revision		date

Do not scale drawings.
Verify all dimensions and conditions on site and immediately
notify the Departmental Representative of all discrepancies.

AECOM

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or
relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use
by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability
whatsoever, to any party that modifies this drawing without AECOM's express written consent.
Do not scale this document. All measurements must be obtained from stated dimensions.

project title
titre du projet
**PORT GRANBY, ONTARIO
PORT HOPE AREA INITIATIVE**

project title
titre du dessin
**LEACHATE REMOVAL
PUMP STATION CELL 1
ELECTRICAL LAYOUT**

drawn by
dessiné par
AJS

designed by
conçue par
JL

approved by
approuvé par
YC/CH

bid
offre
J.A., P.ENG. project manager
administrateur
de projets

project date
date du projet
2013-07-15

project no.
no. du projet
R.023276.217

drawing no.
dessiné no.
LTWMF-E-30