

PROPOSED ROUTING TO BE CONFIRMED BY FIELD CHECK.

SALVAGE 25KVA-1PH-120/240V TRANSFORMER, POLE (TAG#7096039) AND ALL HARDWARE:

INSTALL ON NEW CL4/45' POLE 75KVA-1PH-120/240V TRANSFORMER AND TRANSFER EXISTING SERVICES TO NEW POLE.

REPLACE 35' POLE (TAG#7096041) WITH 40' FOR GRADING. TO CONFIRMED BY DISTRICT.

INSTALL UNDERGROUND SECONDARY TAKE-OFF ON EXISTING POLE.

TRENCH & LAY 60m OF 350MCM TX UNDERGROUND SECONDARY TO CUSTOMER OWNED 400A SPLITTER.


*CUSTOMER RESPONSIBLE FOR ALL WIRING AFTER THE METERING POINT.

*CUSTOMER RESPONSIBLE TO CLEAR RIGHT-OF-WAY OF ALL OBSTACLES AND DEBRIS.



- Quorum _____
- Chief _____ Councilllor
- Councillor _____ Councilllor
- Councillor _____ Councilllor
- Councillor _____ Councilllor
- Councillor _____ Councilllor

SCHEDULE "A"

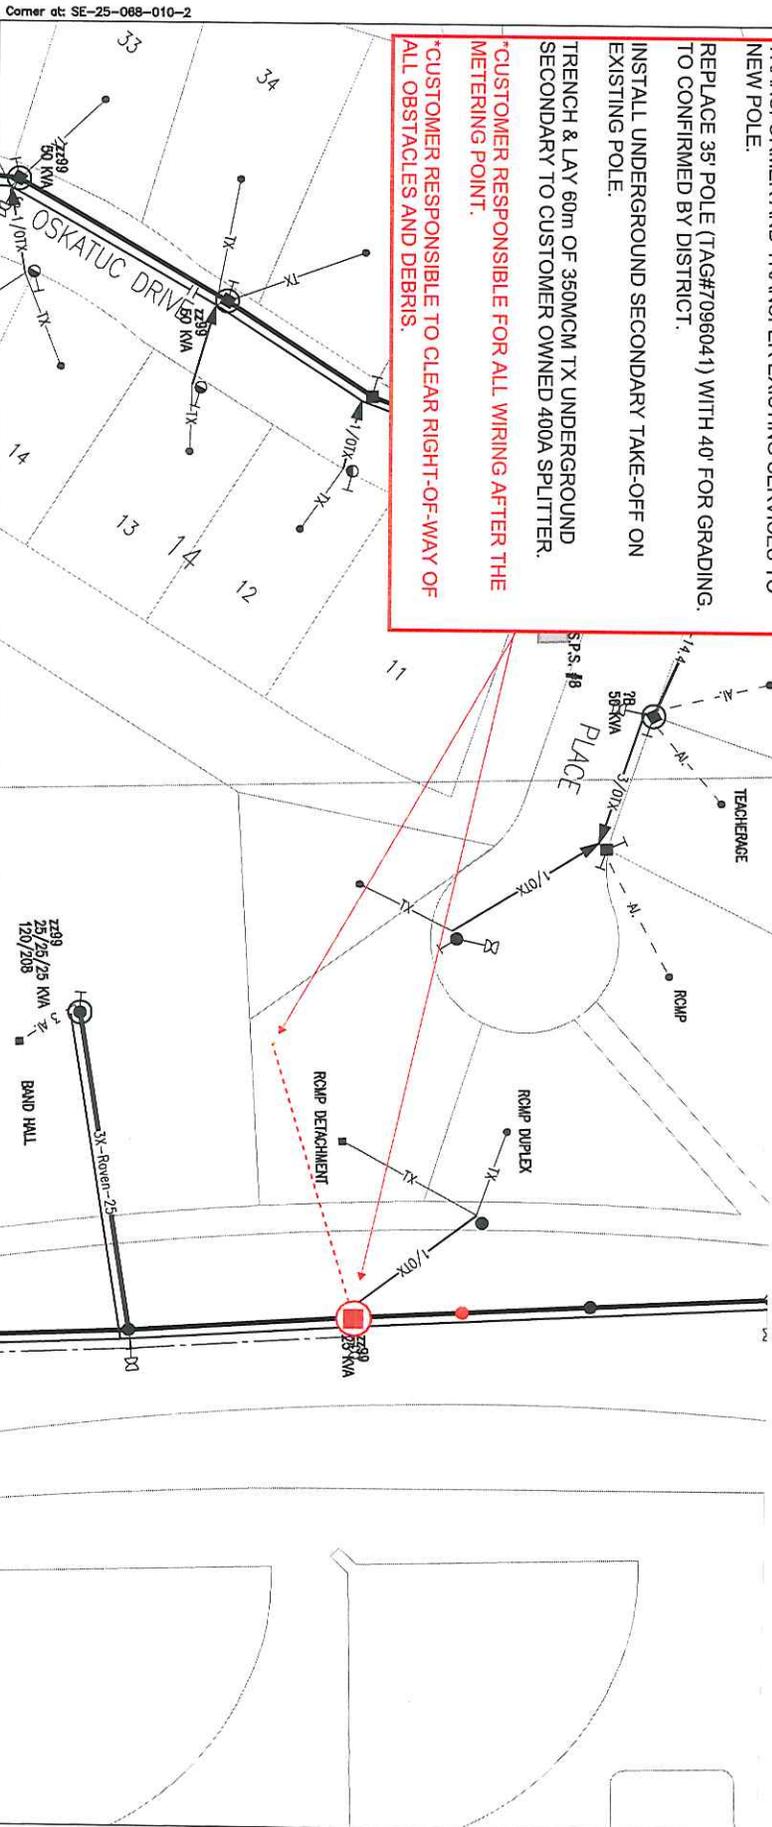

THIS MAP IS A VISUAL REPRESENTATION ONLY AND NOT TO BE USED FOR LOCATING FACILITIES. CONTACT SASK 1ST CALL AT 1-866-828-4888 FOR LOCATES.

<p>VIEWPOINT SCALE: 1:1000</p> <p>PLLOT DATE: 2014/09/10</p> <p>REVISION DATE:</p>	<p>0154 MAP</p> <p>SaskPower</p>	<p>DRAWING TITLE</p> <p>GSU - RCMP F DIVISION F2902</p> <p>NOTIFICATION - 301612970</p> <p>ORDER - 20174633</p> <p>DESCHAMBAULT LAKE IR203 LB B14</p>	<p>DESCRIPTION</p> <p>FEEDERXXX</p> <p>CIRCUITXXX</p> <p>PHASEXXX</p>	<p>MAP ID</p> <p>M4 H96</p> <p>MAP GROUP</p> <p>SHEET NO. 1 of 2</p>
--	---	---	---	--