

revisions	date
0	ISSUED FOR TENDER 02/09/14
B	ISSUED FOR REVIEW 24/09/14
A	ISSUED FOR REVIEW 08/09/14

project
**HARBOUR DEVELOPMENT
PHASE II**

client
**MARY'S HARBOUR,
LABRADOR**

drawing
**NEW WHARF
ELECTRICAL LAYOUT
& TRENCH DETAILS**

designed	K.N.	copy
date	SEPT 2014	
drawn	K.N.	checked
date	SEPT 2014	
approved		approved
drawn		


no. du projet
R.071733.001

no. du dessin
E2

NOTES:
1.) SEE GENERAL NOTES ON DRAWING E1.


ELECTRICAL LEGEND

- LIGHT POLE AND FIXTURES. SEE DETAIL "A" ON DRAWING E3.
- ELECTRICAL PEDESTAL. SEE DETAILS "B", "C" DRAWING E3.
- INCANDESCENT/HID LIGHTING FIXTURE. LETTER DENOTES TYPE. SEE LIGHTING FIXTURE SCHEDULE & SPECIFICATIONS FOR DESCRIPTION.
- FLUORESCENT LIGHTING FIXTURE. LETTER DENOTES TYPE. SEE LIGHTING FIXTURE SCHEDULE & SPECIFICATIONS FOR DESCRIPTION.
- SINGLE POLE TOGGLE SWITCH. 15 AMP, 120 VOLT, WHITE. SPECIFICATION MOUNT 1200mm ABOVE FINISHED FLOOR.
- LINE VOLTAGE THERMOSTAT RATED 240 VOLT, 4500 WATTS, DPST, WHITE. MOUNT 1200mm AFF.
- SURFACE MOUNTED PANELBOARD
- DUPLEX U-GROUND RECEPTACLE. 120 VOLT, 15 AMP, SPECIFICATION ABOVE FINISHED FLOOR. WALL MOUNT 400mm ABOVE FINISHED FLOOR. "WP" INDICATES WEATHERPROOF GASKET AND COVERPLATE.
- ELECTRIC HEATER.

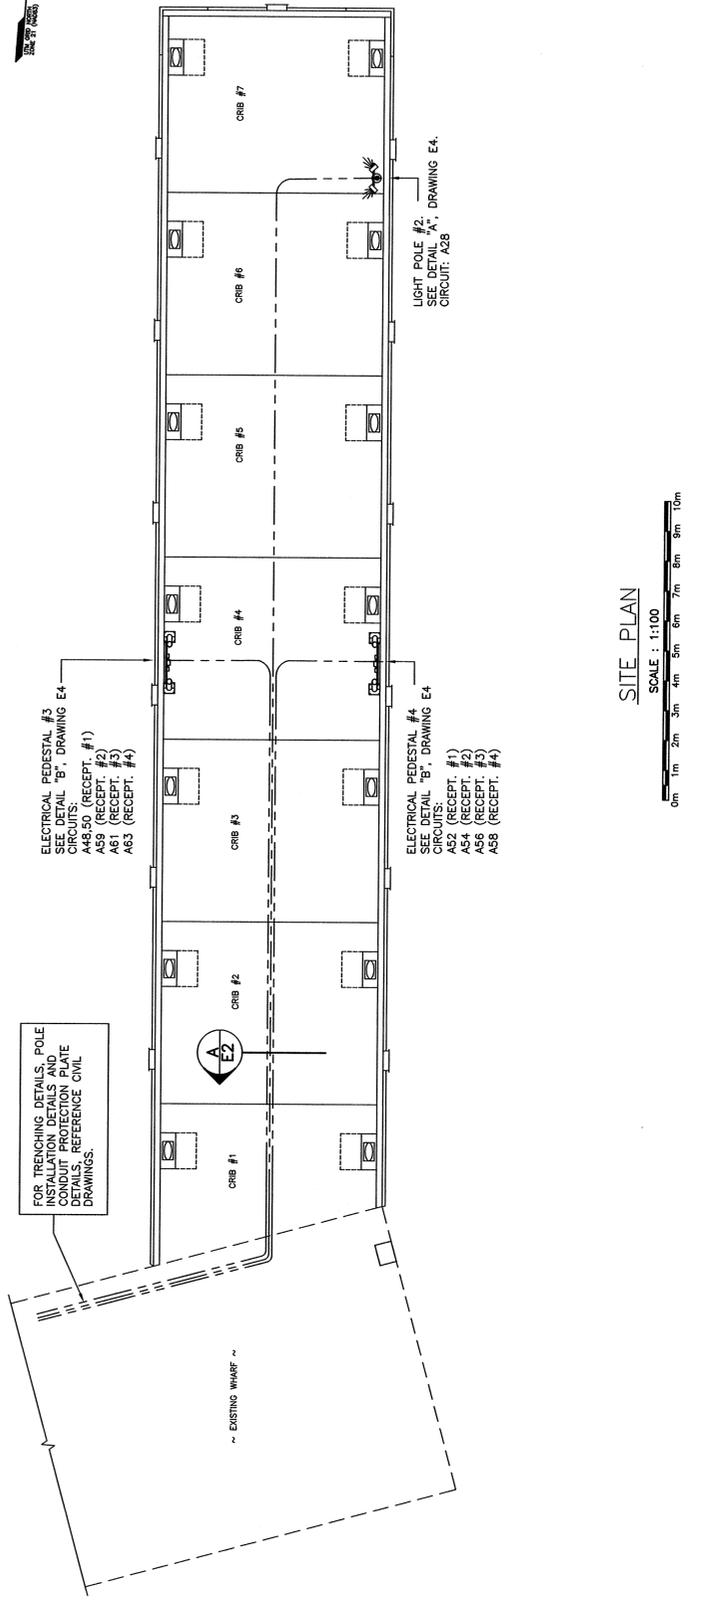

BROKEN LINE INDICATES EXISTING
SOLID LINE INDICATES NEW

LAYOUT INDICATED IS APPROXIMATE
ONLY. CONTRACTOR TO VERIFY
EXACT LOCATIONS OF ALL
ELECTRICAL DEVICES ON SITE
PRIOR TO ROUGH-IN.

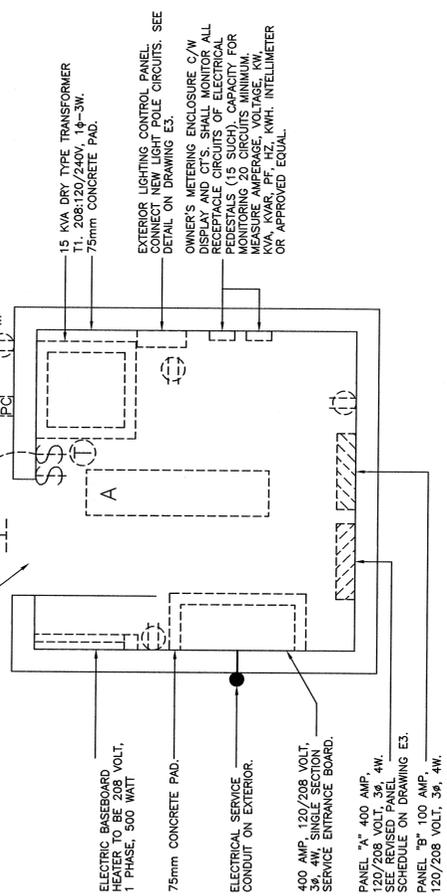

NOTE:
1. CONDUIT LOCATIONS ARE APPROXIMATE ONLY. ACTUAL
CONDUIT LOCATIONS TO BE COORDINATED ON SITE.
2. STEEL REINFORCEMENT OMITTED FOR CLARITY. SEE
CIVIL DRAWINGS FOR DETAILS.

