


- LIGHT POLE AND FIXTURES. SEE DETAIL "A" ON DRAWING E3.

GENERAL NOTES:

1. ALL WORK TO BE IN ACCORDANCE WITH THE LATEST REQUIREMENTS OF: THE NATIONAL BUILDING CODE OF CANADA, LATEST EDITION; CANADIAN ELECTRICAL CODE, CURRENT EDITION; ANY OTHER AUTHORITIES HAVING JURISDICTION.
2. THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION UNLESS IT IS ISSUED FOR CONSTRUCTION AND STAMPED AND SIGNED BY THE PROJECT ENGINEER.
3. CONTRACTOR TO PROVIDE ALL CUTTING, PATCHING AND PAINTING TO MATCH EXISTING. SEE SPECIFICATION FOR DETAILS. COORDINATE ON SITE.
4. CONTRACTOR MUST VERIFY ALL DIMENSIONS AND CONDITIONS ON SITE BEFORE PROCEEDING WITH ANY PORTION OF THIS WORK. DO NOT SCALE FROM DRAWINGS. CONTRACTOR TO ASSESS WORK AREA IN ADVANCE WITH OWNER REPRESENTATIVE FOR COORDINATION OF RELATED DAILY WORK SCHEDULES, PARKING, BUILDING ACCESS, AND STORAGE OF EQUIPMENT.
5. WORK SHALL BE SCHEDULED DURING NORMAL WORKING HOURS. CONTRACTOR MAY WORK AFTER NORMAL WORKING HOURS AS COORDINATED BY OWNER REPRESENTATIVE. BUILDING TO REMAIN OPERATIONAL DURING CONSTRUCTION.
6. CONTRACTOR SHALL BE RESPONSIBLE FOR CLEAN UP AND DISPOSALS OF WORK AREA ON A DAILY BASIS AFTER EACH WORKING SHIFT. BUILDING TO BE CLEARED AND FREE OF DEBRIS. BUILDING GARBAGE BINS ARE NOT TO BE USED.
7. ANY ELECTRICAL SYSTEM SHUTDOWN TO BE SCHEDULED AFTER NORMAL BUSINESS HOURS. THIS SHALL BE COORDINATED WITH OWNER REPRESENTATIVE. SUFFICIENT NOTICE SHALL BE GIVEN; 5 WORKING DAYS NOTICE IS REQUIRED FOR ANY DISRUPTION.
8. ALL WIRING TO BE INSTALLED IN CONDUIT AS INDICATED.
9. ACCESS TO FACILITY TO BE COORDINATED WITH OWNER REPRESENTATIVE.
10. RE-LABEL CIRCUITS IN EXISTING PANEL BOARD DIRECTORIES IF APPLICABLE.
11. LABEL ALL EQUIPMENT WITH LAMACOID TAGS ACCORDING TO PWGSC STANDARDS.
12. ALL EXISTING ELECTRICAL EQUIPMENT REMOVED TO BE TURNED OVER TO OWNER. IF OWNER REFUSES THEN CONTRACTOR TO REMOVE FROM SITE AND DISPOSE.

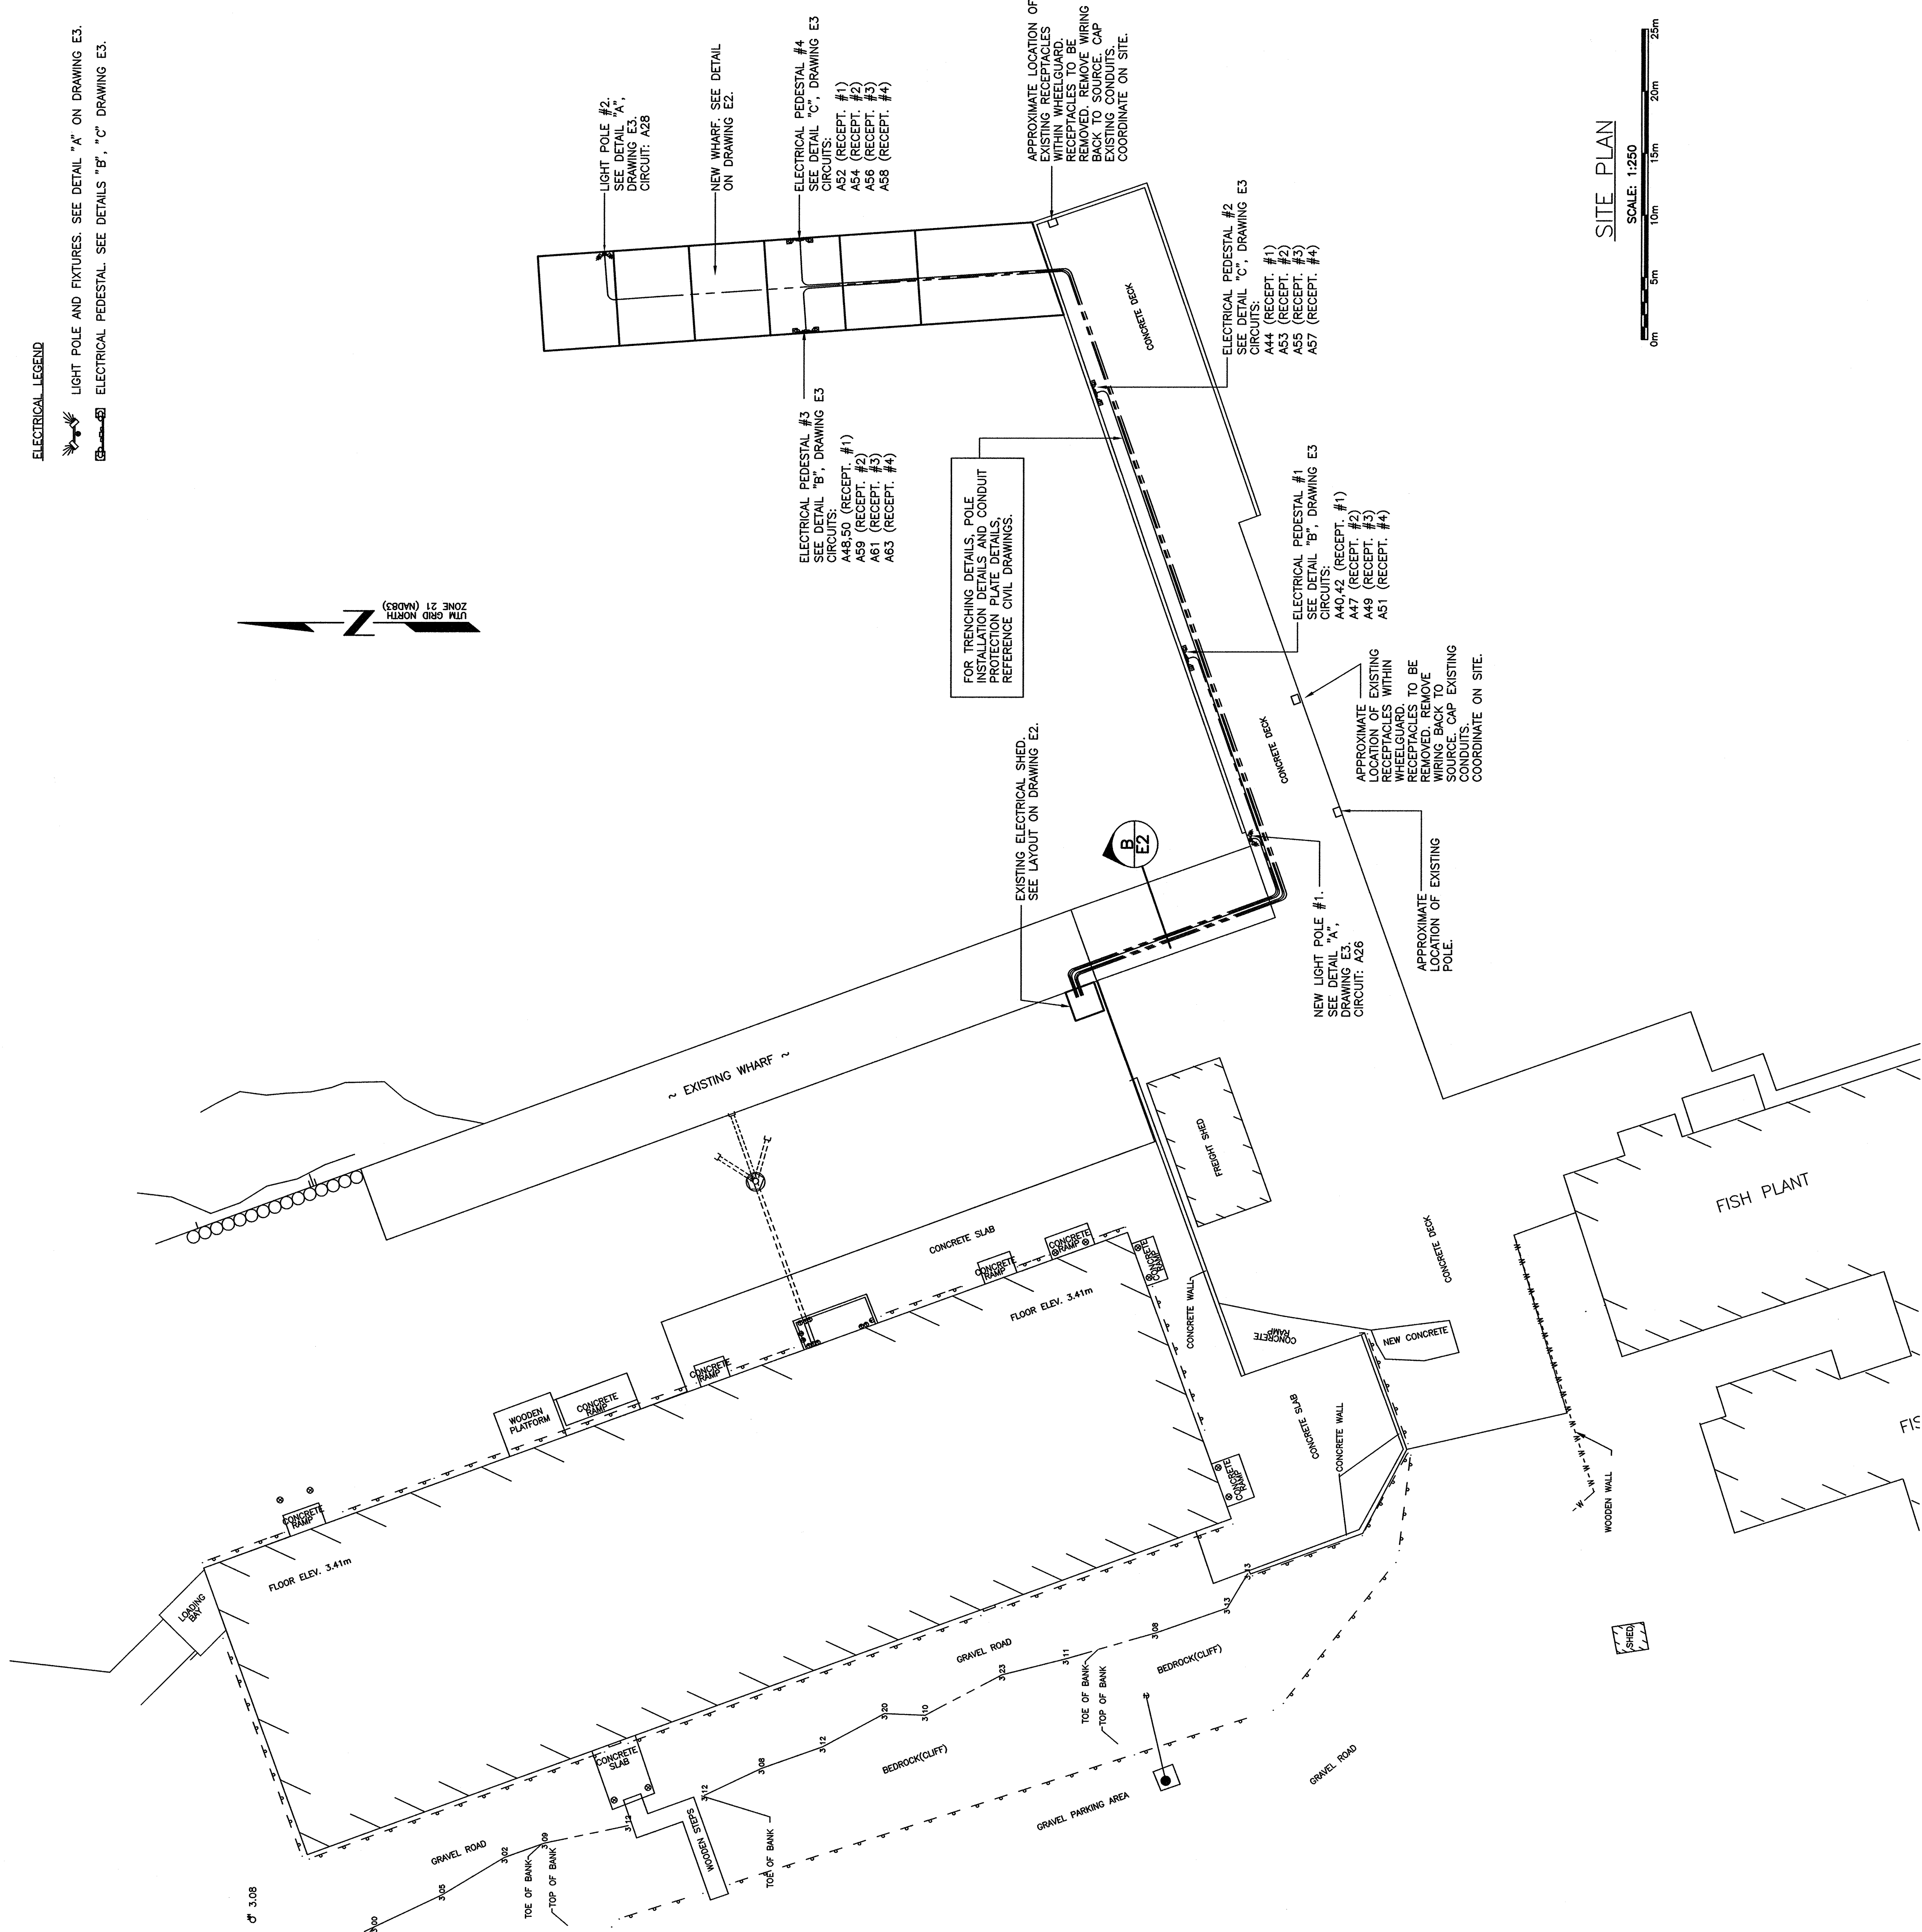

0	ISSUED FOR TENDER	02/10/14
B	ISSUED FOR REVIEW	24/09/14
A	ISSUED FOR REVIEW	08/09/14

project

HARBOUR DEVELOPMENT
PHASE II

MARY'S HARBOUR,
LABRADOR

drawing

design

ELECTRICAL SITE PLAN

designed	K.N.	conçu
date	SEPT 2014	
drawn	K.N.	dessiné
date	SEPT 2014	
approved		approuvé

date _____
Tender _____
PWSC Project Manager _____
Submission _____
Administrateur de projets TPSGC _____

drawing no.	no. du dessin
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21
22	22
23	23
24	24
25	25
26	26
27	27
28	28
29	29
30	30
31	31
32	32
33	33
34	34
35	35
36	36
37	37
38	38
39	39
40	40
41	41
42	42
43	43
44	44
45	45
46	46
47	47
48	48
49	49
50	50
51	51
52	52
53	53
54	54
55	55
56	56
57	57
58	58
59	59
60	60
61	61
62	62
63	63
64	64
65	65
66	66
67	67
68	68
69	69
70	70
71	71
72	72
73	73
74	74
75	75
76	76
77	77
78	78
79	79
80	80
81	81
82	82
83	83
84	84
85	85
86	86
87	87
88	88
89	89
90	90
91	91
92	92
93	93
94	94
95	95
96	96
97	97
98	98
99	99
100	100