
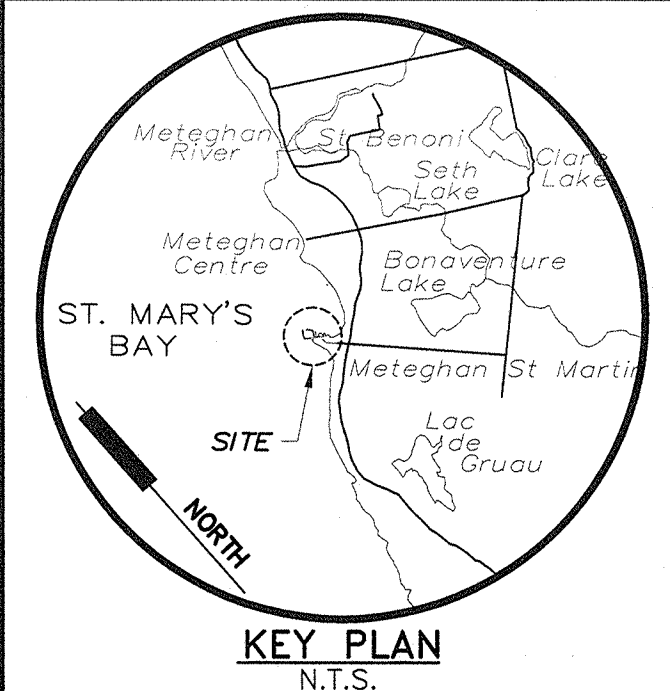
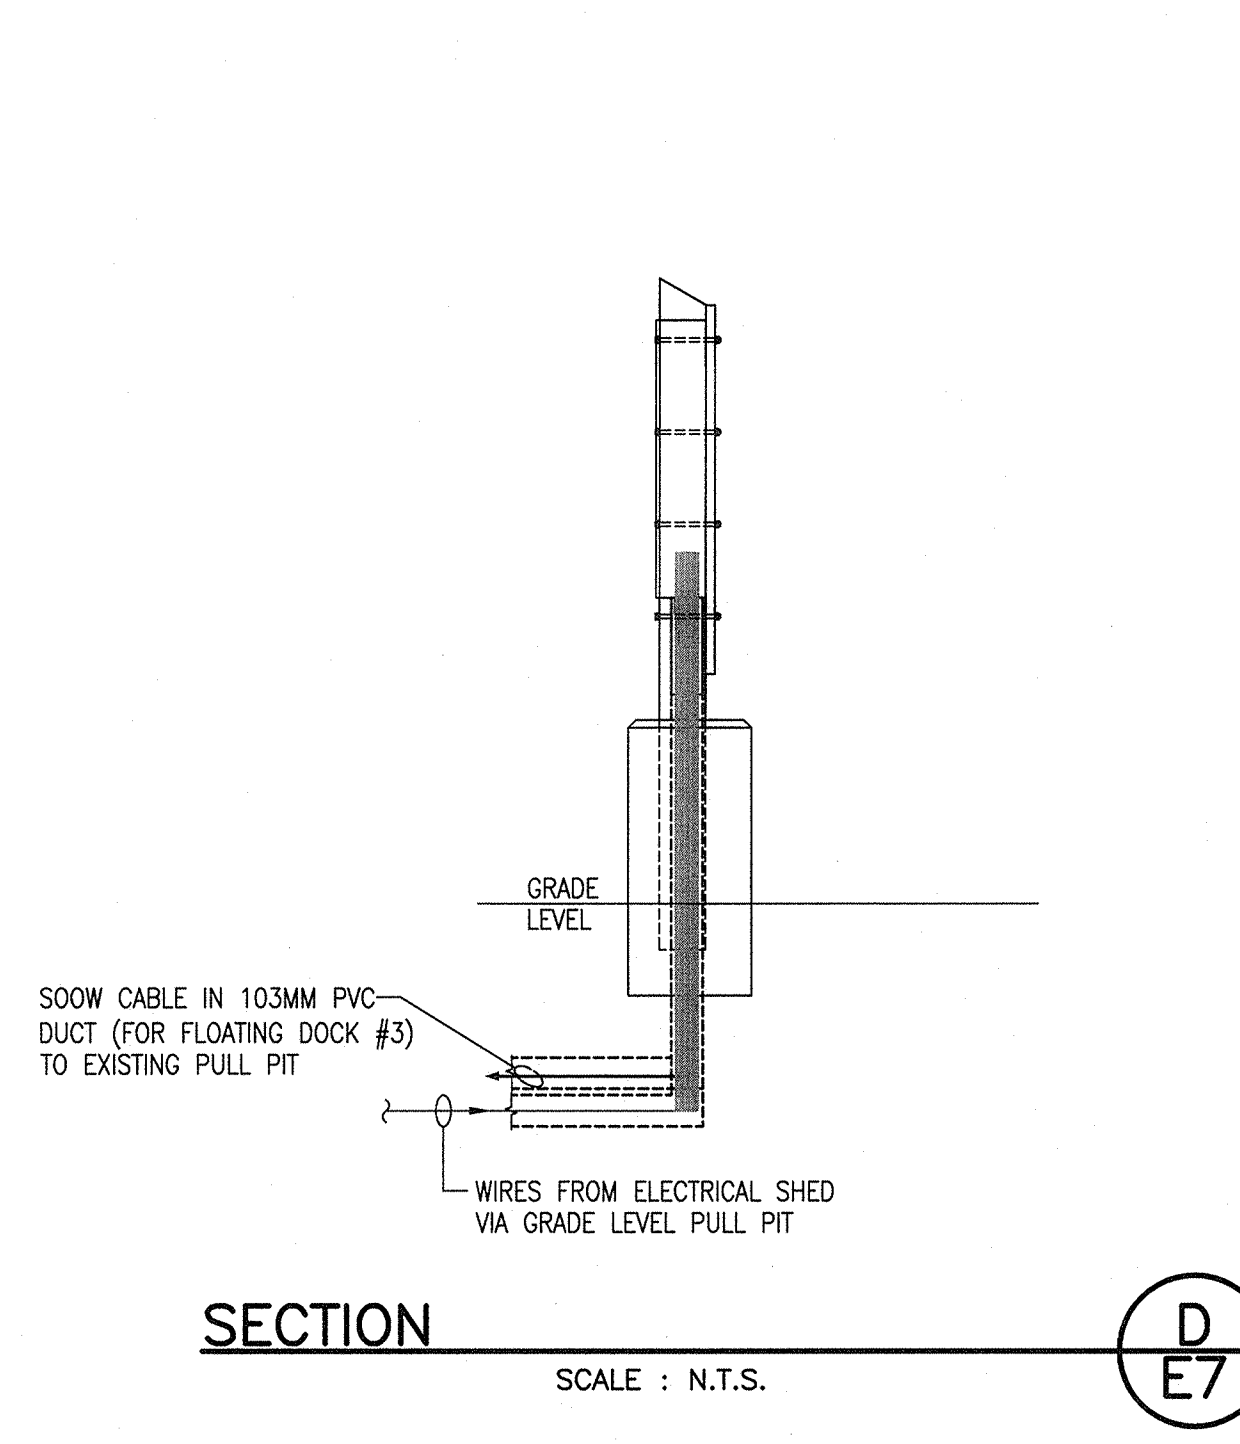
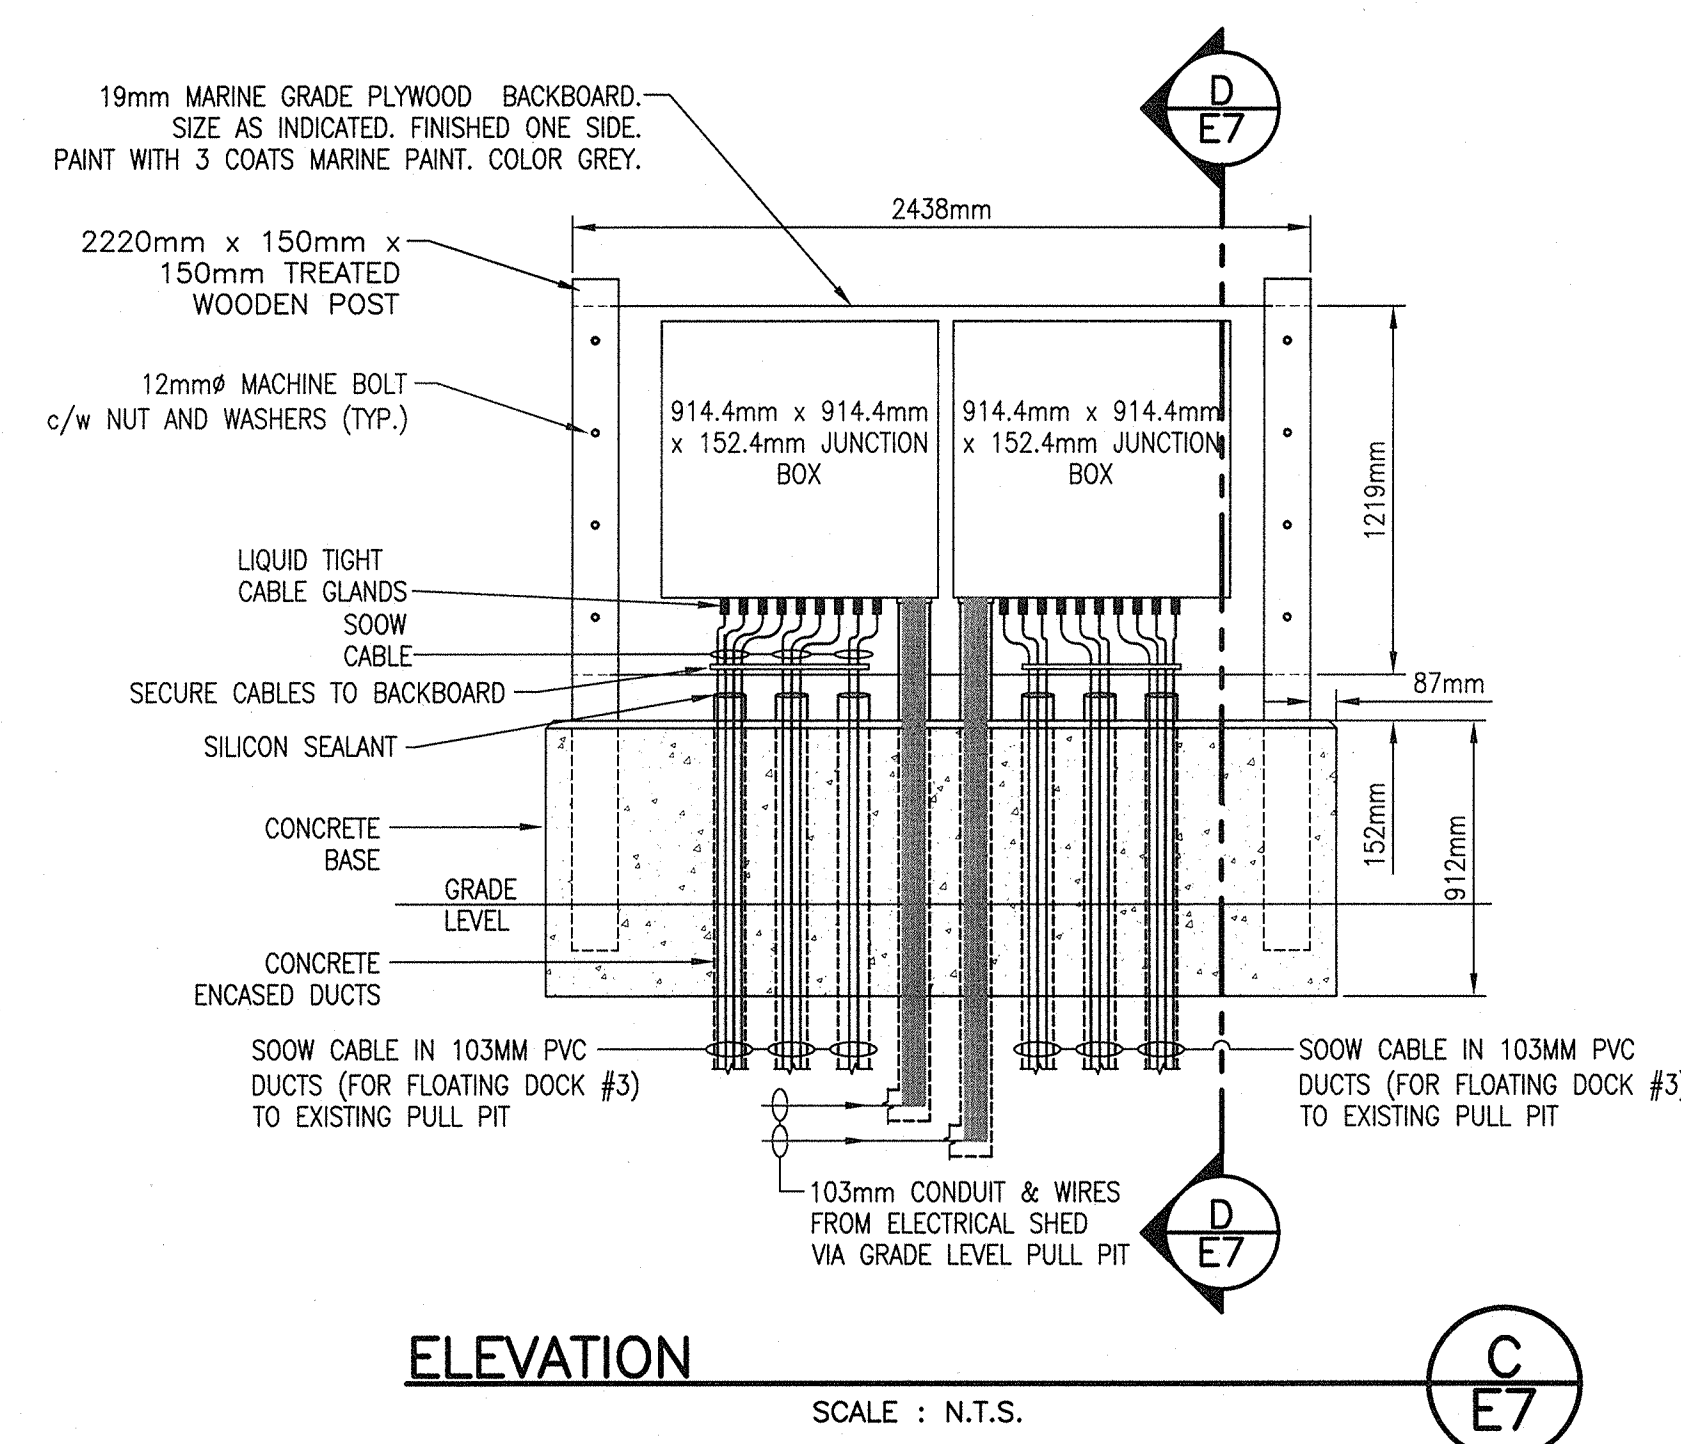


NOTES:

1. SUPPLY AND INSTALL PVC SLEEVES. SEAL THE AREA AROUND THE CONDUIT SLEEVE WITH SILICON SEALANT.
2. FOR CLARITY NOT ALL TYPE SOOW (CABTIRE) CABLES ARE SHOWN. REFER TO WIRING DIAGRAMS.
3. AFTER CABLES ARE INSTALLED SEALED CONDUITS.
4. SUPPLY NEW FLEXIBLE CONDUIT TO CARRY THE CIRCUIT WIRES AS SHOWN.

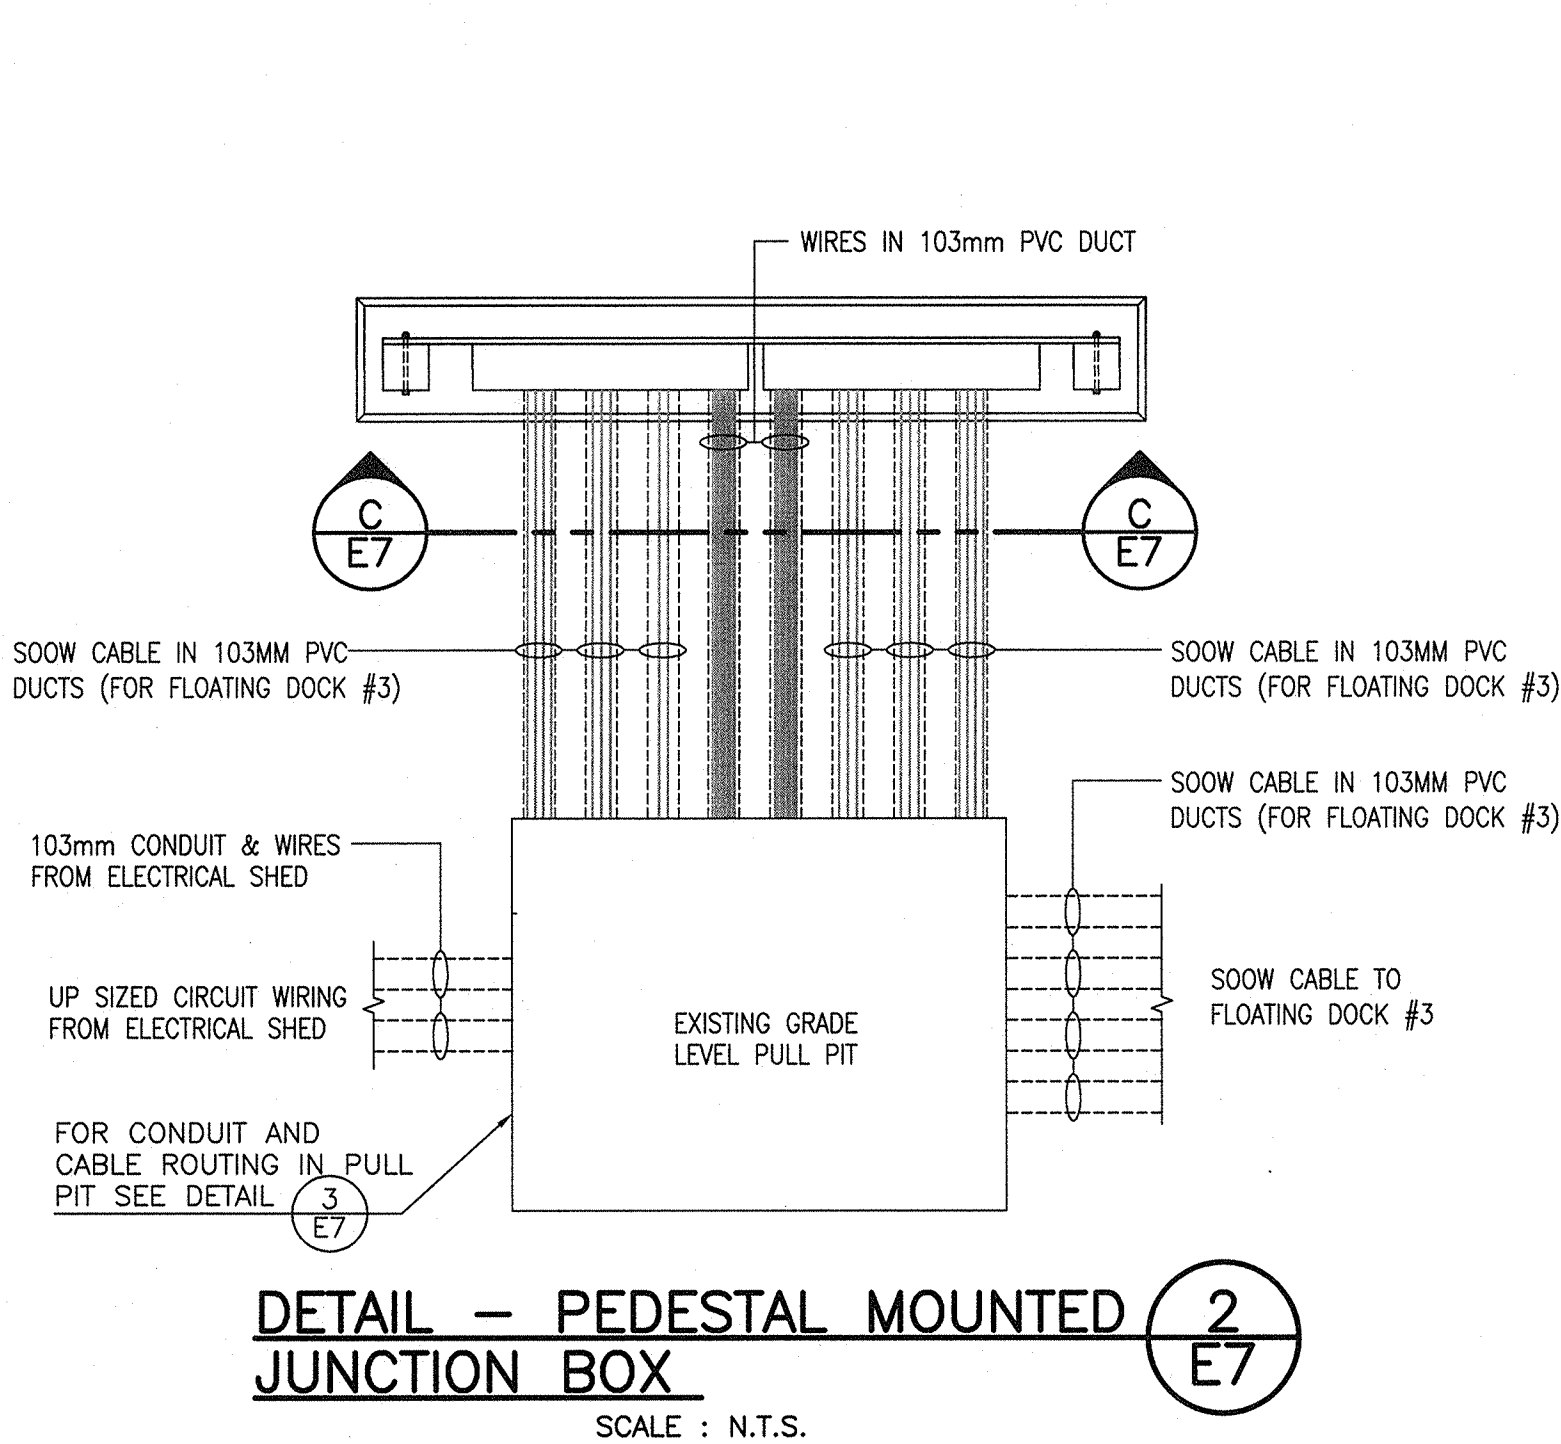

1	ISSUED FOR TENDER	DEC. 2014
revisions		date
project	METEGHAN WHARF FLOATING DOCK ELECTRICAL INSTALLATION	
	DIGBY COUNTY, NOVA SCOTIA	
drawing	PEDESTAL MOUNTED JUNCTION BOX DETAILS	
designed	G. BOWSER	conçu
date	DECEMBER 2014	
drawn	K. WOLFE	dessiné
date	DECEMBER 2014	
approved		approuvé
date	2014 12 10	
tender		soumission
PWSSC Project Manager	Administrateur de projets TPSSC	
project number	R.074439.002	
drawing no.	E7	