



**TEMPORARY
 MICROWAVE ZONE 10
 REQUIRES 1 PAIR TX RX**

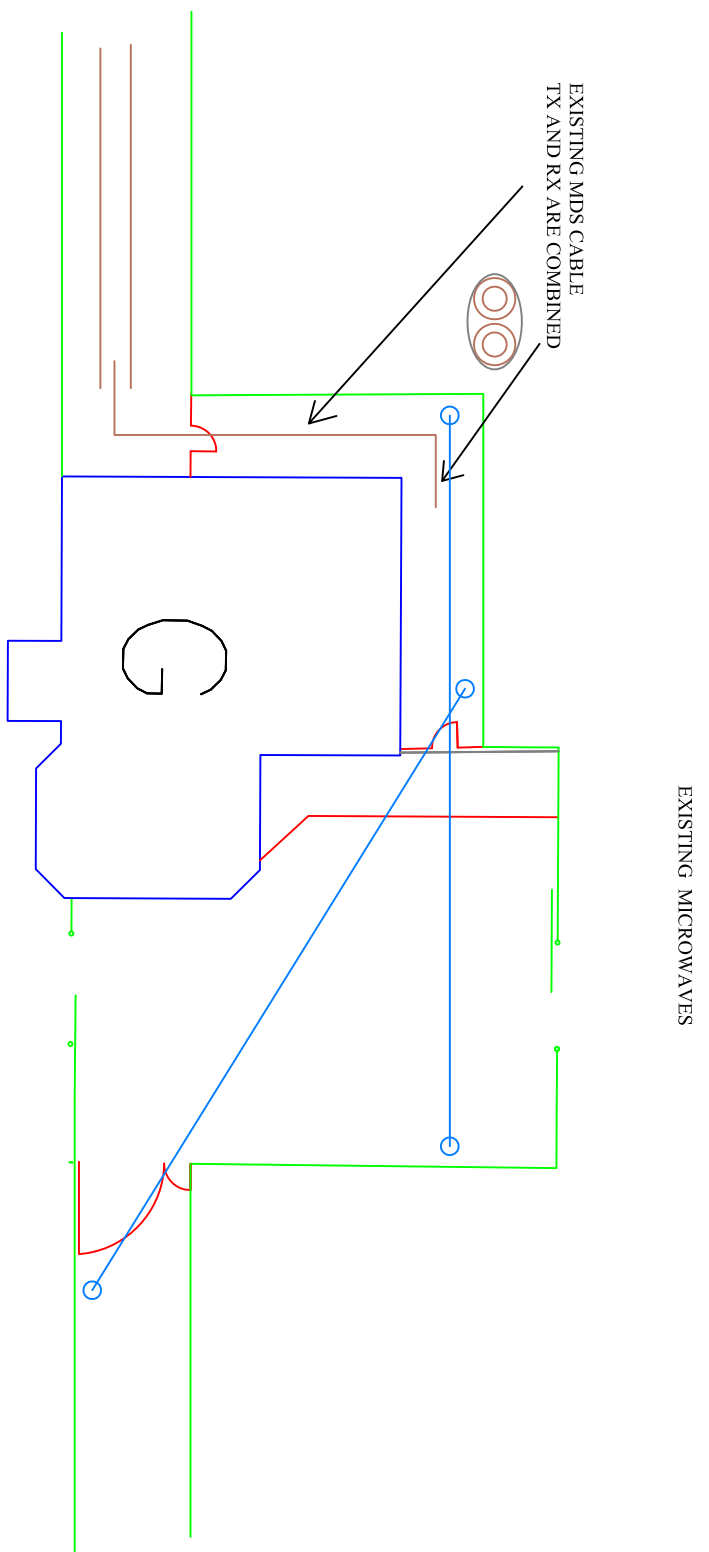

**EXISTING MDS ZONE 1
 CONSISTS OF MDS CABLE AND TWO
 PAIRS OF MICROWAVE TX RX**

**TEMPORARY
 MICROWAVE ZONE 1
 REQUIRES 3 PAIRS TX RX**

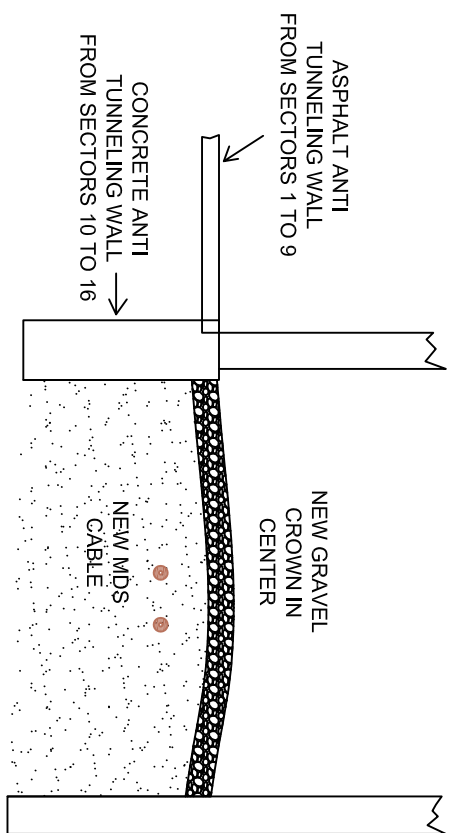

**CORRECTIONAL SERVICE
 CANADA**

**PACIFIC INSTITUTION
 MDS and PIDS PA
 REPLACEMENT PROJECT**

Prepared By/Checked by	W. HUNKEN
Date	2014-07-07
Drawn by	W. HUNKEN

**PIDS SECTORS
 MDS ZONES**

Project No./Rev. of project	Sheet/Total	Date/Revision/By
	2 of 2	1