




WET WELL PLAN 1:30 1

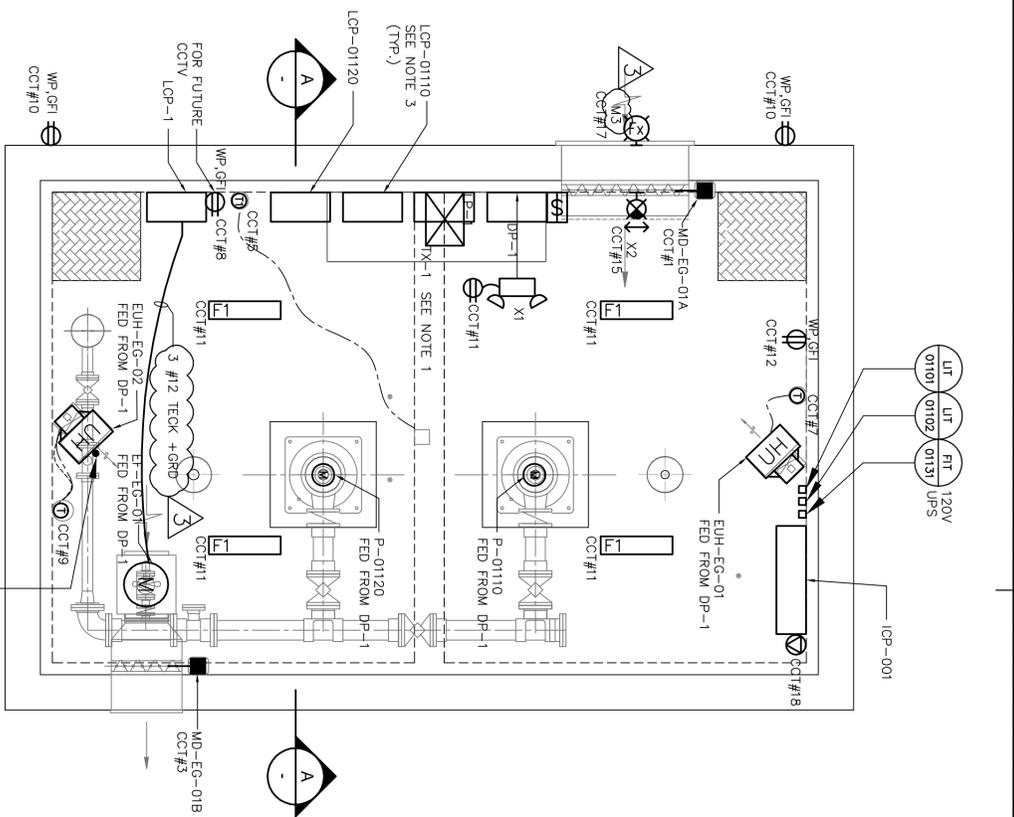

GROUND FLOOR PLAN 1:30 1

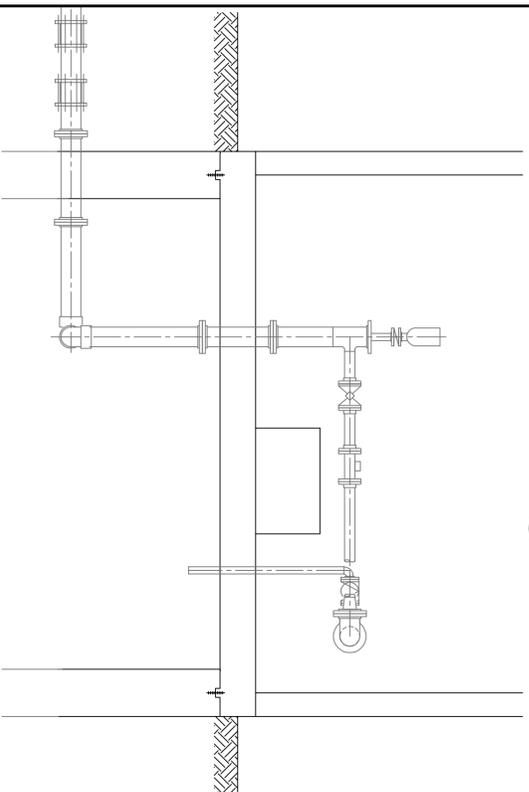

SECTIONS 1:30 B

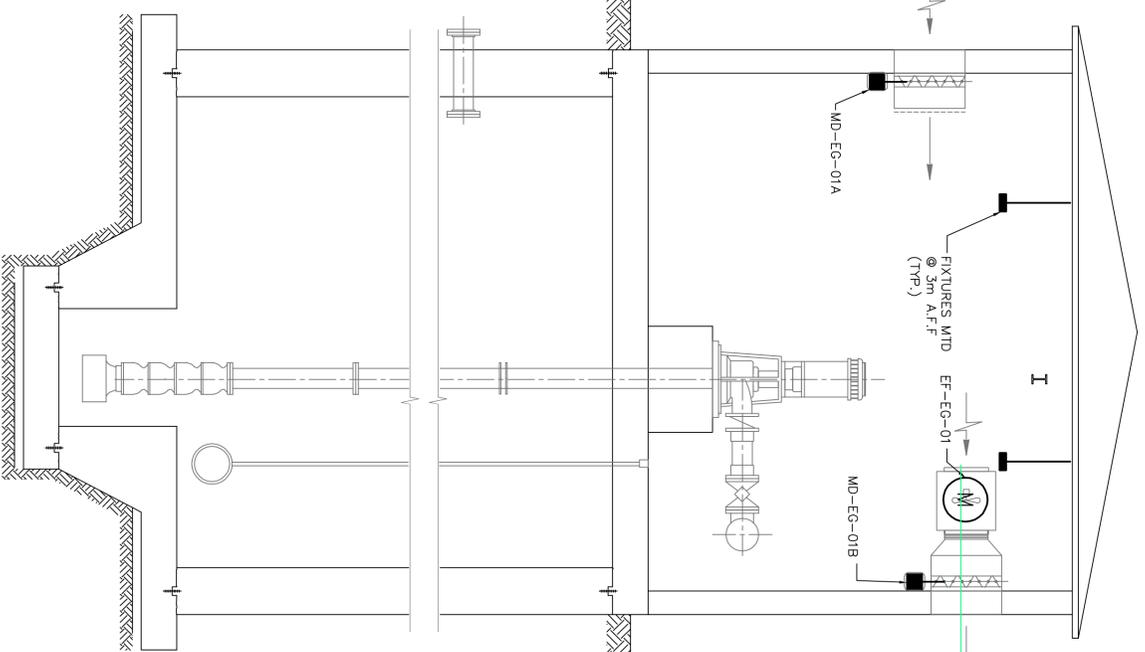

SECTIONS 1:30 A

- NOTE
1. ALL ELECTRICAL CIRCUIT SHALL BE FED FROM LP-1.
  2. REFER TO DRAWING PGWMF-E-03 FOR DETAIL OF LIGHTING FIXTURES
  3. COORDINATE EXACT LOCATIONS OF LOCAL CONTROL PANELS AND POWER PANELS ON SITE PRIOR TO INSTALLATION

Public Works and Government Services Canada  
Travaux publics et Services gouvernementaux Canada

key plan

04		
03	TENDER ADDENDUM No. 5	2014/12/18
02	TENDER ADDENDUM No. 1	2014/10/01
01	ISSUED FOR TENDER	2013/08/28
revision		date

Do not scale drawings. Verify all dimensions and conditions on site and immediately notify the Departmental Representative of all discrepancies.

**AECOM**

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or disseminated in any form without the prior written consent of AECOM. AECOM shall not be liable for any errors or omissions in this drawing. AECOM's liability is limited to the professional services provided by AECOM to its client.

Project Title  
**PORT GRANBY, ONTARIO  
PORT HOPE AREA INITIATIVE  
PORT GRANBY PROJECT  
LTMF CONSTRUCTION AND  
PGWMF REMEDIATION**

drawing title  
**EAST GORGE RESERVOIR  
PUMP STATION  
ELECTRICAL LAYOUT**

designed by  
ALS

designed by  
JL

approved by  
EM/CH

approved by  
J.A., PLENG.

project manager  
administrateur de projets

project date  
2013-07-15

project no.  
R.023276.217

drawing no.  
PGWMF-E-30

designe no.  
AECOM PROJECT NO.: 60154177