


Do not scale drawings.  
Verify all dimensions and conditions on site and immediately notify the Departmental Representative of all discrepancies.

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from stated dimensions.


PORT GRABBY PROJECT  
LTMF CONSTRUCTION AND  
PGWMF REMEDIATION

# WEST GORGE RESERVOIR PUMP STATION ELECTRICAL LAYOUT

drawn by dessiné par	AJS
designed by conçu par	JL
approved by approuvé par	EM/CH
bld offre	J.A., P.ENG.  project manager administrateur de projets
project date date du projet	2013-07-15
project no. no. du projet	R.023276.217
drawing no. dessinée no.	PQWME-E-31

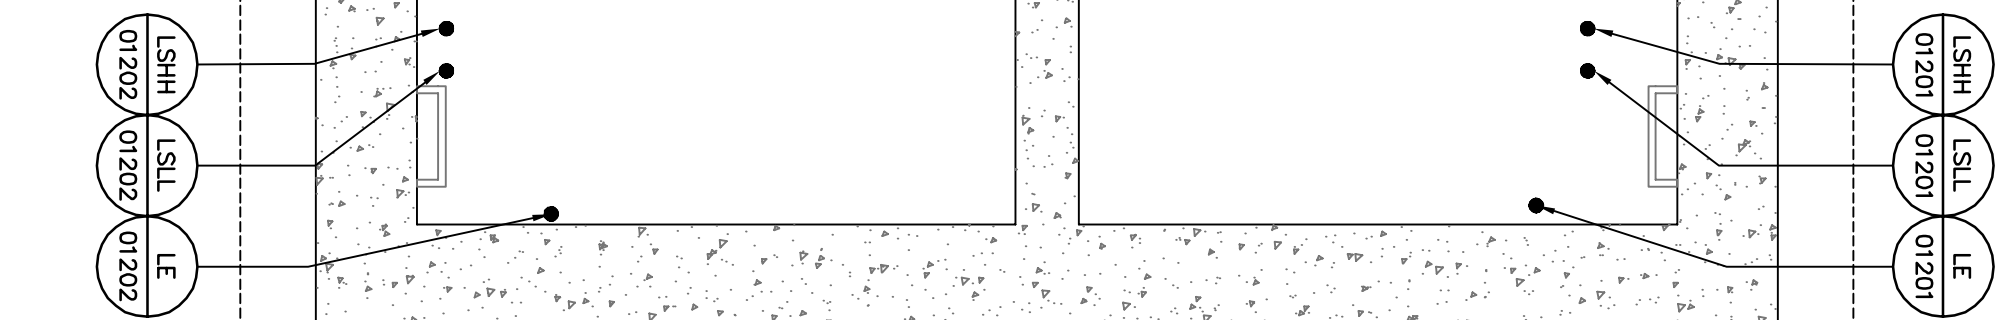
 $\left. \begin{array}{l} \text{---} \\ \text{---} \end{array} \right\} \rightarrow$ 

1:30

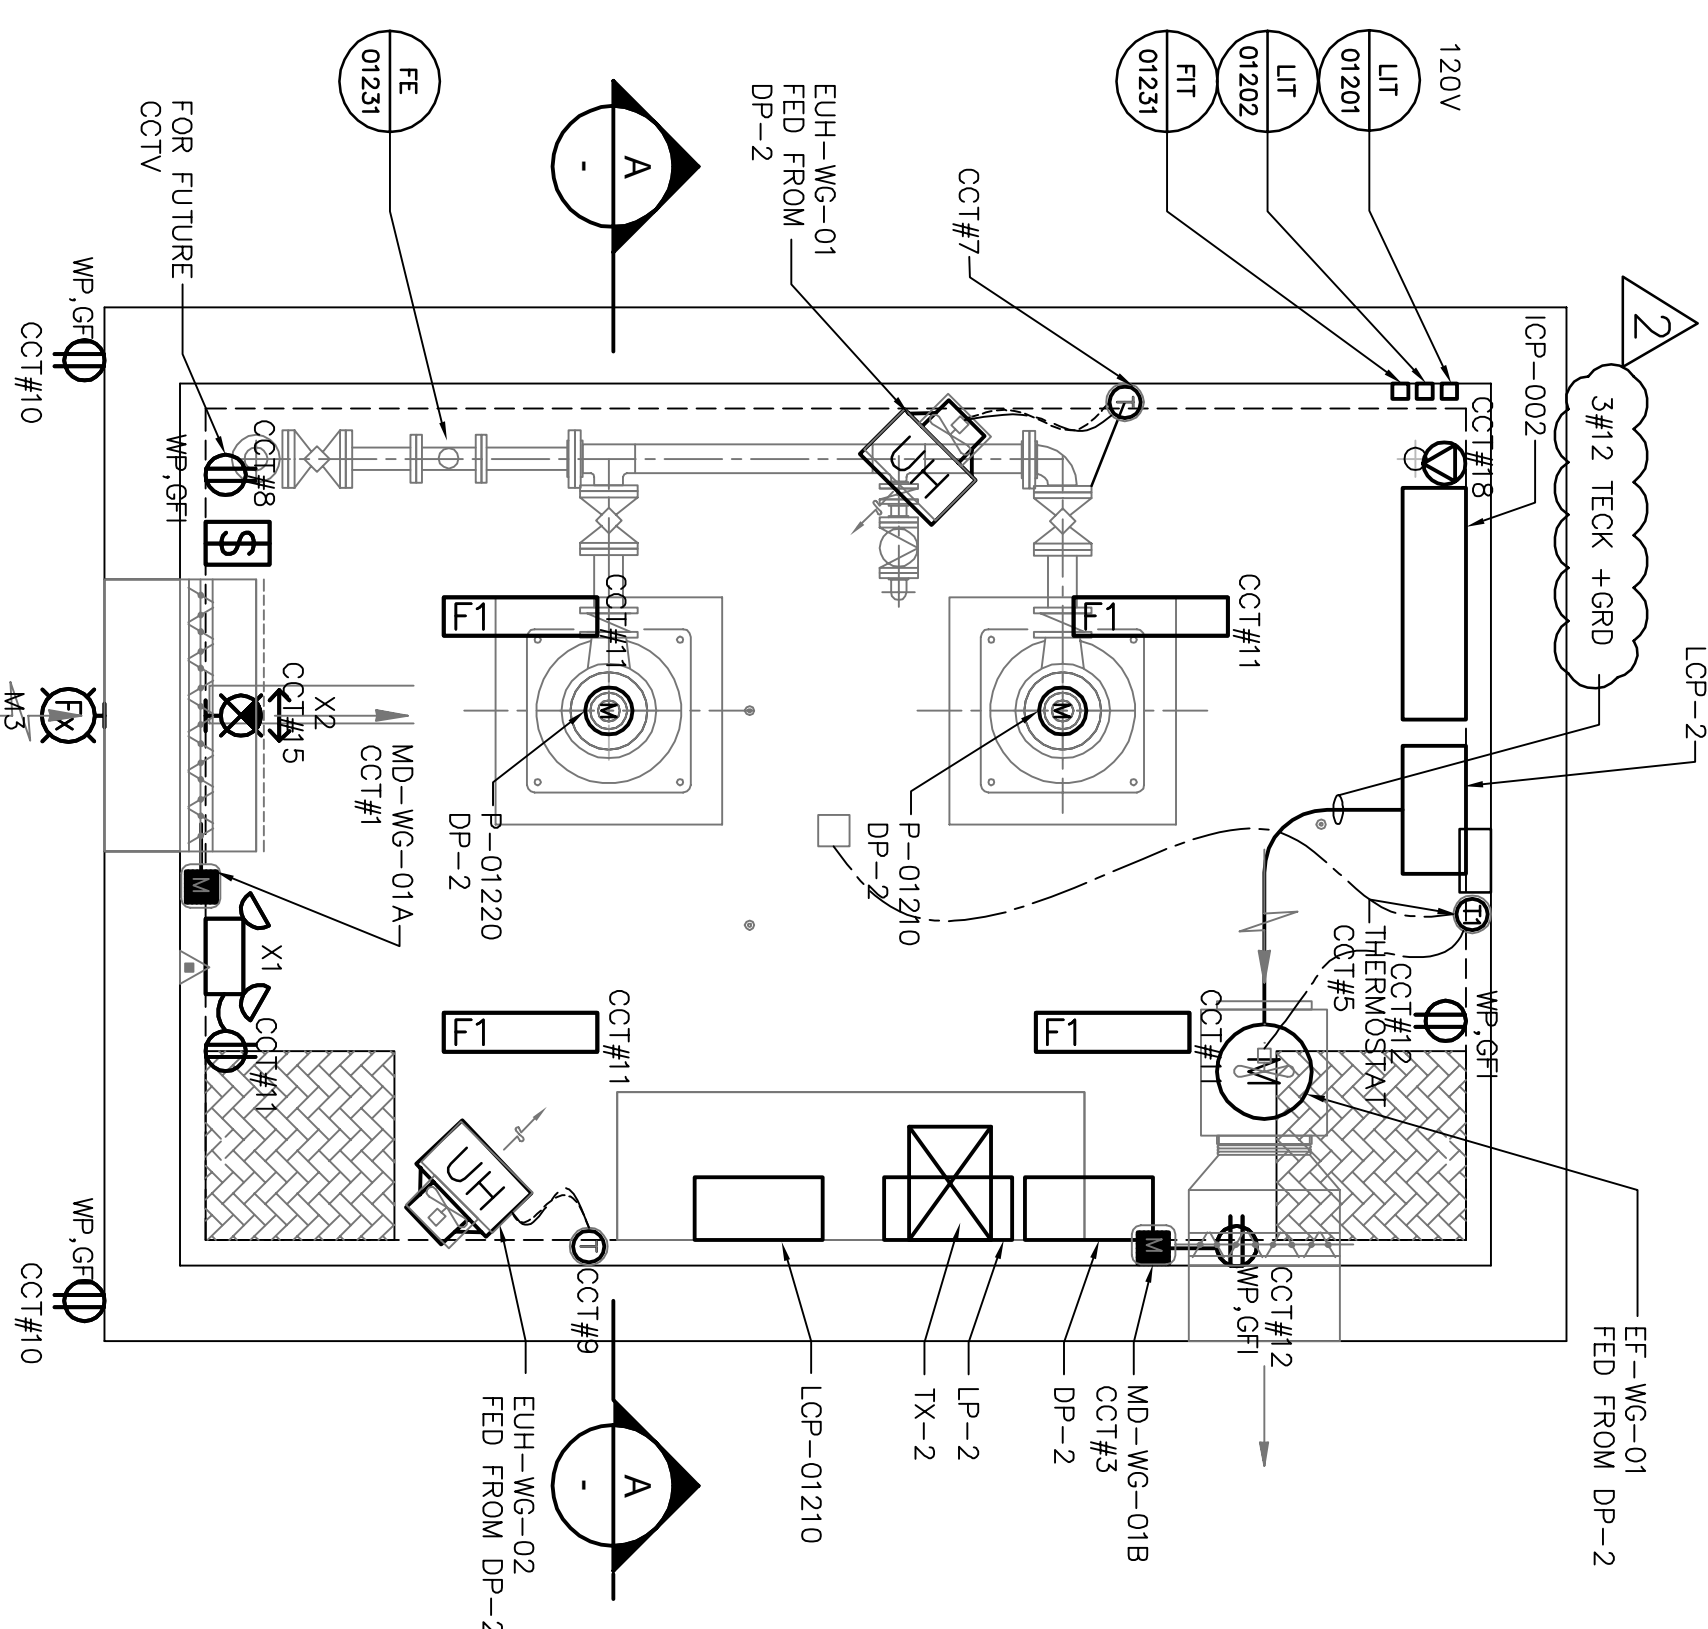


1

1:30

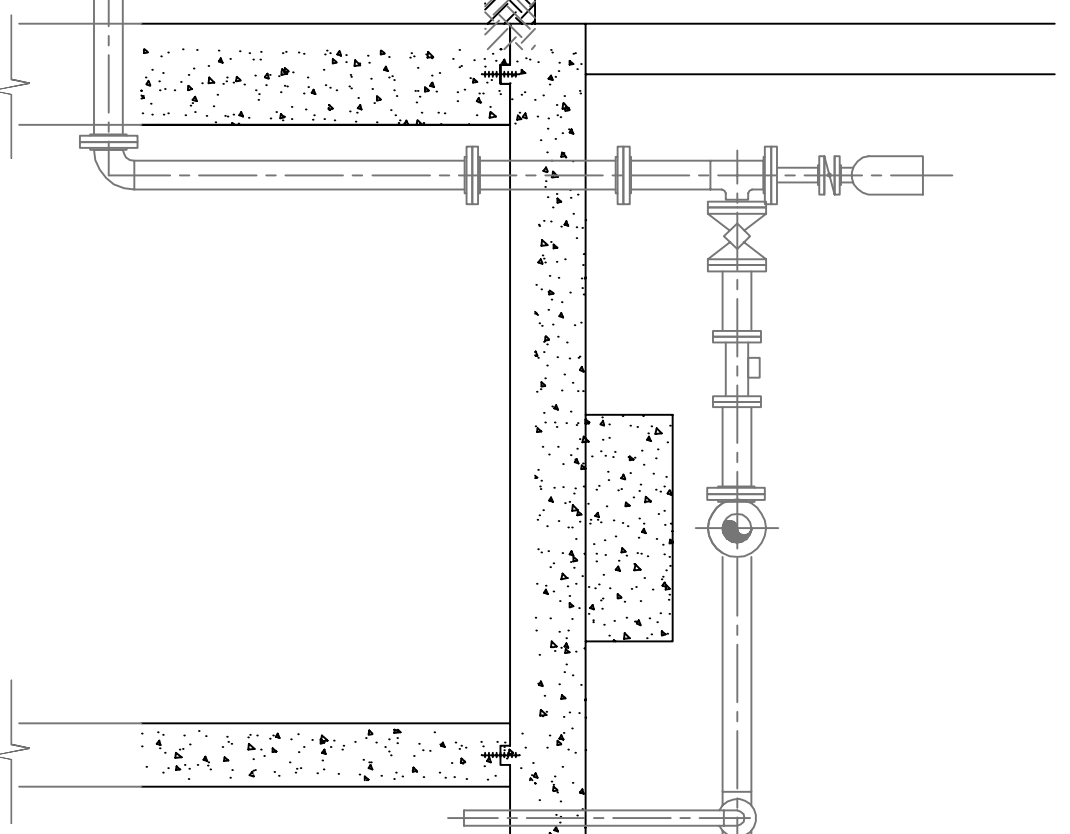


(B)

1:30

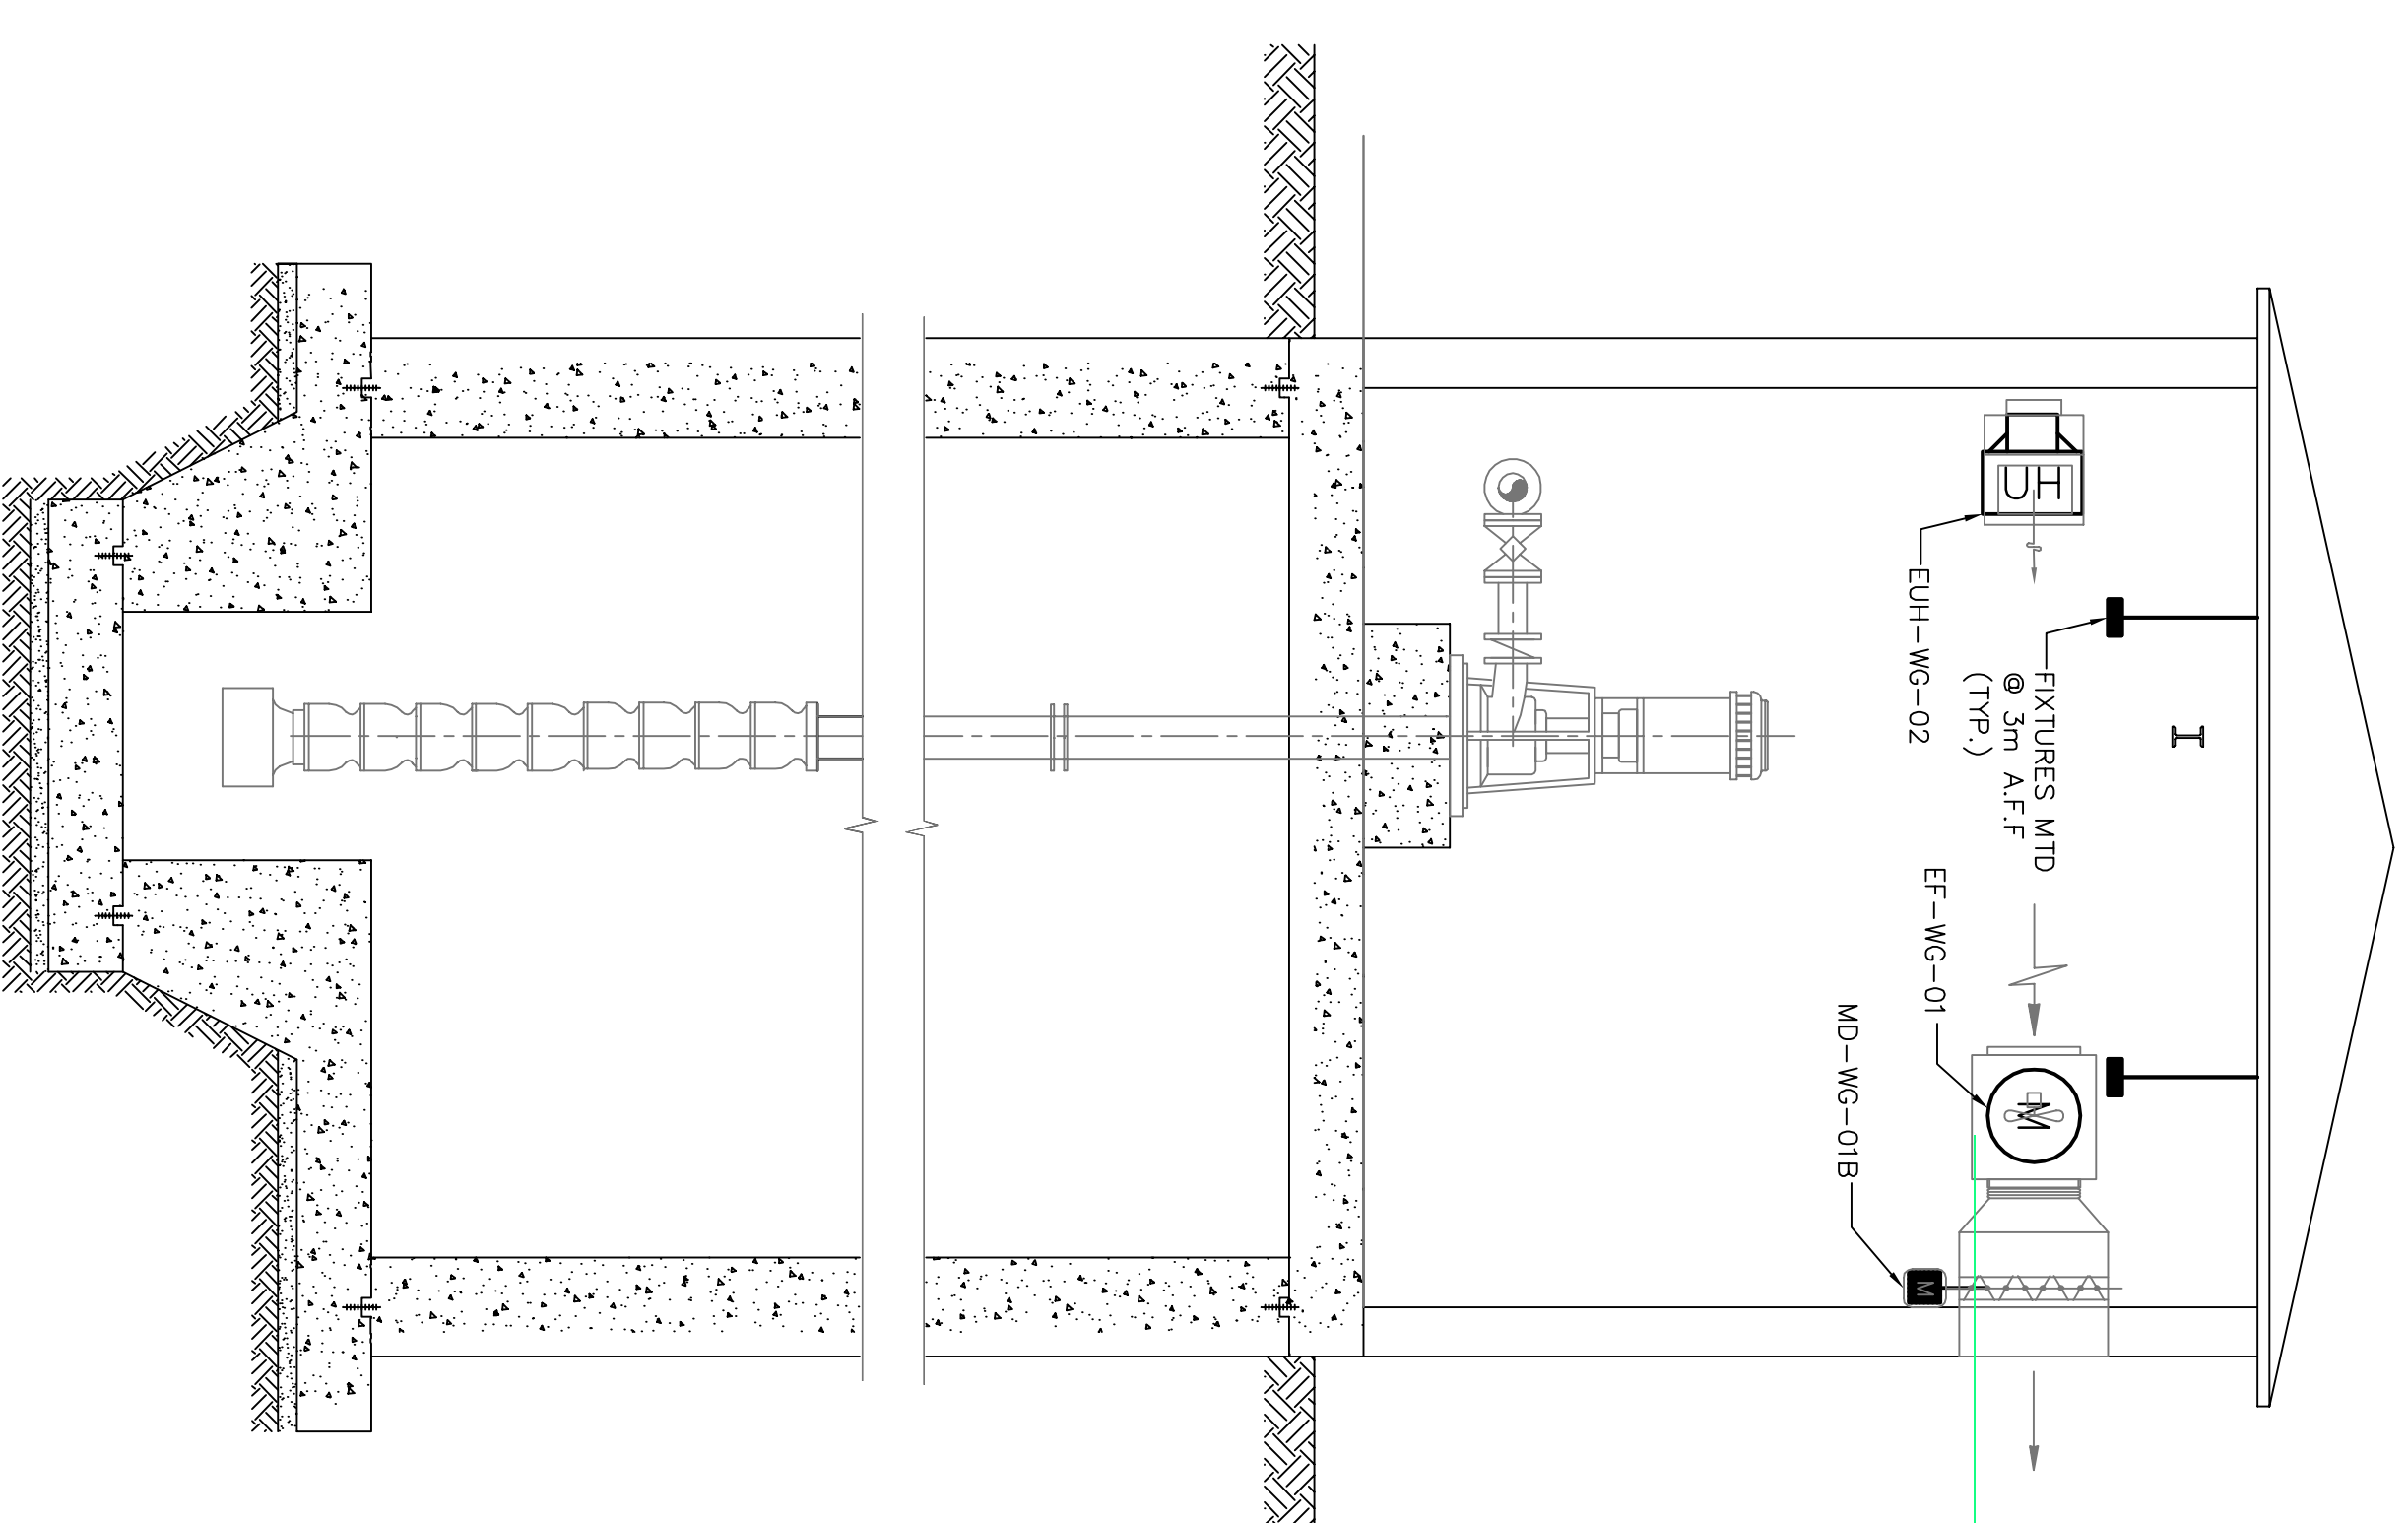

1:30

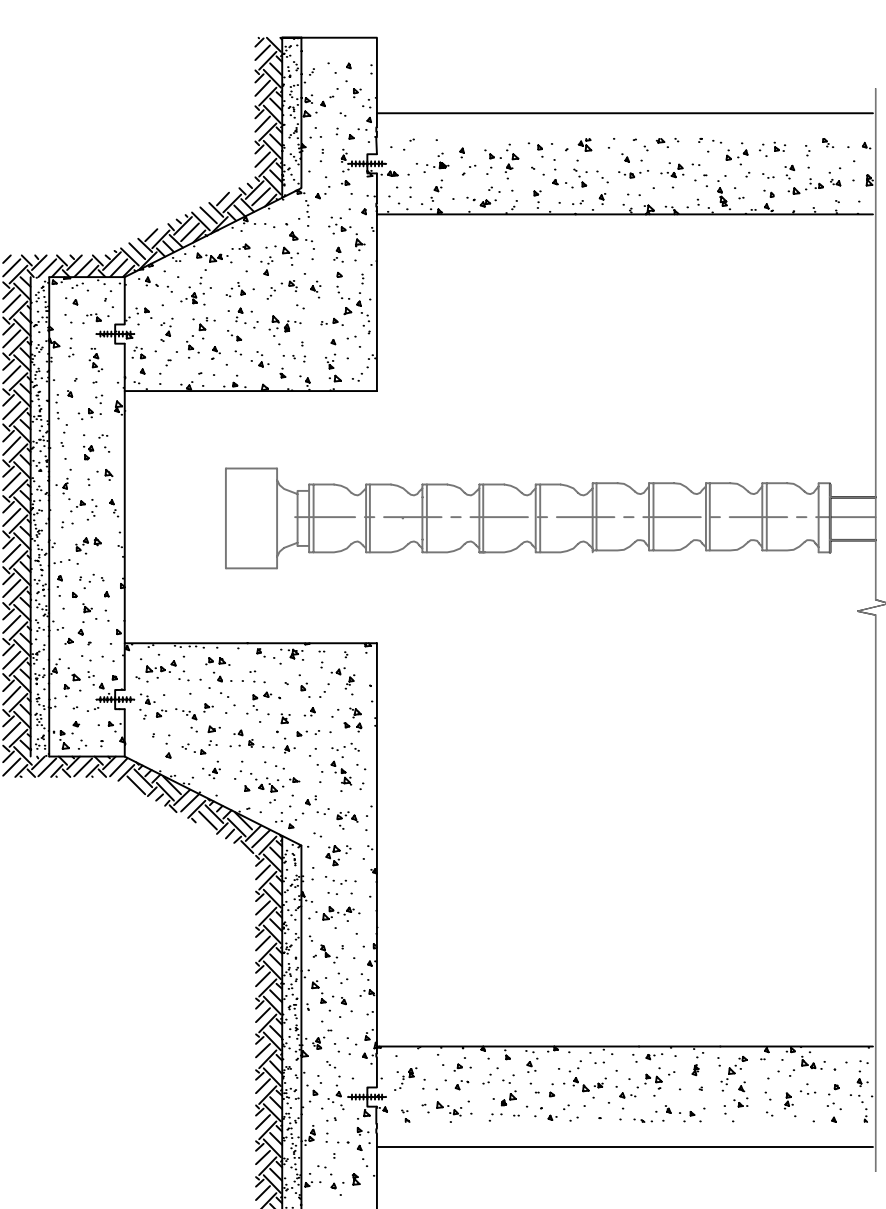

NOTE

1. ALL ELECTRICAL CIRCUIT SHALL BE FED FROM LP-2.
2. REFER TO DRAWING PMWF-E-03 FOR DETAIL OF LIGHTING FIXTURES
3. COORDINATE EXACT LOCATIONS OF LOCAL CONTROL PANELS AND POWER PANELS ON SITE PRIOR TO INSTALLATION.
4. EXTERIOR LIGHTING M4 SHALL BE A TYPE OF FIXTURE C/W SEALED PHOTOCELL.