

04		
03	TENDER ADDENDUM No. 5	2014/12/18
02	TENDER ADDENDUM No. 1	2014/10/01
01	ISSUED FOR TENDER	2013/06/28
revision		date

Do not scale drawings.
Verify all dimensions and conditions on site and immediately notify the Departmental Representative of all discrepancies.



This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from stated dimensions.

PORT GRANBY, ONTARIO

PORT HOPE AREA INITIATIVE

PORT GRANBY PROJECT LTMF CONSTRUCTION AND PGMMF REMEDIATION

drawing title
titre du dessin

EQUALIZATION POND
PUMP STATION
POWER AND LIGHTING LAYOUT

drawn by
dessine par
AJS

designed by
conc par
JL

approved by
approuvé par
YC/CH

bid offre	J.A., P.ENG.	project manager administrateur de projets
--------------	--------------	---


project date	2013-07-15
date du projet	

project no.
no. du projet


R.023276.217

drawing no. dessine no.	1 TWME-F-32
----------------------------	-------------


GROUND LEVEL PLAN

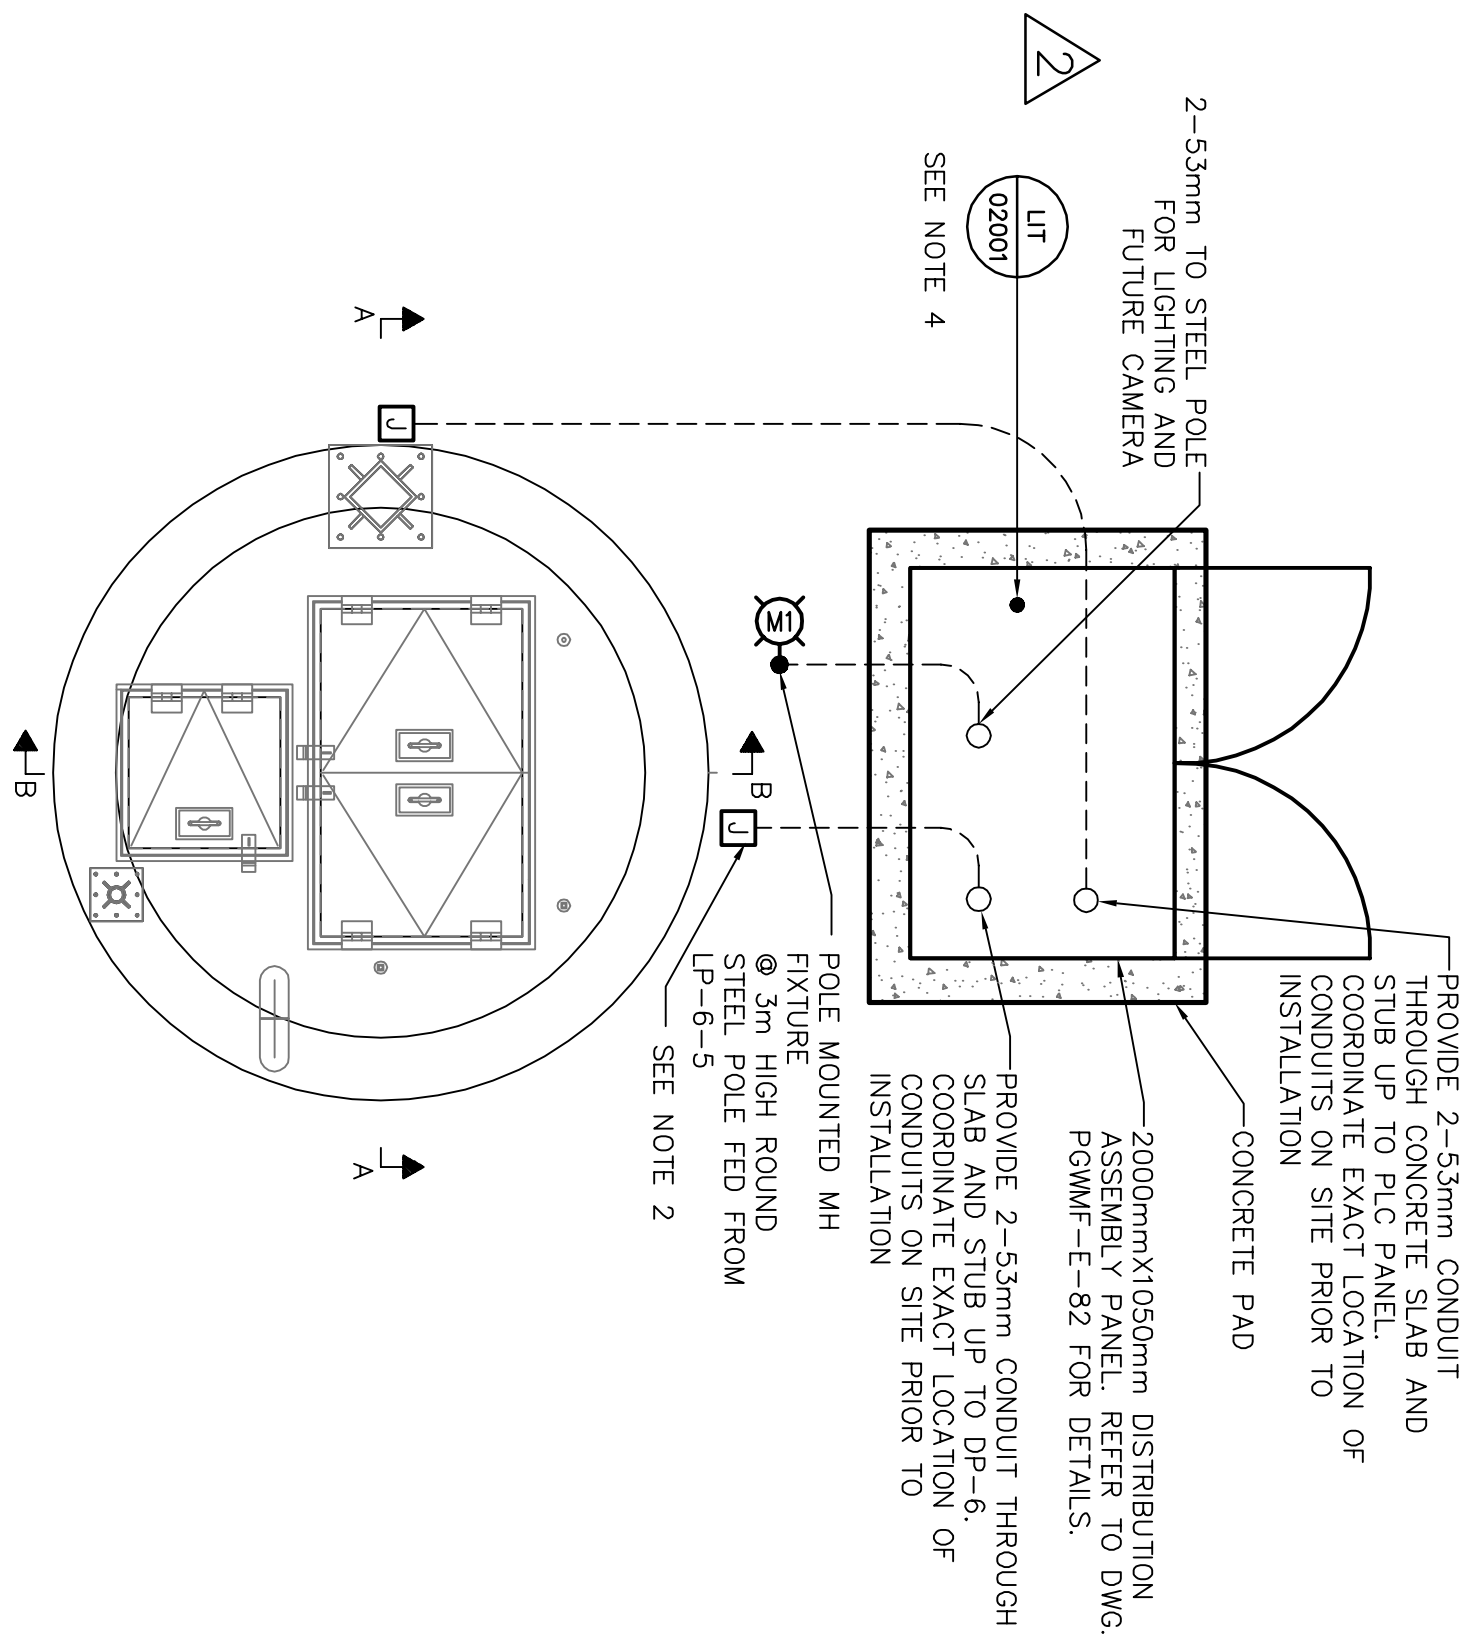


SECTIONS

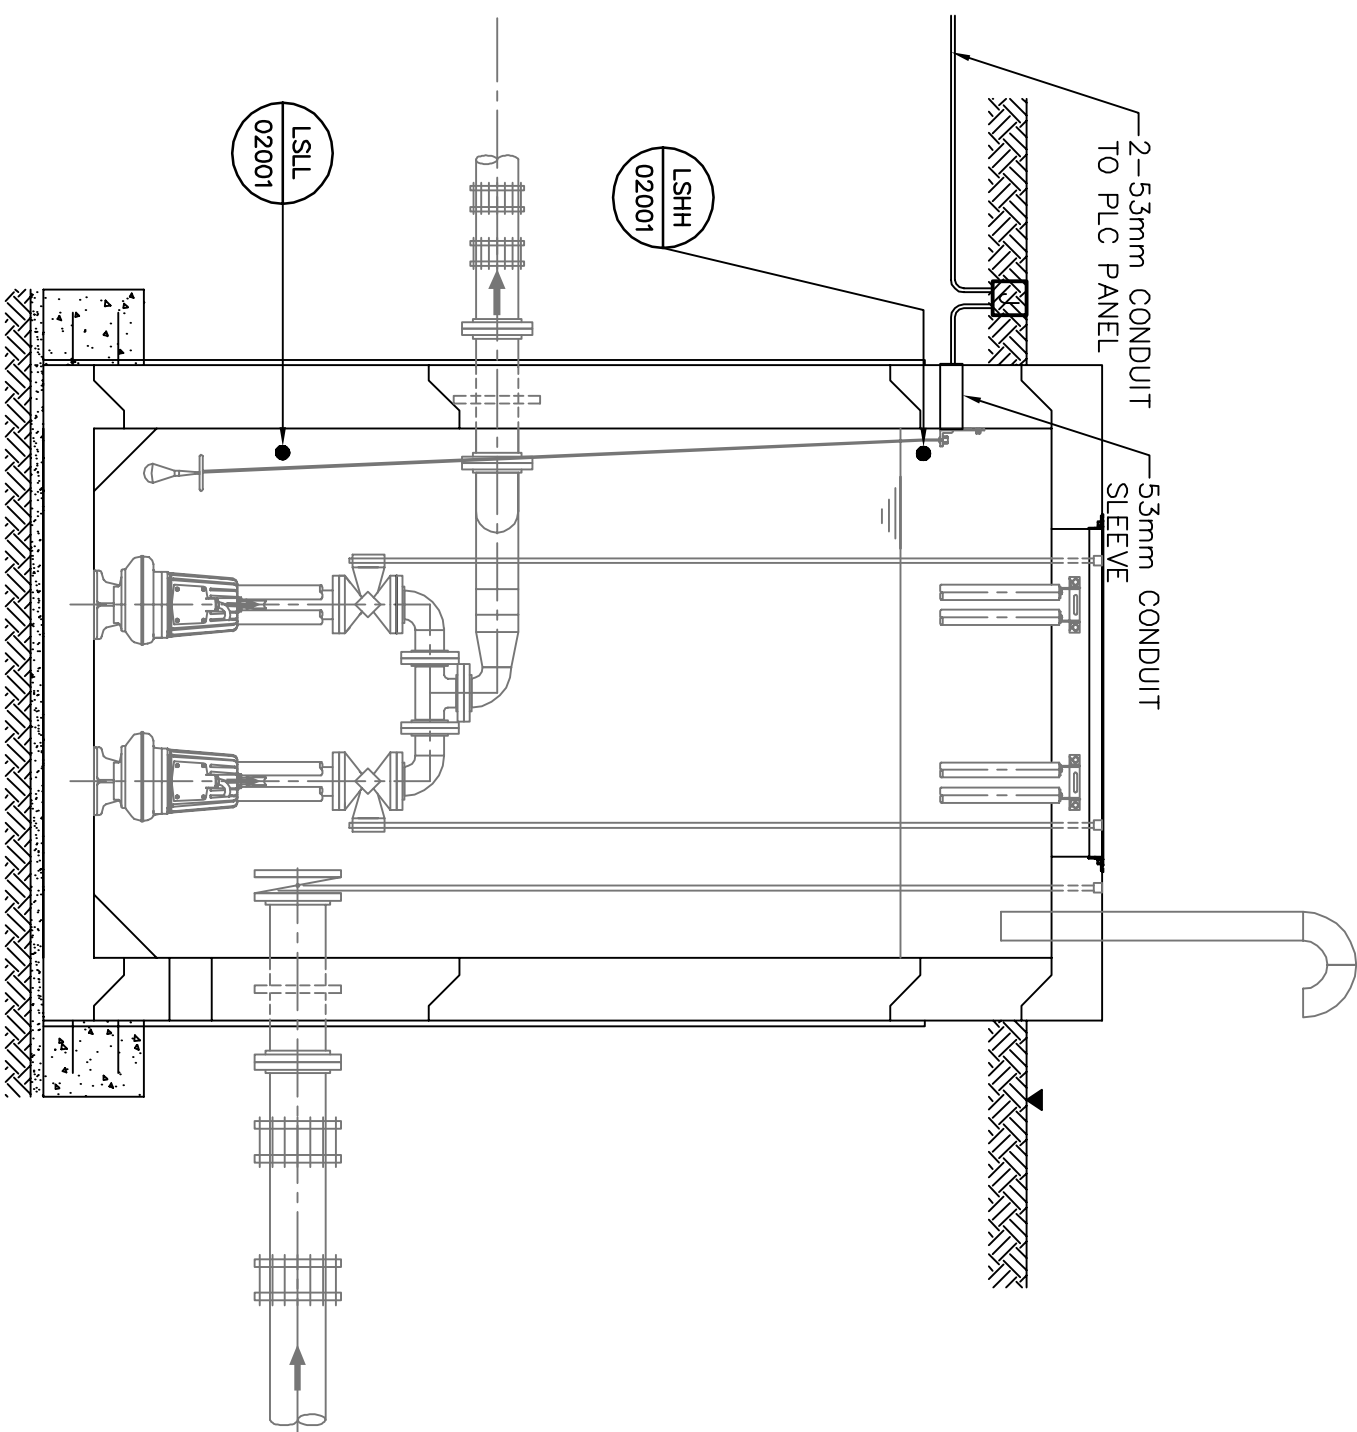

SECTIONS

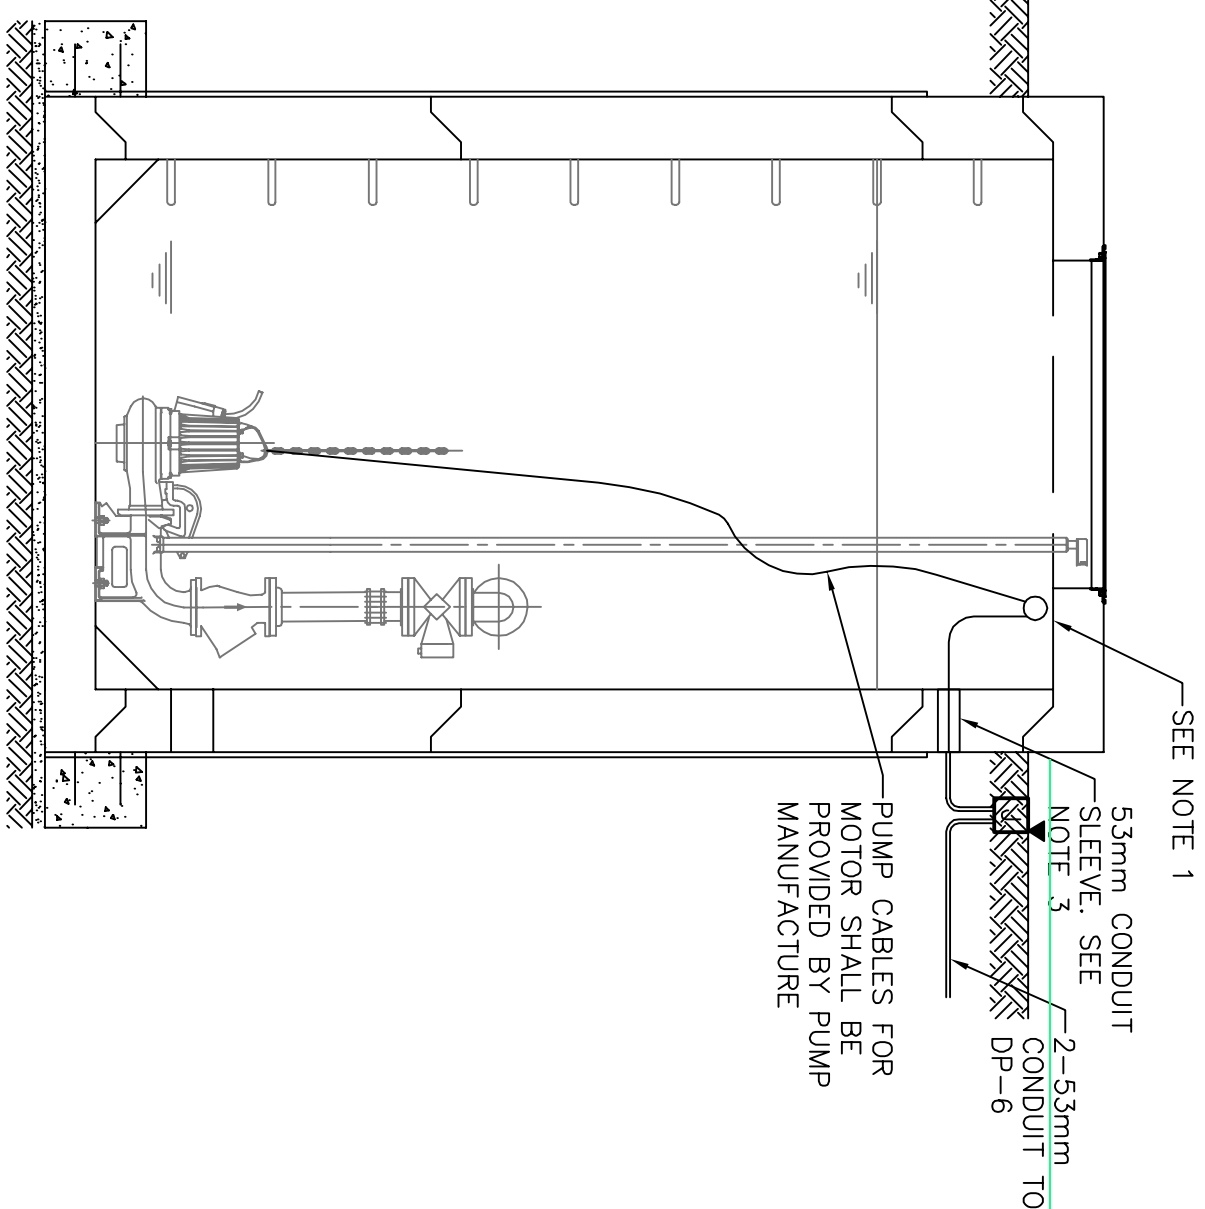


GROUND LEVEL PLAN

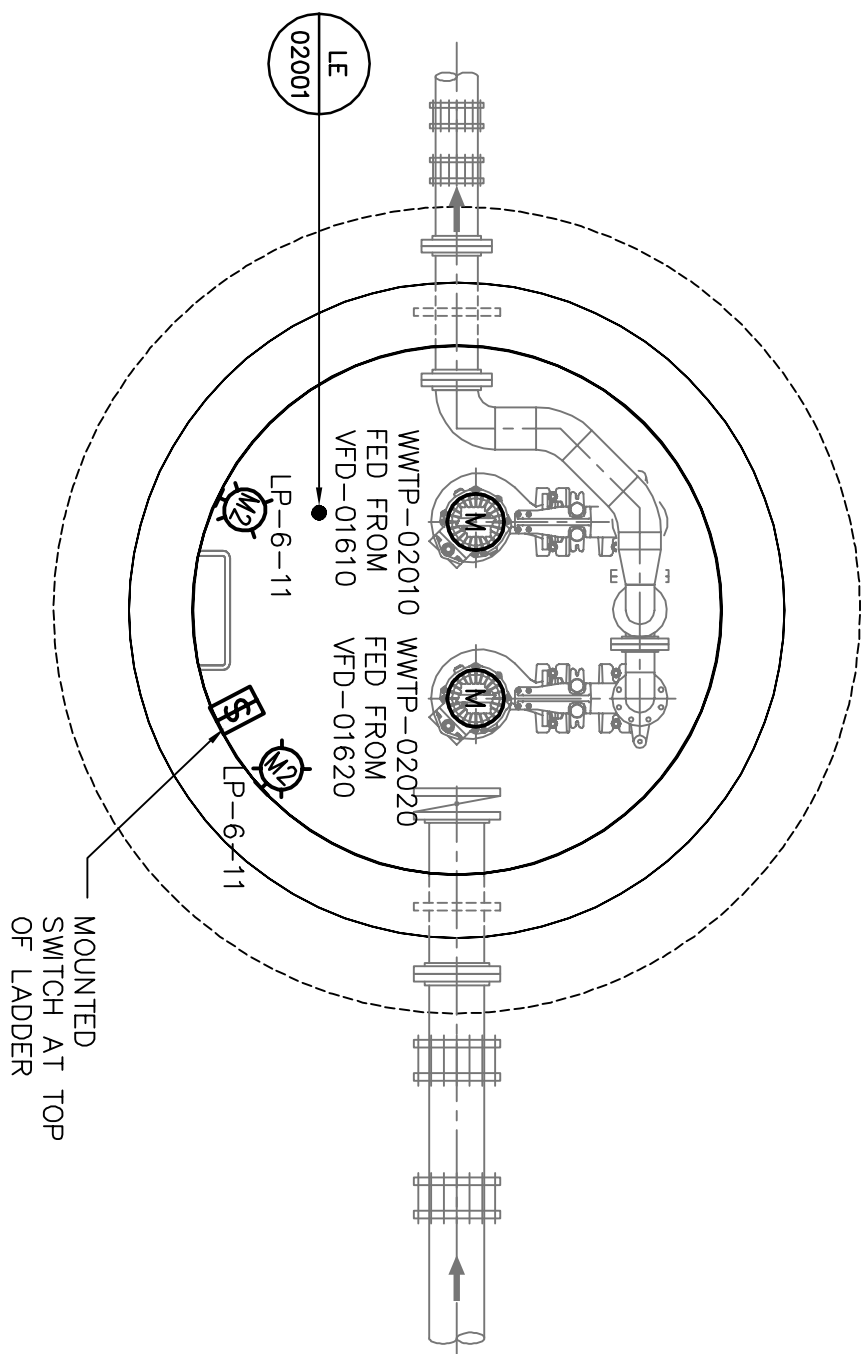

WET WELL PLAN

LIGHTING POLE DETAIL

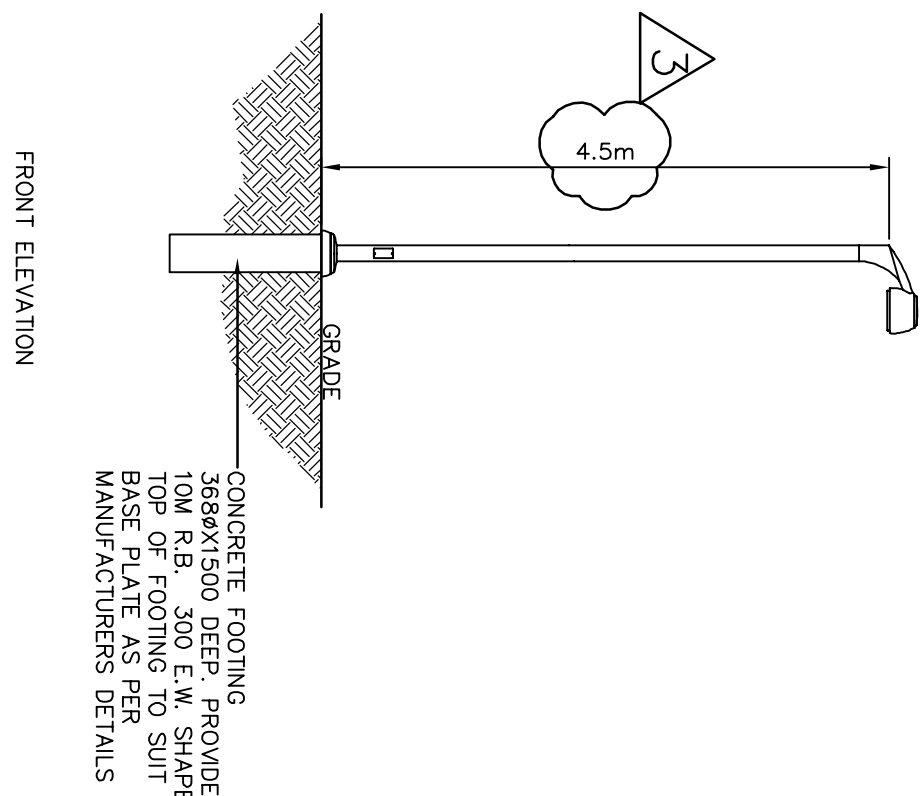

NOTE

1. PROVIDE "J" HOOK MOUNTED AS HIGH AS POSSIBLE UNDER HATCH OPENING.
2. PROVIDE 6"x6"x5" DEEP JUNCTION BOX FLUSH WITH GRADE. INSTALL 53mm CONDUIT FOR PUMP POWER/FLOAT CABLE. SEAL CONDUITS TO BUILDING. CONTRACTOR TO COORDINATE EXACT LOCATION OF THE JUNCTION BOX ON SITE PRIOR TO INSTALLATION
3. PROVIDE 53mm CONDUIT SLEEVE THROUGH WET WELL DECK. PROVIDE STAINLESS STEEL STRAIN RELIEF FITTINGS (EACH CABLE).
4. UT-02001 MOUNTED ON FACE OF LCP-02010