


- NOTES:**
- OWNER HAS FIRST RIGHT OF REFUSAL OF ALL REMOVED MATERIAL. IF OWNER REFUSES MATERIALS, CONTRACTOR IS TO REMOVE MATERIALS FROM THE SITE.
  - THE ELECTRICAL CONTRACTOR MUST TRACE ALL CIRCUITS TO BE REMOVED BACK TO ASSOCIATED PANEL. ENSURE ANY AREAS THAT ARE EXISTING TO REMAIN, NOT IN CONTRACTOR'S FEEDING AREAS OUTSIDE OF REMOVED SPACE ARE MAINTAINED. MAKE NECESSARY MODIFICATIONS TO EXISTING CIRCUITS TO SUIT THESE CONDITIONS.
  - REMOVE ALL EXISTING CONDUIT, WIRING, MOUNTING SUPPORT, ETC. ASSOCIATED WITH EQUIPMENT IDENTIFIED TO BE REMOVED.
  - MODIFY EXISTING CONDUIT AND WIRING TO SUIT ALL EQUIPMENT NOTED AS EXISTING TO BE RELOCATED. PROVIDE ADDITIONAL CONDUIT AND WIRING TO SUIT NEW LOCATION.



**NOTE:**  
THIS DRAWING IS PROVIDED TO GIVE A GENERAL INDICATION OF POWER AND MISCELLANEOUS SYSTEMS TO BE REMOVED UNDER THIS FOR PAROLE OFFICE FIT-UP CSC. THE CONTRACTOR SHALL VERIFY ALL SYSTEMS TO BE REMOVED UNDER THIS FOR PAROLE OFFICE FIT-UP CSC. THE CONTRACTOR SHALL VERIFY ALL SYSTEMS TO BE REMOVED UNDER THIS FOR PAROLE OFFICE FIT-UP CSC. THE CONTRACTOR SHALL VERIFY ALL SYSTEMS TO BE REMOVED UNDER THIS FOR PAROLE OFFICE FIT-UP CSC. REQUIREMENTS MAY VARY. EXISTING EQUIPMENT AND ASSOCIATED CONDUIT AND WIRING TO BE REMOVED IS TO BE DISPOSED OF IN ACCORDANCE WITH ALL APPLICABLE ENVIRONMENTAL REGULATIONS UNLESS INDICATED OTHERWISE.

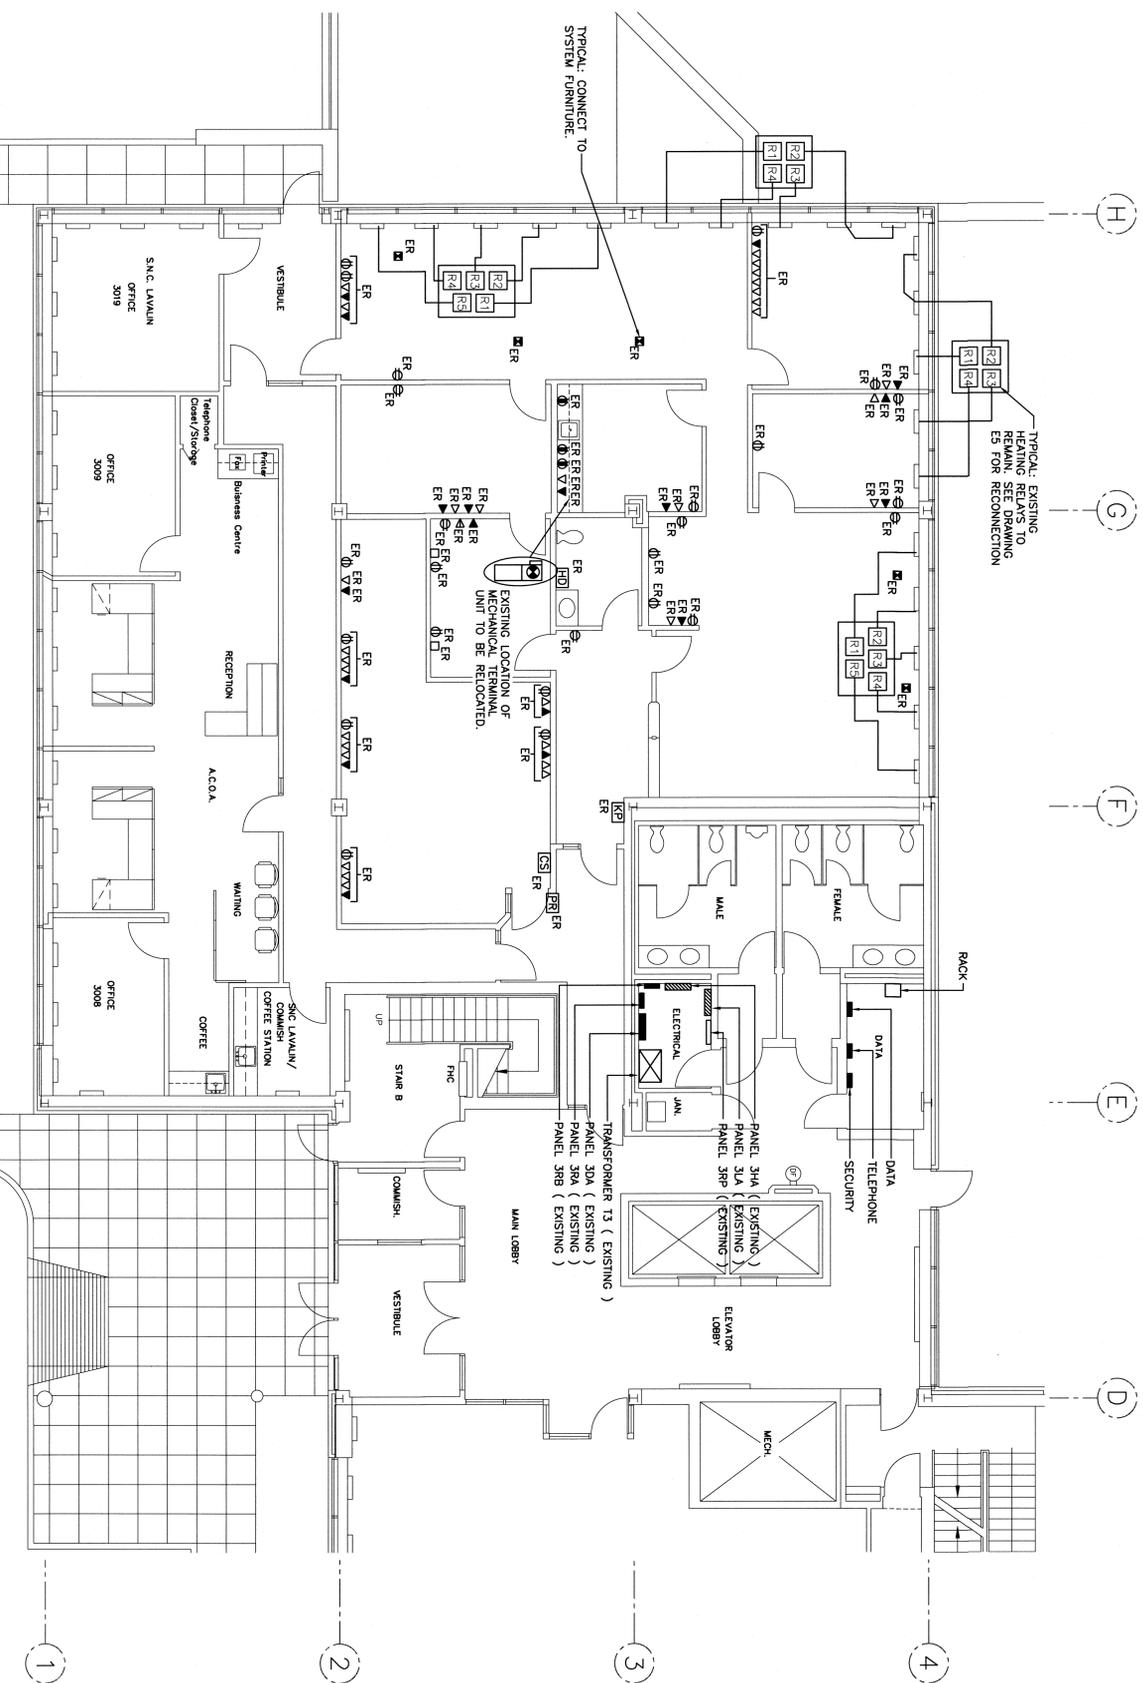

PROVINCE OF ONTARIO REGISTRATION AND LICENSING  
**PERMIT HOLDER**  
 This Permit Allows  
**STANTEC CONSULTING LTD.**  
 To Practice Professional Engineering  
 in Ontario  
 Permit No. as Issued by PEG 20281  
 which is valid for the year 2014.

Public Works and  
 Government Services  
 Ontario

0 ISSUED FOR TENDER  
 DEC 10 2014

PAROLE OFFICE FIT-UP CSC

DEMOLITION POWER  
 AND MISC. SYSTEMS  
 FLOOR PLAN - LEVEL 3

designed	conçu
drawn	dessiné
checked	vérifié
approved	approuvé
date	date
author	auteur
PMSCS Project Manager	Administrateur de projet PMSCS
project number	no. du projet
R.063761.003	
drawing no.	no. du dessin
E3	