


- NOTES:
1. OWNER HAS FIRST RIGHT OF REFUSAL OF ALL REMOVED MATERIAL. IF OWNER REFUSES MATERIALS, CONTRACTOR IS TO REMOVE MATERIALS FROM THE SITE.
 2. THE ELECTRICAL CONTRACTOR MUST TRACE ALL CIRCUITS TO BE REMOVED BACK TO ASSOCIATED PANEL. ENSURE ANY AREAS THAT ARE EXISTING TO REMAIN, NOT IN CONTRACT OR FEEDING AREAS OUTSIDE OF RENOVATED SPACE ARE MAINTAINED. MAKE NECESSARY MODIFICATIONS TO EXISTING CIRCUITS TO SUIT THESE CONDITIONS.
 3. REMOVE ALL EXISTING CONDUIT, WIRING, MOUNTING SUPPORT, ETC. ASSOCIATED WITH EQUIPMENT IDENTIFIED TO BE REMOVED.
 4. MODIFY EXISTING CONDUIT AND WIRING TO SUIT ALL EQUIPMENT NOTED AS EXISTING TO BE RELOCATED. PROVIDE ADDITIONAL CONDUIT AND WIRING TO SUIT NEW LOCATION.



NOTE:
 THIS DRAWING IS PROVIDED TO GIVE A GENERAL INDICATION OF LIGHTING AND MISCELLANEOUS SYSTEMS TO BE REMOVED UNDER THIS CONTRACT. CONTRACTOR TO CONFIRM EXACT QUANTITIES AND LOCATIONS OF DEVICES ON SITE. ALL ASSOCIATED CONDUIT AND WIRE FOR ALL DEVICES TO BE REMOVED BACK TO PANELS AND/OR CLOSERS UNLESS OTHERWISE INDICATED. ACTUAL SITE CONDITIONS AND REQUIREMENTS MAY VARY. EXISTING EQUIPMENT, CONDUIT AND WIRING TO BE REMOVED IS TO BE DISPOSED OF IN ACCORDANCE WITH ALL APPLICABLE ENVIRONMENTAL REGULATIONS UNLESS INDICATED OTHERWISE.

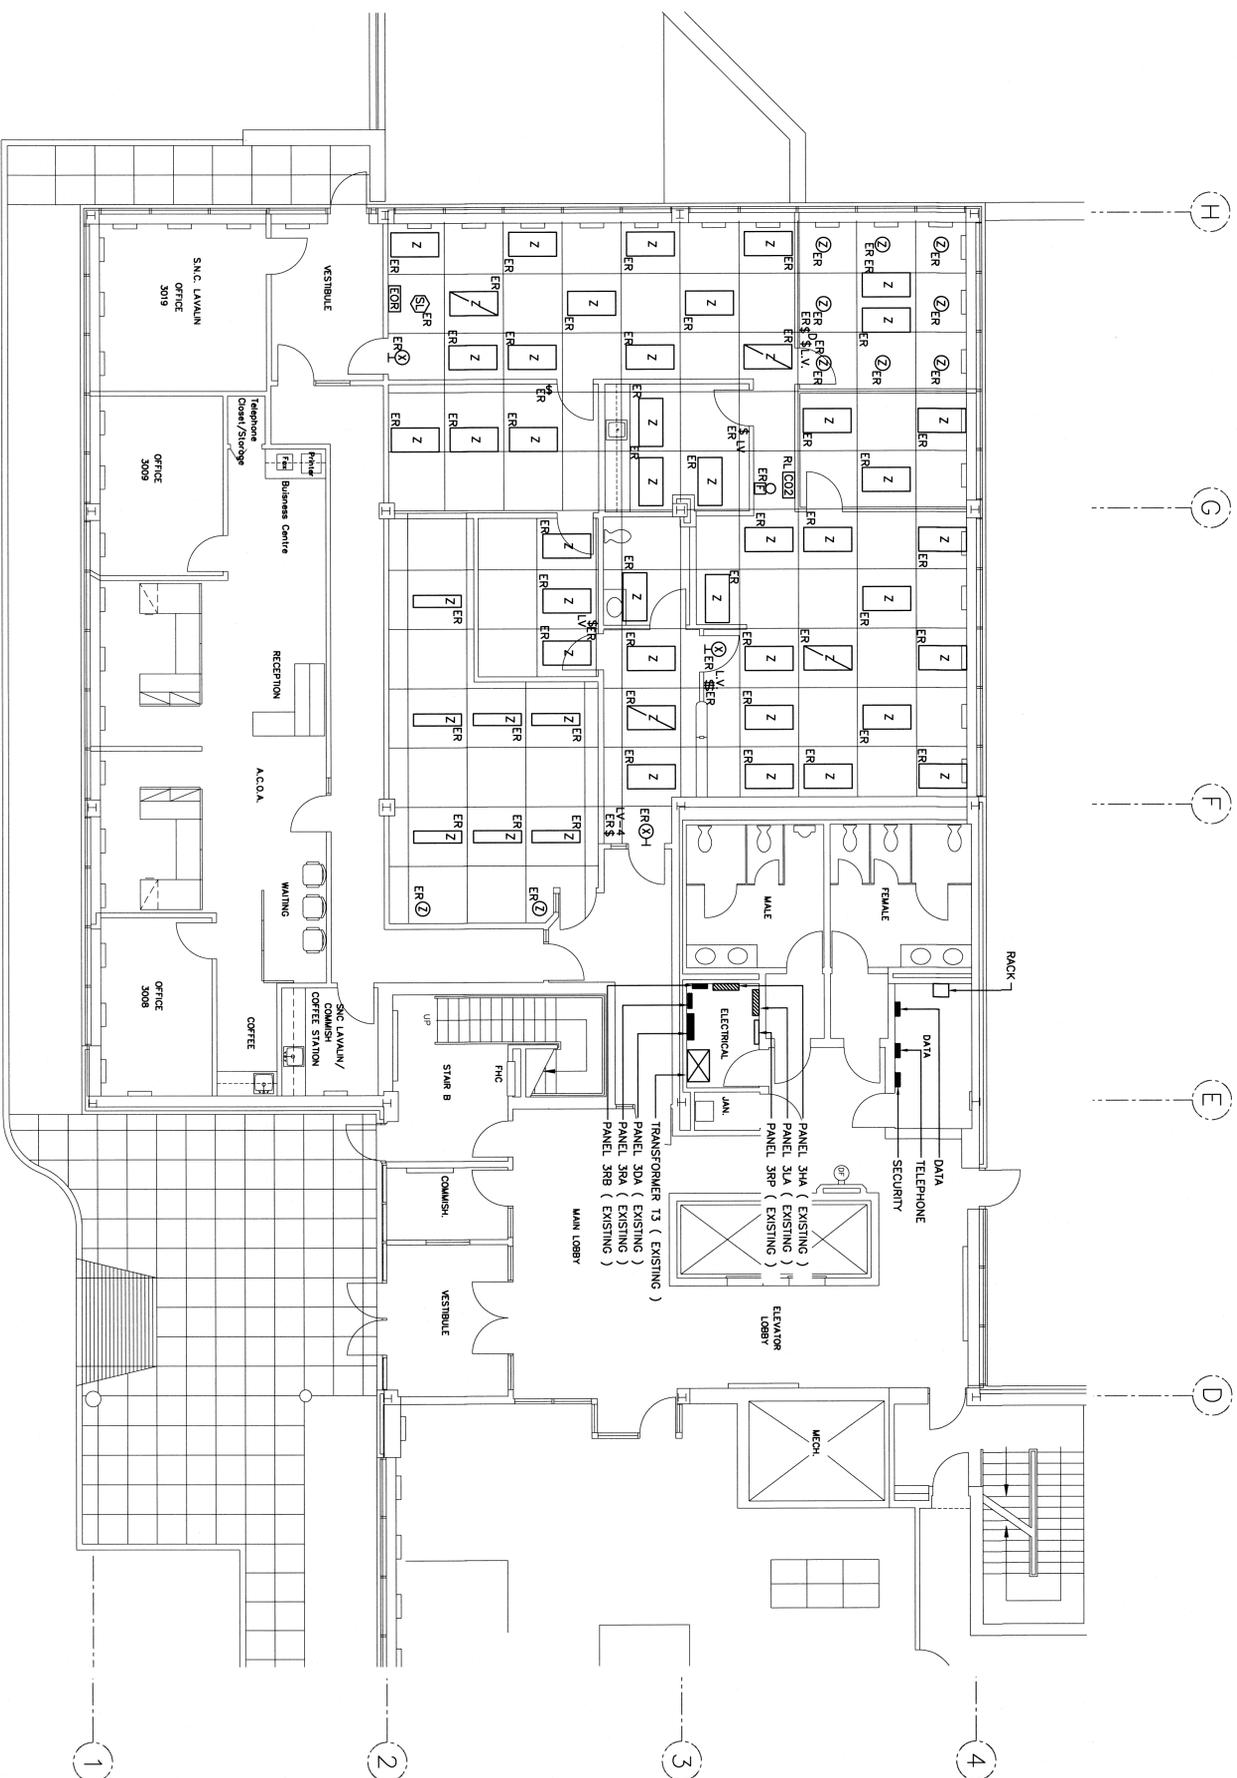

PROVINCE OF NEWBRUNSWICK AND LABOUR
PEA PERMIT HOLDER
 This Permit Allows
STANTEC CONSULTING LTD.
 To practice Professional Engineering
 in New Brunswick and Labrador
 from 2014 to 2015
 which is valid for the year 2014.

Public Works and
 Government Services
 Ontario
 Services gouvernementales
 Québec

revision	0	ISSUED FOR TENDER	2014
project	PAROLE OFFICE FIT-UP CSC		

DEMOLITION LIGHTING
 AND FIRE ALARM
 SYSTEMS
 FLOOR PLAN - LEVEL 3

designed		comp.	
date		designé	
drawn		dessiné	
date			
approved		approuvé	
author	S. J. W.	2014-12-17	2014
title	2014-12-17		
project number	R.063761.003	no. du projet	
drawing no.	E2	no. du dessin	