



NOTES:
 1. UPON ADDITION OF FIRE ALARM DEVICES, RE-VERIFY FIRE ALARM SYSTEM IN ACCORDANCE WITH LATEST EDITION OF CAN/ULC-5537. PROVIDE WRITTEN VERIFICATION CERTIFICATE.

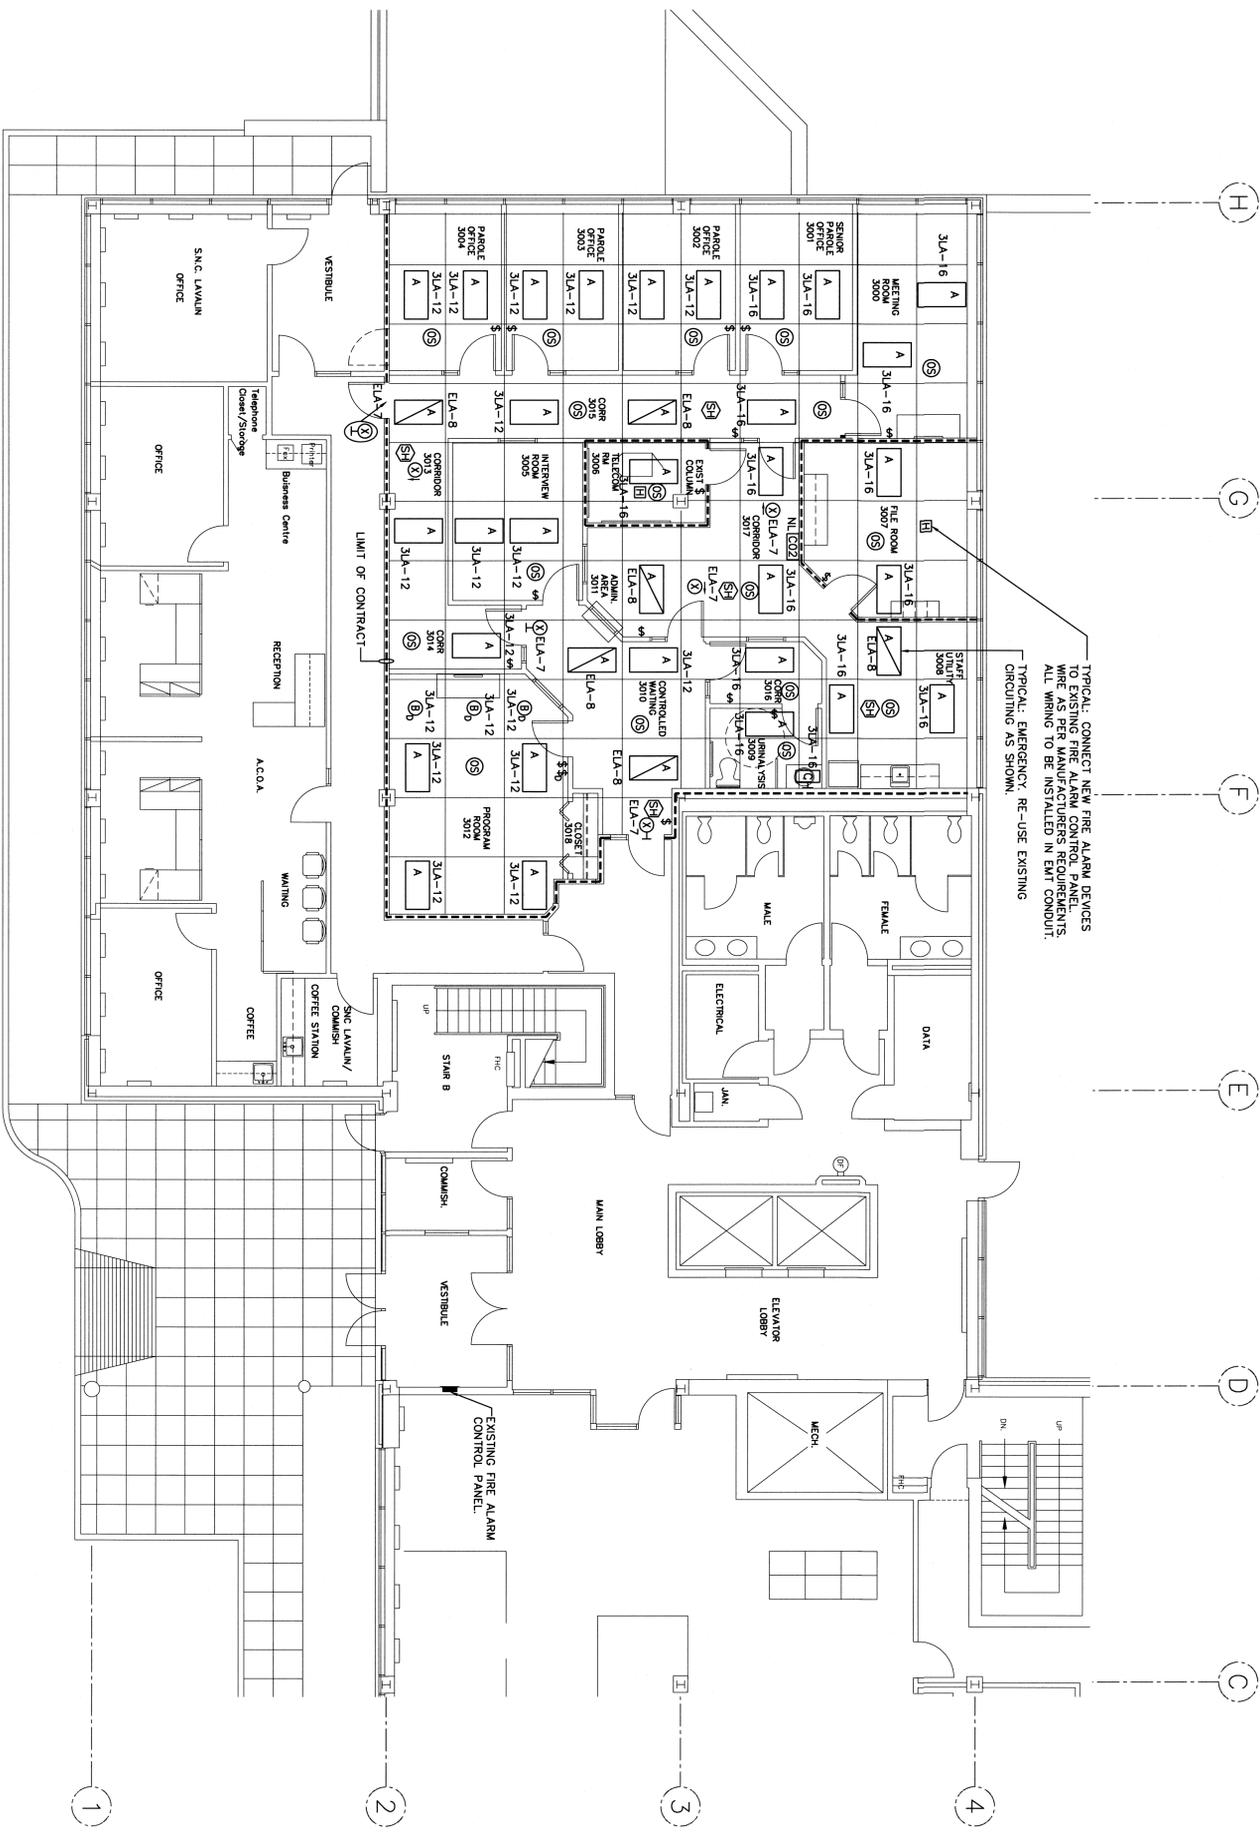

TYPICAL: CONNECT NEW FIRE ALARM DEVICES TO EXISTING FIRE ALARM CONTROL PANEL. WIRE AS PER MANUFACTURERS REQUIREMENTS. ALL WIRING TO BE INSTALLED IN EMT CONDUIT. TYPICAL: EMERGENCY. RE-USE EXISTING CIRCUITING AS SHOWN.



PROVINCE OF NEWBRUNSWICK AND LABRADOR
 REGISTRATION AND LICENSING
 PERMIT HOLDER
 This Permit Allows
STANTEC CONSULTING LTD.
 To practice Professional Engineering
 in New Brunswick and Labrador
 under the authority of the Engineering
 Act (R.S.N.S. 1988, c. 124) and the
 Regulations made thereunder (N.S.R. 2014,
 which is valid for the year 2014.



Public Works and
 Government Services
 Services gouvernementales
 Timour Publics et
 Canada

0	ISSUED FOR TENDER	DEC 10
1	REVISED	2014
2	PROJECT	PROJ

PAROLE OFFICE FIT-UP CSC

REVISED LIGHTING
 AND FIRE ALARM
 SYSTEMS
 FLOOR PLAN - LEVEL 3

PROJECT NORTH
 SCALE: 1:75
 0m 0.75m 1.5m 2.25m 3.0m 3.75m 4.5m 5.25m 6.0m 6.75m 7.5m