


mechanical & electrical engineers

303-100 Osborne St. South
Winnipeg, MB R3L 1Y5

p 204.453.1080
ese@eppsiepmann.com

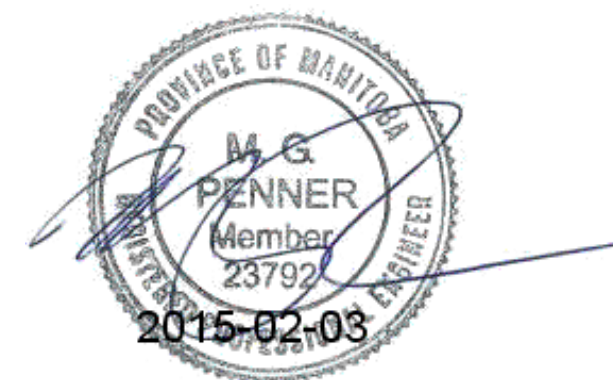


**PUBLIC WORKS AND
GOVERNMENT SERVICES
CANADA**

Project	Project
<p align="center">INTERIOR LEASE FIT-UP FOR CIC RELOCATION TO VICTORY BUILDING, WINNIPEG</p> <p align="center">269 MAIN STREET WINNIPEG, MANITOBA</p>	


Designed by Srivats Vijayan	Conçu par
Drawn by Srivats Vijayan	Dessiné par
Approved by Matt Penner	Approuvé par
PWGSC Project Manager John Ailbin	Administrateur de Projets TPSGC _____
Drawing title	Titre du dessin

**FOURTH FLOOR AND SEVENTH FLOOR
POWER & SYSTEMS PLAN
DEMOLITION LAYOUT**

Project no./No. du projet	Drawing no./No. du dessin	Revision no.
R.055488.006	EDP2.1	3
	3 OF 6	

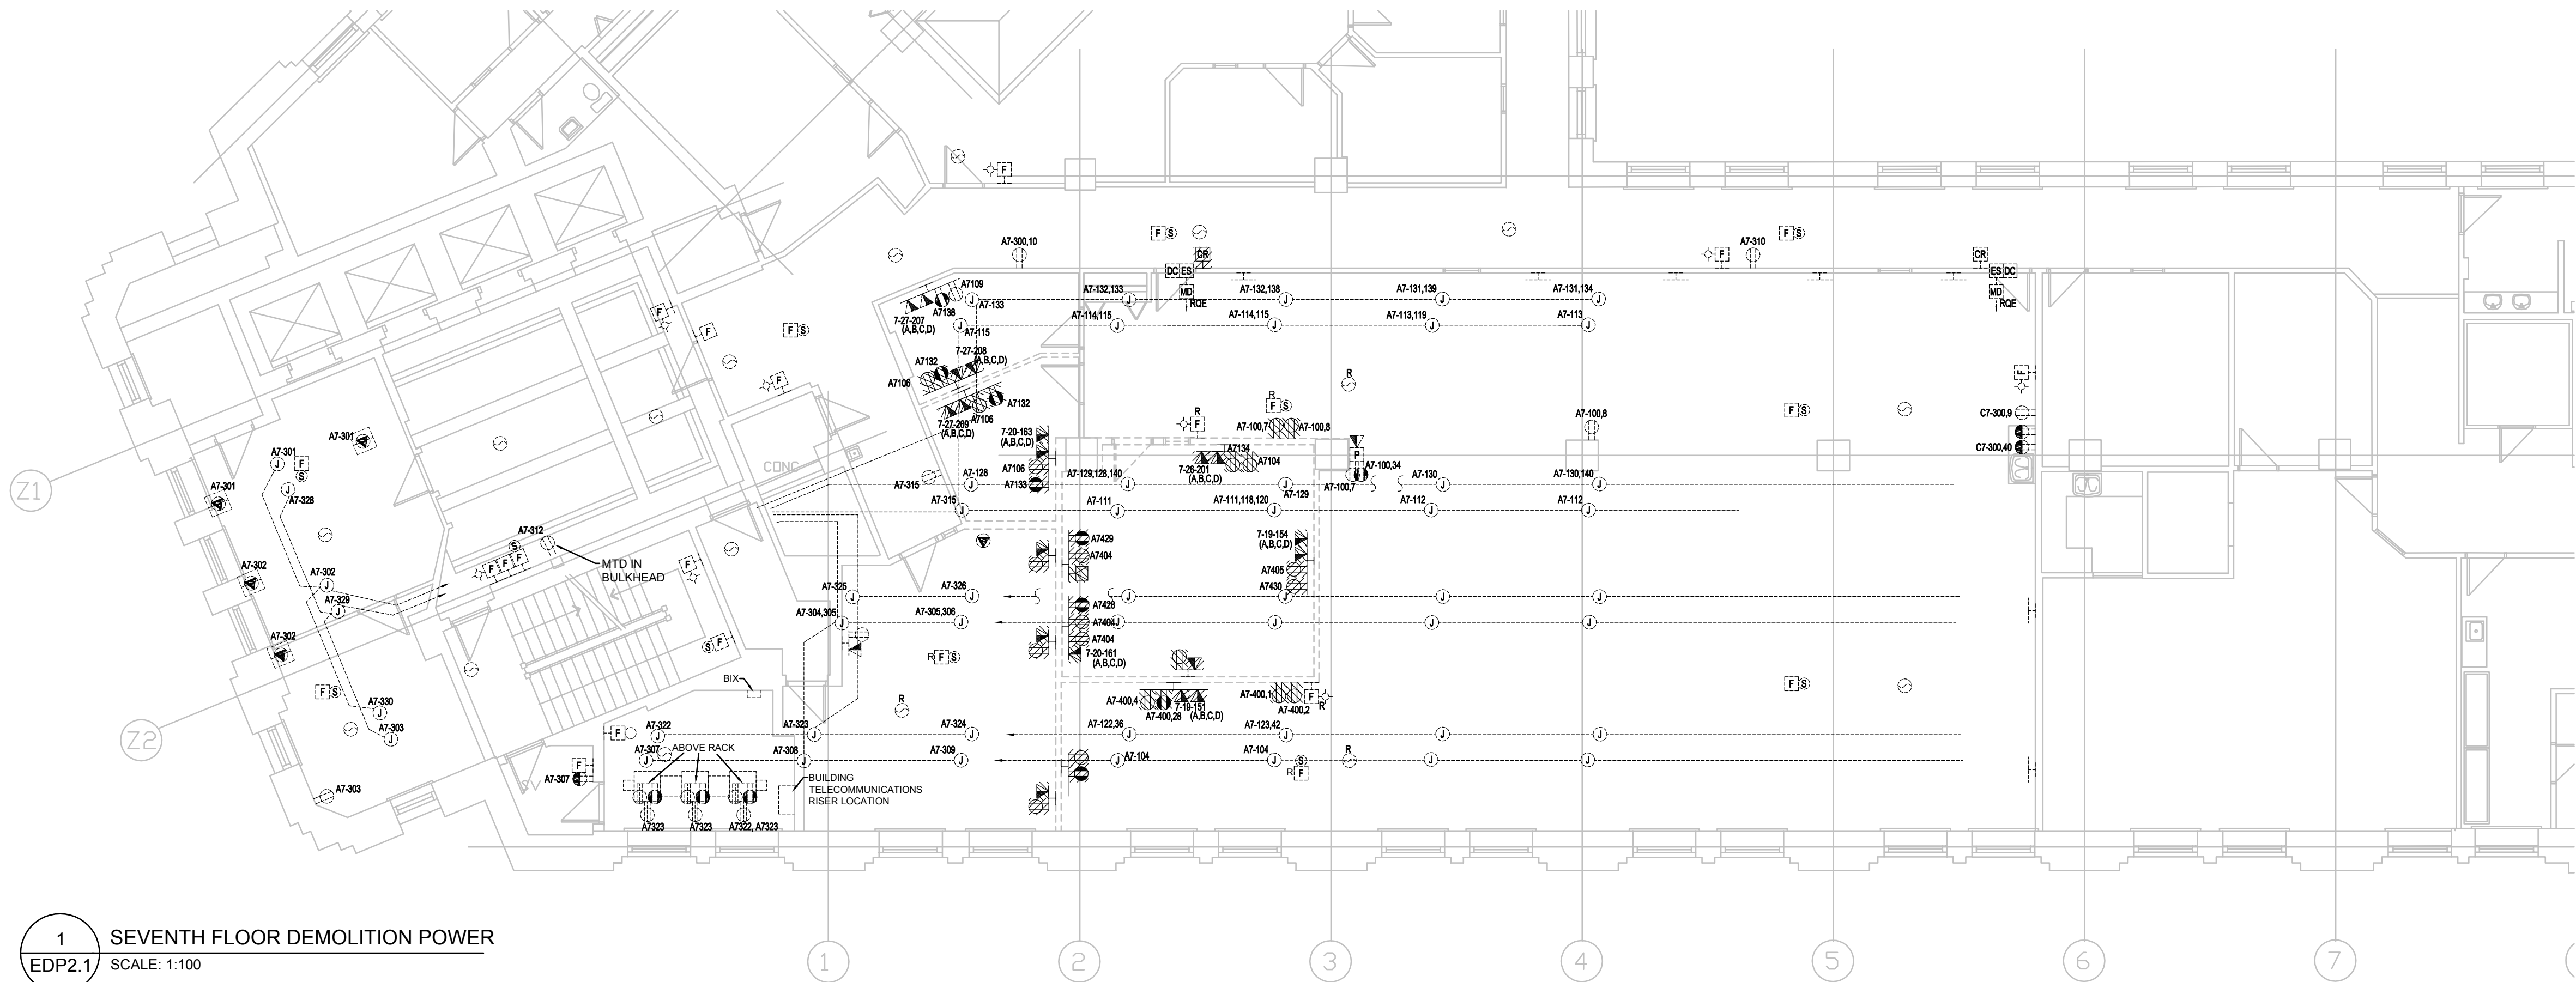

1 SEVENTH FLOOR DEMOLITION POWER
EDP2.1 SCALE: 1:100

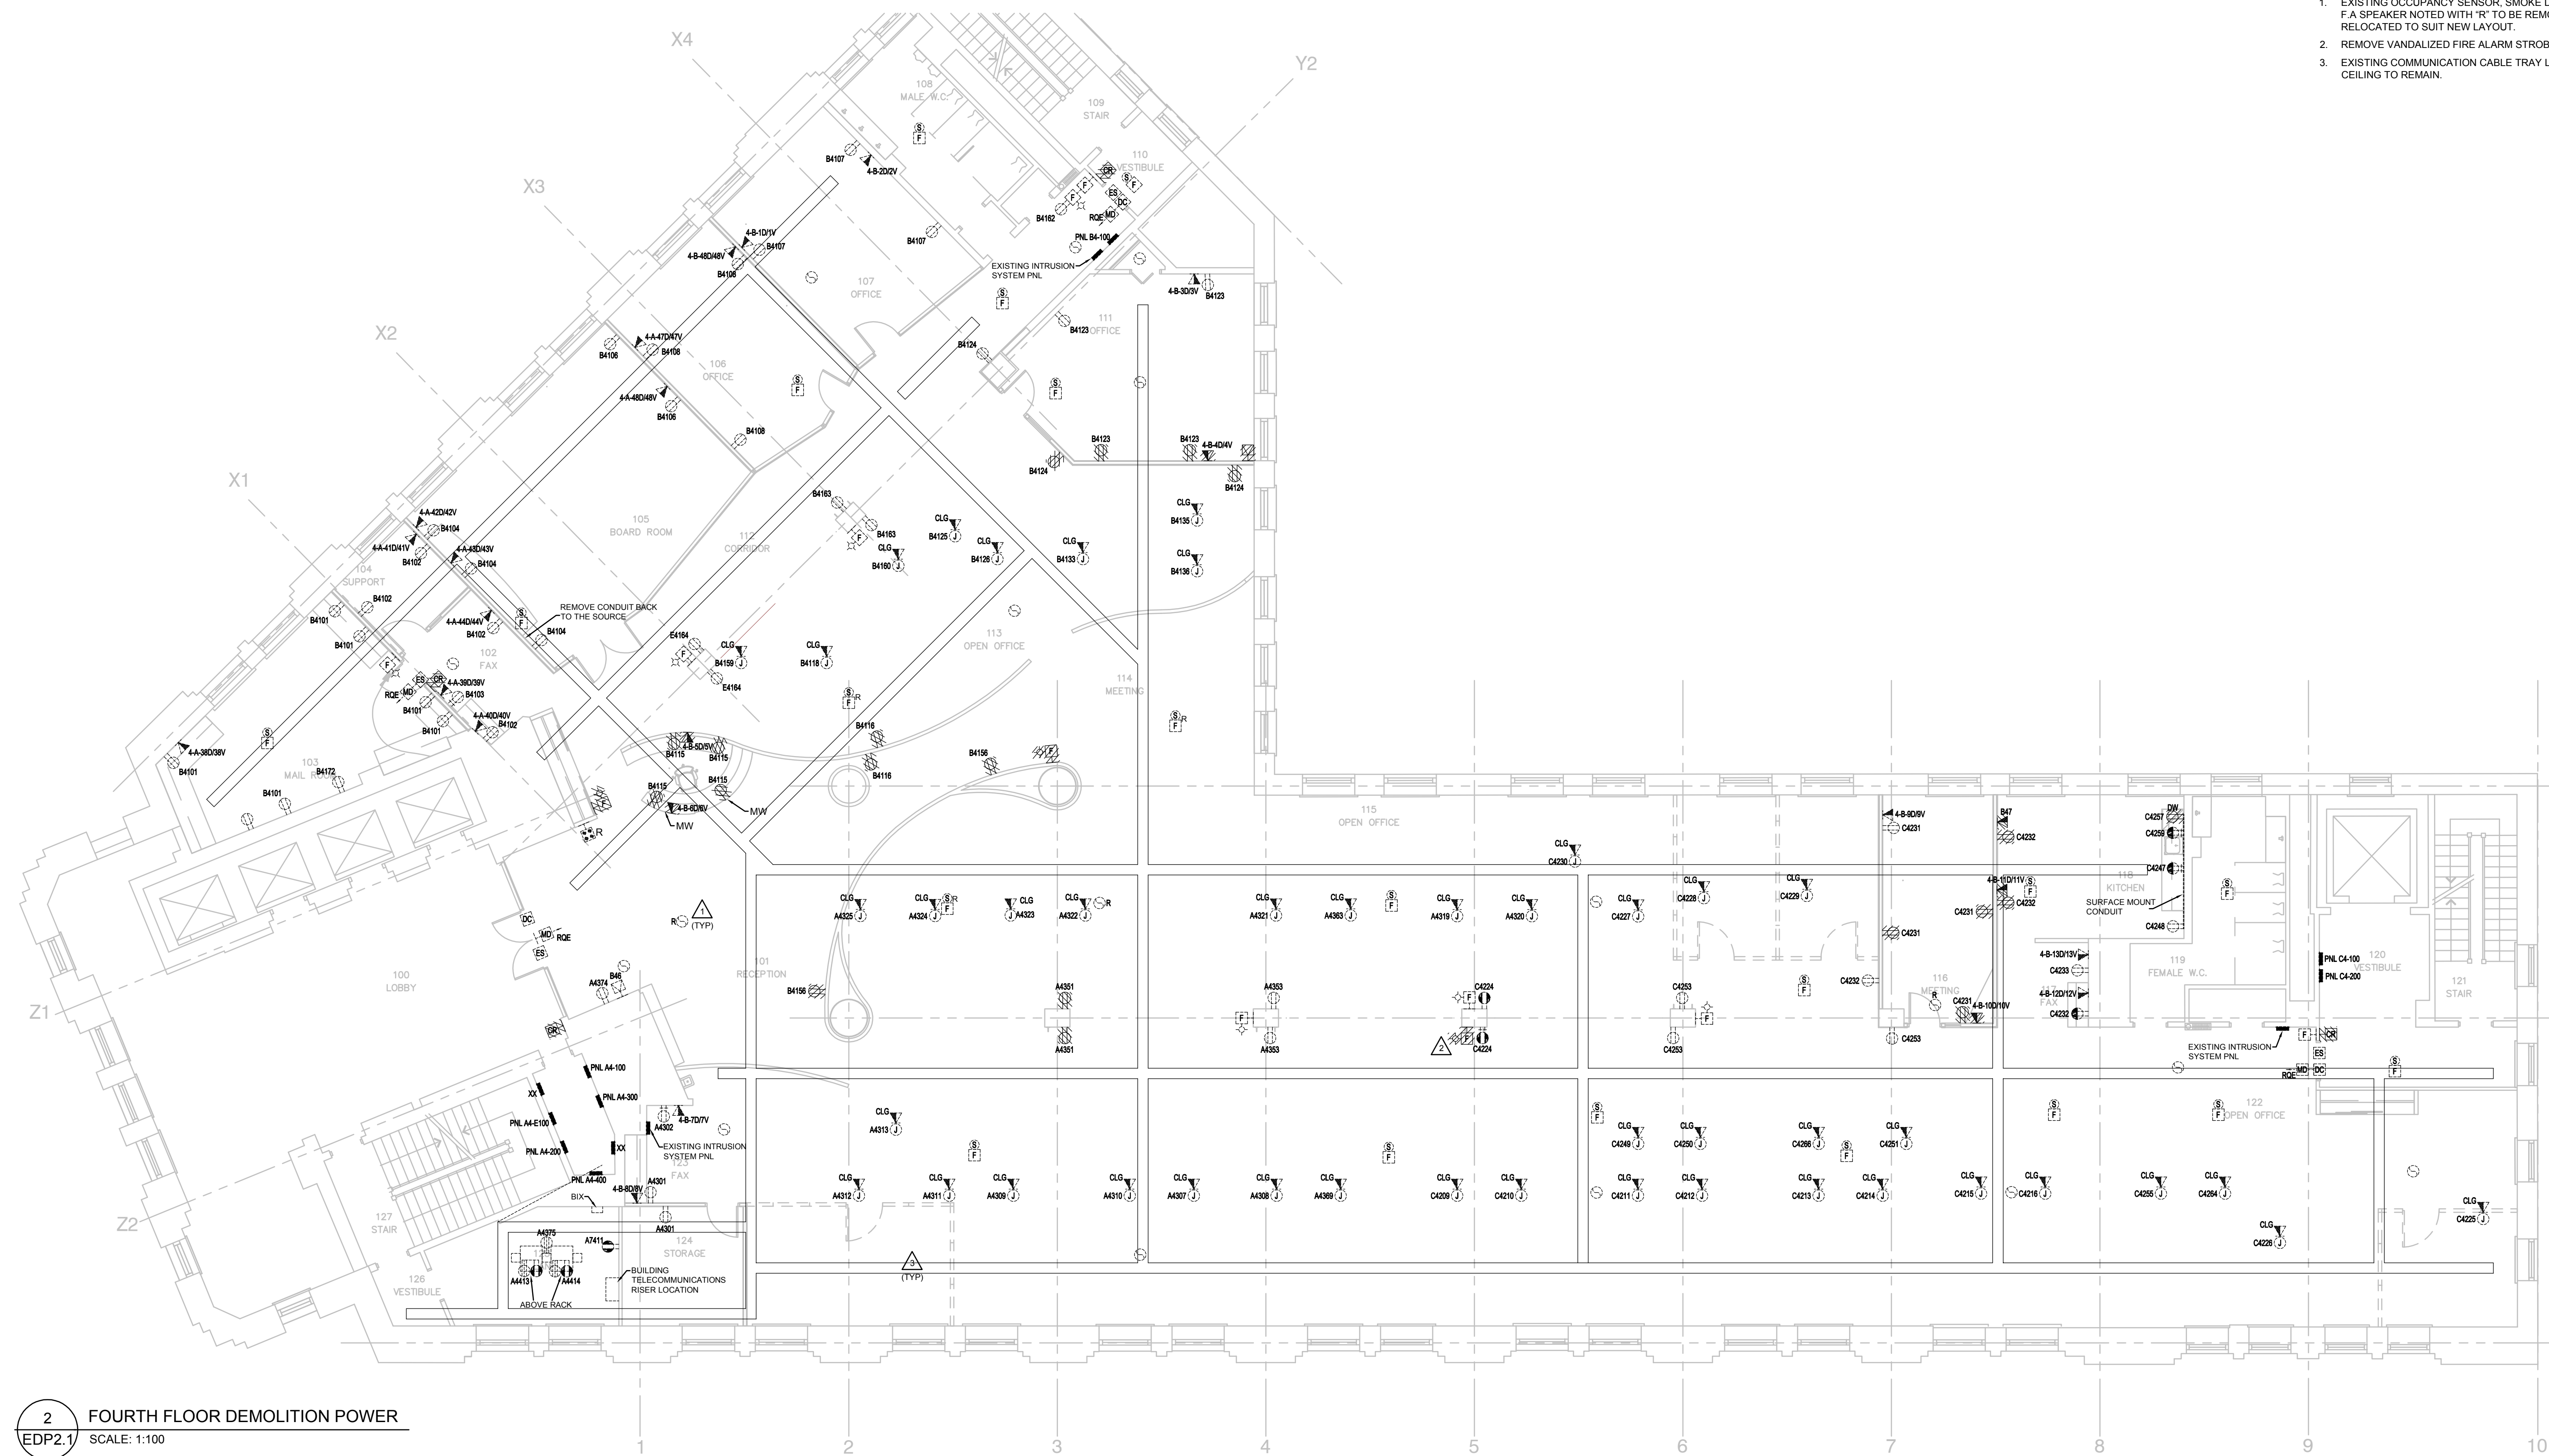

2 FOURTH FLOOR DEMOLITION POWER
EDP2.1 SCALE: 1:100

- a) COORDINATE ALL WORK REQUIRING SHUT-DOWN OF EXISTING SYSTEMS THAT COULD AFFECT EXISTING TENANTS WITH THE BUILDING OWNER AT A TIME AND MANNER SUITABLE TO THEM.
- b) REUSE EXISTING CIRCUITS FOR RELOCATED LIGHTING AND POWER LOADS WITHIN THE SPACE. PROVIDE TYPEWRITTEN PANEL DISCREPANCIES INDICATING DELETED CIRCUITING.
- c) ALL EXISTING DEVICES SHALL REMAIN UNLESS OTHERWISE NOTED.
- d) DEMOLISH ALL EXISTING COMMUNICATION CABLEING ON FLOOR. WIRING THROUGH CONCEALED SPACES SHALL BE CUT AND LEFT TO BE USED AS PULLCORD FOR NEW CABLEING. PROVIDE TYPEWRITTEN DISCREPANCIES TO CANADIAN WIRELESS COMMUNICATIONS (SCS) NEW COMMUNICATION WIRING NIC.
- e) DISCONNECT AND REMOVE WIRING AND CONDUIT FOR ALL DEMOLISHED ELECTRICAL DEVICES AND EQUIPMENT BACK TO SOURCE WHERE NOT BEING REUSED.
- f) CONTRACTOR SHALL CLEAN UP AND REMOVE AND ABANDON BRING AND REMOVE ALL DEBRIS.
- g) CONTRACTOR SHALL CONFIRM ALL SYSTEMS TO BE IN WORKING CONDITION PRIOR TO CARRYING OUT MODIFICATIONS. WHERE EXISTING SYSTEMS ARE NOT OPERABLE, THE KEY PERSONNEL OR SYSTEMAL REPRESENTATIVE PRIOR TO CARRYING OUT WORK.

1. EXISTING OCCUPANCY SENSOR, SMOKE DETECTOR AND F.A. SPEAKER NOTED WITH "R" TO BE REMOVED AND RELOCATED TO SUIT NEW LAYOUT.
2. REMOVE VANDALIZED FIRE ALARM STROBE LIGHT.
3. EXISTING COMMUNICATION CABLE TRAY LOCATED ABOVE CEILING TO REMAIN.