


303-100 Osborne St. South
Winnipeg, MB
R3L 1Y5
p 204.453.1080
ese@eppsiepmann.com

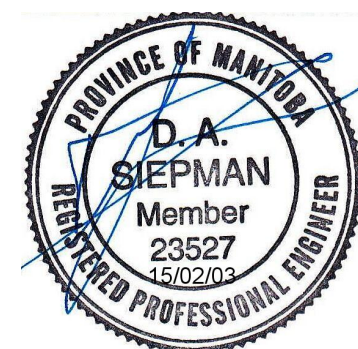

**PUBLIC WORKS AND
GOVERNMENT SERVICES
CANADA**

**INTERIOR LEASE FIT-UP FOR
CIC RELOCATION TO
VICTORY BUILDING, WINNIPEG**

**269 MAIN STREET
WINNIPEG, MANITOBA**

Drawing file

**SPRINKLER
FOURTH & SEVENTH FLOOR
RENOVATION**

15/01/2015


A00C



- COORDINATE ALL WORK REQUIRING SHUT-DOWN OF EXISTING SYSTEMS THAT COULD AFFECT EXISTING TENANTS WITH THE BUILDING OWNER AT A TIME AND MANNER SUITABLE TO THEM.
- FIRE STOP ALL NEW MECHANICAL PENETRATIONS THROUGH FIRE-RATED PARTITIONS.
- SPRINKLER CONTRACTOR TO INSTALL COMPLETE SPRINKLER SYSTEM AS NOTED ON DRAWINGS AND SPEC.
- SPRINKLER CONTRACTOR TO LAY OUT AND SIZE PIPING AND SUBMIT DESIGN TO THE ENGINEER FOR REVIEW AND COORDINATION.
- SPRINKLER CONTRACTOR SHALL REFER TO SITE FOR LOCATIONS OF EXISTING DUCTWORK PIPING AND EQUIPMENT FOR COORDINATION PURPOSES. LOCATE BRANCH LINES AS REQUIRED.
- GRADE ALL NEW SPRINKLER PIPING TO ALLOW COMPLETE SYSTEM DRAINAGE.
- SPRINKLER INSTALLATION SHALL COMPLY WITH NFPA 13.
- SPRINKLER CONTRACTOR TO ENSURE COMPLETE SPRINKLER COVERAGE AS REQUIRED BY NFPA 13.
- LAYOUT IS SCHEMATIC. PROVIDE ADDITIONAL NEW SPRINKLER HEADS AS REQUIRED TO FULLY COMPLY WITH NFPA 13.
- FIRE EXTINGUISHERS BY OWNER.

1. PROVIDE NEW SPRINKLER HEAD AND BRANCH PIPING AS REQUIRED.
2. RELOCATE EXISTING SPRINKLER HEADS, ADJUST BRANCH PIPE AS REQUIRED.
3. REMOVE SPRINKLER HEAD AND CAP PIPING WITHIN CEILING.
4. PROVIDE NEW CAGES ON EXISTING UPRIGHTS.
5. PROVIDE NEW ABC 10# FIRE EXTINGUISHER AT LOCATION SHOWN. RETURN EXISTING FIRE EXTINGUISHER TO OWNER.

<input type="radio"/>	NEW/REVISED PENDANT SPRINKLER HEAD
<input type="radio"/>	EXISTING PENDANT HEAD

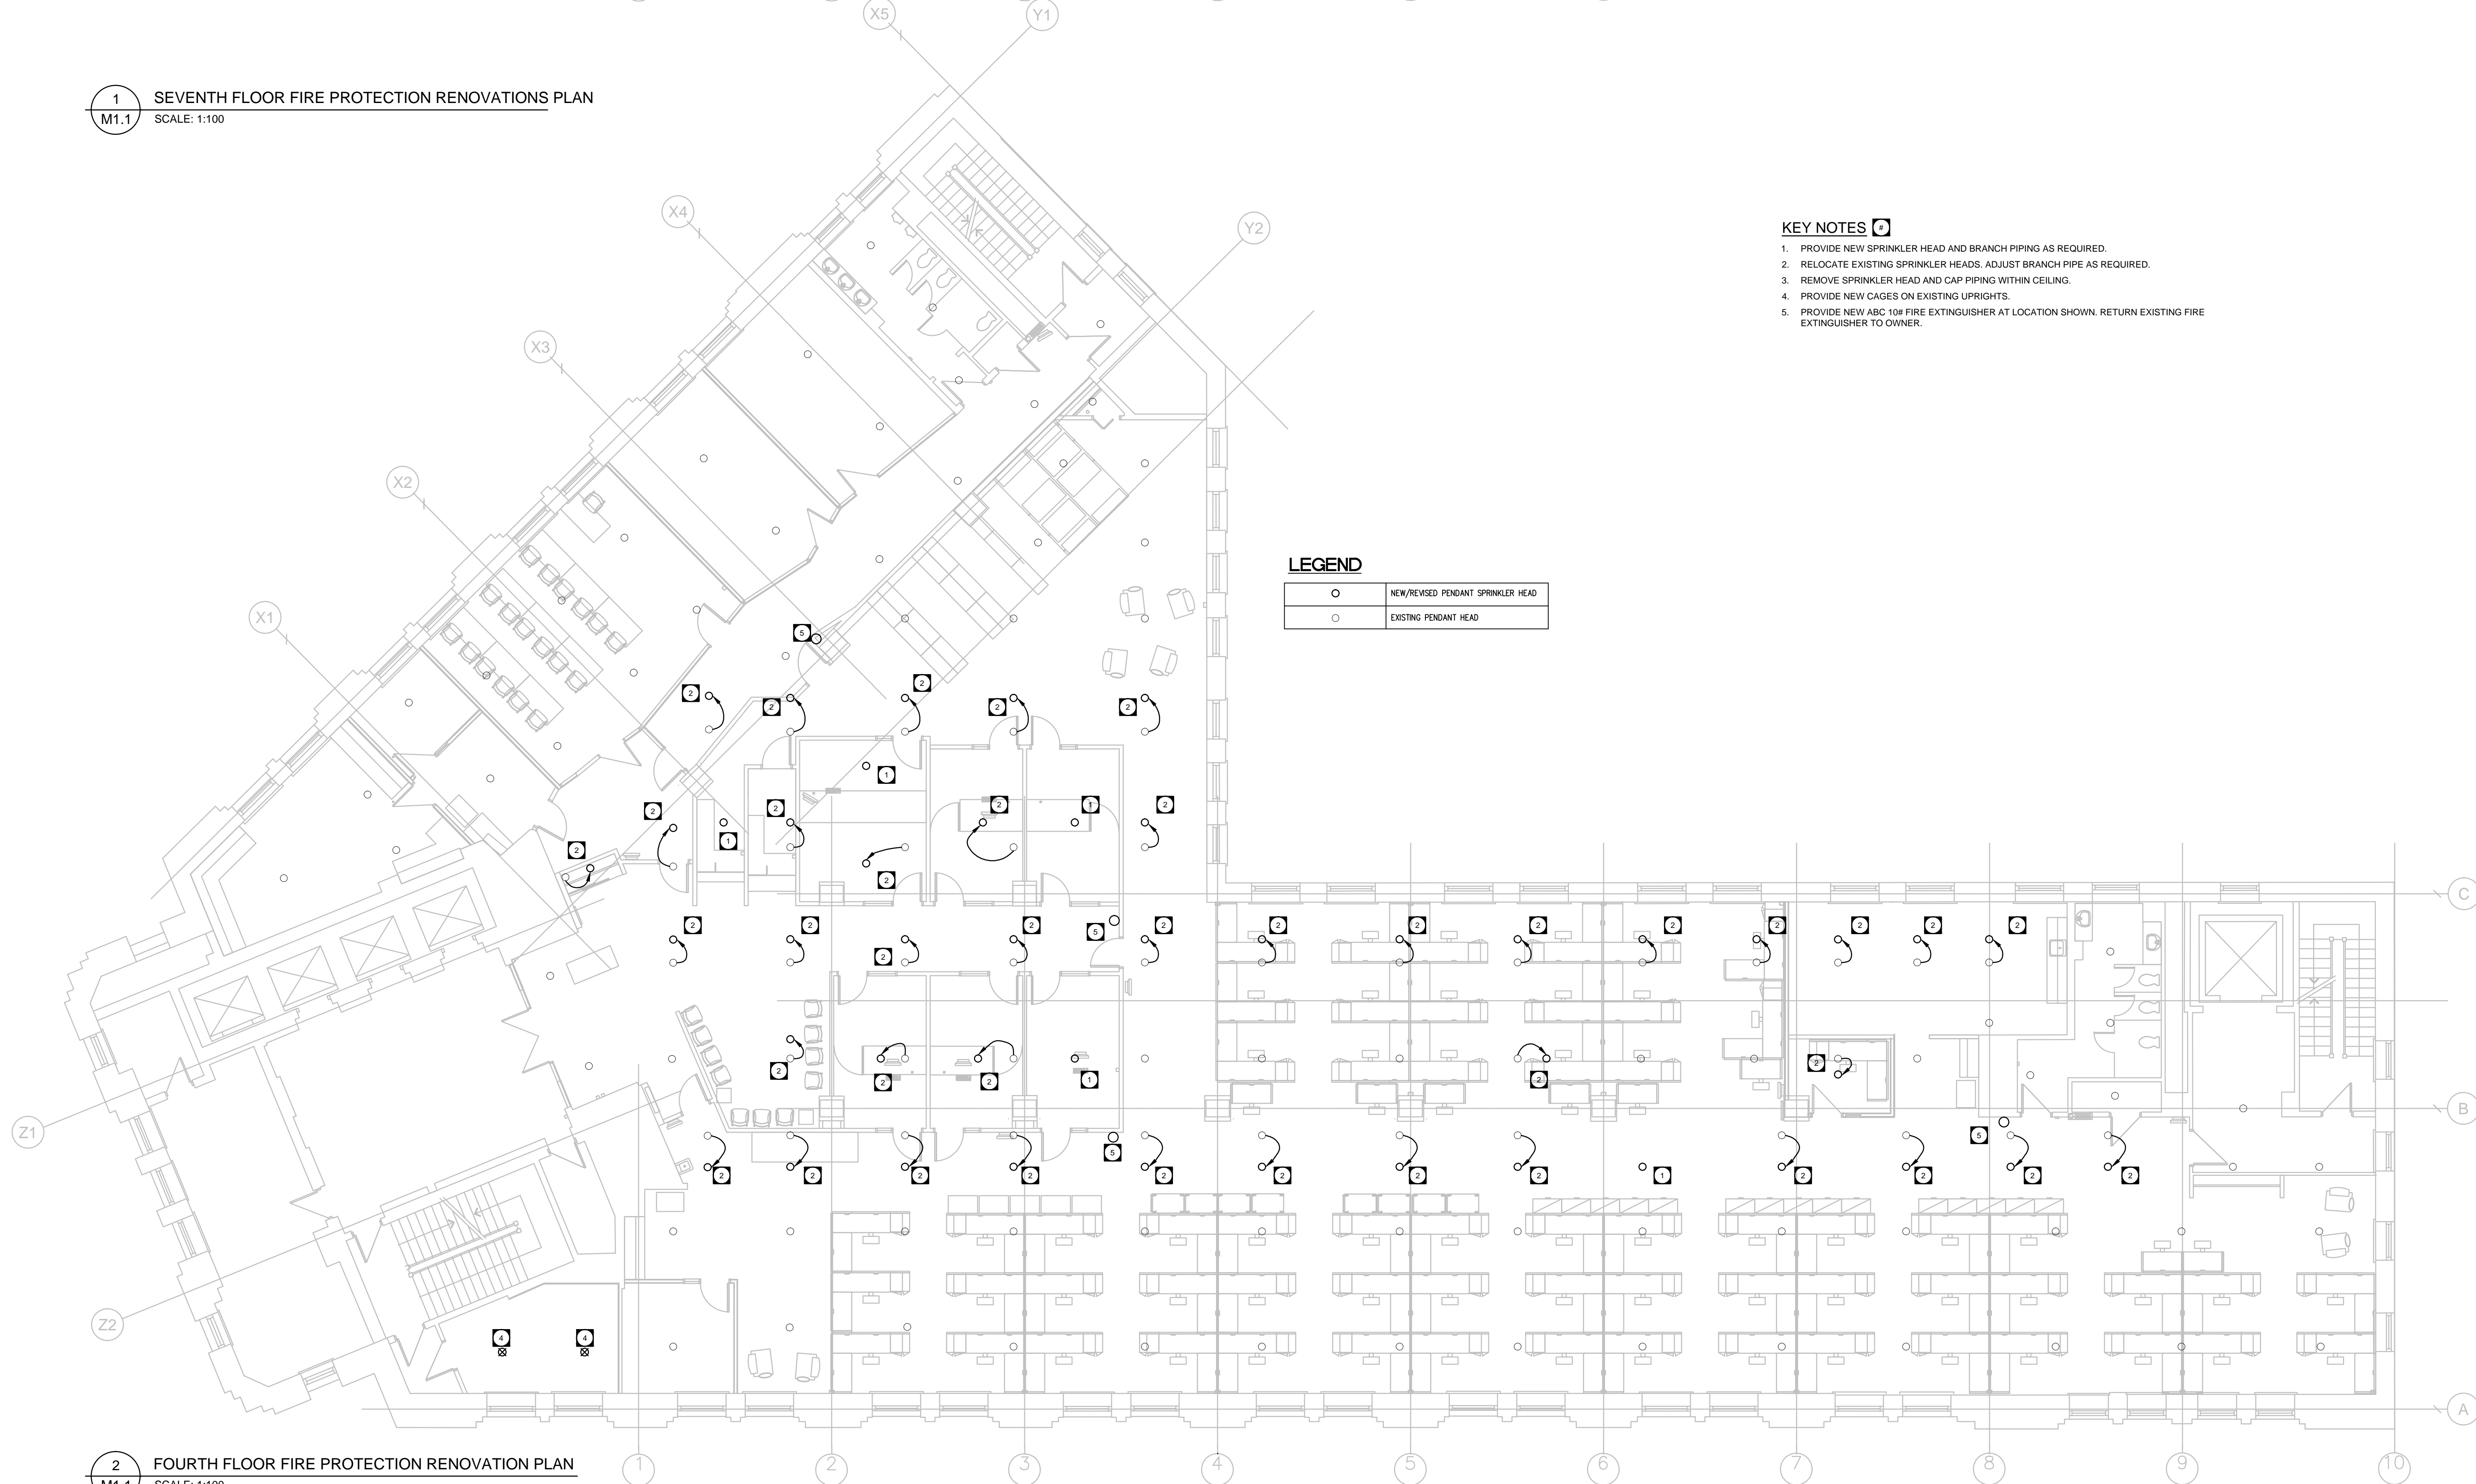

1 SEVENTH FLOOR FIRE PROTECTION RENOVATIONS PLAN
M1.1 SCALE: 1:100

2 FOURTH FLOOR FIRE PROTECTION RENOVATION PLAN
M1.1 SCALE: 1:100