

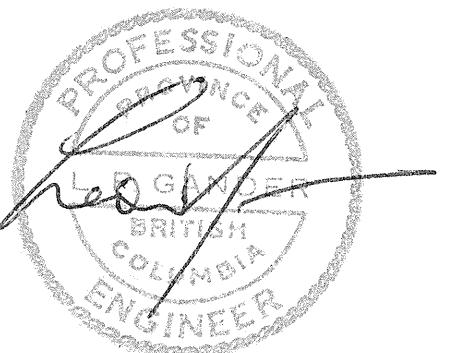


**L.P. GANDER &
ASSOCIATES LTD.**
CONSULTING ENGINEERS ELECTRICAL

106-3855 HENNING DRIVE BURNABY
B.C. V5C 6N3 email: lpg@axion.net
TEL: 604 298 0939 FAX: 604 298 9823

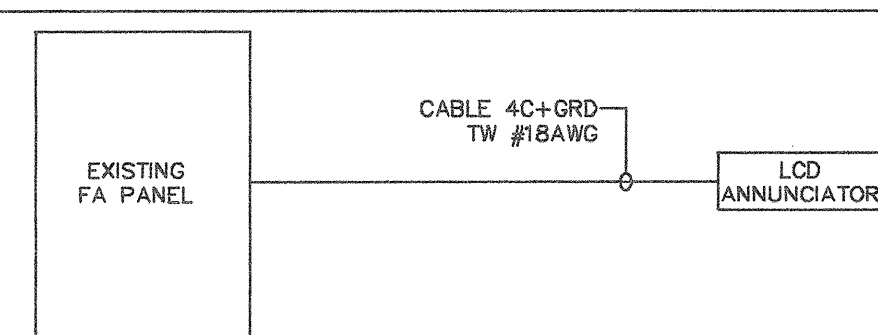



Feb 23, 2015

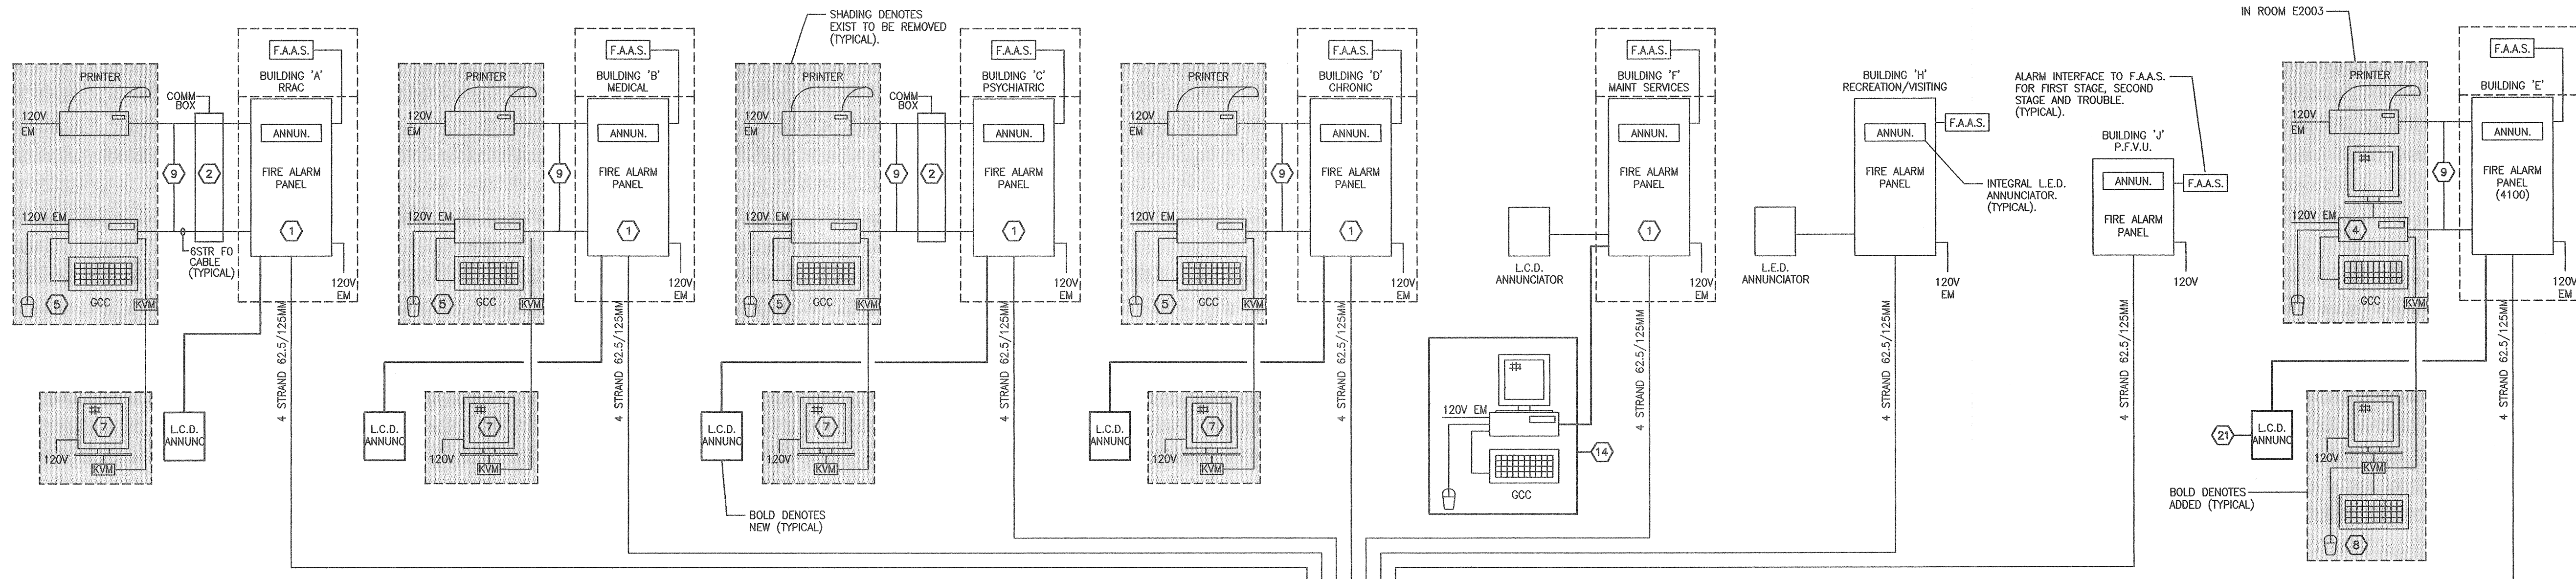

**WIRING INSTALLATION REQUIREMENTS
FOR NEW ANNUNCIATORS**
NTS

NOTES:

1. CABLE SHALL BE INSTALLED IN EXISTING CONDUITS AND RACEWAYS. 4C #18AWG TWISTED PLUS GROUND.
2. WHERE CABLE IS INSTALLED IN COMM BOXES, PULL BOXES OR IN RAISED FLOORS WITH OTHER CABLES FOR OTHER SYSTEMS, (NOT FIRE ALARM) THEN THE FIRE ALARM ANNUNCIATOR CABLE SHALL BE INSTALLED IN A SEPARATING SHEATH OR OTHER ACCEPTABLE MATERIAL SUCH AS FLEXIBLE METAL CONDUIT. OUT-ENDS OF FLEX SHALL BE PROTECTED WITH TERMINATIONS SO THAT THE FIRE ALARM CABLE IS NOT DAMAGED. THE SEPARATING SHEATH OR FLEXIBLE CONDUIT IS REQUIRED ONLY WHEN THE FIRE ALARM ANNUNCIATOR CABLE IS NOT IN ITS OWN SEPARATE CONDUIT, AND ONLY FOR THE LENGTH THAT THE CABLE IS EXPOSED TO OTHER WIRING. POKE SLEEVE INTO ENDS OF CONDUITS AS APPROPRIATE.

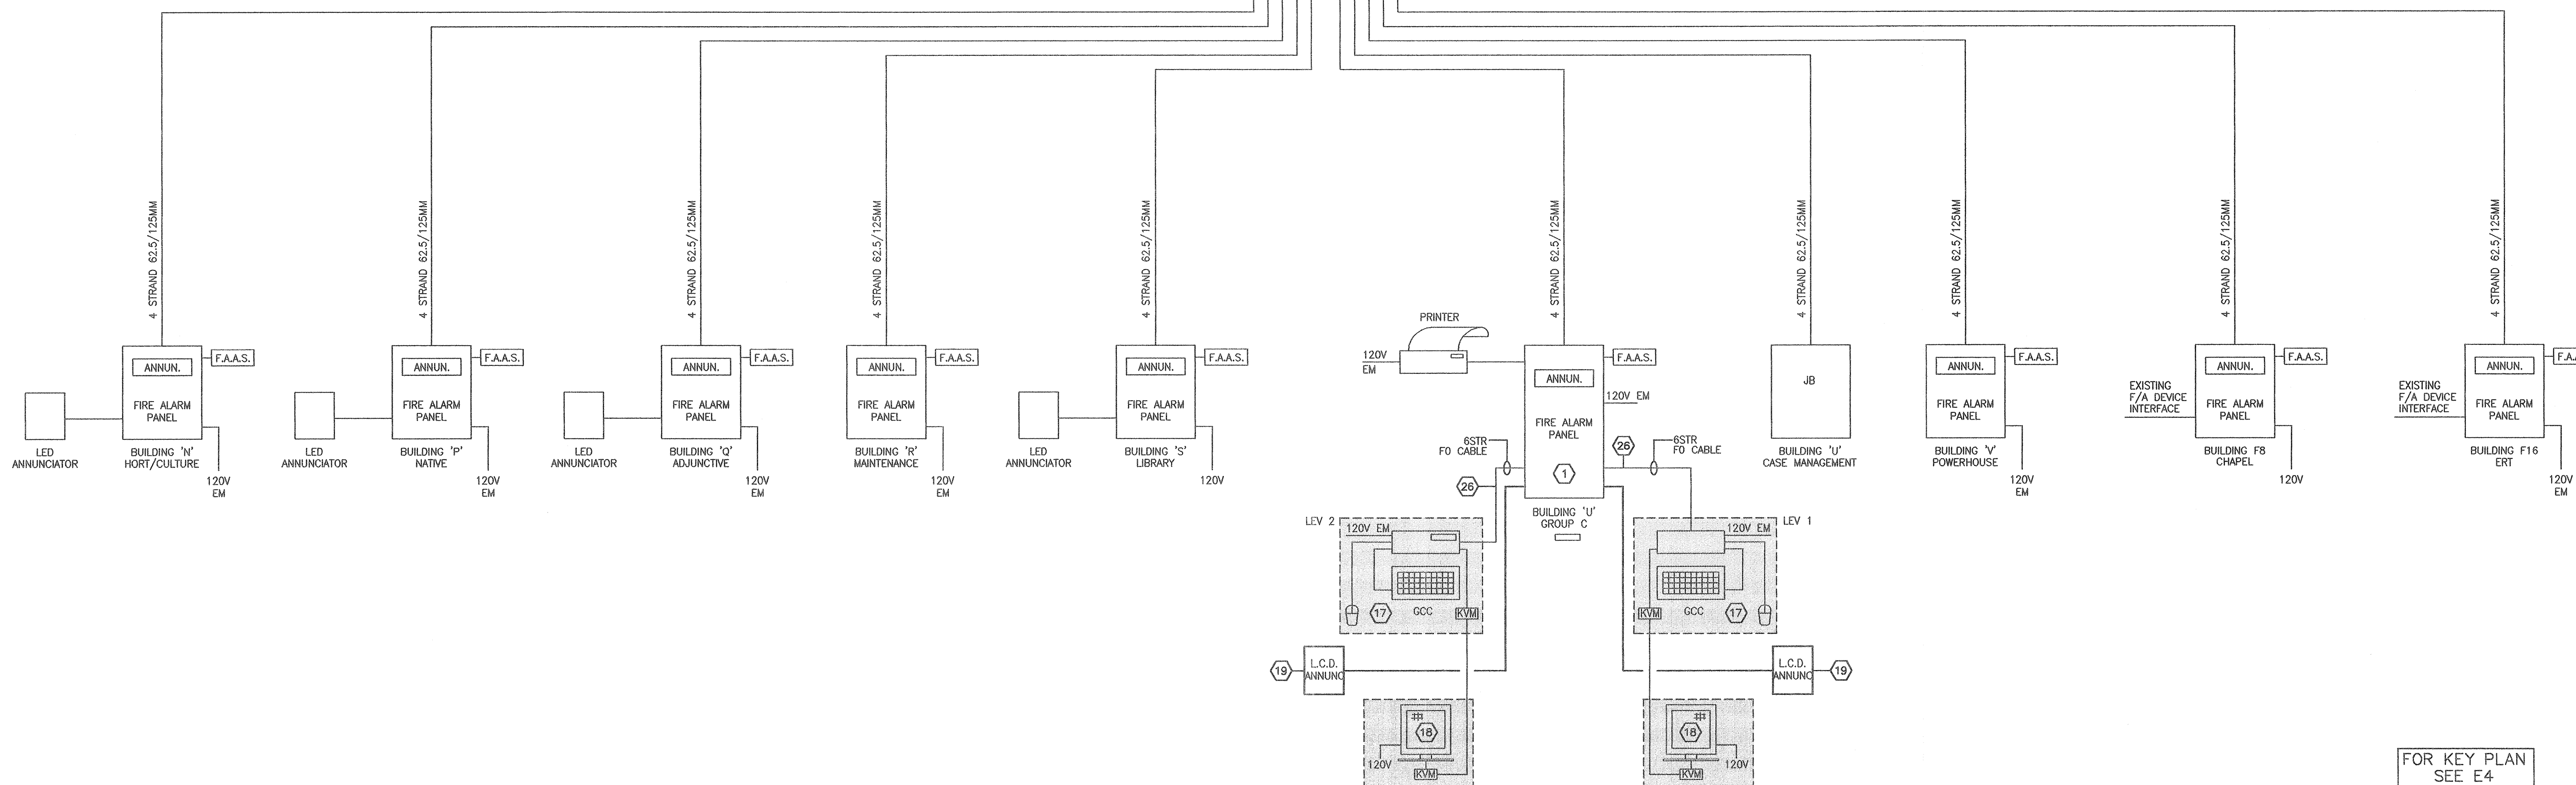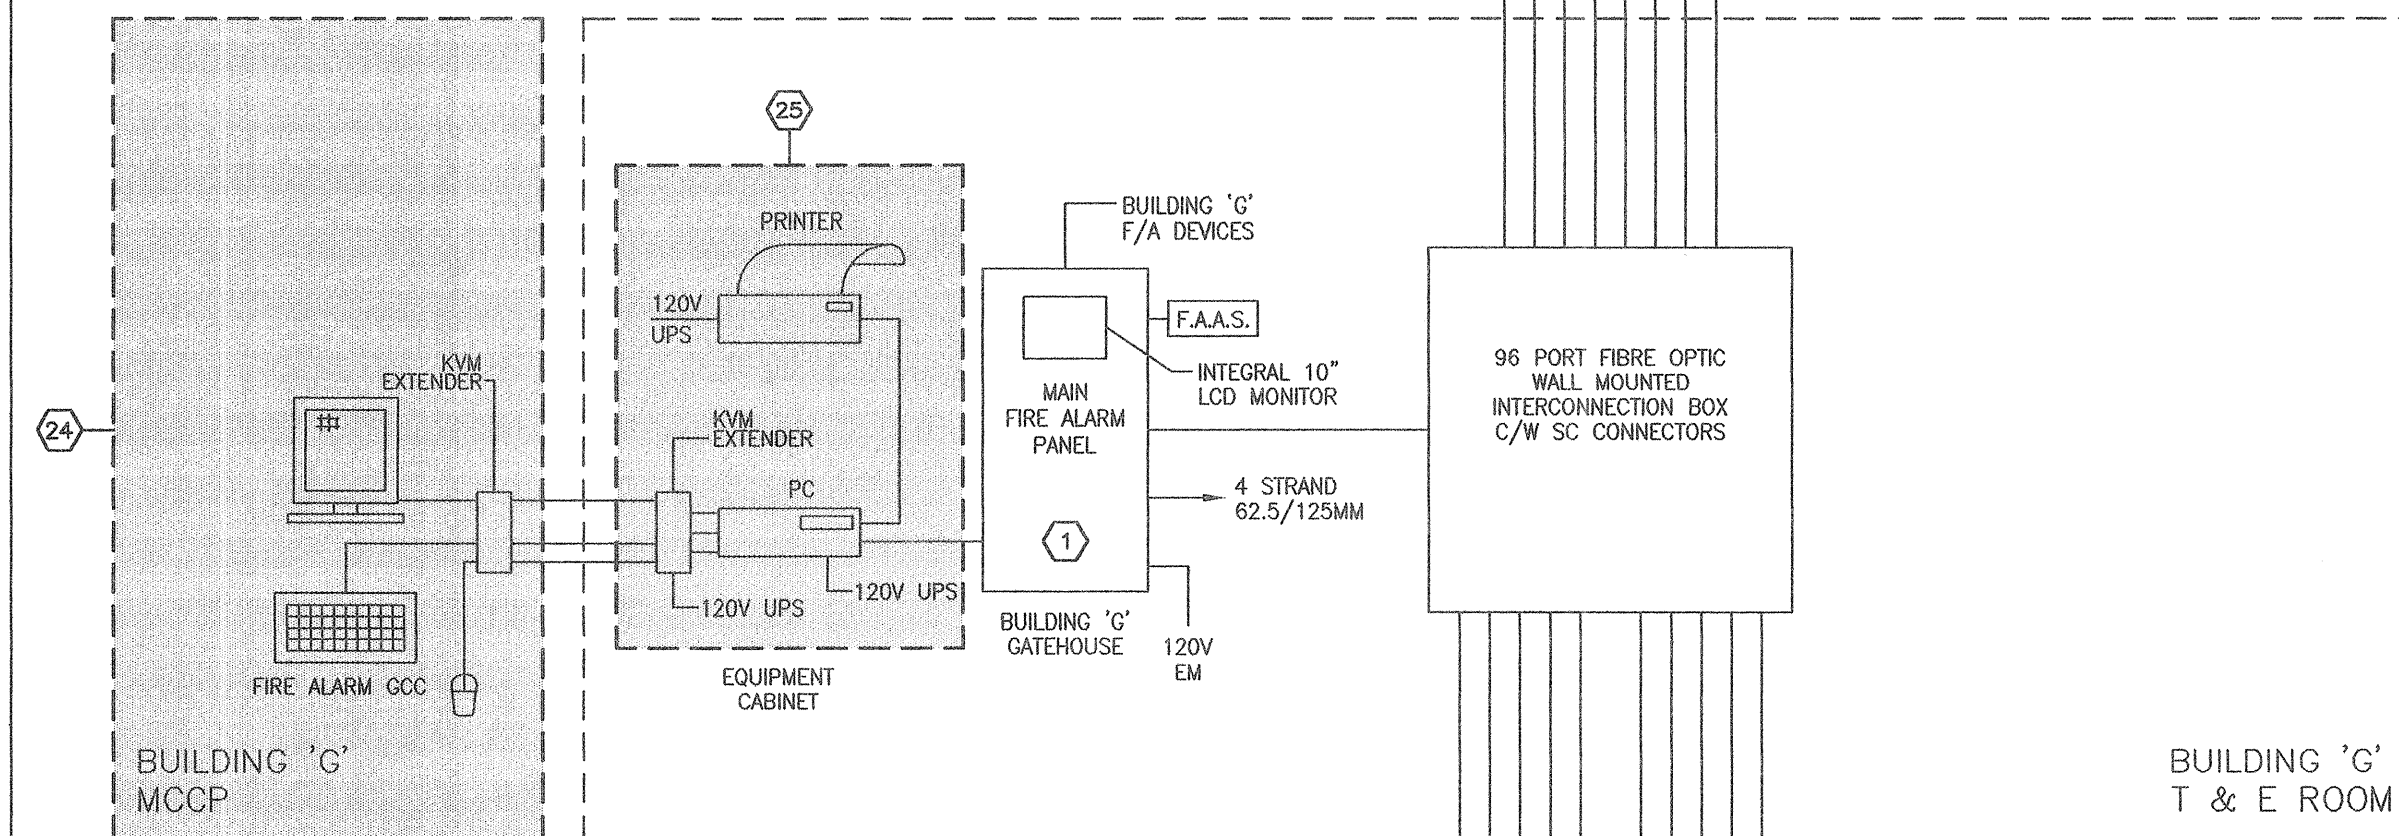

FOR KEY PLAN
SEE E4

Revision	Issued For Tender	Date
1	Issued For Tender	02/23/15

Client
**Correctional Service Canada
Abbotsford BC
Pacific Institution**

Project title/Titre du projet

**Fire Alarm System
Computer Replacement**

Designed by/Conçue par
L.P. GANDER
Drawn by/Dessiné par
LMG Jan 2015
PWOSC Project Manager/Administrateur de Projets
Tony Tang
Regional Manager, Architectural and Engineering Services
Régionaliste régionale, Services d'architecture et de génie, 1950C
P. Paul
Drawing title/Titre du dessin

Fire Alarm Riser

Project No./No. du projet	Sheet/Feuille	Revision no./La Révision no.
R.072304.001	E1	