


NOTES

- CONTRACTOR TO VERIFY ALL DIMENSIONS AND LOCATIONS OF EXISTING UTILITIES AND REPORT TO THE DEPARTMENTAL REPRESENTATIVE AND/OR SUBSIDIARY CONDITIONS SHALL BE REPORTED TO THE DEPARTMENTAL REPRESENTATIVE.
- DO NOT SCALE FROM DRAWINGS.
- SEE CIVIL DRAWINGS TO DETERMINE LOCATION OF PEDESTALS AND LIGHTS ON WHARFS TO LADDERS.
- FOR PROTECTIVE POSTS, SEE CIVIL DRAWINGS FOR DETAILS.
- EXISTING PEDESTAL LAYOUTS FOR 120V, 250V, 50A SINGLE TWIST LOCK RECEPTACLES, 3 #2 120V WITH TWO CIRCUITS ATTACHED. CONTRACTOR TO VERIFY ALL DIMENSIONS AND LOCATIONS TO INDICATE SIZE.
- FOR CONDUIT LAYOUTS IN BECKING, SEE CIVIL DRAWING C10 FOR LAYOUT.
- NEW LADDERS SHALL BE INSTALLED WITH WIRING IN DOUBLE FENDER OF EXISTING AREA UNTIL RIGID PVC CONDUIT TO NEW LIGHTING POLE. Ensure lighting is tied into existing lighting control panel.
- AND CONDUITS TO REMAIN.

- PEDESTALS #1, #4, AND #7 CONDUITS**
 RUN 7 #10 RIGID PVC, 30A 120V RECEPTACLES, 3 #2 RIGID PVC, 50A 250V RECEPTACLE, 2 #4 RIGID PVC, 1 #4 TW BOND IN 53mm PVC CONDUIT.
- PEDESTAL #2 CONDUIT**
 RUN 4 #10 RIGID PVC, 30A 120V RECEPTACLES, 3 #2 RIGID PVC, 50A 250V RECEPTACLE, 2 #4 RIGID PVC, 1 #4 TW BOND IN 53mm PVC CONDUIT.
- PEDESTAL #3 CONDUIT**
 RUN 7 #4 RIGID PVC, 30A 120V RECEPTACLES, 3 #2 RIGID PVC, 50A 250V RECEPTACLE, 2 #4 RIGID PVC, 1 #4 TW BOND IN 53mm PVC CONDUIT.

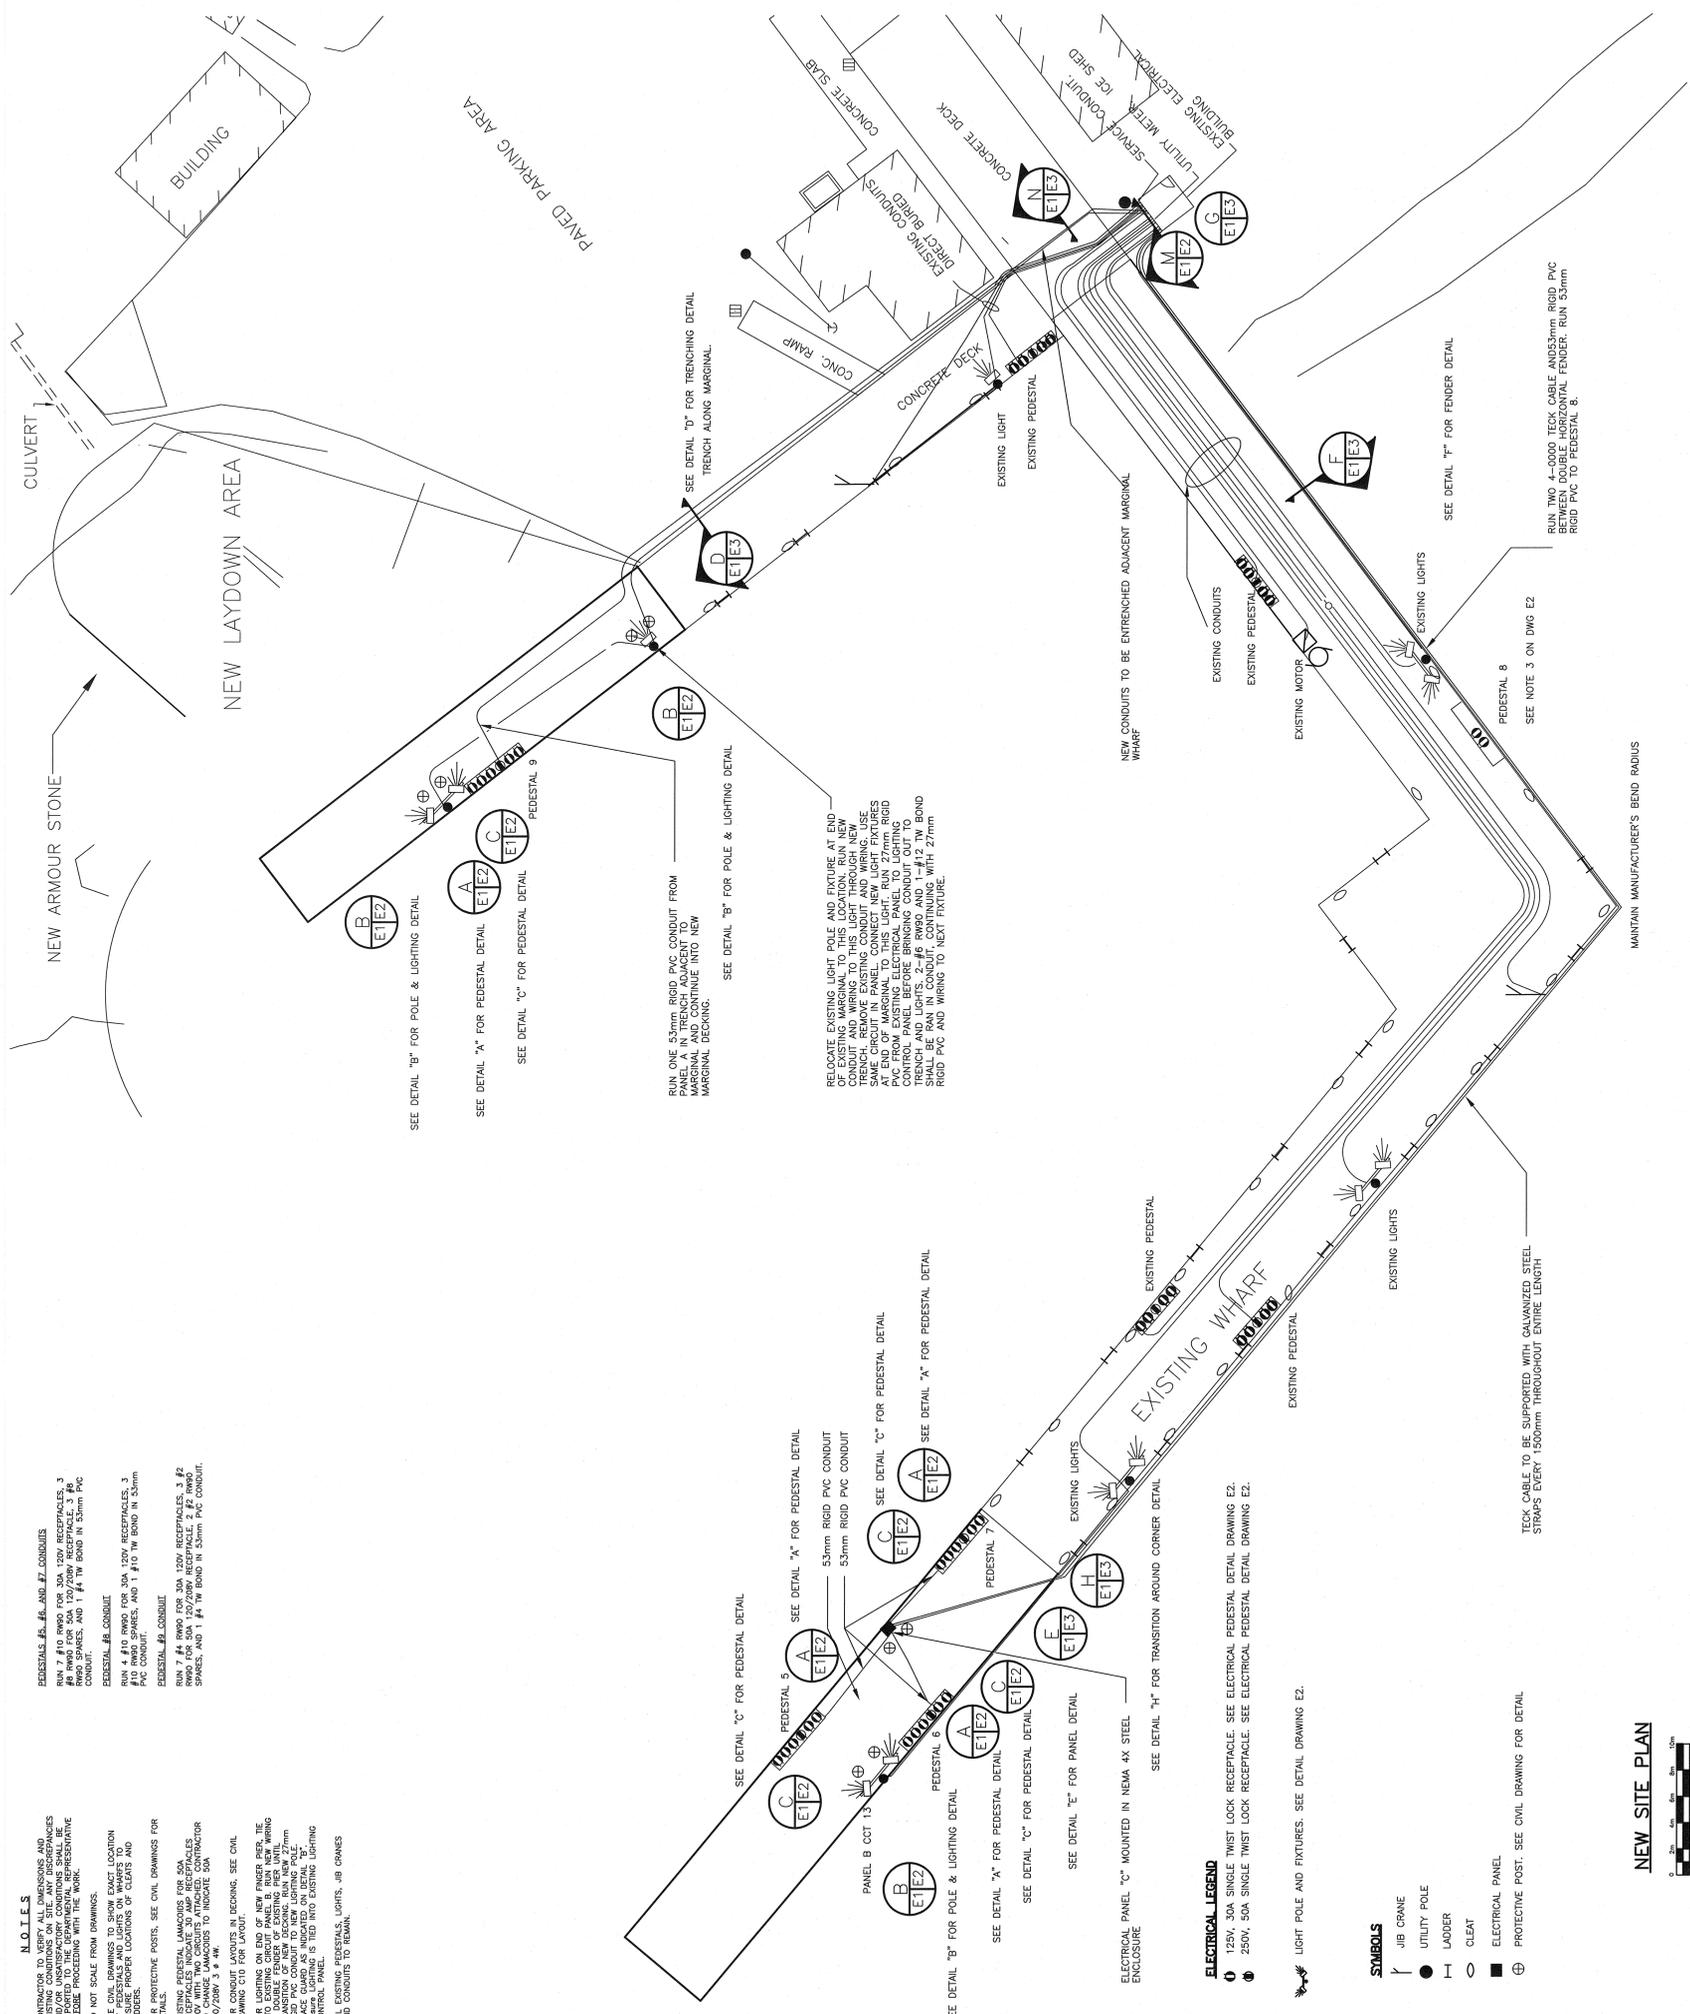

ELECTRICAL LEGEND


- 120V, 30A SINGLE TWIST LOCK RECEPTACLE. SEE ELECTRICAL PEDESTAL DETAIL DRAWING E2.
- 250V, 50A SINGLE TWIST LOCK RECEPTACLE. SEE ELECTRICAL PEDESTAL DETAIL DRAWING E2.

LIGHT POLE AND FIXTURES. SEE DETAIL DRAWING E2.

SYMBOLS

- JIB CRANE
- UTILITY POLE
- LADDER
- CLEAT
- ELECTRICAL PANEL
- PROTECTIVE POST. SEE CIVIL DRAWING FOR DETAIL

NEW SITE PLAN



1 : 200

<table border="1"> <tr> <th>revisions</th> <th>date</th> <th>project</th> </tr> <tr> <td>2</td> <td>RE-ISSUED FOR TENDER</td> <td>17/04/15</td> </tr> <tr> <td>1</td> <td>RE-ISSUED FOR TENDER</td> <td>04/04/15</td> </tr> <tr> <td>0</td> <td>ISSUED FOR TENDER</td> <td>17/03/15</td> </tr> <tr> <td>D</td> <td>ISSUED FOR 98% REVIEW</td> <td>14/02/15</td> </tr> </table>	revisions	date	project	2	RE-ISSUED FOR TENDER	17/04/15	1	RE-ISSUED FOR TENDER	04/04/15	0	ISSUED FOR TENDER	17/03/15	D	ISSUED FOR 98% REVIEW	14/02/15	<p>NEW WHARF CONSTRUCTION ST. LUNAIRE, NL</p> <p>drawing</p> <p>NEW ELECTRICAL SITE PLAN</p> <p>designed J.F.</p> <p>date MARCH, 2015</p> <p>checked S.P.M.</p> <p>date MARCH, 2015</p> <p>approved J.F.</p> <p>date MARCH, 2015</p> <p>Project Manager: <i>[Signature]</i></p> <p>Administrateur de projet: J.F. COOPER</p> <p>project number: R.076000.001</p> <p>drawing no. E1 OF 3</p> <p>no. de dessin: E1 OF 3</p>
revisions	date	project														
2	RE-ISSUED FOR TENDER	17/04/15														
1	RE-ISSUED FOR TENDER	04/04/15														
0	ISSUED FOR TENDER	17/03/15														
D	ISSUED FOR 98% REVIEW	14/02/15														